FILE FOLDER

DESCRIPTION ON TAB:

11330.4A Fluoride Analysis

☒ **Outside/inside of actual folder did not contain hand written information**

☐ **Outside/inside of actual folder did contain hand written information**
***Scanned as next image**

Confidential Records Management, Inc.
New Bern, NC
1-888-622-4425
9/08

11330.4A FLUORIDE ANALYSIS Shop 83

OPEN

CLOSED ✓

JANUARY 1987 - DESTROY

TEMP. SECNAVINST 5212.5B, Part II

Chap 11, par. 11300(2) 2 years

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 31 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.24
TARAWA TERRACE	0.20	1.09
HOLCOMB BLVD.	0.20	0.40

HP TURBIDITY:	0.40	0.20
TT TURBIDITY:	4.10	0.20
HB. TURBIDITY:	1.00	0.20

ANALYST: J VANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3/30/85

PLANT	RAW	TREATED
HADNOT POINT	0.20	0.52
TARAWA TERRACE	0.22	1.29
HOLCOMB BLVD.	0.22	1.02

HP TURBIDITY:	0.80	0.20
TT TURBIDITY:	5.90	0.30
HB. TURBIDITY:	0.80	0.20

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.07
TARAWA TERRACE	0.19	1.11
HOLCOMB BLVD.	0.18	1.02

HP TURBIDITY:	1.9	0.2
TT TURBIDITY:	4.0	0.2
HB. TURBIDITY:	0.8	0.4

ANALYST: R Tschapelle

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 28MAR85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.07
TARAWA TERRACE	0.20	0.16
HOLCOMB BLVD.	0.19	1.05

HP TURBIDITY:	0.53	0.31
TT TURBIDITY:	4.10	5.47
HB. TURBIDITY:	0.65	0.35

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.06
TARAWA TERRACE	0.22	1.02
HOLCOMB BLVD.	0.21	1.04

HP TURBIDITY:	0.60	0.18
TT TURBIDITY:	3.90	0.17
HB. TURBIDITY:	0.81	0.13

ANALYST: A. Babee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3/26/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.96
TARAWA TERRACE	0.19	0.92
HOLCOMB BLVD.	0.18	0.93

HP TURBIDITY:	0.80	0.10
TT TURBIDITY:	2.70	0.20
HB. TURBIDITY:	1.0	0.20

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.00
TARAWA TERRACE	0.21	1.01
HOLCOMB BLVD.	0.20	1.00

HP TURBIDITY:	1.2	0.3
TT TURBIDITY:	4.1	0.3
HB. TURBIDITY:	0.8	0.2

ANALYST: Hunnicutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	No Samples	
TARAWA TERRACE	0.20	1.00
HOLCOMB BLVD.	0.22	0.98

HP TURBIDITY: No Samples
TT TURBIDITY: 5.4 0.2
HB. TURBIDITY: 0.7 0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.19	0.99
HOLCOMB BLVD.	0.19	1.08

HP TURBIDITY: 1.11 / 0.16
TT TURBIDITY: 4.48 / 0.16
HB. TURBIDITY: 2.14 / 0.13

ANALYST: ThBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.04
TARAWA TERRACE	0.18	0.85
HOLCOMB BLVD.	0.17	0.87

HP TURBIDITY:	1.2	0.8
TT TURBIDITY:	2.6	0.2
HB. TURBIDITY:	1.0	0.1

ANALYST: A Jackson

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 21 Mar-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.25
TARAWA TERRACE	0.21	0.85
HOLCOMB BLVD.	0.18	0.94

HP TURBIDITY:	1.23	0.16
TT TURBIDITY:	4.76	0.18
HB. TURBIDITY:	1.26	0.16

ANALYST: thBarbee

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 20 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.03
TARAWA TERRACE	0.19	0.91
HOLCOMB BLVD.	0.17	0.98

HP TURBIDITY:	1.70	0.70
TT TURBIDITY:	2.60	0.70
HB. TURBIDITY:	1.3	0.30

ANALYST: BVANS

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 19 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.05
TARAWA TERRACE	0.20	1.13
HOLCOMB BLVD.	0.17	0.93

HP TURBIDITY: 1.0 0.2
TT TURBIDITY: 5.5 0.3
HB. TURBIDITY: 1.3 0.1

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.04
TARAWA TERRACE	0.20	1.19
HOLCOMB BLVD.	0.17	0.92

HP TURBIDITY:	1.3	0.2
TT TURBIDITY:	0.9	0.3
HB. TURBIDITY:	0.9	0.2

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 17 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.20	1.17
HOLCOMB BLVD.	0.17	0.95

HP TURBIDITY:	0.4	0.1
TT TURBIDITY:	0.5	0.2
HB. TURBIDITY:	0.6	0.2

ANALYST: L Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 Mar 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.05
TARAWA TERRACE	0.20	1.10
HOLCOMB BLVD.	0.18	0.91

HP TURBIDITY:	1.0	0.3
TT TURBIDITY:	0.5	0.2
HB. TURBIDITY:	0.8	0.2

ANALYST: R Lachenmeier

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3-15-85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.24
TARAWA TERRACE	0.23	0.94
HOLCOMB BLVD.	0.20	0.96

HP TURBIDITY:	1.5	0.6
TT TURBIDITY:	0.7	0.3
HB. TURBIDITY:	0.3	0.3

ANALYST: Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3-14-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.20
TARAWA TERRACE	0.22	0.63
HOLCOMB BLVD.	0.20	0.99

HP TURBIDITY:	0.90	0.90
TT TURBIDITY:	0.60	0.40
HB. TURBIDITY:	1.0	0.20

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 March 85.

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.13
TARAWA TERRACE	0.20	0.55
HOLCOMB BLVD.	0.18	0.94

HP TURBIDITY:	1.3	0.4
TT TURBIDITY:	0.5	0.2
HB. TURBIDITY:	0.8	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12MAR85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.21	0.76
HOLCOMB BLVD.	0.17	0.93

HP TURBIDITY: 0.94 0.24
TT TURBIDITY: 0.55 0.20
HB TURBIDITY: 0.70 0.22

ANALYST: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3-11-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.76
TARAWA TERRACE	0.19	0.84
HOLCOMB BLVD.	0.17	0.93

HP TURBIDITY:	0.50	0.20
TT TURBIDITY:	0.50	0.30
HB TURBIDITY:	0.20	0.20

ANALYST: EVANS

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 3-10-85

Plant	Raw	Treated
Hadnot Point	0.15	0.82
Tarawa Terrace	0.20	0.85
Holcomb Blvd.	0.18	0.95

HP Turbidity: 0.50 0.80
TT Turbidity: 0.90 0.20
HB Turbidity: 0.80 0.20

Analyst: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3-9-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.90
TARAWA TERRACE	0.21	0.80
HOLCOMB BLVD.	0.18	1.00

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	0.6	0.3
HB TURBIDITY:	0.6	0.2

ANALYST: Honeycutt

5315
5320

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3-8-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.95
TARAWA TERRACE	0.22	1.01
HOLCOMB BLVD.	0.21	1.00

HP TURBIDITY:	2.2	1.2
TT TURBIDITY:	0.9	0.5
HB TURBIDITY:	0.9	1.9

ANALYST: Hennegatt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 MARCH 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.84
TARAWA TERRACE	0.19	1.00
HOLCOMB BLVD.	0.18	0.95

HP TURBIDITY:	0.60	0.21
TT TURBIDITY:	1.91	0.14
HB TURBIDITY:	0.51	0.17

ANALYST: TH Barbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 3-6-85

Plant	Raw	Treated
Hadnot Point	0.16	1.14
Tarawa Terrace	0.23	1.03
Holcomb Blvd.	0.21	1.12

HP Turbidity: 1.4 | 0.3
TT Turbidity: 1.0 | 0.3
HB Turbidity: 0.5 | 0.3

Analyst: [signature]

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 3/5/85

Plant	Raw	Treated
Hadnot Point	0.16	1.04
Tarawa Terrace	0.20	0.97
Holcomb Blvd.	0.14	1.00

HP Turbidity: 0.80 0.40
TT Turbidity: 0.70 0.20
HB Turbidity: 0.60 1.00

Analyst: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0,15	1,02
TARAWA TERRACE	0,19	0,72
HOLCOMB BLVD.	0,18	0,99

HP TURBIDITY:	1,1	0,2
TT TURBIDITY:	0,5	0,2
HB TURBIDITY:	0,9	0,7

ANALYST: R Lockridge

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3 MAR 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.98
TARAWA TERRACE	0.19	0.71
HOLCOMB BLVD.	0.17	1.17

HP TURBIDITY:	1.0	0.2
TT TURBIDITY:	0.4	0.2
HB TURBIDITY:	0.6	0.2

ANALYST: R Tschopik

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 3/2/85

Plant	Raw	Treated
Hadnot Point	0.14	0.82
Tarawa Terrace	0.18	0.80
Holcomb Blvd.	0.17	0.95

HP Turbidity:	0.6	0.4
TT Turbidity:	0.8	0.3
HB Turbidity:	0.7	0.2

Analyst: Burns

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 3-1-85

Plant	Raw	Treated
Hadnot Point	0.14	0.91
Tarawa Terrace	0.18	0.81
Holcomb Blvd.	0.17	0.96

HP Turbidity:	0.5	0.4
TT Turbidity:	0.5	0.3
HB Turbidity:	0.7	0.2

Analyst: R Lachapelle

DAILY. FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-28-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.14
TARAWA TERRACE	0.24	0.21
HOLCOMB BLVD.	0.21	1.09

HP TURBIDITY:	1.9	0.6
TT TURBIDITY:	0.8	4.6
HB TURBIDITY:	0.9	0.3

ANALYST: Hemingway

DAILY. FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.99
TARAWA TERRACE	0.19	1.06
HOLCOMB BLVD.	0.18	1.04

HP TURBIDITY:	0.5	0.5
TT TURBIDITY:	1.0	0.7
HB TURBIDITY:	0.7	0.3

ANALYST: Robert Lachapelle

DAILY. FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-26-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.07
TARAWA TERRACE	0.22	1.10
HOLCOMB BLVD.	0.20	1.11

HP TURBIDITY:	0.6	0.4
TT TURBIDITY:	1.6	0.2
HB TURBIDITY:	0.7	0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 FEB 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.05
TARAWA TERRACE	0.21	1.18
HOLCOMB BLVD.	0.19	1.15

HP TURBIDITY:	0.44	0.20
TT TURBIDITY:	3.17	0.21
HB TURBIDITY:	0.74	0.30

ANALYST: H Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 FEB 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.05
TARAWA TERRACE	0.21	1.13
HOLCOMB BLVD.	0.19	1.14

HP TURBIDITY:	0.59	0.12
TT TURBIDITY:	1.95	0.20
HB TURBIDITY:	0.47	0.24

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23FEB85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.03
TARAWA TERRACE	0.20	1.17
HOLCOMB BLVD.	0.19	1.15

HP TURBIDITY:	0.60	0.08
TT TURBIDITY:	0.61	0.26
HB TURBIDITY:	0.43	0.18

ANALYST: th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.96
TARAWA TERRACE	0.18	0.99
HOLCOMB BLVD.	0.17	1.05

HP TURBIDITY:	1.0	0.2
TT TURBIDITY:	0.8	0.5
HB TURBIDITY:	0.6	0.3

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO WATER TREATMENT PLANT FOREMAN

DATE: 21 FEB 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.96
TARAWA TERRACE	0.21	1.00
HOLCOMB BLVD.	0.20	1.03

HP TURBIDITY: 1.30 0.13
TT TURBIDITY: 0.96 1.30
HB TURBIDITY: 0.61 0.15

ANALYST: T Barber

DAILY TURBIDITY REPORT

FROM: QUALITY CONTROL LABORATORY
TO WATER TREATMENT PLANT FOREMAN

DATE: 2-20-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.02
TARAWA TERRACE	0.23	1.12
HOLCOMB BLVD.	0.21	1.02

HP TURBIDITY: 0.7 0.1
TT TURBIDITY: 1.3 3.2
HB TURBIDITY: 0.9 0.7

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.91
TARAWA TERRACE	0.21	1.00
HOLCOMB BLVD	0.18	0.96

HP TURBIDITY:	0.8	0.3
TT TURBIDITY:	1.0	0.2
HB TURBIDITY:	0.7	0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-18-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.94
TARAWA TERRACE	0.21	0.84
HOLCOMB BLVD.	0.21	0.91

HP TURBIDITY:	0.3	0.3
TT TURBIDITY:	0.5	0.6
HB TURBIDITY:	0.9	0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-17-85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.21	0.92
HOLCOMB BLVD.	0.19	0.92

HP TURBIDITY:	0.4	0.1
TT TURBIDITY:	0.5	0.2
HB TURBIDITY:	0.3	0.2

ANALYST: Heneycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.97
TARAWA TERRACE	0.19	1.05
HOLCOMB BLVD.	0.18	0.86

HP TURBIDITY:	0.6	0.2
TT TURBIDITY:	0.5	0.4
HB TURBIDITY:	1.1	0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2/15/85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.13
TARAWA TERRACE	0.24	0.95
HOLCOMB BLVD.	0.20	0.94
HP TURBIDITY:	2.2	0.3
TT TURBIDITY:	0.5	0.7
HB TURBIDITY:	0.7	0.2

ANALYST: Hemphill

DAILY FLOORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2/14/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.85
TARAWA TERRACE	0.18	0.44
HOLCOMB BLVD.	0.16	0.80

HP TURBIDITY:	0.60	0.20
TT TURBIDITY:	0.60	0.30
HB TURBIDITY:	3.00	0.30

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-13-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.98
TARAWA TERRACE	0.21	0.80
HOLCOMB BLVD.	0.20	0.84

HP TURBIDITY:	0,8	0,2
TT TURBIDITY:	0,5	0,2
HB TURBIDITY:	1.2	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.96
TARAWA TERRACE	0.19	0.16
HOLCOMB BLVD.	0.17	0.73

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	1.2	(6.6)
HB TURBIDITY:	1.8	0.4

ANALYST: R. Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-11-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.00
TARAWA TERRACE	0.18	1.10
HOLCOMB BLVD.	0.19	0.78

HP TURBIDITY:	0.70	0.40
TT TURBIDITY:	1.20	0.80
HB TURBIDITY:	2.30	0.40

ANALYST: BYRNS

DAILY FLUORIDE REPORT

From: QUALITY CONTROL LABORATORY
To: WATER TREATMENT PLANT FOREMAN

DATE: 2-10-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.97
TARAWA TERRACE	0.18	1.12
HOLCOMB BLVD.	0.18	0.73

HP TURBIDITY:	0.40	0.20
TT TURBIDITY:	0.70	0.30
HB TURBIDITY:	1.0	0.60

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-9-85

PLANT	RAW	TREATED
HADNOT POINT	0.20	1.07
TARAWA TERRACE	0.24	1.29
HOLCOMB BLVD.	0.22	0.80

HP TURBIDITY:	0.4	0.2
TT TURBIDITY:	0.7	0.7
HB TURBIDITY:	0.9	0.9

ANALYST: Hargett

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.05
TARAWA TERRACE	0.22	0.87
HOLCOMB BLVD.	0.18	0.75

HP TURBIDITY:	1.6	0.1
TT TURBIDITY:	0.7	0.2
HB TURBIDITY:	1.0	2.4

ANALYST: L Ladyville

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 FEB 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.07
TARAWA TERRACE	0.23	1.08
HOLCOMB BLVD.	0.21	0.83

HP TURBIDITY:	0.88	0.11
TT TURBIDITY:	0.64	0.16
HB TURBIDITY:	0.96	0.54

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.97
TARAWA TERRACE	0.18	0.84
HOLCOMB BLVD.	0.15	0.69

HP TURBIDITY:	1.4	0.2
TT TURBIDITY:	2.1	0.2
HB TURBIDITY:	0.5	0.3

ANALYST: R Lackey Jr

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 5 FEB 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.14
TARAWA TERRACE	0.20	1.02
HOLCOMB BLVD.	0.18	0.85

HP TURBIDITY:	0.77	0.29
TT TURBIDITY:	0.62	0.19
HB TURBIDITY:	0.48	1.07

ANALYST: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-4-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.17
TARAWA TERRACE	0.20	1.09
HOLCOMB BLVD.	—	—

HP TURBIDITY: 0.50 / 0.20
TT TURBIDITY: 0.70 / 0.30
HB TURBIDITY: — / —

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-3-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.14
TARAWA TERRACE	0.23	1.04
HOLCOMB BLVD.	—	—

HP TURBIDITY:	1.20	0.20
TT TURBIDITY:	1.0	0.20
HB TURBIDITY:	—	—

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2-2-85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.06
TARAWA TERRACE	0.22	0.87
HOLCOMB BLVD.	—	—

HP TURBIDITY:	1.80	0.30
TT TURBIDITY:	0.70	0.30
HB TURBIDITY:	—	—

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1 Feb 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.00
TARAWA TERRACE	0.21	0.85
HOLCOMB BLVD.		

HP TURBIDITY: 1.4 / 0.2
TT TURBIDITY: 0.7 / 1.2
HB TURBIDITY: /

ANALYST: L Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 31 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.21	0.21
HOLCOMB BLVD	—	—

HT TURBIDITY: 1.60 0.113
TT TURBIDITY: 1.20 0.56
HB TURBIDITY: ____ ____

ANALYST: Th Barber

DAILY . FLUORIDE . REPORT

FROM: QUALITY CONTROL LABORATORY

TO: WATER TREATMENT PLANT FOREMAN

DATE: 11/30/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.96
TARAWA TERRACE	0.18	1.14
HOLCOMB BLVD	—	—

HP TURBIDITY:	1.50	0.30
TT TURBIDITY:	1.10	0.20
HB TURBIDITY:	—	—

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1/29/85

PLANT	RAW	TREATED
HADNOT POINT	0.20	1.09
TARAWA TERRACE	0.24	1.22
HOLCOMB BLVD	—	—

HP TURBIDITY:	1.70	0.30
TT TURBIDITY:	2.10	0.20
HB TURBIDITY:	—	—

ANALYST: JVANS

DAILY . FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1-28-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.00
TARAWA TERRACE	0.22	1.05
HOLCOMB BLVD.	0.19	0.96

HP TURBIDITY: 3.5 0.2
TT TURBIDITY: 1.1 0.2
HB TURBIDITY: 1.3 0.2

ANALYST: Hereyc...

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1-27-85

PLANT	RAW	TREATED
HADNOT POINT	0.20	0.94
TARAWA TERRACE	0.21	1.04
HOLCOMB BLVD.	0.22	0.97

HP TURBIDITY:	1.2	0.3
TT TURBIDITY:	1.1	0.2
HB TURBIDITY:	1.1	0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 26 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.05
TARAWA TERRACE	0.21	1.01
HOLCOMB BLVD.	0.21	1.08

HP TURBIDITY:	1.10	0.23
TT TURBIDITY:	2.82	0.23
HB TURBIDITY:	1.51	0.50

ANALYST: Th Barbee

DAILY. FLUORIDE. REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.23	1.05
HOLCOMB BLVD.	0.20	0.86

HP TURBIDITY:	1.7	0.2
TT TURBIDITY:	1.6	0.4
HB TURBIDITY:	1.1	0.6

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24JAN85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.06
TARAWA TERRACE	0.23	1.13
HOLCOMB BLVD.	0.20	0.81

HP TURBIDITY:	1.04	0.14
TT TURBIDITY:	0.78	0.56
HB TURBIDITY:	1.78	0.50

ANALYST: thBarbee

DAILY . FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.12
TARAWA TERRACE	0.70	0.63
HOLCOMB BLVD.	0.19	0.74

HP TURBIDITY: 3.7 / 0.3
TT TURBIDITY: 0.4 / 2.3
HB TURBIDITY: 1.0 / 0.7

ANALYST: Hemphill

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22JAN85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.02
TARAWA TERRACE	0.21	1.13
HOLCOMB BLVD.	0.18	1.03

HP TURBIDITY:	1.09	0.16
TT TURBIDITY:	0.85	0.21
HB TURBIDITY:	1.14	1.54

ANALYST: H Barbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1/21/85

Plant	Raw	Treated
Hadnot Point	0.18	1.50
Tarawa Terrace	0.23	0.93
Holcomb Blvd.	0.19	1.26

HP Turbidity: 0.90 | 0.20
TT Turbidity: 0.40 | 0.60
HB Turbidity: 0.50 | 0.20

Analyst: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1/20/85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.98
TARAWA TERRACE	0.24	0.95
HOLCOMB BLVD.	0.19	1.34

HP TURBIDITY:	0.50	0.20
TT TURBIDITY:	0.50	0.30
HB TURBIDITY:	0.30	0.50

ANALYST: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19JAN85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.22	0.99
HOLCOMB BLVD.	0.17	1.13

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	0.6	0.2

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1-18-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.93
TARAWA TERRACE	0.24	1.18
HOLCOMB BLVD.	0.19	1.12

HP TURBIDITY: 0.4 0.2
TT TURBIDITY: 0.9 0.3
HB TURBIDITY: 0.7 0.3

ANALYST: Hereguett

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 17 JAN 89

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.92
TARAWA TERRACE	0.22	1.22
HOLCOMB BLVD.	0.16	1.19

HP TURBIDITY:	1.9	0.2
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	0.5	0.3

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.88
TARAWA TERRACE	0.25	1.15
HOLCOMB BLVD.	0.19	1.32

HP TURBIDITY:	4.0	0.2
TT TURBIDITY:	0.8	0.3
HB TURBIDITY:	0.5	0.3

ANALYST: R Lachouette

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1-15-85

Plant	Raw	Treated
Hadnot Point	0.15	0.95
Tarawa Terrace	0.21	1.02
Holcomb Blvd.	0.16	1.12

HP Turbidity:	1.46	0.13
TT Turbidity:	0.85	0.73
HB Turbidity:	0.45	0.27

Analyst: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 14 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.61
TARAWA TERRACE	0.16	0.76
HOLCOMB BLVD.	0.12	0.74

HP TURBIDITY:	0.79	0.15
TT TURBIDITY:	0.87	0.32
HB TURBIDITY:	0.49	0.18

ANALYST: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.73
TARAWA TERRACE	0.16	0.77
HOLCOMB BLVD.	0.11	0.73

HP TURBIDITY:	1.25	0.23
TT TURBIDITY:	1.07	0.34
HB TURBIDITY:	0.44	0.16

ANALYST: ThBarbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1/12/85

Plant	Raw	Treated
Hadnot Point	0.14	0.75
Tarawa Terrace	0,18	0,88
Holcomb Blvd.	0,15	0,83

HP Turbidity:	1.4	0,3
TT Turbidity:	0,9	0,5
HB Turbidity:	0,5	0,3

Analyst: Hengwett

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1/11/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.74
TARAWA TERRACE	0.18	0.74
HOLCOMB BLVD.	0.15	0.83

HP TURBIDITY:	1.2	0.30
TT TURBIDITY:	0.70	0.50
HB TURBIDITY:	0.50	0.30

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1/10/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.93
TARAWA TERRACE	0.20	0.75
HOLCOMB BLVD.	0.15	1.07

HP TURBIDITY: 0.7 / 0.1
TT TURBIDITY: 1.8 / 0.4
HB TURBIDITY: 0.4 / 0.3

ANALYST: Honeycutt

FLOURIDE · RESULTS

1/9/85

	RAW	TREATED
H.P	0,17	1.02
T.T.	0.26	0,86
HB	0.20	1.14

TURBIDITY

	RAW	TREATED
H.P	1.30	0.20
T.T	4,00	0.90
HB	0.50	0.40

BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 Jan 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.22	1.30
HOLCOMB BLVD.	0.18	1.08

HP TURBIDITY:	1.01	0.12
TT TURBIDITY:	0.92	0.37
HB TURBIDITY:	0.54	0.13

ANALYST: Th Barber

OFF	ON
	3
240	150
120	150
280	270
180	190
	125
	115
820	180
	1180
	820
	360

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1-7-85

Plant	Raw	Treated
Hadnot Point	0.14	0.90
Tarawa Terrace	0.20	1.04
Holcomb Blvd.	0.16	1.03

HP Turbidity:	0.84	0.10
TT Turbidity:	1.02	0.48
HB Turbidity:	0.50	0.17

Analyst: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1-6-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.94
TARAWA TERRACE	0.19	1.18
HOLCOMB BLVD.	0.16	1.07

HP TURBIDITY:	0.84	0.13
TT TURBIDITY:	0.95	0.58
HB TURBIDITY:	0.46	0.19

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1/5/84

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.07
TARAWA TERRACE	0.24	0.94
HOLCOMB BLVD.	0.20	1.12
H.P	0.90	0.20
TT TURBIDITY:	0.80	0.70
HB TURBIDITY:	0.70	0.30

ANALYST: BVRWS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1-4-85

PLANT	RAW	TREATED
HADNOT POINT	0.20	1.18
TARAWA TERRACE	0.25	0.57
HOLCOMB BLVD.	0.19	1.14
HP Turbidity	1.1	0.2
TT TURBIDITY:	0.7	1.1
HB TURBIDITY:	0.6	0.3

ANALYST: Honeycutt

DAILY. FLUORIDE. REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3 JAN 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.04
TARAWA TERRACE	0.21	0.18
HOLCOMB BLVD.	0.17	0.94

HP TT TURBIDITY:	1.0 0.9	0.2 4.4
HB TURBIDITY:	0.7	0.2

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2 JAN 88

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.05
TARAWA TERRACE	0.21	0.80
HOLCOMB BLVD.	0.20	1.04

HP TURBIDITY:	1.3	0.2
TT TURBIDITY:	0.7	0.3
HB TURBIDITY:	1.3	0.2

ANALYST: R Lafayette

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1-1-85

Plant	Raw	Treated
Hadnot Point	0.11	0.77
Tarawa Terrace	0.17	0.54
Holcomb Blvd.	0.15	0.90

HP Turbidity: 0.5 0.2
TT Turbidity: 1.1 0.2
HB Turbidity: 1.1 0.2

Analyst: Honeycutt

DAILY RECORDS REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.02
TARAWA TERRACE	0.23	1.03
HOLCOMB BLVD.	0.20	1.15

HP TURBIDITY: 1.05 0.14
TT TURBIDITY: 7.33 0.35
HB TURBIDITY: 0.65 0.13

ANALYST: th Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 APRIL 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.23	0.88
HOLCOMB BLVD.	0.22	0.99

HP TURBIDITY:	1.9	0.2
TT TURBIDITY:	5.0	0.6
HB TURBIDITY:	0.6	0.2

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28 APRIL 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.00
TARAWA TERRACE	0.24	0.90
HOLCOMB BLVD.	0.20	1.04

HP TURBIDITY: 0.9 0.2
TT TURBIDITY: 5.8 0.6
HB TURBIDITY: 0.5 0.2

ANALYST: EVANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 APRIL 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.98
TARAWA TERRACE	0 21	0.96
HOLCOMB BLVD.	0.21	1.08

HP TURBIDITY:	1.4	0.9
TT TURBIDITY:	9.1	1.2
HB TURBIDITY:	0.9	0.6

ANALYST: BURNS

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 26 Apr 85

Plant	Raw	Treated
Hadnot Point	0.17	1.00
Tarawa Terrace	0.20	1.10
Holcomb Blvd.	0.19	1.04

HP Turbidity:	1.5	0.2
TT Turbidity:	7.3	1.5
HB Turbidity:	0.9	0.3

Analyst: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 Apr 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.07
TARAWA TERRACE	0.20	1.27
HOLCOMB BLVD.	0.18	0.70

HP TURBIDITY:	0.8	0.1
TT TURBIDITY:	1.0	0.2
HB TURBIDITY:	0.6	0.3

ANALYST: R Fitzgerald

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24APR85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.97
TARAWA TERRACE	0.17	1.16
HOLCOMB BLVD.	0.16	0.96

HP TURBIDITY:	1.44	0.12
TT TURBIDITY:	1.10	0.32
HB TURBIDITY:	0.92	0.20

ANALYST: A Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.79
TARAWA TERRACE	0.17	0.13
HOLCOMB BLVD.	0.15	0.95

HP TURBIDITY: 1.60 0.30
TT TURBIDITY: 5.50 0.40
HB TURBIDITY: 1.10 0.40

ANALYST: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 Apr 85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.87
TARAWA TERRACE	0.20	0.20
HOLCOMB BLVD.	0.17	0.96

HP TURBIDITY:	1.1	0.2
TT TURBIDITY:	6.4	0.2
HB TURBIDITY:	1.2	0.2

ANALYST: R Tschudle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 21 Apr 83

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.89
TARAWA TERRACE	0.18	0.35
HOLCOMB BLVD.	0.18	0.93

HP TURBIDITY: 0.7 0.2
TT TURBIDITY: 5.6 0.2
HB TURBIDITY: 0.8 0.1

ANALYST: R Lafayette

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 20 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.95
TARAWA TERRACE	0.19	0.88
HOLCOMB BLVD.	0.20	1.01

HP TURBIDITY:	0.62	0.24
TT TURBIDITY:	6.85	0.37
HB TURBIDITY:	0.85	0.20

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.07
TARAWA TERRACE	0.19	1.20
HOLCOMB BLVD.	0.19	0.97

HP TURBIDITY:	0.59	0.09
TT TURBIDITY:	3.67	0.26
HB TURBIDITY:	1.01	0.35

ANALYST: thBarber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 Apr 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.23
TARAWA TERRACE	0.19	1.13
HOLCOMB BLVD.	0.19	0.95

HP TURBIDITY: 0.6 0.2
TT TURBIDITY: 3.1 0.3
HB TURBIDITY: 1.0 0.6

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 17 Apr 85

Plant	Raw	Treated
Hadnot Point	0.15	1.16
Tarawa Terrace	0.18	1.00
Holcomb Blvd.	0.19	0.96

HP Turbidity: 1.3 0.4
TT Turbidity: 2.2 0.3
HB Turbidity: 1.6 1.3

Analyst: R Fachnelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.98
TARAWA TERRACE	0.21	0.83
HOLCOMB BLVD.	0.20	0.84

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	6.6	0.4
HB TURBIDITY:	2.0	0.5

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0,17	0,96
TARAWA TERRACE	0.20	0.98
HOLCOMB BLVD.	0.22	0.88

HP TURBIDITY: 0.9 0.7
TT TURBIDITY: 5.1 0.2
HB TURBIDITY: 1.2 0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 14 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.00
TARAWA TERRACE	0.21	0.96
HOLCOMB BLVD.	0.20	0.87

HP TURBIDITY: 0.5 / 0.2
TT TURBIDITY: 5.4 / 0.4
HB TURBIDITY: 0.5 / 0.3

ANALYST: Hemphill

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 Apr 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.09
TARAWA TERRACE	0.19	1.00
HOLCOMB BLVD.	0.19	0.99

HP TURBIDITY: 0.6 / 0.2
TT TURBIDITY: 6.5 / 0.3
HB TURBIDITY: 1.0 / 0.3

ANALYST: R Lockwood

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 APR 15

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.11
TARAWA TERRACE	0.21	1.08
HOLCOMB BLVD.	0.20	1.00

HP TURBIDITY:	0.50	0.3
TT TURBIDITY:	7.8	0.4
HB TURBIDITY:	1.0	0.3

ANALYST: Jones

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.20	0.96
HOLCOMB BLVD.	0.19	0.98

HP TURBIDITY:	1.2	0.10
TT TURBIDITY:	6.2	0.40
HB TURBIDITY:	1.0	0.50

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.02
TARAWA TERRACE	0.22	0.73
HOLCOMB BLVD.	0.21	1.11

HP TURBIDITY:	0.7	0.1
TT TURBIDITY:	7.3	0.4
HB TURBIDITY:	0.9	0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.97
TARAWA TERRACE	0.21	0.74
HOLCOMB BLVD.	0.20	1.00

HP TURBIDITY: 0.57 0.34
TT TURBIDITY: 3.20 0.28
HB TURBIDITY: 1.22 0.27

ANALYST: T H Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.78
TARAWA TERRACE	0.20	0.20
HOLCOMB BLVD.	0.20	0.92

HP TURBIDITY: 6.80 0.10
TT TURBIDITY: 0.70 5.00
HB TURBIDITY: 1.2 0.30

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.91
TARAWA TERRACE	0.19	0.22
HOLCOMB BLVD.	0.19	0.94

HP TURBIDITY:	0.40	0.20
TT TURBIDITY:	1.30	4.50
HB TURBIDITY:	1.20	0.20

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4/6/85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.98
TARAWA TERRACE	0.22	0.95
HOLCOMB BLVD.	0.22	1.00

HP TURBIDITY: 0.7 / 0.1
TT TURBIDITY: 4.8 / 0.4
HB TURBIDITY: 1.4 / 0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4-5-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.06
TARAWA TERRACE	0.22	0.94
HOLCOMB BLVD.	0.22	0.96

HP TURBIDITY:	0.6	0.2
TT TURBIDITY:	5.9	0.3
HB TURBIDITY:	0.9	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 APR 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.10
TARAWA TERRACE	0.19	0.18
HOLCOMB BLVD.	0.19	0.95

HP TURBIDITY:	2.85	0.13
TT TURBIDITY:	5.52	6.26
HB TURBIDITY:	1.07	0.20

ANALYST: Th Barbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 4-3-85

Plant	Raw	Treated
Hadnot Point	0.18	1.06
Tarawa Terrace	0.20	0.77
Holcomb Blvd.	0.20	0.88

HP Turbidity: 0.7 / 0.2
TT Turbidity: 2.9 / 0.9
HB Turbidity: 1.4 / 0.2

Analyst: R Lachapelle

Daily Fluoride Report

From: Quality Control Laboratory

To: Water Treatment Plant Foreman

Date: _____

Plant	Raw	Treated
Hadnot Point		
Tarawa Terrace		
Holcomb Blvd.		

HP Turbidity: _____

TT Turbidity: _____

HB Turbidity: _____

Analyst: _____

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4/2/85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.75
TARAWA TERRACE	0.22	0.96
HOLCOMB BLVD.	0.21	0.67

HP TURBIDITY:	0.50	0.20
TT TURBIDITY:	2.80	1.20
HB TURBIDITY:	0.70	0.20

ANALYST: BVENS

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 1 April 85

Plant	Raw	Treated
Hadnot Point	0.17	0.18
Tarawa Terrace	0.19	1.11
Holcomb Blvd.	0.20	0.24

HP Turbidity:	3.90	0.20
TT Turbidity:	3.80	0.30
HB Turbidity:	0.80	0.20

Analyst: Byers

DAILY FLUORIDE REPORT

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 31 DEC 84

Plant	Raw	Treated
Hadnot Point	0.14	0.90
Tarawa Terrace	0.20	0.76
Holcomb Blvd.	0.17	1.01

HP Turbidity: 1.2 0.2
TT Turbidity: 1.2 0.4
HB Turbidity: 1.1 0.2

Analyst: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.11
TARAWA TERRACE	0.16	0.75
HOLCOMB BLVD.	0.17	1.03

HP TURBIDITY:	0.5	0.2
TT TURBIDITY:	0.4	0.3
HB TURBIDITY:	0.7	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.98
TARAWA TERRACE	0.22	1.07
HOLCOMB BLVD.	0.21	1.09

HP TURBIDITY:	0.84	0.11
TT TURBIDITY:	2.49	0.14
HB TURBIDITY:	1.32	0.16

ANALYST: ThBarbee

DAILY TURBIDITY REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.99
TARAWA TERRACE	0.22	1.11
HOLCOMB BLVD.	0.21	1.09

HP TURBIDITY: 0.9 / 0.2
TT TURBIDITY: 2.1 / 0.3
HB TURBIDITY: 1.8 / 0.2

ANALYST: R Fabrette

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12/27/84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.91
TARAWA TERRACE	0.20	0.76
HOLCOMB BLVD.	0.19	1.01

HP TURBIDITY: 0.8 0.2
TT TURBIDITY: 0.5 0.2
HB TURBIDITY: 1.7 0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12/26/84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.93
TARAWA TERRACE	0.22	0.52
HOLCOMB BLVD.	0.20	0.85

HP TURBIDITY: 1.8 / 0.2
TT TURBIDITY: 0.5 / 0.3
HB TURBIDITY: 3.3 / 0.3

ANALYST: [signature]

DAILY CHLORINE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.02
TARAWA TERRACE	0.21	0.88
HOLCOMB BLVD.	0.19	1.02

HP TURBIDITY:	1.6	0.3
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	1.4	0.4

ANALYST: R Lockville

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.98
TARAWA TERRACE	0.21	0.96
HOLCOMB BLVD.	0.19	0.92

HP TURBIDITY:	1.2	0.5
TT TURBIDITY:	0.8	0.3
HB TURBIDITY:	1.2	0.3

ANALYST: R Tschyselle

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 23 Dec 84

Plant	Raw	Treated
Hadnot Point	0.15	1.00
Tarawa Terrace	0.20	0.92
Holcomb Blvd.	0.19	0.95

HP Turbidity: 1.2 / 0.3
TT Turbidity: 0.9 / 0.2
HB Turbidity: 0.6 / 0.2

Analyst: A Tachapalle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.90
TARAWA TERRACE	0.19	0.93
HOLCOMB BLVD.	0.21	1.03

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	0.6	1.4
HB TURBIDITY:	1.4	0.5

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 21 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.19	0.76
HOLCOMB BLVD.	0.18	0.99

HP TURBIDITY:	1.61	1.31
TT TURBIDITY:	0.71	0.32
HB TURBIDITY:	1.27	0.22

ANALYST: Th Barbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 20 Dec 84

Plant	Raw	Treated
Hadnot Point	0.14	0.83
Tarawa Terrace	0.18	0.92
Holcomb Blvd.	0.16	0.93

HP Turbidity:	1.4	2.0
TT Turbidity:	0.9	0.2
HB Turbidity:	0.6	0.2

Analyst: R Lashyalle

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 12/19/84

Plant	Raw	Treated
Hadnot Point	0.15	0.86
Tarawa Terrace	0.14	0.84
Holcomb Blvd.	0.17	0.89

HP Turbidity:	0.70	0.18
TT Turbidity:	0.80	0.28
HB Turbidity:	0.51	0.17

Analyst: Burns

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 12-18-84

Plant	Raw	Treated
Hadnot Point	0.16	0.96
Tarawa Terrace	0.20	0.63
Holcomb Blvd.	0.17	1.01

HP Turbidity:	0.7	0.2
TT Turbidity:	2.2	0.5
HB Turbidity:	0.5	0.1

Analyst: R Tackyette

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12/12/84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.89
TARAWA TERRACE	0.19	0.95
HOLCOMB BLVD.	0.16	0.92

HP TURBIDITY:	1.52	0.21
TT TURBIDITY:	0.68	0.15
HB TURBIDITY:	0.45	0.11

ANALYST: BURNS

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 12/16/84

Plant	Raw	Treated
Hadnot Point	0.16	0.89
Tarawa Terrace	0.20	0.96
Holcomb Blvd.	0.17	0.92

HP Turbidity: 0.69 0.12
TT Turbidity: 0.60 0.22
HB Turbidity: 0.37 0.09

Analyst: B Jones

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.04
TARAWA TERRACE	0.20	0.73
HOLCOMB BLVD.	0.19	1.05

HP TURBIDITY:	0.67	0.26
TT TURBIDITY:	0.54	0.20
HB TURBIDITY:	0.43	0.15

ANALYST: BANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12/14/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.19	1.04
HOLCOMB BLVD.	0.17	0.93

HP TURBIDITY: 1.10 0.39
TT TURBIDITY: 0.76 0.12
HB TURBIDITY: 0.48 0.08

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.99
TARAWA TERRACE	0.20	1.13
HOLCOMB BLVD.	0.17	1.05

HP TURBIDITY:	1.00	0.31
TT TURBIDITY:	1.07	0.95
HB TURBIDITY:	0.41	0.15

ANALYST: TH Barker

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.06
TARAWA TERRACE	0.20	1.27
HOLCOMB BLVD.	0.18	1.10

HP TURBIDITY: 1.1 0.2
TT TURBIDITY: 1.3 0.3
HB TURBIDITY: 0.9 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.20	1.06
HOLCOMB BLVD.	0.19	1.00

HP TURBIDITY:	0.70	0.34
TT TURBIDITY:	0.73	0.30
HB TURBIDITY:	0.60	0.20

ANALYST: EVANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.77
TARAWA TERRACE	0.18	0.76
HOLCOMB BLVD.	0.16	0.98

HP TURBIDITY:	0.7	0.4
TT TURBIDITY:	1.0	0.4
HB TURBIDITY:	0.6	0.3

ANALYST: Hemgarten

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.84
TARAWA TERRACE	0.19	0.81
HOLCOMB BLVD.	0.18	0.98

HP TURBIDITY:	0.7	0.4
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	0.6	0.3

ANALYST: Hemphill

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.01
TARAWA TERRACE	0.20	0.99
HOLCOMB BLVD.	0.18	1.03

HP TURBIDITY: 0.8 0.2
TT TURBIDITY: 0.7 0.5
HB TURBIDITY: 0.2 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.19	1.14
HOLCOMB BLVD.	0.20	1.01

HP TURBIDITY:	2.5	0.3
TT TURBIDITY:	0.5	0.2
HB TURBIDITY:	0.9	0.3

ANALYST: K Sadowski

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 DEC 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.85
TARAWA TERRACE	0.21	1.12
HOLCOMB BLVD.	0.22	1.00

HP TURBIDITY:	1.4	0.3
TT TURBIDITY:	0.5	0.3
HB TURBIDITY:	1.2	0.3

ANALYST: Davenport

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 5 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.78
TARAWA TERRACE	0.20	1.12
HOLCOMB BLVD.	0.21	0.98

HP TURBIDITY:	1.19	0.22
TT TURBIDITY:	0.80	0.36
HB TURBIDITY:	1.09	0.30

ANALYST: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.11	0.69
TARAWA TERRACE	0.17	1.05
HOLCOMB BLVD.	0.18	1.03

HP TURBIDITY: 1.02 0.55
TT TURBIDITY: 0.92 0.38
HB TURBIDITY: 1.22 0.28

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.11	0.71
TARAWA TERRACE	0.17	0.85
HOLCOMB BLVD.	0.18	1.15

HP TURBIDITY: 1.1 / 0.4
TT TURBIDITY: 1.3 / 0.3
HB TURBIDITY: 1.0 / 0.2

ANALYST: _____

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2 Dec 84

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.73
TARAWA TERRACE	0.17	0.93
HOLCOMB BLVD.	0.18	1.21

HP TURBIDITY: 0.8 0.4
TT TURBIDITY: 0.4 0.2
HB TURBIDITY: 0.5 0.2

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1DEC84

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.88
TARAWA TERRACE	0.19	1.10
HOLCOMB BLVD.	0.18	1.31

HP TURBIDITY:	1.94	0.35
TT TURBIDITY:	1.11	0.23
HB TURBIDITY:	1.02	0.25

ANALYST: Th Barbee

INERT ING 35

calcium 65

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.82
TARAWA TERRACE	0.17	0.92
HOLCOMB BLVD.	0.18	1.14

HP TURBIDITY:	2.20	0.40
TT TURBIDITY:	1.70	0.30
HB TURBIDITY:	1.10	0.60

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.99
TARAWA TERRACE	0.17	0.59
HOLCOMB BLVD.	0.17	1.08

HP TURBIDITY:	1.8	0.3
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	1.1	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.11	0.97
TARAWA TERRACE	0.16	0.66
HOLCOMB BLVD.	0.15	0.95

HP TURBIDITY:	1.67	0.18
TT TURBIDITY:	0.95	0.20
HB TURBIDITY:	0.97	0.12

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.76
TARAWA TERRACE	0.19	0.76
HOLCOMB BLVD.	0.15	1.00

HP TURBIDITY:	1.40	0.30
TT TURBIDITY:	0.73	0.30
HB TURBIDITY:	0.68	0.17

ANALYST: Stevens

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 26 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.94
TARAWA TERRACE	0.21	0.67
HOLCOMB BLVD.	0.16	1.01

HP TURBIDITY:	2.10	0.40
TT TURBIDITY:	0.80	0.30
HB TURBIDITY:	0.70	0.20

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.22	0.84
HOLCOMB BLVD.	0.16	1.07

HP TURBIDITY:	1.34	0.60
TT TURBIDITY:	8.30	0.30
HB TURBIDITY:	0.60	0.20

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.95
TARAWA TERRACE	0.21	1.08
HOLCOMB BLVD.	0.16	1.06

HP TURBIDITY:	1.8	0.5
TT TURBIDITY:	0.6	0.5
HB TURBIDITY:	0.7	0.2

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.90
TARAWA TERRACE	0.19	0.90
HOLCOMB BLVD.	0.16	0.96

HP TURBIDITY: 1.5 0.3
TT TURBIDITY: 0.9 0.7
HB TURBIDITY: 0.8 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.95
TARAWA TERRACE	0.18	0.77
HOLCOMB BLVD.	0.15	0.97

HP TURBIDITY:	0.68	0.23
TT TURBIDITY:	2.68	0.64
HB TURBIDITY:	0.67	0.15

ANALYST: th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 21 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.19	0.78
HOLCOMB BLVD.	0.16	1.00

HP TURBIDITY:	1.5	0.7
TT TURBIDITY:	1.0	0.3
HB TURBIDITY:	0.7	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 20 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.04
TARAWA TERRACE	0.22	1.07
HOLCOMB BLVD.	0.18	1.00

HP TURBIDITY: 1.2 / 1.4
TT TURBIDITY: 0.7 / 0.3
HB TURBIDITY: 0.7 / 0.3

ANALYST: Hemphill

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.99
TARAWA TERRACE	0.21	0.77
HOLCOMB BLVD.	0.14	1.05

HP TURBIDITY: 0.73 1.03
TT TURBIDITY: 0.65 0.38
HB TURBIDITY: 0.76 0.24

ANALYST: B VANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.00
TARAWA TERRACE	0.19	0.78
HOLCOMB BLVD.	0.16	1.10

HP TURBIDITY: 0.42 0.67
TT TURBIDITY: 0.60 0.46
HB TURBIDITY: 0.63 0.24

ANALYST: BURNS

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 11/17/84

Plant	Raw	Treated
Hadnot Point	0.19	1.00
Tarawa Terrace	0.12	1.00
Holcomb Blvd.	0.19	1.05

HP Turbidity:	1.8	1.0
TT Turbidity:	1.4	0.4
HB Turbidity:	0.8	0.3

Analyst: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.95
TARAWA TERRACE	0.19	0.82
HOLCOMB BLVD.	0.18	1.18

HP TURBIDITY:	0.9	1.2
TT TURBIDITY:	0.6	0.4
HB TURBIDITY:	0.8	0.3

ANALYST: R Tackaberry

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.92
TARAWA TERRACE	0.21	1.07
HOLCOMB BLVD.	0.19	1.22

HP TURBIDITY:	0.85	0.63
TT TURBIDITY:	0.92	0.92
HB TURBIDITY:	1.04	0.21

ANALYST: BVANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 14 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.86
TARAWA TERRACE	0.19	1.00
HOLCOMB BLVD	0.23	1.17

HP TURBIDITY: 1.3 0.8
TT TURBIDITY: 1.6 0.3
HB TURBIDITY: 1.0 0.3

ANALYST: Hunegnaw

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.94
TARAWA TERRACE	0.19	0.91
HOLCOMB BLVD.	0.19	1.00

HP TURBIDITY:	0.95	0.34
TT TURBIDITY:	0.84	0.25
HB TURBIDITY:	1.00	0.20

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.16	0.66
HOLCOMB BLVD.	0.19	1.04

HP TURBIDITY:	0.88	0.49
TT TURBIDITY:	0.63	0.42
HB TURBIDITY:	1.50	0.24

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.89
TARAWA TERRACE	0.20	0.78
HOLCOMB BLVD.	0.20	1.01

HP TURBIDITY:	0.58	0.36
TT TURBIDITY:	0.87	0.38
HB TURBIDITY:	0.54	0.16

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.94
TARAWA TERRACE	0.20	1.05
HOLCOMB BLVD.	0.21	1.00

HP TURBIDITY: 1.56 0.34
TT TURBIDITY: 0.59 0.38
HB TURBIDITY: 0.95 0.14

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.08
TARAWA TERRACE	0.19	1.04
HOLCOMB BLVD.	0.20	1.08

HP TURBIDITY:	3.4	0.3
TT TURBIDITY:	0.7	0.4
HB TURBIDITY:	1.3	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.88
TARAWA TERRACE	0.20	0.91
HOLCOMB BLVD.	0.21	1.16

HP TURBIDITY:	2.0	0.4
TT TURBIDITY:	1.0	0.5
HB TURBIDITY:	1.2	0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 Nov 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.10
TARAWA TERRACE	0.21	1.16
HOLCOMB BLVD.	0.22	1.41

HP TURBIDITY:	2.2	0.2
TT TURBIDITY:	0.8	0.9
HB TURBIDITY:	0.9	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 NOV 84

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.01
TARAWA TERRACE	0.18	1.05
HOLCOMB BLVD.	0.19	1.23

HP TURBIDITY:	1.8	0.2
TT TURBIDITY:	0.8	2.6
HB TURBIDITY:	1.0	0.2

ANALYST: R Fachnelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11-5-84

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.76
TARAWA TERRACE	0.17	0.81
HOLCOMB BLVD.	0.17	0.95
HP TURBIDITY:	0.8	0.3
TT TURBIDITY:	0.7	0.8
HB TURBIDITY:	0.9	0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11-4-84

PLANT	RAW	TREATED
HADNOT POINT	0,11	0,79
TARAWA TERRACE	0,17	0,82
HOLCOMB BLVD.	0,17	0.99

HP TURBIDITY: 0.5 0.3
TT TURBIDITY: 0.4 0.5
HB TURBIDITY: 0.8 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11/3/84

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.00
TARAWA TERRACE	0.17	0.84
HOLCOMB BLVD.	0.19	1.02

HP TURBIDITY:	1.85	0.43
TT TURBIDITY:	0.70	0.24
HB TURBIDITY:	1.55	0.15

ANALYST: TWBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11/2/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.99
TARAWA TERRACE	0.20	0.93
HOLCOMB BLVD.	0.20	1.09

HP TURBIDITY:	1.38	0.28
TT TURBIDITY:	1.21	0.44
HB TURBIDITY:	0.94	0.29

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11/1/84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.92
TARAWA TERRACE	0.20	0.86
HOLCOMB BLVD.	0.18	0.92

HP TURBIDITY:	4.1	0.30
TT TURBIDITY:	0.90	0.50
HB TURBIDITY:	0.80	0.20

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 31 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.21	0.93
HOLCOMB BLVD.	0.17	0.94

HP TURBIDITY:	2.3	0.2
TT TURBIDITY:	0.8	0.5
HB TURBIDITY:	3.1	0.7

ANALYST: R Fachelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.03
TARAWA TERRACE	0.22	0.91
HOLCOMB BLVD.	0.20	0.91

HP TURBIDITY:	2.2	0.3
TT TURBIDITY:	0.8	0.7
HB TURBIDITY:	0.7	0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0,17	0.95
TARAWA TERRACE	0.20	0,97
HOLCOMB BLVD.	0.18	0,87

HP TURBIDITY: 2.5 0.3
TT TURBIDITY: 1.8 1.1
HB TURBIDITY: 1.0 0.2

ANALYST: Honeycutt

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 10/28/84

Plant	Raw	Treated
Hadnot Point	0.15	0.91
Tarawa Terrace	0.20	0.94
Holcomb Blvd.	0.19	0.89

HP Turbidity:	0.6	0.2
TT Turbidity:	2.5	0.6
HB Turbidity:	0.8	0.3

Analyst: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.00
TARAWA TERRACE	0.20	1.17
HOLCOMB BLVD.	0.16	0.86

HP TURBIDITY: 0.7 0.3
TT TURBIDITY: 1.1 0.7
HB TURBIDITY: 1.0 0.2

ANALYST: K Sabourdle

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 26 Oct 84

Plant	Raw	Treated
Hadnot Point	0.16	1.09
Tarawa Terrace	0.20	1.15
Holcomb Blvd.	0.17	0.88

HP Turbidity: 1.0 0.4
TT Turbidity: 1.1 0.6
HB Turbidity: 0.9 0.2

Analyst: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/25/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.21	1.11
HOLCOMB BLVD.	0.18	0.91

HP TURBIDITY:	0.70	0.7
TT TURBIDITY:	0.9	0.6
HB TURBIDITY:	1.0	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.06
TARAWA TERRACE	0.23	1.09
HOLCOMB BLVD.	0.20	0.92

HP TURBIDITY:	1.4	0.6
TT TURBIDITY:	0.8	2.1
HB TURBIDITY:	1.2	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23OCT84

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.00
TARAWA TERRACE	0.19	0.78
HOLCOMB BLVD.	0.16	0.83

HP TURBIDITY:	2.40	0.34
TT TURBIDITY:	0.69	0.47
HB TURBIDITY:	0.75	0.23

ANALYST: M Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/22/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.86
TARAWA TERRACE	0.20	1.07
HOLCOMB BLVD.	0.18	0.72

HP TURBIDITY:	1.3	0.4
TT TURBIDITY:	0.6	0.6
HB TURBIDITY:	0.7	0.6

ANALYST: Honeycutt

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 10/21/84

Plant	Raw	Treated
Hadnot Point	0.15	0.95
Tarawa Terrace	0.17	0.96
Holcomb Blvd.	0.17	0.74

HP Turbidity: 1.1 0.5
TT Turbidity: 2.6 0.6
HB Turbidity: 1.0 0.5

Analyst: Hunyatt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 20 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.21	0.62
HOLCOMB BLVD.	0.17	0.70

HP TURBIDITY: 1.2 0.3
TT TURBIDITY: 0.9 1.3
HB TURBIDITY: 1.7 0.9

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19OCT84

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.02
TARAWA TERRACE	0.21	0.85
HOLCOMB BLVD.	0.17	0.74

HP TURBIDITY:	1.31	0.18
TT TURBIDITY:	0.83	0.50
HB TURBIDITY:	0.69	1.24

ANALYST: T Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.06
TARAWA TERRACE	0.20	1.17
HOLCOMB BLVD.	0.16	0.69

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	1.1	0.5
HB TURBIDITY:	0.6	4.9

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 17 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.02
TARAWA TERRACE	0.20	1.24
HOLCOMB BLVD.	0.15	0.82

HP TURBIDITY:	2.10	0.27
TT TURBIDITY:	0.82	0.39
HB TURBIDITY:	0.73	0.17

ANALYST: th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/16/84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.97
TARAWA TERRACE	0.20	1.10
HOLCOMB BLVD.	0.16	1.05

HP TURBIDITY: 0.7 0.3
TT TURBIDITY: 0.6 0.4
HB TURBIDITY: 0.9 0.2

ANALYST: BRANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/15/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.20	0.93
HOLCOMB BLVD.	0.17	0.99

HP TURBIDITY:	1.1	0.2
TT TURBIDITY:	0.5	0.7
HB TURBIDITY:	0.9	0.3

ANALYST: Evans

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/14/84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.97
TARAWA TERRACE	0.21	0.85
HOLCOMB BLVD.	0.17	1.50

HP TURBIDITY: 0.5 0.2
TT TURBIDITY: 0.3 0.3
HB TURBIDITY: 0.5 0.2

ANALYST: BYRNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10/13/84

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.89
TARAWA TERRACE	0.20	0.73
HOLCOMB BLVD.	0.16	1.12

HP TURBIDITY: 6.7 / 0.2
TT TURBIDITY: 0.8 / 0.8
HB TURBIDITY: 1.1 / 0.4

ANALYST: EVANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.84
TARAWA TERRACE	0.20	0.98
HOLCOMB BLVD.	0.20	0.78

HP TURBIDITY:	0.8	0.3
TT TURBIDITY:	0.9	1.0
HB TURBIDITY:	1.1	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 11 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.90
TARAWA TERRACE	0.21	1.24
HOLCOMB BLVD.	0.21	1.31

HP TURBIDITY:	20	3.4
TT TURBIDITY:	1.0	0.5
HB TURBIDITY:	2.3	0.3

ANALYST: R Fachinelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.22	1.30
HOLCOMB BLVD.	0.21	1.04

HP TURBIDITY:	2.9	0.9
TT TURBIDITY:	0.9	0.3
HB TURBIDITY:	1.5	0.4

ANALYST: R Lachuelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10-9-84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.22	1.24
HOLCOMB BLVD.	0.20	0.98

HP TURBIDITY:	3.25	0.33
TT TURBIDITY:	0.91	0.46
HB TURBIDITY:	1.18	0.40

ANALYST: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.25	1.26
HOLCOMB BLVD.	0.22	0.91

HP TURBIDITY:	1.8	1.1
TT TURBIDITY:	1.3	0.3
HB TURBIDITY:	1.6	0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.96
TARAWA TERRACE	0.23	1.26
HOLCOMB BLVD.	0.20	1.00

HP TURBIDITY: 1.2 / 0.4
TT TURBIDITY: 0.5 / 0.2
HB TURBIDITY: 1.0 / 0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.97
TARAWA TERRACE	0.23	1.12
HOLCOMB BLVD.	0.20	1.14

HP TURBIDITY:	1.80	0.38
TT TURBIDITY:	1.00	0.18
HB TURBIDITY:	1.03	0.50

ANALYST: TH Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 5 Oct 84

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.07
TARAWA TERRACE	0.22	1.12
HOLCOMB BLVD.	0.22	0.94

HP TURBIDITY: 2.0 / 0.3
TT TURBIDITY: 0.7 / 0.9
HB TURBIDITY: 1.1 / 1.0

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.02
TARAWA TERRACE	0.22	0.81
HOLCOMB BLVD.	0.21	1.38

HP TURBIDITY:	1.60	0.50
TT TURBIDITY:	0.80	0.30
HB TURBIDITY:	1.20	1.50

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.90
TARAWA TERRACE	0.16	0.88
HOLCOMB BLVD.	0.15	0.99

HP TURBIDITY: 1.6 / 0.4
TT TURBIDITY: 0.7 / 0.5
HB TURBIDITY: 1.1 / 2.1

ANALYST: Honeycutt

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 20 Oct 84

Plant	Raw	Treated
Hadnot Point	0.15	0.94
Tarawa Terrace	0.16	0.97
Holcomb Blvd.	0.14	0.96

HP Turbidity: 1.7 0.2
TT Turbidity: 1.1 0.3
HB Turbidity: 1.3 0.3

Analyst: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 OCT 84

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.95
TARAWA TERRACE	0.19	0.96
HOLCOMB BLVD.	0.17	1.06

HP TURBIDITY:	1.40	0.40
TT TURBIDITY:	1.40	0.60
HB TURBIDITY:	1.30	0.80

ANALYST: BUENO

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-30-85

PLANT	RAW	TREATED
HADNOT POINT	0.11	0.09
TARAWA TERRACE	0.15	0.80
HOLCOMB BLVD.	0.13	0.14

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	7.5	0.3
HB TURBIDITY:	0.2	0.2

ANALYST: Lyndia Z Lane

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-29-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.10
TARAWA TERRACE	0.17	0.95
HOLCOMB BLVD.	0.15	0.12

HP TURBIDITY: 0.6 0.1
TT TURBIDITY: 8.0 0.3
HB TURBIDITY: 0.7 1.6

ANALYST: Lyndia J. Love

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-28-85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.13
TARAWA TERRACE	0.17	0.23
HOLCOMB BLVD.	0.19	0.17

HP TURBIDITY: 1.3 0.2
TT TURBIDITY: 5.8 0.3
HB TURBIDITY: 2.1 0.4

ANALYST: Honeycutt

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-27-85

PLANT	RAW	TREATED
HADNOT POINT	NO SAMPLE	
TARAWA TERRACE	0.25	0.84
HOLCOMB BLVD.	NO SAMPLE	

HP TURBIDITY: ____ ____
TT TURBIDITY: 1.0 0.2
HB TURBIDITY: ____ ____

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/26/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.18
TARAWA TERRACE	0.18	0.64
HOLCOMB BLVD.	0.22	0.20

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	4.5	0.2
HB TURBIDITY:	0.8	0.2

ANALYST: Jerequel

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-25-85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.39
TARAWA TERRACE	0.18	0.82
HOLCOMB BLVD.	0.16	0.41

HP TURBIDITY:	0.6	0.2
TT TURBIDITY:	7.1	0.3
HB TURBIDITY:	1.1	0.4

ANALYST: BVERNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 SEP 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.85
TARAWA TERRACE	0.19	0.87
HOLCOMB BLVD.	0.16	0.93

HP TURBIDITY:	1.9	0.2
TT TURBIDITY:	7.6	0.3
HB TURBIDITY:	1.6	0.2

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/23/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.77
TARAWA TERRACE	0.20	0.93
HOLCOMB BLVD.	0.17	0.93

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	4.7	0.2
HB TURBIDITY:	1.7	0.2

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/22/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.82
TARAWA TERRACE	0.22	0.98
HOLCOMB BLVD.	0.18	0.93

HP TURBIDITY:	1.1	0.2
TT TURBIDITY:	6.7	0.3
HB TURBIDITY:	0.5	0.4

ANALYST: <VEN>

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-21-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.83
TARAWA TERRACE	0.22	0.70
HOLCOMB BLVD.	0.16	0.95

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	9.1	0.2
HB TURBIDITY:	2.8	0.1

ANALYST: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/20/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.84
TARAWA TERRACE	0.17	0.74
HOLCOMB BLVD.	0.15	0.88

HP TURBIDITY:	1.1	0,3
TT TURBIDITY:	8.2	0,3
HB TURBIDITY:	2.4	0,2

ANALYST: Byers

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/14/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.87
TARAWA TERRACE	0.20	0.85
HOLCOMB BLVD.	0.16	0.89

HP TURBIDITY:	0.9	0.4
TT TURBIDITY:	7.8	0.5
HB TURBIDITY:	1.4	0.3

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/18/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.92
TARAWA TERRACE	0.22	1.41
HOLCOMB BLVD.	0.17	0.81

HP TURBIDITY:	1.6	0.6
TT TURBIDITY:	8.0	0.1
HB TURBIDITY:	0.5	0.9

ANALYST: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-17-85

PLANT	RAW	TREATED
HADNOT POINT	0.22	0.98
TARAWA TERRACE	0.24	1.66
HOLCOMB BLVD.	0.22	0.88

HP TURBIDITY:	5.7	0.2
TT TURBIDITY:	8.7	0.2
HB TURBIDITY:	1.3	0.2

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 SEPT 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.88
TARAWA TERRACE	0.25	1.12
HOLCOMB BLVD.	0.19	1.10

HP TURBIDITY:	1.2	0.2
TT TURBIDITY:	8.2	0.4
HB TURBIDITY:	0.7	0.3

ANALYST: BYERS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 SEPT 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.90
TARAWA TERRACE	0.23	1.02
HOLCOMB BLVD.	0.19	1.11

HP TURBIDITY: 0.4 / 0.7
TT TURBIDITY: 7.5 / 0.3
HB TURBIDITY: 0.5 / 2.8

ANALYST: BVRNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/14/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.70
TARAWA TERRACE	0.23	0.89
HOLCOMB BLVD.	0.19	0.99

HP TURBIDITY:	0.7	0.3
TT TURBIDITY:	9.1	0.3
HB TURBIDITY:	0.6	1.0

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/14/85

PLANT	RAW	TREATED
HADNOT POINT		
TARAWA TERRACE		
HOLCOMB BLVD.		

HP TURBIDITY: _____ _____
TT TURBIDITY: _____ _____
HB TURBIDITY: _____ 0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/13/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.56
TARAWA TERRACE	0.20	0.88
HOLCOMB BLVD.	0.15	1.24

HP TURBIDITY:	0.9	0.4
TT TURBIDITY:	9.5	0.3
HB TURBIDITY:	0.8	0.2

ANALYST: BYRNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/12/85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.82
TARAWA TERRACE	0.19	1.04
HOLCOMB BLVD.	0.16	1.33

HP TURBIDITY:	0.6	0.4
TT TURBIDITY:	8.2	0.4
HB TURBIDITY:	0.7	0.4

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-11-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.87
TARAWA TERRACE	0.19	1.12
HOLCOMB BLVD.	0.17	1.29

HP TURBIDITY:	1.5	0.6
TT TURBIDITY:	8.1	0.4
HB TURBIDITY:	0.5	0.2

ANALYST: BURNS

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/10/85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.91
TARAWA TERRACE	0.20	0.73
HOLCOMB BLVD.	0.18	0.94

HP TURBIDITY: 1.5 0.3
TT TURBIDITY: 2.0 0.4
HB TURBIDITY: 1.4 0.5

ANALYST: Hennigett

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/9/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.99
TARAWA TERRACE	0.19	0.75
HOLCOMB BLVD.	0.17	1.00

HP TURBIDITY:	1.3	0.4
TT TURBIDITY:	0.7	0.3
HB TURBIDITY:	1.0	0.3

ANALYST: BUENS

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/8/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.98
TARAWA TERRACE	0.20	0.95
HOLCOMB BLVD.	0.17	1.06

HP TURBIDITY: 0.4 3.3
TT TURBIDITY: 6.4 0.4
HB TURBIDITY: 1.0 0.3

ANALYST: Byers

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-7-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.00
TARAWA TERRACE	0.22	1.28
HOLCOMB BLVD.	0.16	1.11

HP TURBIDITY:	0.6	0.4
TT TURBIDITY:	7.7	0.4
HB TURBIDITY:	0.7	0.2

ANALYST: TH Barbee

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/6/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.01
TARAWA TERRACE	0.22	1.34
HOLCOMB BLVD.	0.19	1.11

HP TURBIDITY:	2.5	0.1
TT TURBIDITY:	7.2	0.3
HB TURBIDITY:	1.5	0.8

ANALYST: T. Barber

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-5-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.98
TARAWA TERRACE	0.23	1.21
HOLCOMB BLVD.	0.18	1.11

HP TURBIDITY:	1.1	0.1
TT TURBIDITY:	7.0	0.2
HB TURBIDITY:	1.5	0.2

ANALYST: thBarbee

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/4/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.98
TARAWA TERRACE	0.21	1.10
HOLCOMB BLVD.	0.17	1.23

HP TURBIDITY:	1.9	0.3
TT TURBIDITY:	6.9	0.2
HB TURBIDITY:	1.3	0.7

ANALYST: th Barker

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9/3/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.92
TARAWA TERRACE	0.18	0.99
HOLCOMB BLVD.	0.18	1.08

HP TURBIDITY: 1.3 0.4
TT TURBIDITY: 8.1 0.3
HB TURBIDITY: 1.7 0.5

ANALYST: Honeycutt

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-2-85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.85
TARAWA TERRACE	0.19	0.90
HOLCOMB BLVD.	0.17	1.01

HP TURBIDITY:	0.5	0.3
TT TURBIDITY:	8.2	0.1
HB TURBIDITY:	1.5	0.6

ANALYST: M Barbee

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9-1-85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.90
TARAWA TERRACE	0.21	0.92
HOLCOMB BLVD.	0.17	1.00

HP TURBIDITY:	0.5	0.3
TT TURBIDITY:	9.1	0.2
HB TURBIDITY:	0.7	0.8

ANALYST: M Barbee

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/31/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.83
TARAWA TERRACE	0.22	1.09
HOLCOMB BLVD.	0.21	0.99

HP TURBIDITY:	1.0	0.3
TT TURBIDITY:	10.2	0.5
HB TURBIDITY:	1.0	0.6

ANALYST: Honeycutt

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/30/85

PLANT	RAW	TREATED
HADNOT POINT	0.11	0.80
TARAWA TERRACE	0.22	0.78
HOLCOMB BLVD.	0.19	1.02

HP TURBIDITY:	0.7	0.3
TT TURBIDITY:	8.2	0.4
HB TURBIDITY:	1.7	0.5

ANALYST: Honeycutt

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 AUG 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.86
TARAWA TERRACE	0.21	0.80
HOLCOMB BLVD.	0.16	1.27

HP TURBIDITY:	0.8	0.2
TT TURBIDITY:	7.4	0.4
HB TURBIDITY:	0.8	0.2

ANALYST: BYRNS

LAB 1-15 DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8-28-85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.86
TARAWA TERRACE	0.17	1.10
HOLCOMB BLVD.	0.15	1.16

HP TURBIDITY: 1.1 / 0.3
TT TURBIDITY: 7.6 / 0.3
HB TURBIDITY: 0.8 / 0.2

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/27/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.86
TARAWA TERRACE	0.18	0.87
HOLCOMB BLVD.	0.15	0.96

HP TURBIDITY: 1.7 0.2
TT TURBIDITY: 8.7 0.3
HB TURBIDITY: 1.5 0.3

ANALYST: Hemphill

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 26 AUG 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.92
TARAWA TERRACE	0.20	0.82
HOLCOMB BLVD.	0.16	1.02

HP TURBIDITY:	0.5	0.1
TT TURBIDITY:	8.8	0.1
HB TURBIDITY:	1.3	0.2

ANALYST: thBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 AUG 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.21	0.71
HOLCOMB BLVD.	0.18	1.08

HP TURBIDITY:	0.5	0.3
TT TURBIDITY:	7.6	0.2
HB TURBIDITY:	0.8	0.2

ANALYST: A Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8-24-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.19	0.83
HOLCOMB BLVD.	0.17	1.03

HP TURBIDITY:	0.5	0.1
TT TURBIDITY:	7.5	0.2
HB TURBIDITY:	1.8	0.2

ANALYST: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/23/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.92
TARAWA TERRACE	0.21	1.00
HOLCOMB BLVD.	0.20	1.07

HP TURBIDITY:	0.5	0.2
TT TURBIDITY:	7.6	0.3
HB TURBIDITY:	0.8	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/22/85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.96
TARAWA TERRACE	0.18	0.85
HOLCOMB BLVD.	0.18	1.00

HP TURBIDITY:	1.0	0.4
TT TURBIDITY:	4.0	0.3
HB TURBIDITY:	0.9	0.4

ANALYST: J Evans

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/21/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.97
TARAWA TERRACE	0.23	0.79
HOLCOMB BLVD.	0.20	0.98

HP TURBIDITY:	0.6	0.3
TT TURBIDITY:	7.5	0.3
HB TURBIDITY:	1.0	0.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/20/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.94
TARAWA TERRACE	0.20	1.05
HOLCOMB BLVD.	0.18	1.00

HP TURBIDITY:	1.1	0.3
TT TURBIDITY:	7.8	0.4
HB TURBIDITY:	0.9	0.6

ANALYST: JENNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/19/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.93
TARAWA TERRACE	0.20	0.86
HOLCOMB BLVD.	0.17	0.66

HP TURBIDITY: 1.1 0.2
TT TURBIDITY: 7.5 0.3
HB TURBIDITY: 0.8 0.4

ANALYST: BJANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/18/85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.95
TARAWA TERRACE	0.22	1.00
HOLCOMB BLVD.	0.18	1.11

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	8.0	0.4
HB TURBIDITY:	0.7	0.7

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/17/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.91
TARAWA TERRACE	0.22	0.83
HOLCOMB BLVD.	0.16	0.95

HP TURBIDITY:	0.6	0.3
TT TURBIDITY:	7.7	0.4
HB TURBIDITY:	1.4	0.8

ANALYST: Hemperley

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/16/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.87
TARAWA TERRACE	0.18	0.75
HOLCOMB BLVD.	0.16	0.80

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	7.6	0.4
HB TURBIDITY:	0.9	0.3

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 AUG 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.02
TARAWA TERRACE	0.23	0.75
HOLCOMB BLVD.	0.18	0.86

HP TURBIDITY:	1.7	0.3
TT TURBIDITY:	7.1	0.3
HB TURBIDITY:	1.3	0.3

ANALYST: Hunnicutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/14/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.86
TARAWA TERRACE	0.22	0.91
HOLCOMB BLVD.	0.19	0.95

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	7.9	0.3
HB TURBIDITY:	1.4	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/13/85

PLANT	RAW	TREATED
HADNOT POINT	0.20	0.95
TARAWA TERRACE	0.22	1.00
HOLCOMB BLVD.	0.20	1.12

HP TURBIDITY:	2.0	0.3
TT TURBIDITY:	6.4	0.4
HB TURBIDITY:	1.8	0.2

ANALYST: Burns

OPNAV 5216/144 (REV. 6-70)
S/N 0107-LF-778-8097

DEPARTMENT OF THE NAVY

Memorandum

DATE: 8/12/85

FROM: WQ Lab (Honeycutt)

TO: Water Plant Foreman

SUBJ: Flouride (Daily) 8/12/85

		F (mg/L)	Turbidity
HP	R	0.18	1.4
	T	0.95	0.6
TT	R	0.22	6.6
	T	0.23	2.4
HB	R	0.16	1.1
	T	1.12	0.2

OPNAV 5216/144 (REV. 6-70)
S/N 0107-LF-778-8097

DEPARTMENT OF THE NAVY

Memorandum

DATE: 8/12/85

FROM: WQ Lab (Hunegnaw)

TO: Water Plant Foreman

SUBJ: Flouride (Daily) 8/11/85

		F' (mg/l)	Turbidity
HP	R	0.20	2.1
	T	1.05	0.6
TT	R	0.25	6.7
	T	0.81	0.3
HB	R	0.20	1.4
	T	1.09	0.2

OPNAV 5216/144 (REV. 6-70)
S/N 0107-LF-778-8097

DEPARTMENT OF THE NAVY

Memorandum

DATE: 10 AUG 85

FROM: WATER QUALITY CONTROL LAB

TO: WATER TREATMENT, BLDG. 670

SUBJ: FLUORIDE, TURBIDITY

PLANT	FLUORIDE		TURBIDITY	
	RAW	TREATED	RAW	TREATED
H P	0.19	0.96	1.4	0.2
T T	0.24	1.01	8.3	0.2
H B	0.21	1.07	0.6	0.2

Th Barbee

OPNAV 5216/144 (REV. 6-70)
S/N 0107-LF-778-8097

DEPARTMENT OF THE NAVY

Memorandum

DATE: 9 Aug 1985

FROM:

TO:

SUBJ: Flouride Results

	R =	T =	Turb. R =	Turb. T =
HP	0.17	0.95	2.2	0.2
TT	0.21	0.99	7.9	0.2
HB	0.18	1.05	0.7	0.1

(Bravo)

OPNAV 5216/144 (REV. 6-70)
S/N 0107-LF-778-8097
DEPARTMENT OF THE NAVY

Memorandum

DATE: 8/8/85

FROM:

TO:

SUBJ: FLOURIDE RESULTS

	RAW	TREATED	TURBIDITY RAW	TREATED
H.P.	0.16	0.92	1.1	0.1
T.T.	0.21	0.97	6.1	0.1
H.B.	0.16	1.04	0.8	0.3

Burns

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 7 Aug 1985

Plant	Raw	Treated
Hadnot Point	0.16	0.89
Tarawa Terrace	0.22	0.87
Holcomb Blvd.	0.17	0.86

HP Turbidity:	1.2	0.2
TT Turbidity:	8.8	0.2
HB Turbidity:	0.6	0.2

Analyst: T. B

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 Aug 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.82
TARAWA TERRACE	0.21	0.91
HOLCOMB BLVD.	0.16	0.81

HP TURBIDITY:	1.7	0.1
TT TURBIDITY:	7.0	0.2
HB TURBIDITY:	0.7	0.2

ANALYST: TBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/5/85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.86
TARAWA TERRACE	0.22	1.05
HOLCOMB BLVD.	0.19	1.04

HP TURBIDITY:	2.8	0.2
TT TURBIDITY:	9.7	0.4
HB TURBIDITY:	0.9	0.2

ANALYST: BUENS

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 8/4/85

Plant	Raw	Treated
Hadnot Point	0.16	0.80
Tarawa Terrace	0.23	0.96
Holcomb Blvd.	0.18	0.98

HP Turbidity:	1.2	0.2
TT Turbidity:	10.9	0.4
HB Turbidity:	0.4	0.2

Analyst: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8/3/85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.90
TARAWA TERRACE	0.23	0.95
HOLCOMB BLVD.	0.19	1.12

HP TURBIDITY:	1.6	0.2
TT TURBIDITY:	11.1	0.4
HB TURBIDITY:	1.1	0.2

ANALYST: Hereguet

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8-2-85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.01
TARAWA TERRACE	0.25	0.96
HOLCOMB BLVD.	0.20	1.13

HP TURBIDITY:	3.4	0.2
TT TURBIDITY:	8.7	0.3
HB TURBIDITY:	1.2	0.2

ANALYST: R Yarbrough

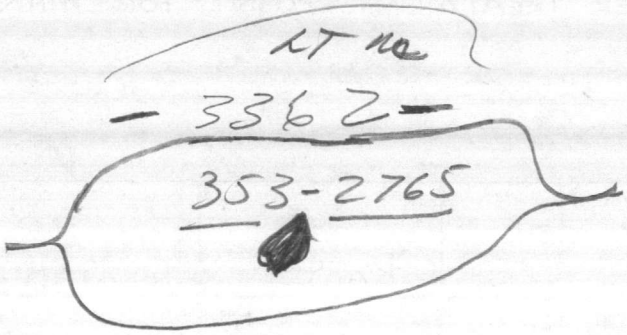
LT no
- 3362 -
353-2765

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8-1-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.94
TARAWA TERRACE	0.23	0.80
HOLCOMB BLVD.	0.18	1.03

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	8.1	0.3
HB TURBIDITY:	1.0	0.2

ANALYST: Burns

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-31-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.94
TARAWA TERRACE	0.24	0.98
HOLCOMB BLVD.	0.19	1.06

HP TURBIDITY:	1.1	0.1
TT TURBIDITY:	8.9	0.2
HB TURBIDITY:	1.5	0.1

ANALYST: BJAWS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.94
TARAWA TERRACE	0.24	0.98
HOLCOMB BLVD.	0.20	1.05

HP TURBIDITY:	1.8	0.2
TT TURBIDITY:	2.2	0.6
HB TURBIDITY:	2.2	0.3

ANALYST: R Lockwood

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.90
TARAWA TERRACE	0.22	0.88
HOLCOMB BLVD.	0.18	1.02

HP TURBIDITY: 0.8 / 0.1
TT TURBIDITY: 6.9 / 0.8
HB TURBIDITY: 2.0 / 0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28 July 83

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.95
TARAWA TERRACE	0.24	0.89
HOLCOMB BLVD.	0.19	1.02

HP TURBIDITY: 0.7 / 0.1
TT TURBIDITY: 7.5 / 0.2
HB TURBIDITY: 0.5 / 0.1

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-27-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.96
TARAWA TERRACE	0.23	1.01
HOLCOMB BLVD.	0.20	1.01

HP TURBIDITY: 0.5 0.1
TT TURBIDITY: 8.6 0.2
HB TURBIDITY: 2.0 0.1

ANALYST: th Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 26 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.06
TARAWA TERRACE	0.27	0.95
HOLCOMB BLVD.	0.22	1.14

HP TURBIDITY:	1.3	0.2
TT TURBIDITY:	8.4	0.3
HB TURBIDITY:	2.2	0.2

ANALYST: R Tachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 Jul 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.04
TARAWA TERRACE	0.25	0.96
HOLCOMB BLVD.	0.21	1.07

HP TURBIDITY:	1.9	0.2
TT TURBIDITY:	7.3	0.5
HB TURBIDITY:	1.8	0.2

ANALYST: K Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 JULY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.99
TARAWA TERRACE	0.24	0.93
HOLCOMB BLVD.	0.22	0.99

HP TURBIDITY:	1.8	0.1
TT TURBIDITY:	9.1	0.4
HB TURBIDITY:	1.1	0.2

ANALYST: H. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 JULY 85

PLANT	RAW	TREATED
HADNOT POINT	.18	1.04
TARAWA TERRACE	.25	.88
HOLCOMB BLVD.	.20	1.07

HP TURBIDITY: 1.1 / 0.2
TT TURBIDITY: 5.1 / 1.0
HB TURBIDITY: 1.1 / 0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.20	1.01
TARAWA TERRACE	0.25	0.72
HOLCOMB BLVD.	0.22	1.01

HP TURBIDITY:	0.7	0.1
TT TURBIDITY:	7.4	0.3
HB TURBIDITY:	1.5	0.2

ANALYST: T Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 21 JULY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.09
TARAWA TERRACE	0.24	0.79
HOLCOMB BLVD.	0.21	1.04

HP TURBIDITY:	1.6	0.2
TT TURBIDITY:	8.0	0.3
HB TURBIDITY:	0.9	0.2

ANALYST: H Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7/20/85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.03
TARAWA TERRACE	0.26	0.96
HOLCOMB BLVD.	0.22	1.08

HP TURBIDITY: 1.0 0.3
TT TURBIDITY: 6.0 0.3
HB TURBIDITY: 1.1 0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.21	1.02
TARAWA TERRACE	0.24	1.06
HOLCOMB BLVD.	0.19	1.10

HP TURBIDITY:	2.6	0.4
TT TURBIDITY:	6.9	0.3
HB TURBIDITY:	1.9	0.3

ANALYST: TH Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.07
TARAWA TERRACE	0.24	1.07
HOLCOMB BLVD.	0.20	1.11

HP TURBIDITY:	1.1	.3
TT TURBIDITY:	8.1	0.4
HB TURBIDITY:	1.1	0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 17 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	1.04
TARAWA TERRACE	0.23	0.99
HOLCOMB BLVD.	0.18	1.01

HP TURBIDITY: 1.3 / 0.2
TT TURBIDITY: 7.7 / 0.2
HB TURBIDITY: 0.7 / 0.1

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7/16/85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.97
TARAWA TERRACE	0.22	0.85
HOLCOMB BLVD.	0.18	0.95

HP TURBIDITY: 0.4 0.1
TT TURBIDITY: 7.9 0.4
HB TURBIDITY: 0.9 0.4

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.00
TARAWA TERRACE	0.20	0.80
HOLCOMB BLVD.	0.17	0.84

HP TURBIDITY:	8.0	0.1
TT TURBIDITY:	6.3	0.3
HB TURBIDITY:	0.8	0.3

ANALYST: R. Tarbuck

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 14 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.96
TARAWA TERRACE	0.19	0.91
HOLCOMB BLVD.	0.16	0.82

HP TURBIDITY: 1.0 0.1
TT TURBIDITY: 7.7 0.2
HB TURBIDITY: 0.4 0.3

ANALYST: K Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 JULY 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.02
TARAWA TERRACE	0.21	1.08
HOLCOMB BLVD.	0.18	0.46

HP TURBIDITY:	0.8	0.1
TT TURBIDITY:	8.5	0.4
HB TURBIDITY:	0.7	0.3

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.21	0.93
HOLCOMB BLVD.	0.18	0.94

HP TURBIDITY: 0.5 / 0.1
TT TURBIDITY: 5.7 / 0.2
HB TURBIDITY: 0.6 / 0.2

ANALYST: R Fairchild

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-11-85

PLANT	RAW	TREATED
HADNOT POINT	0.09	0.83
TARAWA TERRACE	0.17	0.80
HOLCOMB BLVD.	0.13	0.80

HP TURBIDITY:	0.6	0.2
TT TURBIDITY:	7.8	0.3
HB TURBIDITY:	1.0	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.99
TARAWA TERRACE	0.16	0.82
HOLCOMB BLVD.	0.12	0.90

HP TURBIDITY:	1.4	0.2
TT TURBIDITY:	8.1	0.2
HB TURBIDITY:	1.2	0.1

ANALYST: A Tachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 July 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.96
TARAWA TERRACE	0.20	0.98
HOLCOMB BLVD.	0.16	0.91

HP TURBIDITY: 1.1 / 0.1
TT TURBIDITY: 7.8 / 0.2
HB TURBIDITY: 1.1 / 0.2

ANALYST: R. Fachinelle

$$\frac{3.7}{1}$$

$$4.7$$

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-8-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.87
TARAWA TERRACE	0.20	0.97
HOLCOMB BLVD.	0.17	0.91

HP TURBIDITY:	2.1	0.2
TT TURBIDITY:	8.1	0.3
HB TURBIDITY:	0.9	0.2

ANALYST: BWN

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-7-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.86
TARAWA TERRACE	0.20	0.95
HOLCOMB BLVD.	0.16	0.91

HP TURBIDITY: 0.6 / 0.2
TT TURBIDITY: 10.3 / 0.6
HB TURBIDITY: 0.2 / 0.2

ANALYST: Evans

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-6-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.87
TARAWA TERRACE	0.22	0.94
HOLCOMB BLVD.	0.20	0.91

HP TURBIDITY:	1.2	0.4
TT TURBIDITY:	7.5	0.4
HB TURBIDITY:	0.9	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7/5/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.91
TARAWA TERRACE	0.22	0.77
HOLCOMB BLVD.	0.20	0.95

HP TURBIDITY:	0.4	0.2
TT TURBIDITY:	7.9	0.4
HB TURBIDITY:	1.0	0.2

ANALYST: Honeycutt

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 7-4-85

Plant	Raw	Treated
Hadnot Point	0.16	0.97
Tarawa Terrace	0.22	0.68
Holcomb Blvd.	0.18	0.95

HP Turbidity:	1.1	0.2
TT Turbidity:	7.3	0.4
HB Turbidity:	1.0	0.3

Analyst: Unreported

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 7-3-85

Plant	Raw	Treated
Hadnot Point	0.17	0.95
Tarawa Terrace	0.21	0.91
Holcomb Blvd.	0.18	0.94

HP Turbidity: 0.7 / 0.9
TT Turbidity: 9.1 / 0.2
HB Turbidity: 0.8 / 0.3

Analyst: H. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7-2-85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.99
TARAWA TERRACE	0.24	1.08
HOLCOMB BLVD.	0.19	0.97

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	8.8	0.4
HB TURBIDITY:	0.8	0.3

ANALYST: [signature]

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 7-1-85

Plant	Raw	Treated
Hadnot Point	0.18	0.94
Tarawa Terrace	0.22	0.95
Holcomb Blvd.	0.17	1.05

HP Turbidity:	0.7	0.5
TT Turbidity:	9.4	0.2
HB Turbidity:	0.5	0.2

Analyst: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6-30-85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.91
TARAWA TERRACE	0.21	1.04
HOLCOMB BLVD.	0.17	0.92

HP TURBIDITY:	0.9	1.7
TT TURBIDITY:	7.5	0.2
HB TURBIDITY:	0.8	0.3

ANALYST: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 Jun 85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.87
TARAWA TERRACE	0.27	1.16
HOLCOMB BLVD.	0.19	0.95

HP TURBIDITY: 1.1 / 0.2
TT TURBIDITY: 8.1 / 0.3
HB TURBIDITY: 1.1 / 0.5

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.92
TARAWA TERRACE	0.24	1.27
HOLCOMB BLVD.	0.19	1.16

HP TURBIDITY:	2.5	0.2
TT TURBIDITY:	7.4	0.2
HB TURBIDITY:	0.8	0.3

ANALYST: ThBarbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 27 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.79
TARAWA TERRACE	0.21	0.91
HOLCOMB BLVD.	0.17	0.78

HP TURBIDITY:	0.9	0.1
TT TURBIDITY:	7.1	0.2
HB TURBIDITY:	1.2	0.7

ANALYST: A Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6/26/85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.55
TARAWA TERRACE	0.22	0.95
HOLCOMB BLVD.	0.19	1.03

HP TURBIDITY:	1.1	0.1
TT TURBIDITY:	9.1	0.4
HB TURBIDITY:	1.4	0.4

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.18
TARAWA TERRACE	0.21	1.00
HOLCOMB BLVD.	0.16	1.02

HP TURBIDITY:	1.3	0.2
TT TURBIDITY:	6.0	0.2
HB TURBIDITY:	1.0	0.5

ANALYST: R Schnelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.22
TARAWA TERRACE	0.21	1.02
HOLCOMB BLVD.	0.16	1.00

HP TURBIDITY:	1.4	0.1
TT TURBIDITY:	6.5	0.2
HB TURBIDITY:	1.1	0.3

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.36
TARAWA TERRACE	0.21	1.02
HOLCOMB BLVD.	0.16	1.00

HP TURBIDITY: 0.4 / 0.1
TT TURBIDITY: 6.6 / 0.2
HB TURBIDITY: 0.9 / 0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6-22-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.78
TARAWA TERRACE	0.23	0.90
HOLCOMB BLVD.	0.18	1.13

HP TURBIDITY:	1.2	0.1
TT TURBIDITY:	8.6	0.2
HB TURBIDITY:	1.1	0.2

ANALYST: Th Barbee

Daily Fluoride Report

From: Quality Control Laboratory
To: Water Treatment Plant Foreman

Date: 21 June 85

Plant	Raw	Treated
Hadnot Point	0.17	0.76
Tarawa Terrace	0.21	0.74
Holcomb Blvd.	0.16	1.03

HP Turbidity:	1.4	0.1
TT Turbidity:	8.1	0.1
HB Turbidity:	1.1	0.2

Analyst: T. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6-20-85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.78
TARAWA TERRACE	0.21	0.92
HOLCOMB BLVD.	0.17	1.05

HP TURBIDITY:	0.7	0.3
TT TURBIDITY:	6.5	0.3
HB TURBIDITY:	0.8	0.2

ANALYST: H Barber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.80
TARAWA TERRACE	0.23	0.98
HOLCOMB BLVD.	0.17	1.06

HP TURBIDITY:	0.48	0.35
TT TURBIDITY:	7.67	0.26
HB TURBIDITY:	2.83	0.37

ANALYST: Th Barbee

pH - HP water is 8.5

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.79
TARAWA TERRACE	0.22	0.97
HOLCOMB BLVD.	0.18	1.03

HP TURBIDITY:	1.18	3.40
TT TURBIDITY:	8.84	0.12
HB TURBIDITY:	0.81	0.12

ANALYST: th Barker

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 17 Jun 85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.63
TARAWA TERRACE	0.19	1.04
HOLCOMB BLVD.	0.15	1.01

HP TURBIDITY: 0.6 / 0.2
TT TURBIDITY: 8.5 / 0.2
HB TURBIDITY: 1.0 / 0.3

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 Jun 89

PLANT	RAW	TREATED
HADNOT POINT	0,15	0.62
TARAWA TERRACE	0,19	1.07
HOLCOMB BLVD.	0,15	0.99

HP TURBIDITY:	0,6	0,2
TT TURBIDITY:	8,1	0,2
HB TURBIDITY:	0,6	0,7

ANALYST: R Tachyelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6-15-85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.83
TARAWA TERRACE	0.23	0.96
HOLCOMB BLVD.	0.18	1.18

HP TURBIDITY:	1.1	0.4
TT TURBIDITY:	9.5	0.4
HB TURBIDITY:	1.1	0.4

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6/14/85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.36
TARAWA TERRACE	0.22	0.8C
HOLCOMB BLVD.	0.18	1.09

HP TURBIDITY: 2.0 0.3 - pH = 9.0
TT TURBIDITY: 6.9 0.4
HB TURBIDITY: 1.1 0.3

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 JAN 83

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.39
TARAWA TERRACE	0.19	0.89
HOLCOMB BLVD.	0.17	1.16

HP TURBIDITY:	1.1	0.2
TT TURBIDITY:	14.2	0.3
HB TURBIDITY:	1.1	0.2

ANALYST: R Larkapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.17
TARAWA TERRACE	0.20	0.88
HOLCOMB BLVD.	0.17	1.07

HP TURBIDITY: 0.8 0.3 PH 8.8
TT TURBIDITY: 14.8 0.5
HB TURBIDITY: 1.3 0.3

ANALYST: BVANS

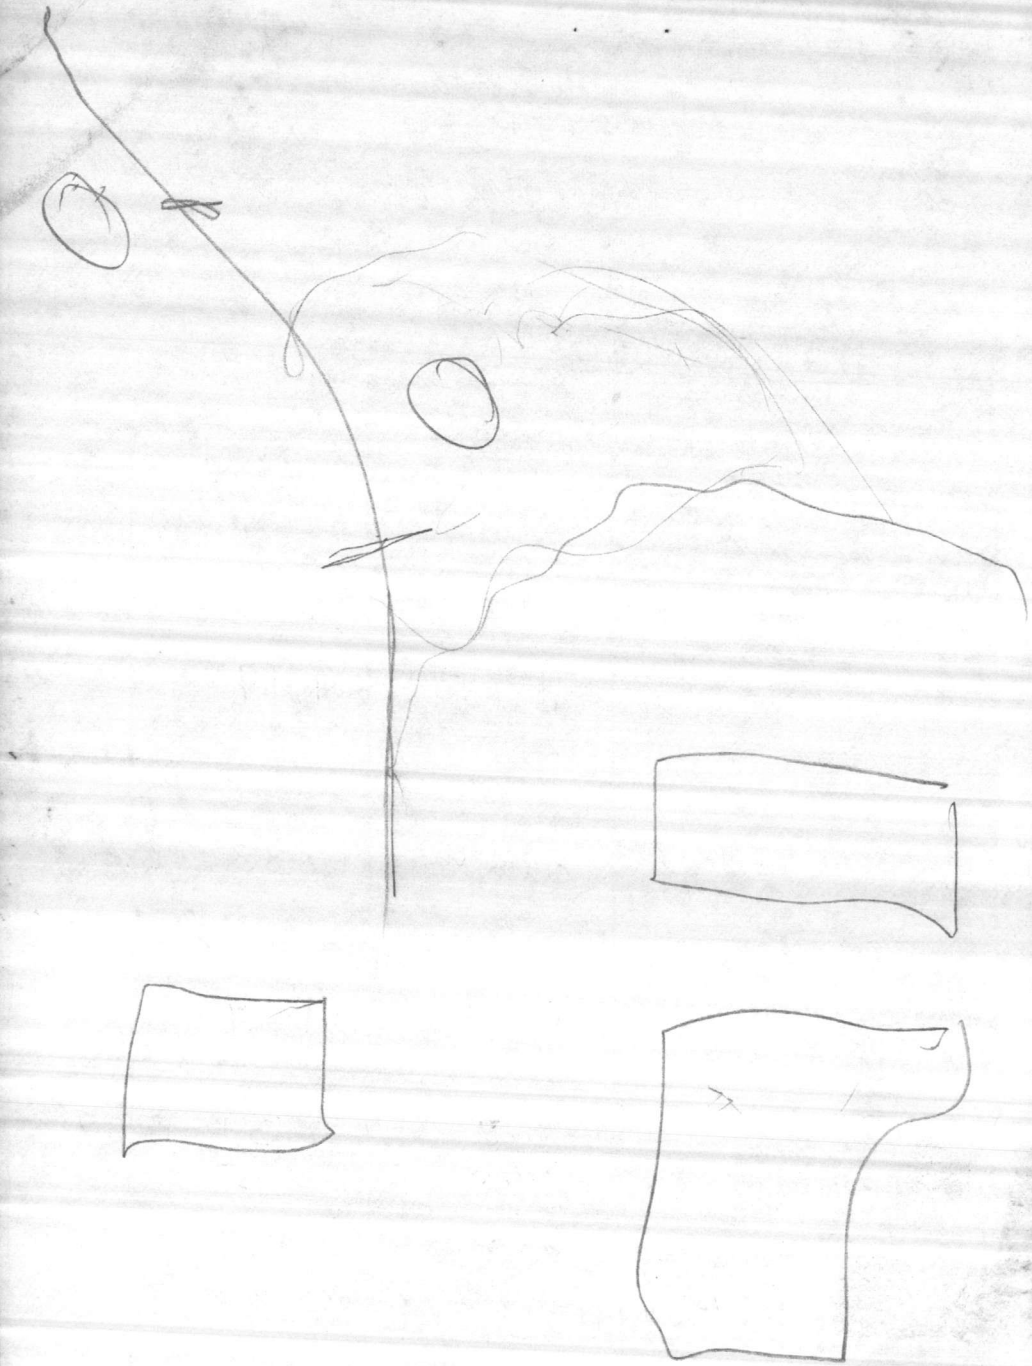

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6-11-85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.00
TARAWA TERRACE	0.21	1.04
HOLCOMB BLVD.	0.18	1.04

HP TURBIDITY:	1.0	0.2
TT TURBIDITY:	14.3	0.3
HB TURBIDITY:	1.2	0.2

ANALYST: BYRNS

DAILY. FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.95
TARAWA TERRACE	0.22	1.25
HOLCOMB BLVD.	0.17	1.10

HP TURBIDITY:	0.85	0.14
TT TURBIDITY:	7.35	0.24
HB TURBIDITY:	1.45	0.29

ANALYST: TLBarber

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.99
TARAWA TERRACE	0.24	1.19
HOLCOMB BLVD.	0.17	1.14

HP TURBIDITY:	0.65	0.10
TT TURBIDITY:	6.16	0.30
HB TURBIDITY:	0.89	0.14

ANALYST: M Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	1.00
TARAWA TERRACE	0.20	1.05
HOLCOMB BLVD.	0.18	1.00

HP TURBIDITY:	0.6	0.3
TT TURBIDITY:	15.1	0.6
HB TURBIDITY:	1.2	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 JUN 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	1.05
TARAWA TERRACE	0.17	0.95
HOLCOMB BLVD.	0.16	0.92

HP TURBIDITY:	0.5	0.1
TT TURBIDITY:	13.3	0.9
HB TURBIDITY:	0.9	0.5

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 JUN 89

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.02
TARAWA TERRACE	0.18	0.67
HOLCOMB BLVD.	0.16	0.84

HP TURBIDITY:	1.1	0.2
TT TURBIDITY:	16.5	2.0
HB TURBIDITY:	1.5	0.4

ANALYST: A Lockwelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 5 June 89

PLANT	RAW	TREATED
HADNOT POINT	0.13	1.04
TARAWA TERRACE	0.18	1.07
HOLCOMB BLVD.	0.16	0.77

HP TURBIDITY:	0.8	0.1
TT TURBIDITY:	17.9	0.4
HB TURBIDITY:	1.4	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 June 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.12
TARAWA TERRACE	0.20	1.16
HOLCOMB BLVD.	0.19	0.63

HP TURBIDITY:	1.4	0.2
TT TURBIDITY:	14.5	0.4
HB TURBIDITY:	1.1	1.3

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.08
TARAWA TERRACE	0.19	0.82
HOLCOMB BLVD.	0.18	0.91

HP TURBIDITY:	3.1	0.3
TT TURBIDITY:	14.5	0.4
HB TURBIDITY:	3.2	0.2

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2 JUNE 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.07
TARAWA TERRACE	0.18	0.51
HOLCOMB BLVD.	0.18	0.92

HP TURBIDITY: 1.6 0.2
TT TURBIDITY: 13.4 0.4
HB TURBIDITY: 0.9 0.2

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13JUN85

PLANT	RAW	TREATED
HADNOT POINT	0.12	0.90
TARAWA TERRACE	0.18	0.99
HOLCOMB BLVD.	0.18	0.85

HP TURBIDITY:	1.3	0.1
TT TURBIDITY:	13.4	0.4
HB TURBIDITY:	0.8	0.3

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 31 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.86
TARAWA TERRACE	0.19	1.07
HOLCOMB BLVD.	0.17	0.86

HP TURBIDITY:	0.9	0.1
TT TURBIDITY:	9.3	0.4
HB TURBIDITY:	0.7	0.2

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 30 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.95
TARAWA TERRACE	0.18	1.08
HOLCOMB BLVD.	0.17	0.97

HP TURBIDITY:	0.8	0.2
TT TURBIDITY:	13.5	0.5
HB TURBIDITY:	0.7	0.3

ANALYST: R Lachenelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 29 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.14	1.00
TARAWA TERRACE	0.18	0.82
HOLCOMB BLVD.	0.17	1.01

HP TURBIDITY:	1.6	0.2
TT TURBIDITY:	12.4	0.5
HB TURBIDITY:	0.8	0.4

ANALYST: R Fairbanks

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 28MAY85

PLANT	RAW	TREATED
HADNOT POINT	0.19	0.99
TARAWA TERRACE	0.18	0.76
HOLCOMB BLVD.	0.17	0.94

HP TURBIDITY:	0.74	0.57
TT TURBIDITY:	13.65	0.33
HB TURBIDITY:	1.88	0.27

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.91
TARAWA TERRACE	0.19	0.65
HOLCOMB BLVD.	0.18	0.95

HP TURBIDITY:	3.0	0.2
TT TURBIDITY:	14.4	0.3
HB TURBIDITY:	0.7	0.3

ANALYST: R Fachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 26 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.90
TARAWA TERRACE	0.19	0.65
HOLCOMB BLVD.	0.18	0.78

HP TURBIDITY:	0.5	0.4
TT TURBIDITY:	15.1	0.3
HB TURBIDITY:	0.6	0.2

ANALYST: R Fackenthal

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 25 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.05
TARAWA TERRACE	0.19	1.07
HOLCOMB BLVD.	0.22	1.04

HP TURBIDITY:	0.7	0.5
TT TURBIDITY:	7.0	0.4
HB TURBIDITY:	7.6	0.3

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 24 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.03
TARAWA TERRACE	0.22	1.00
HOLCOMB BLVD.	0.22	0.98

HP TURBIDITY: 4.0 0.5
TT TURBIDITY: 13.1 0.3
HB TURBIDITY: 2.3 0.3

ANALYST: BUENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 23 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.20	NO SAMPLE
TARAWA TERRACE	0.21	1.07
HOLCOMB BLVD.	0.16	0.90

HP TURBIDITY:	7.2	
TT TURBIDITY:	14.6	0.3
HB TURBIDITY:	1.1	0.3

ANALYST: R Lafayette

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 22 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.14	0.79
TARAWA TERRACE	0.18	0.91
HOLCOMB BLVD.	0.17	0.84

HP TURBIDITY:	1.1	0.9
TT TURBIDITY:	13.8	0.5
HB TURBIDITY:	0.9	0.5

ANALYST: 13 VANS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 21 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.88
TARAWA TERRACE	0.20	0.96
HOLCOMB BLVD.	0.19	0.94

HP TURBIDITY:	1.5	1.8
TT TURBIDITY:	7.5	1.4
HB TURBIDITY:	0.9	0.3

ANALYST: BVENS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 20 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.86
TARAWA TERRACE	0.18	1.08
HOLCOMB BLVD.	0.18	0.96

HP TURBIDITY: 0.9 / 0.3
TT TURBIDITY: 15.0 / 0.3
HB TURBIDITY: 0.9 / 0.3

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 19 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.13	0.81
TARAWA TERRACE	0.18	1.07
HOLCOMB BLVD.	0.18	0.93

HP TURBIDITY:	0.6	0.2
TT TURBIDITY:	13.7	0.5
HB TURBIDITY:	0.70	0.10

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 18MAY85

PLANT	RAW	TREATED
HADNOT POINT	0.16	0.95
TARAWA TERRACE	0.20	0.98
HOLCOMB BLVD.	0.17	0.96

HP TURBIDITY:	4.22	0.28
TT TURBIDITY:	18.40	0.19
HB TURBIDITY:	0.91	0.15

ANALYST: T.L. Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 17 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.87
TARAWA TERRACE	0.21	0.81
HOLCOMB BLVD.	0.19	0.88

HP TURBIDITY: 5.6 / 0.2
TT TURBIDITY: 16.4 / 0.3
HB TURBIDITY: 1.2 / 0.6

ANALYST: BURNS

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 16 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.93
TARAWA TERRACE	0.19	0.95
HOLCOMB BLVD.	0.18	0.93

HP TURBIDITY:	1.3	0.2
TT TURBIDITY:	13.0	0.2
HB TURBIDITY:	1.2	0.1

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 15 May 85

PLANT	RAW	TREATED
HADNOT POINT	0,16	0,99
TARAWA TERRACE	0.20	1.08
HOLCOMB BLVD.	0,18	0,93

HP TURBIDITY:	1,4	0,3
TT TURBIDITY:	13,2	0,2
HB TURBIDITY:	1,0	0,1

ANALYST: R Lockyerlle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 14 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.10
TARAWA TERRACE	0.23	1.28
HOLCOMB BLVD.	0.21	1.05

HP TURBIDITY:	1.36	0.23
TT TURBIDITY:	15.15	0.23
HB TURBIDITY:	1.40	0.13

ANALYST: Th Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 13 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	1.08
TARAWA TERRACE	0.25	1.17
HOLCOMB BLVD.	0.22	1.04

HP TURBIDITY: 0.9 / 0.3
TT TURBIDITY: 15.0 / 0.2
HB TURBIDITY: 1.3 / 0.3

ANALYST: Hunnicutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 12 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.22
TARAWA TERRACE	0.25	1.17
HOLCOMB BLVD.	0.24	1.00

HP TURBIDITY: 0.8 / 0.2
TT TURBIDITY: 15.4 / 0.3
HB TURBIDITY: 0.7 / 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.10
TARAWA TERRACE	0.21	1.21
HOLCOMB BLVD.	0.19	0.95

HP TURBIDITY: 0.7 / 0.1
TT TURBIDITY: 10.3 / 0.2
HB TURBIDITY: 0.8 / 0.1

ANALYST: R Fachaelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 10 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	1.25
TARAWA TERRACE	0.19	1.07
HOLCOMB BLVD.	0.18	0.91

HP TURBIDITY: 0.9 0.2
TT TURBIDITY: 10.9 0.2
HB TURBIDITY: 0.7 0.1

ANALYST: R Lukapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 9 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.17
TARAWA TERRACE	0.21	0.65
HOLCOMB BLVD.	0.19	0.91

HP TURBIDITY: 3.1 / 0.3
TT TURBIDITY: 10.3 / 0.3
HB TURBIDITY: 0.6 / 0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 8 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	1.09
TARAWA TERRACE	0.21	0.94
HOLCOMB BLVD.	0.20	0.94

HP TURBIDITY:	1.0	0.2
TT TURBIDITY:	9.3	0.2
HB TURBIDITY:	0.7	0.2

ANALYST: [signature]

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 7 May 85

PLANT	RAW	TREATED
HADNOT POINT	0.15	0.96
TARAWA TERRACE	0.18	1.15
HOLCOMB BLVD.	0.17	0.97

HP TURBIDITY:	0.7	0.1
TT TURBIDITY:	10.4	0.2
HB TURBIDITY:	0.8	0.4

ANALYST: R Lachapelle

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 6 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.95
TARAWA TERRACE	0.21	1.06
HOLCOMB BLVD.	0.21	0.99

HP TURBIDITY:	0.7	0.2
TT TURBIDITY:	7.6	0.3
HB TURBIDITY:	0.9	0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 5 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.88
TARAWA TERRACE	0.20	1.04
HOLCOMB BLVD.	0.20	0.99

HP TURBIDITY:	0.9	0.2
TT TURBIDITY:	6.2	0.4
HB TURBIDITY:	0.5	0.6

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 4 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.93
TARAWA TERRACE	0.21	0.95
HOLCOMB BLVD.	0.21	0.64

HP TURBIDITY: 0.7 / 0.2
TT TURBIDITY: 4.1 / 0.8
HB TURBIDITY: 0.9 / 0.2

ANALYST: Honeycutt

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 3 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.18	0.96
TARAWA TERRACE	0.21	1.24
HOLCOMB BLVD.	0.21	1.00

HP TURBIDITY: 1.5 0.2
TT TURBIDITY: 6.6 0.4
HB TURBIDITY: 0.7 0.5

ANALYST: Hemequist

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 2MAY85

PLANT	RAW	TREATED
HADNOT POINT	0.17	0.96
TARAWA TERRACE	0.20	0.99
HOLCOMB BLVD.	0.19	1.06

HP TURBIDITY:	1.05	0.13
TT TURBIDITY:	8.29	0.34
HB TURBIDITY:	0.70	0.13

ANALYST: TH Barbee

DAILY FLUORIDE REPORT

FROM: QUALITY CONTROL LABORATORY
TO: WATER TREATMENT PLANT FOREMAN

DATE: 1 MAY 85

PLANT	RAW	TREATED
HADNOT POINT	0.16	1.03
TARAWA TERRACE	0.20	1.00
HOLCOMB BLVD.	0.19	1.15

HP TURBIDITY:	2.7	0.3
TT TURBIDITY:	8.0	0.5
HB TURBIDITY:	0.6	0.2

ANALYST: R Sedgwick