

# DAILY FLUORIDE AND TURBIDITY REPORT

From: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

To: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-31-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	1.03	2.3	0.6
HOLCOMB BLVD	0.18	1.08	2.1	0.8
TARAWA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 10-31-87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: 10

CALLED BY: Bob

TIME: 09:20

DATE: 10/31/87

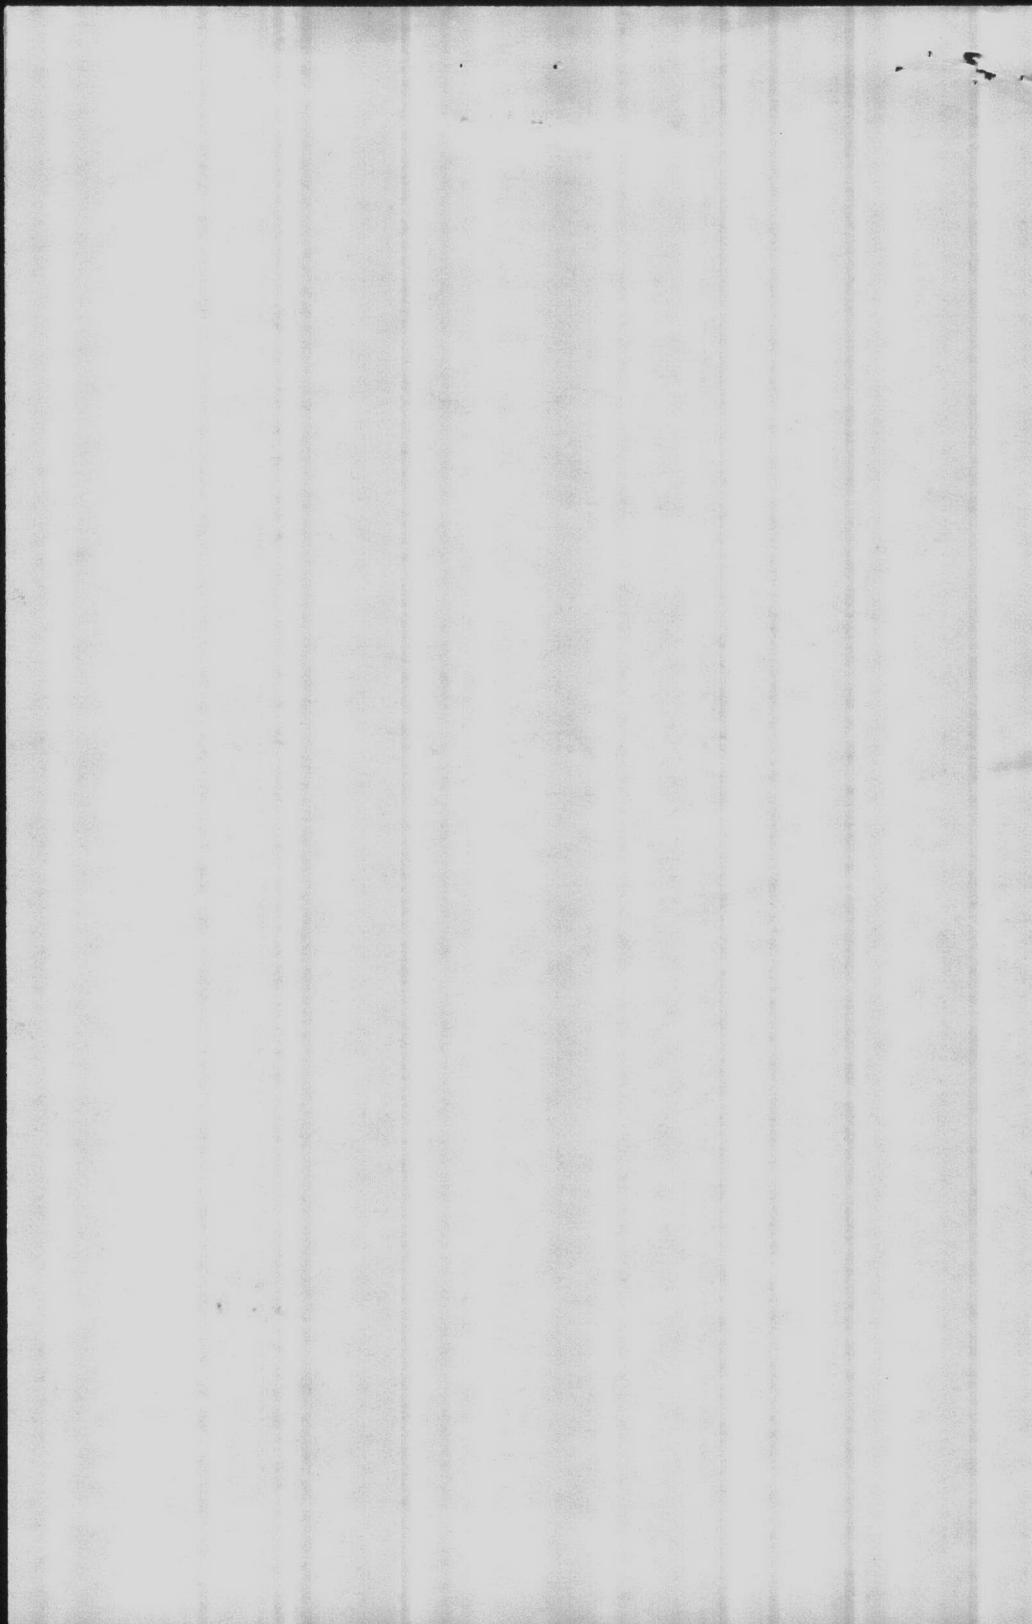

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10/30/87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.86	5.6	0.8
HOLCOMB BLVD	0.15	0.93	2.6	0.9
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 10-30-87

ANALYST: [Signature]

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: [Signature]

TIME: 09:10

DATE: 10/30/87

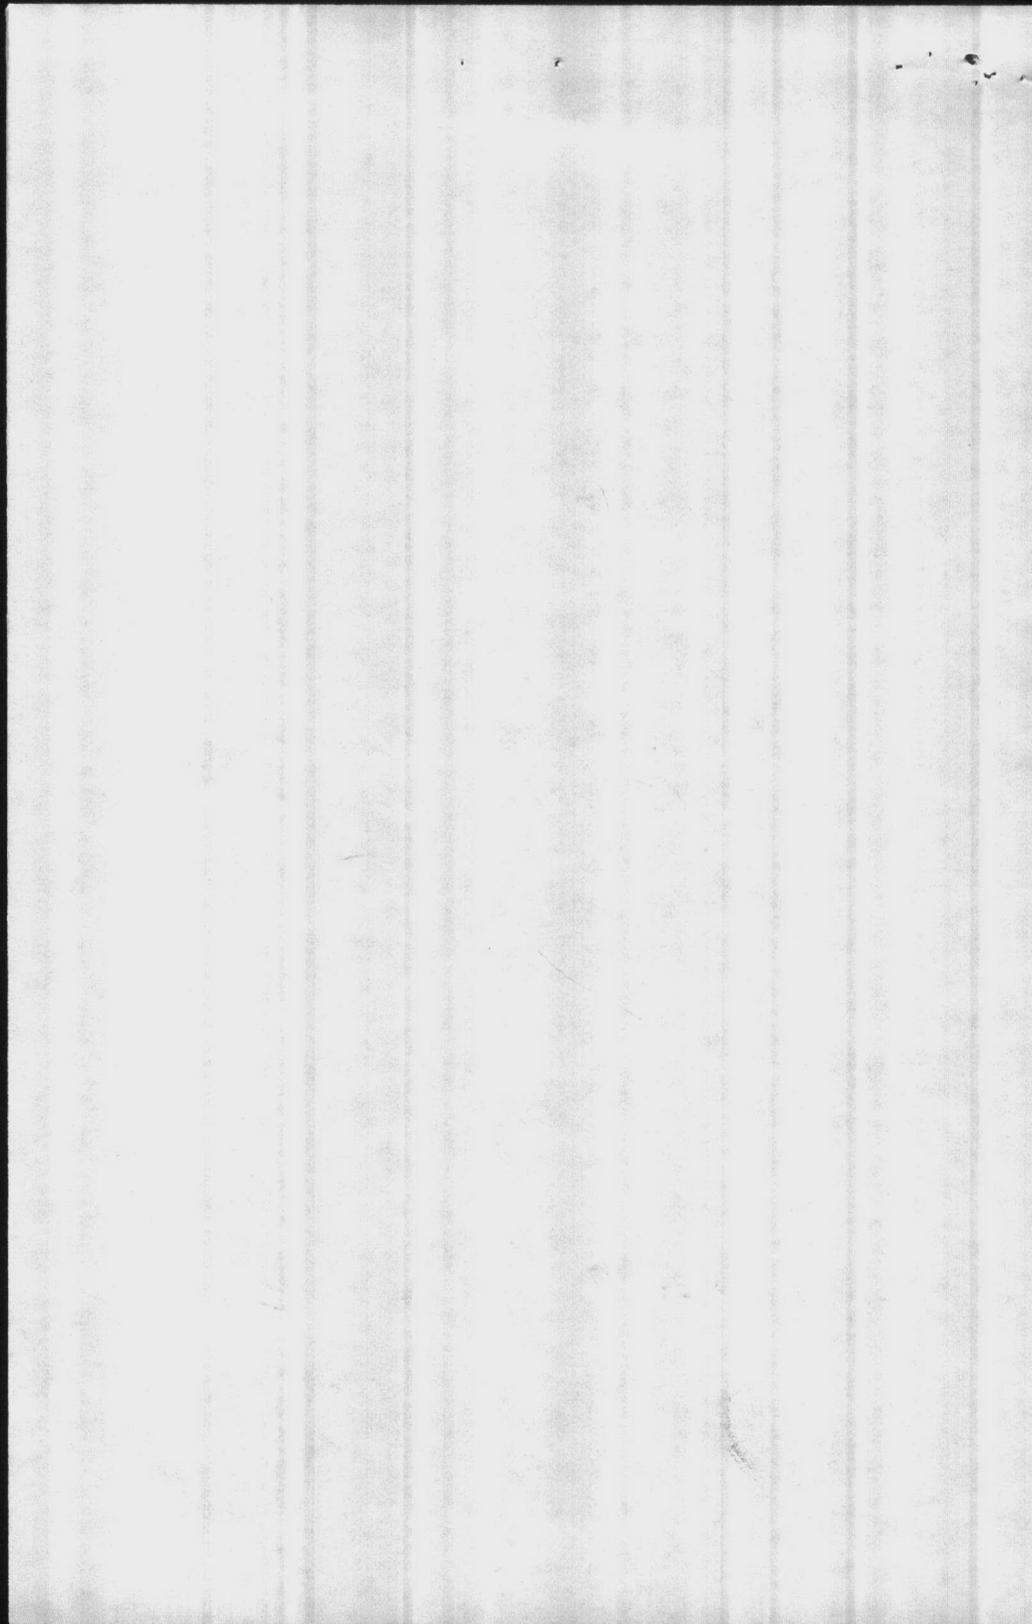

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-29-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.93	4.2	0.6
HOLCOMB BLVD	0.15	1.11	2.6	1.6
TARAWA TERRACE	-	-	-	-

REMARKS:

ANALYSIS DATE: 10-29-87

ANALYST: Pat

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: R

CALLED BY: Pat

TIME: 09:20

DATE: 10/29/87

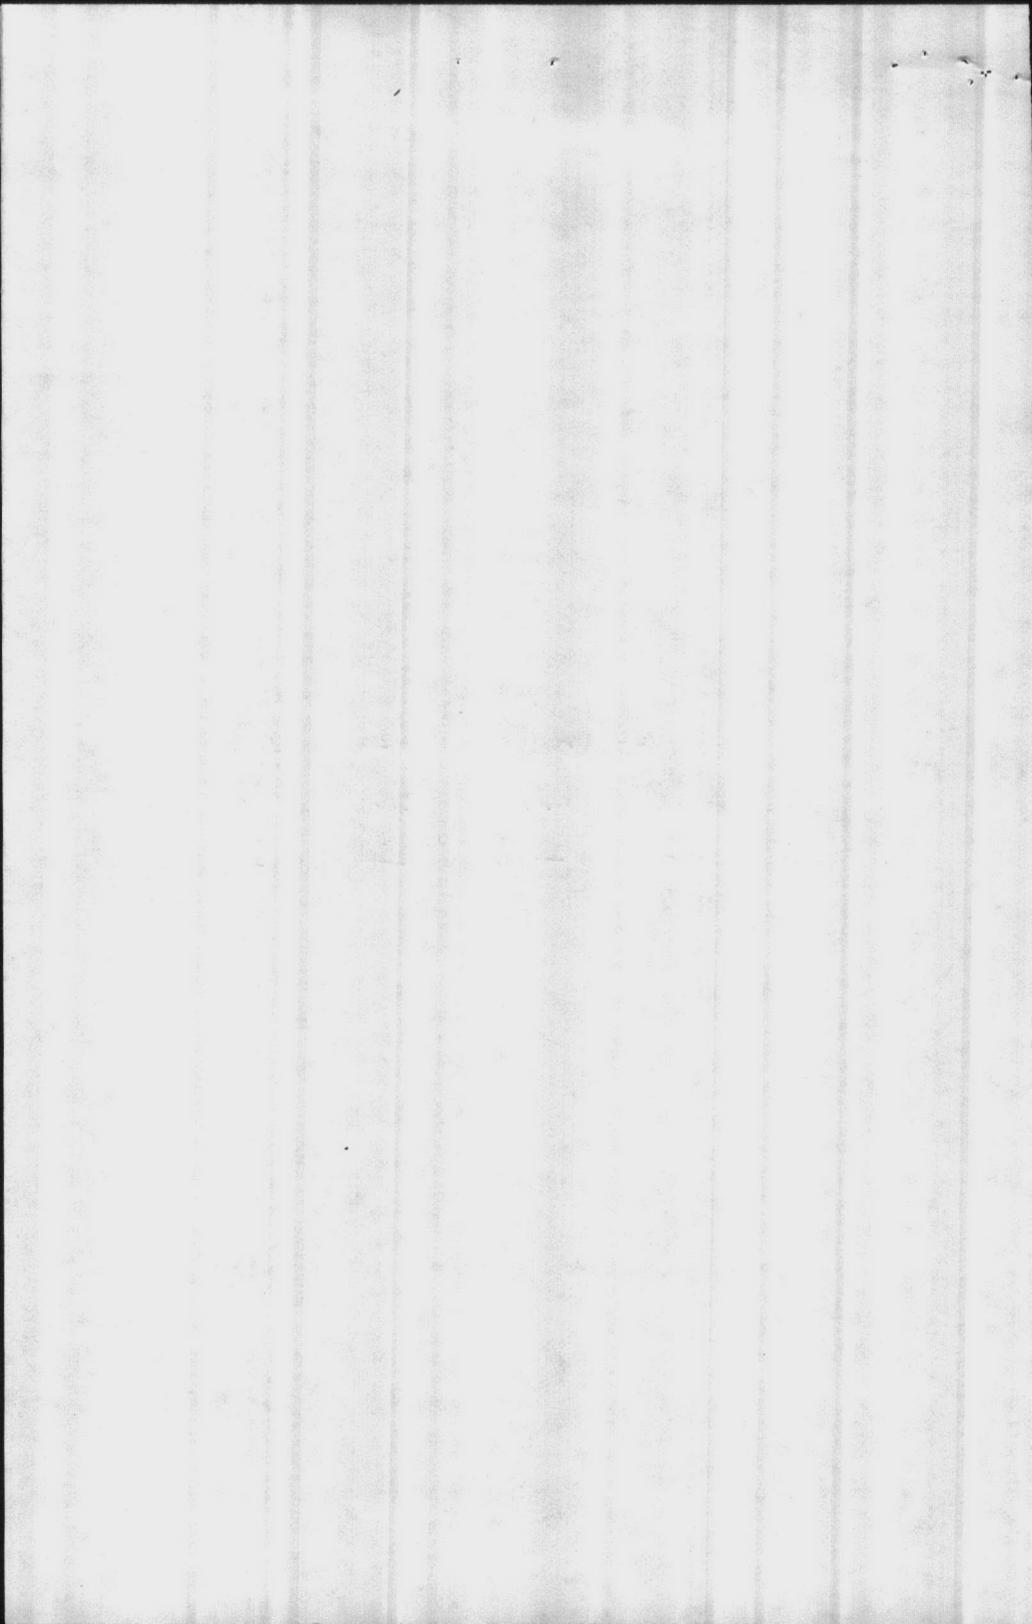

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Wed 10-24-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.88	2.9	0.7
HOLCOMB BLVD	0.15	0.94	3.5	1.2
TARAWA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 10-24/87

ANALYST: BT

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: BT

TIME: 11:15

DATE: 10/24/87

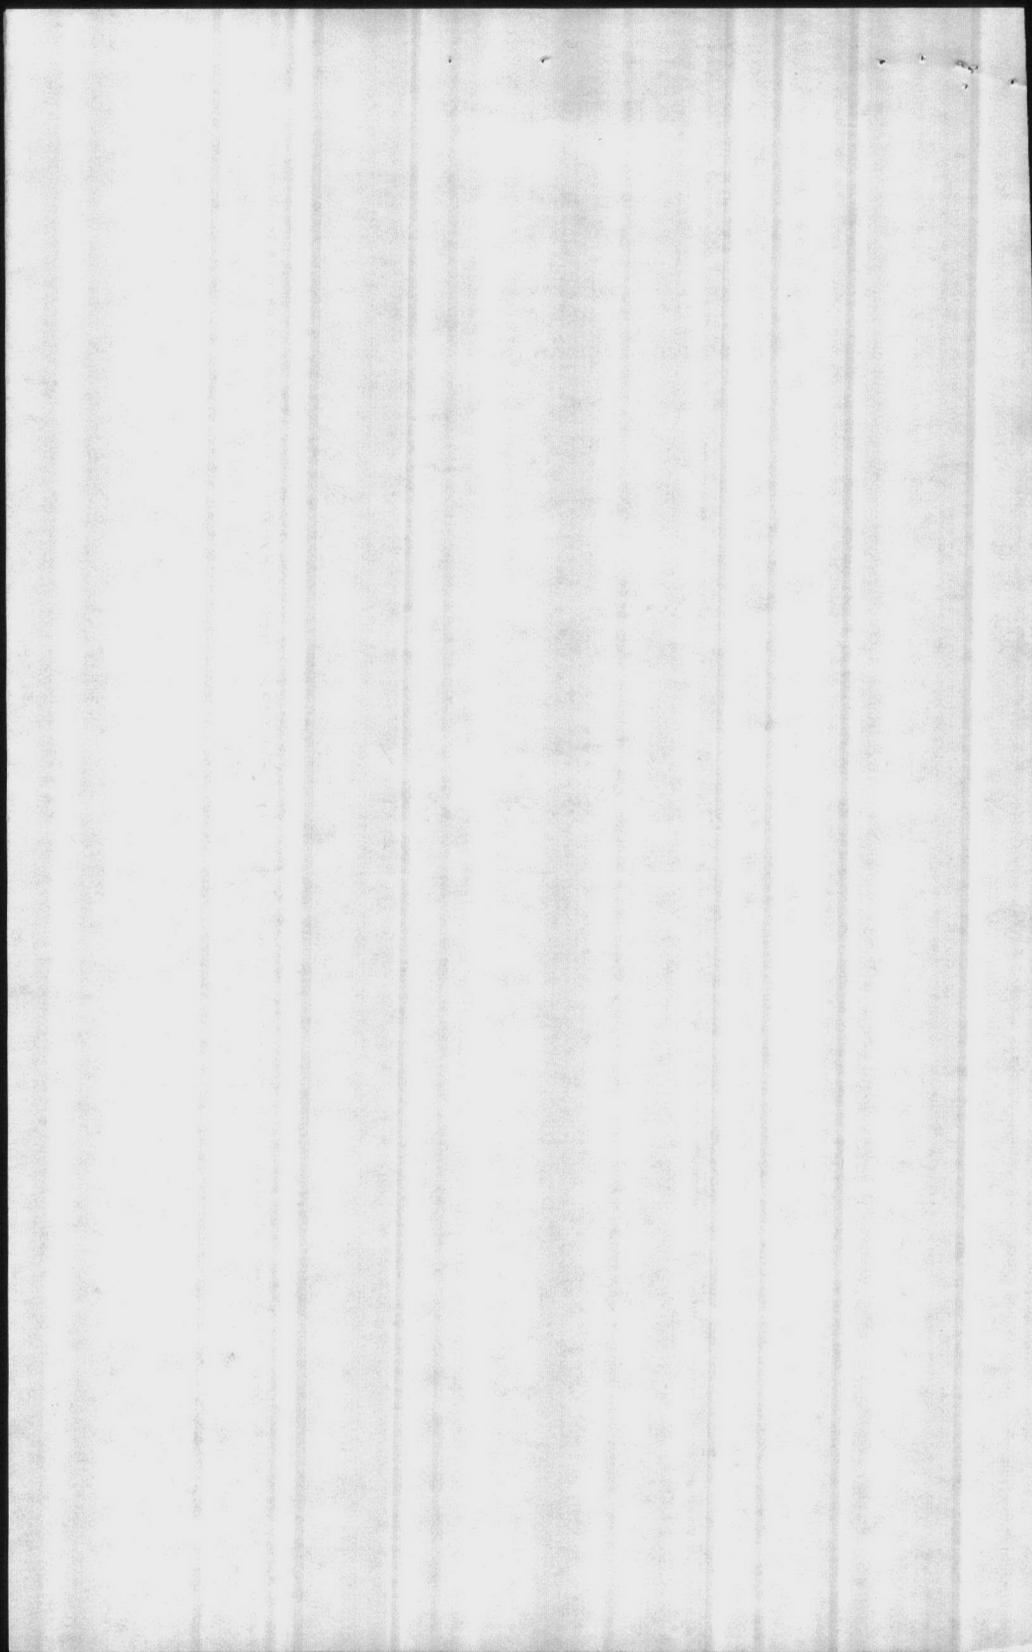

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-27-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.01	2.4	0.6
HOLCOMB BLVD	0.16	1.02	3.0	0.6
TARAWA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 10-27-87

ANALYST: B.S.

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: J. Kelly

CALLED BY: B.S.

TIME: 09:10

DATE: 10-22-87

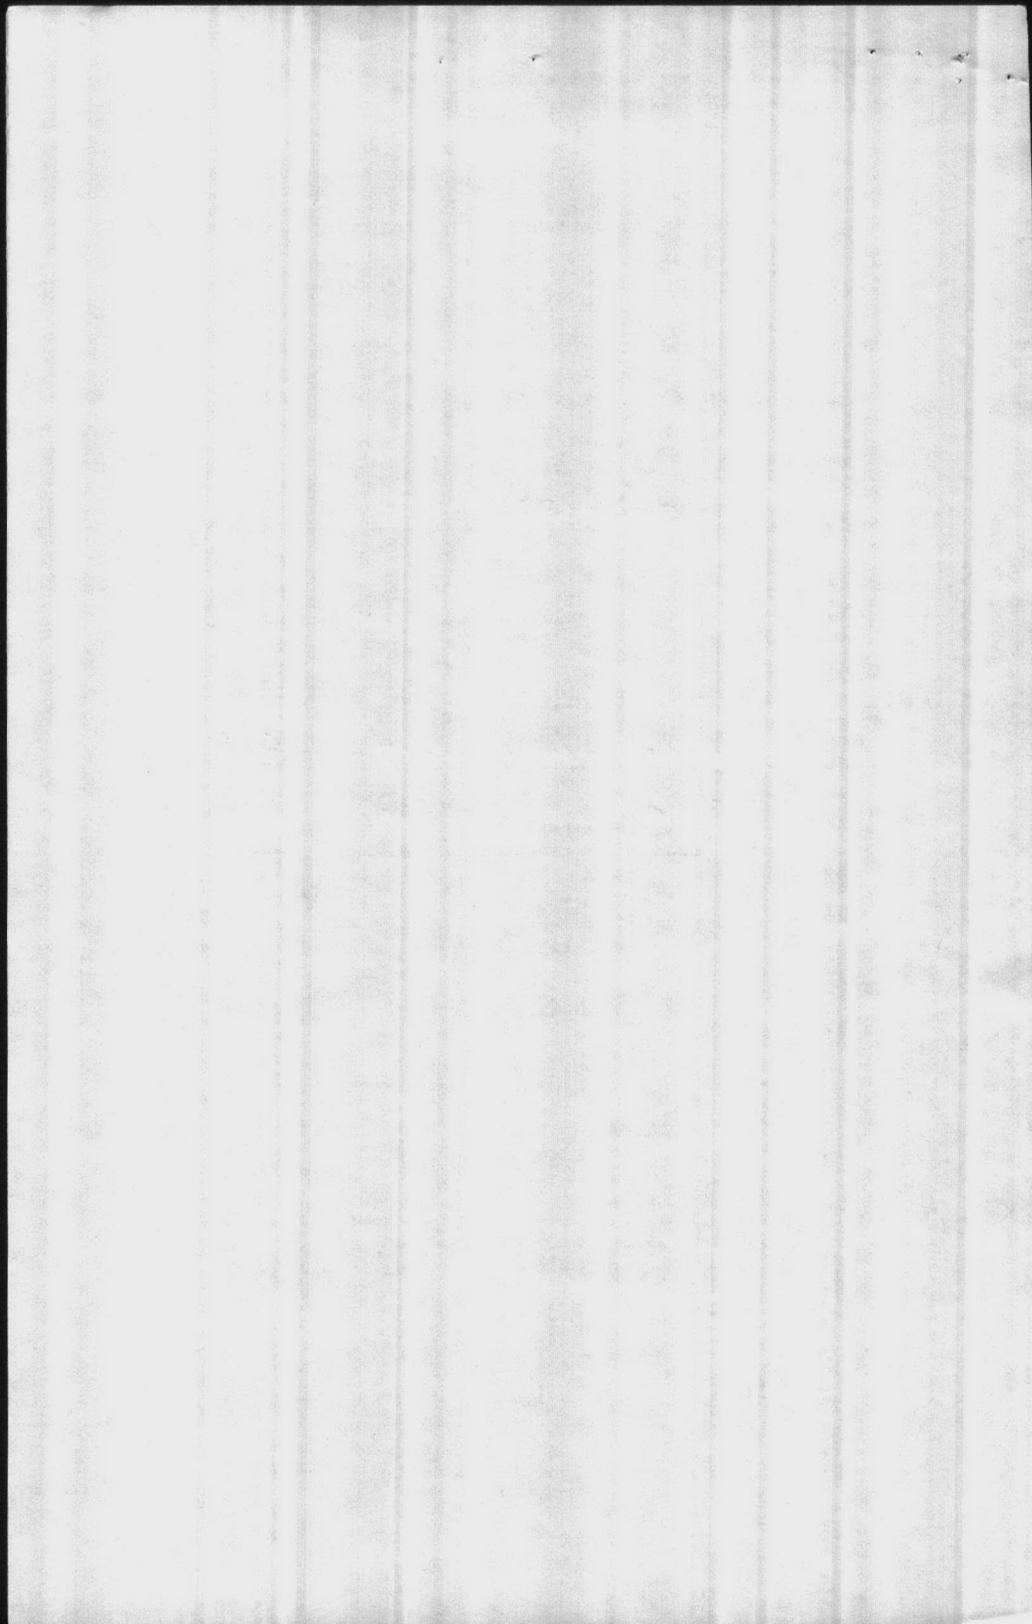

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 10-26-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	1.18	2.3	0.7
HOLCOMB BLVD	0.17	1.02	2.6	0.7
TERRAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 10-26-87

ANALYST: [Signature]

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: [Signature]

TIME: 10:00

DATE: 10/26/87

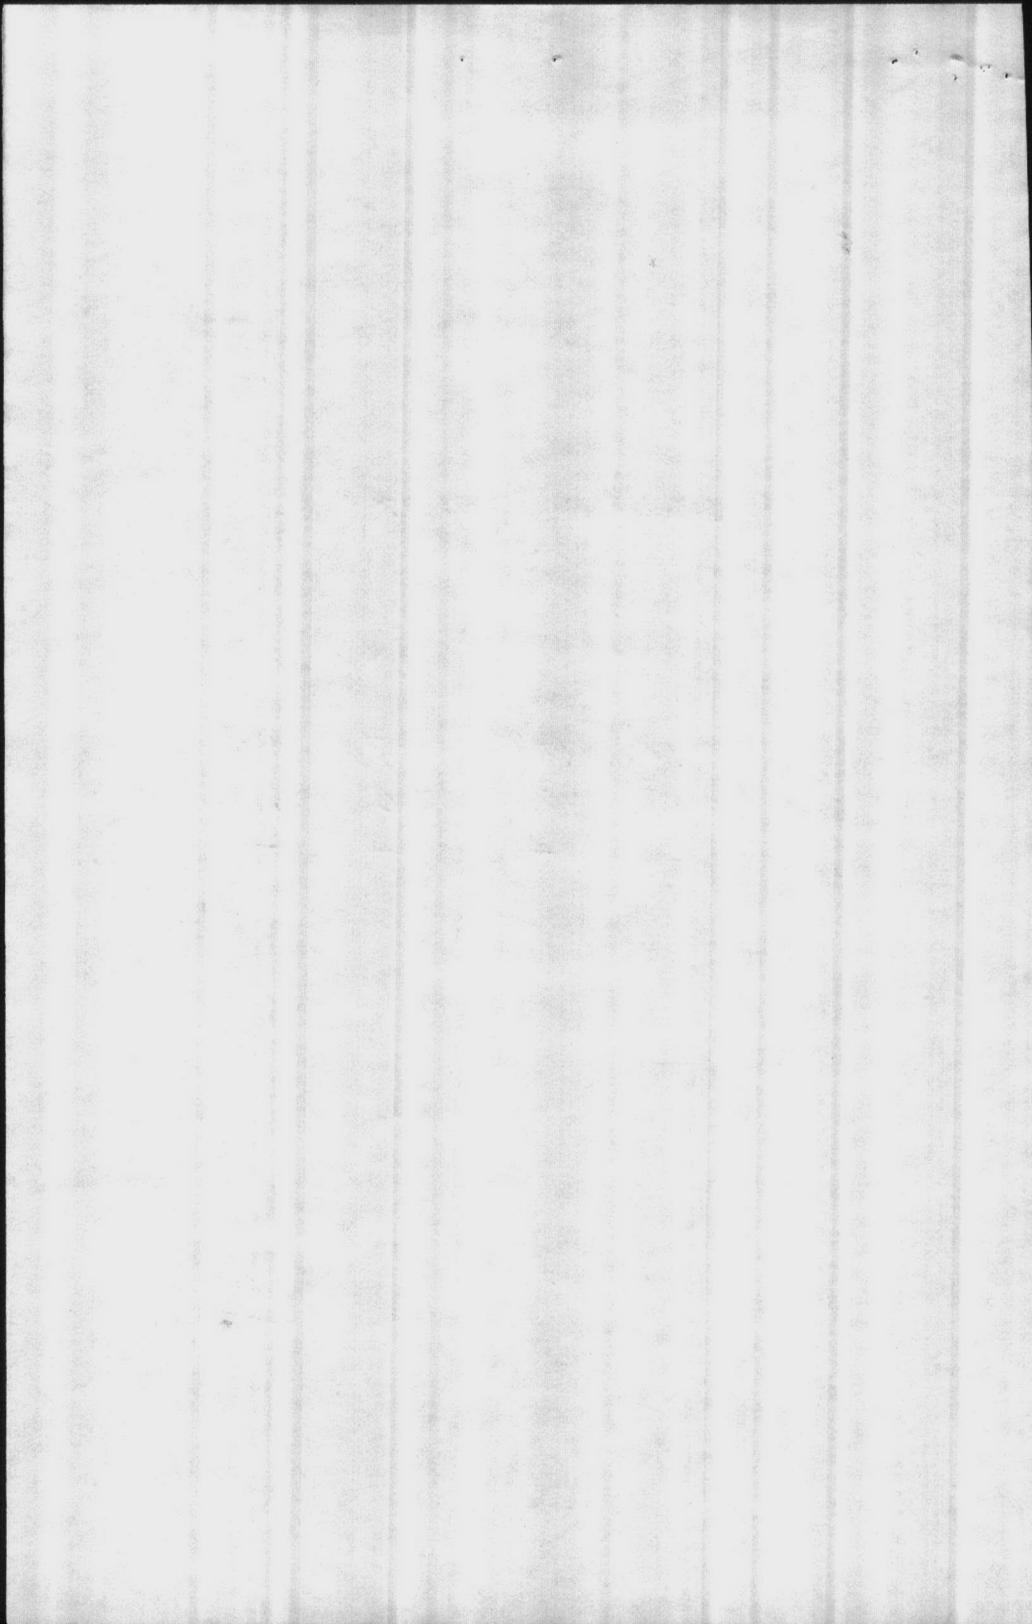

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
 NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
 UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 10-25-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	1.00	2.4	0.5
HOLCOMB BLVD	0.15	1.05	1.5	0.7
TARA WA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 10-26-87

ANALYST: BR

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: BR

TIME: 10:00

DATE: 10-26-87

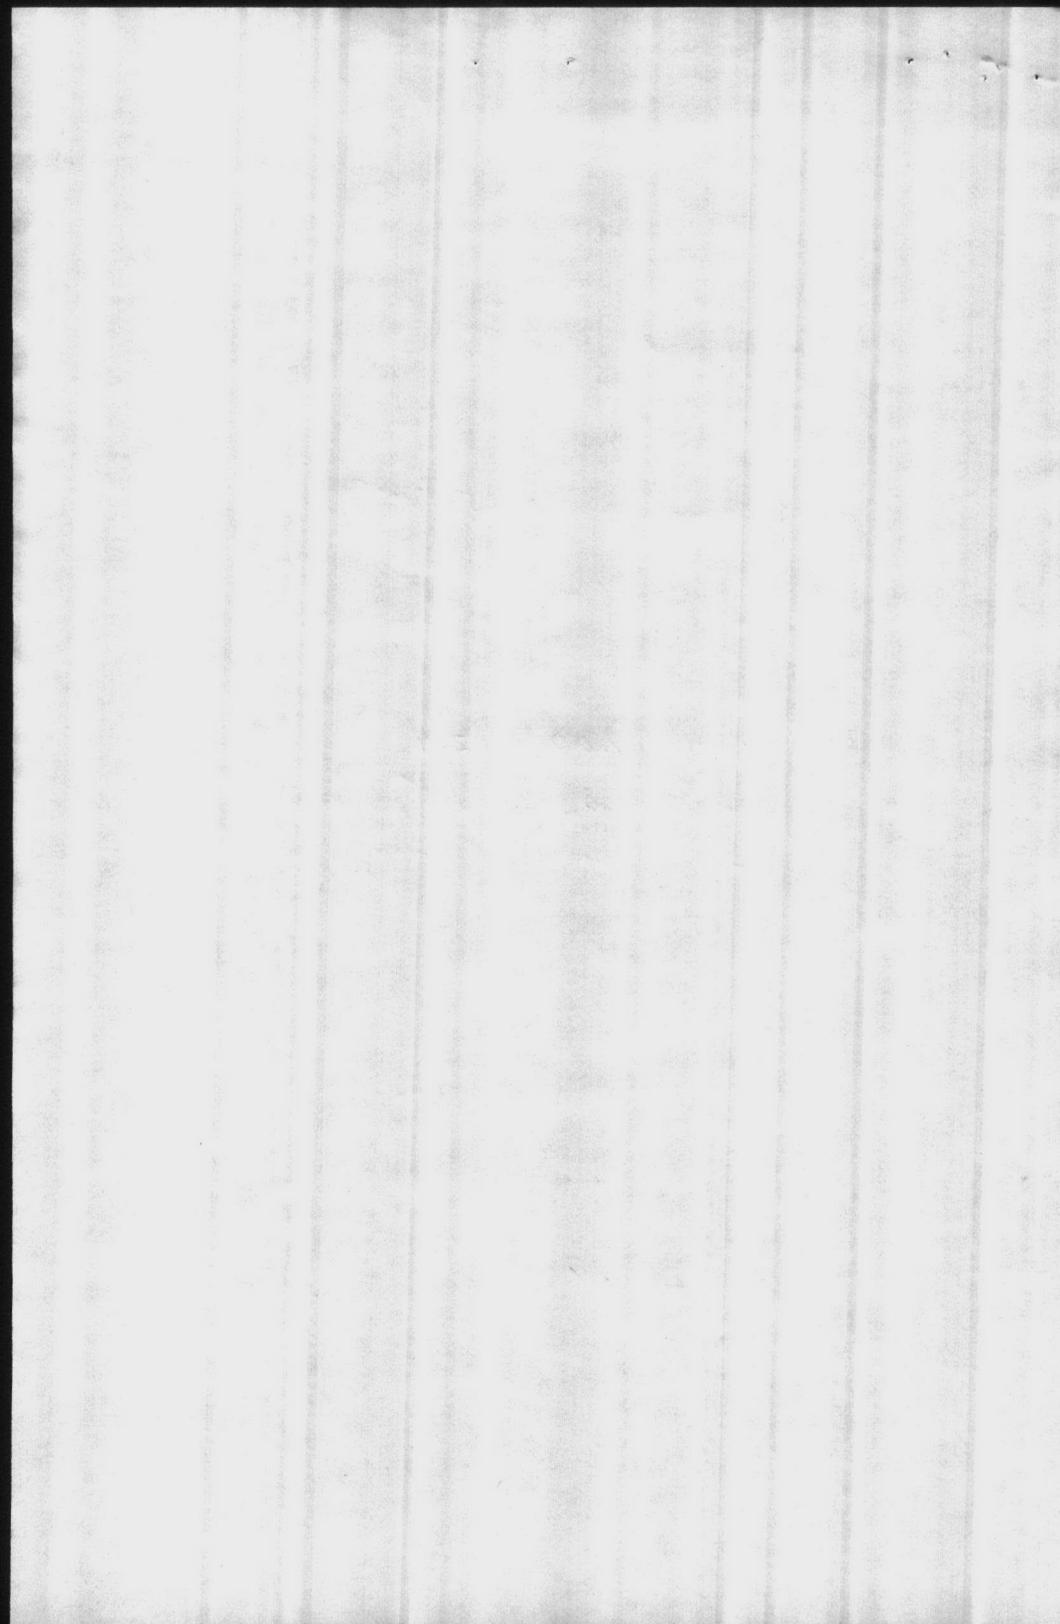

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-24-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.95	3.5	0.7
HOLCOMB BLVD	0.14	0.97	3.0	0.7
TACAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10-24-87

ANALYST: Th Barbee

FLUORIDE PROCEDURE: Probe

SPRINGS

CALLED TO: Hartsoc

CALLED BY: thB

TIME: 1118

DATE: 10-24-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
 NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
 UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-23-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	1.08	2.9	0.9
HOLDOMB BLVD	0.19	1.01	3.4	0.6
TARAWA TERRACE				

REMARKS:

---



---



---

ANALYSIS DATE: 10-23-87

ANALYST: BURNS

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

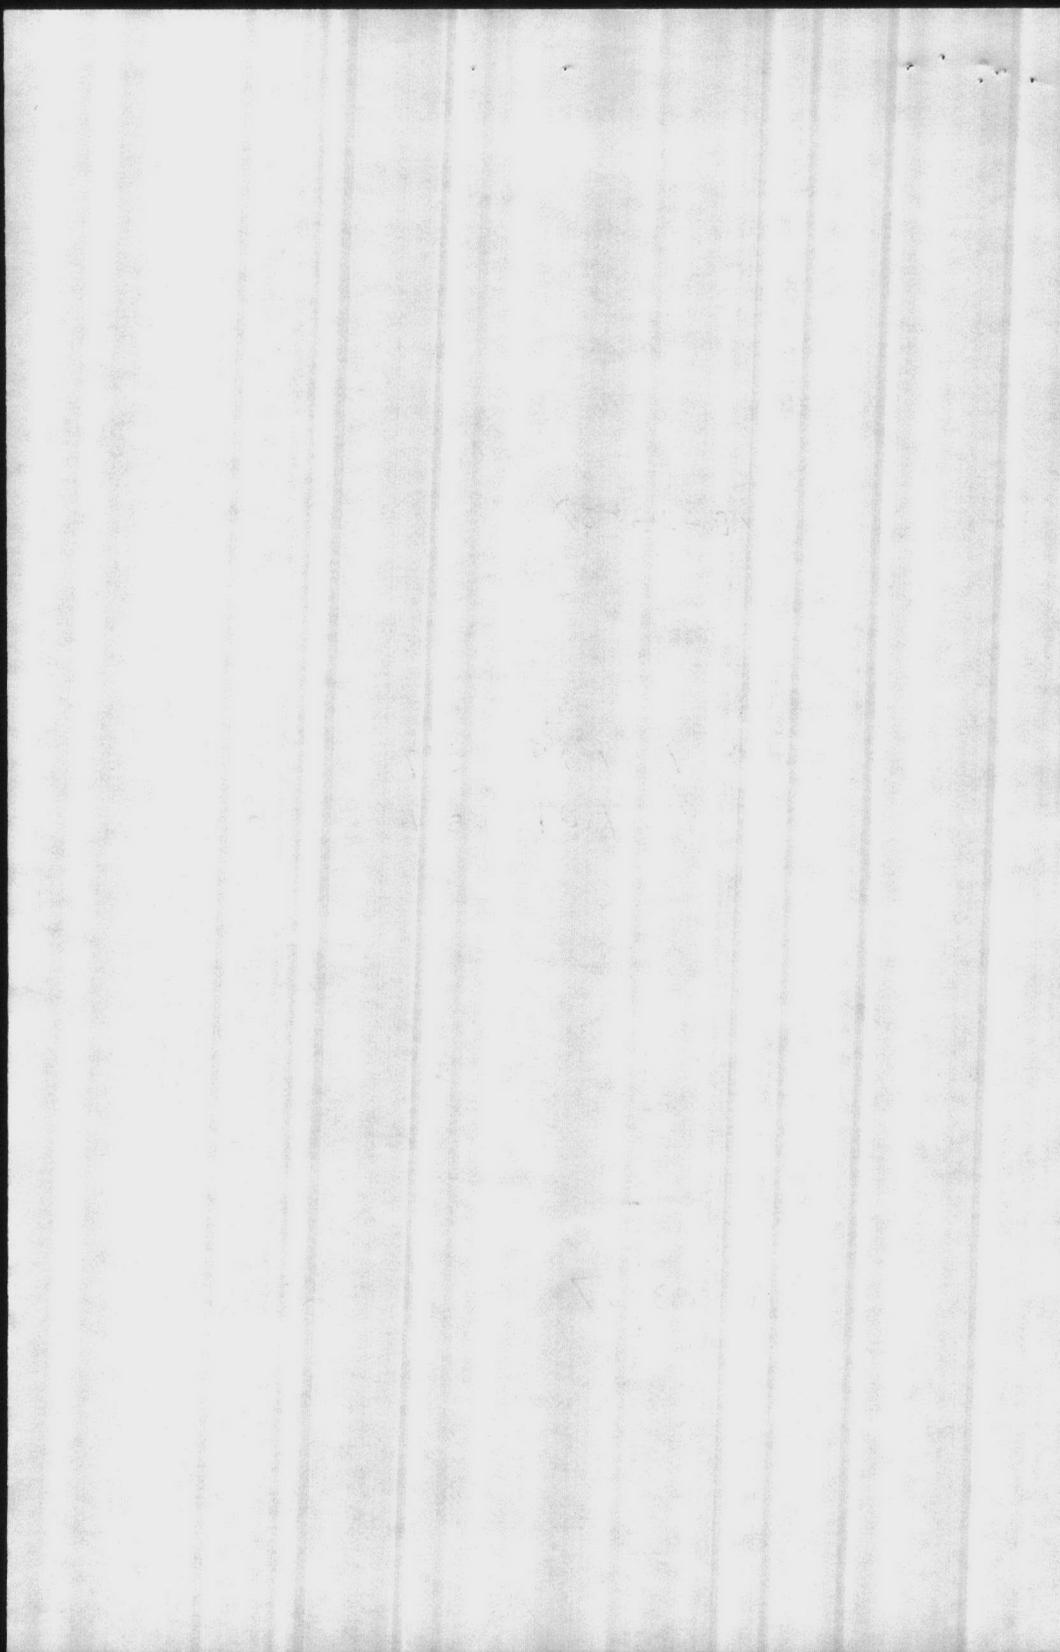

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-22-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.22	1.05	3.9	0.6
HOLCOMB BLVD	0.19	1.19	3.5	1.0
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10-22-87

ANALYST: Buens

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-21-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.85	4.9	0.6
HOLCOMB BLVD	0.14	1.12	4.1	1.2
TARA WA TERRACE				

REMARKS:

---



---



---

ANALYSIS DATE: 10-21

ANALYST: Carol Shines

FLUORIDE PROCEDURE: PROBE


SPANS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

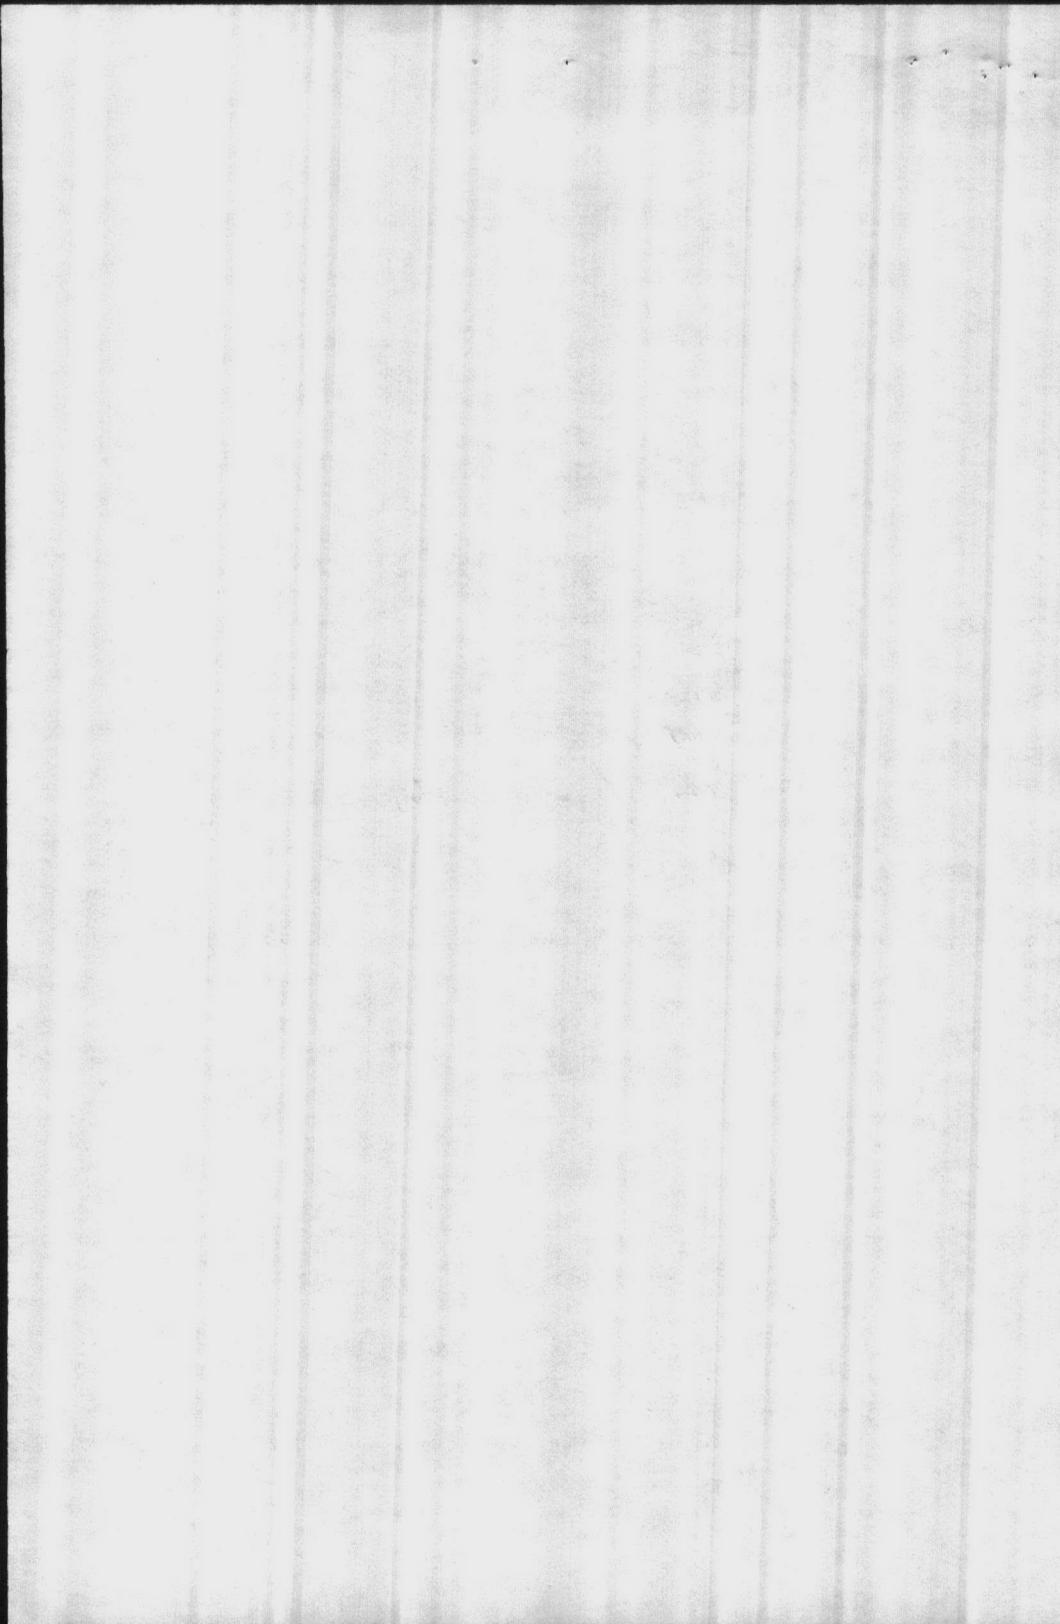

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-20-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.94	3.3	0.5
HOLCOMB BLVD	0.15	1.06	3.5	0.9
TARAWA TERRACE				

REMARKS:

---

---

---

ANALYSIS DATE: 10-20

ANALYST: Carol Shaver

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-19-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.21	3.1	0.1
HOLCOMB BLVD	0.14	1.09	2.6	0.3
TARAWA TERRACE				

REMARKS:

---



---



---

ANALYSIS DATE: 10-19

ANALYST: Carl Sheu

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-18-87, Sunday

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	1.17	1.5	0.9
HOLCOMB BLVD	0.14	1.10	3.2	0.1
TARAWA TERRACE				

REMARKS:

---



---



---

ANALYSIS DATE: 10-19-

ANALYST: Carl Shue

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-16-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.90	5.2	0.5
HOLCOMB BLVD	0.12	0.91	3.1	0.3
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10-16

ANALYST: Carl Shora

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-15-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HANNOT POINT	0.15	0.93	3.4	0.6
HOLCOMB BLVD	0.15	1.10	2.7	1.3
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10-15-87

ANALYST: DUNNS

FLUORIDE PROCEDURE: PROBE


SPAGNS

CALLED TO: Sally

CALLED BY: AL

TIME: 10:45

DATE: 10-15/87

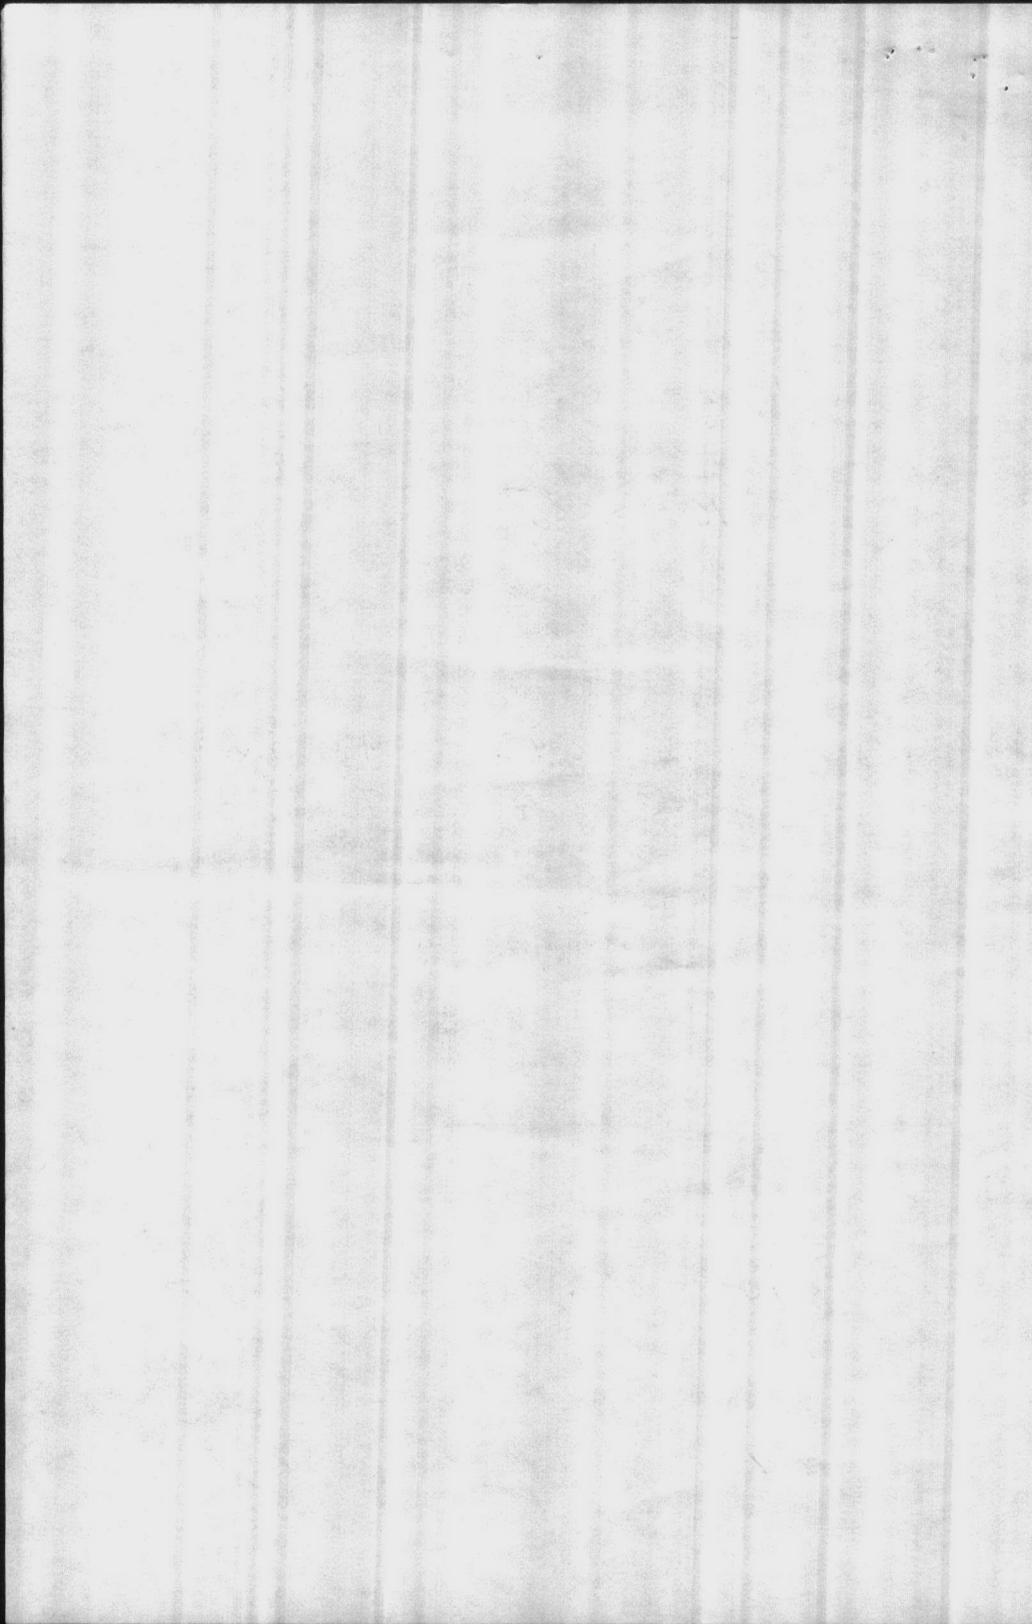

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-14-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	1.06	4.1	0.6
HOLDOMB BLVD	0.16	1.06	3.2	1.6
TARANA TERRACE				

REMARKS:

---

---

---

ANALYSIS DATE: 10-14-87

ANALYST: Bvens

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Tuesday 10-13

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	1.14	2.9	0.7
HOLCOMB BLVD	0.17	1.18	4.5	1.1
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 10-13-17

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

From: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

To: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 10-12

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HAGNOT POINT	0.17	1.04	3.0	0.6
HOLCOMB BLVD	0.17	1.06	4.0	0.7
TARAWA TERRACE				

REMARKS:

---

---

---

ANALYSIS DATE: 10-13-47

ANALYST: RS

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 10-11

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.08	2.5	0.6
HOLCOMB BLVD	0.19	1.16	2.0	0.9
TARAWA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: Wed 10-13-87 ANALYST: [Signature]

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: \_\_\_\_\_ CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_ DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Saturday 10-10-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.05	4.6	1.2
HOLCOMB BLVD	0.15	1.07	3.4	0.6
TARA WA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 10-10-87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Peterson

CALLED BY: Bob

TIME: 09:53

DATE: 10-10-87

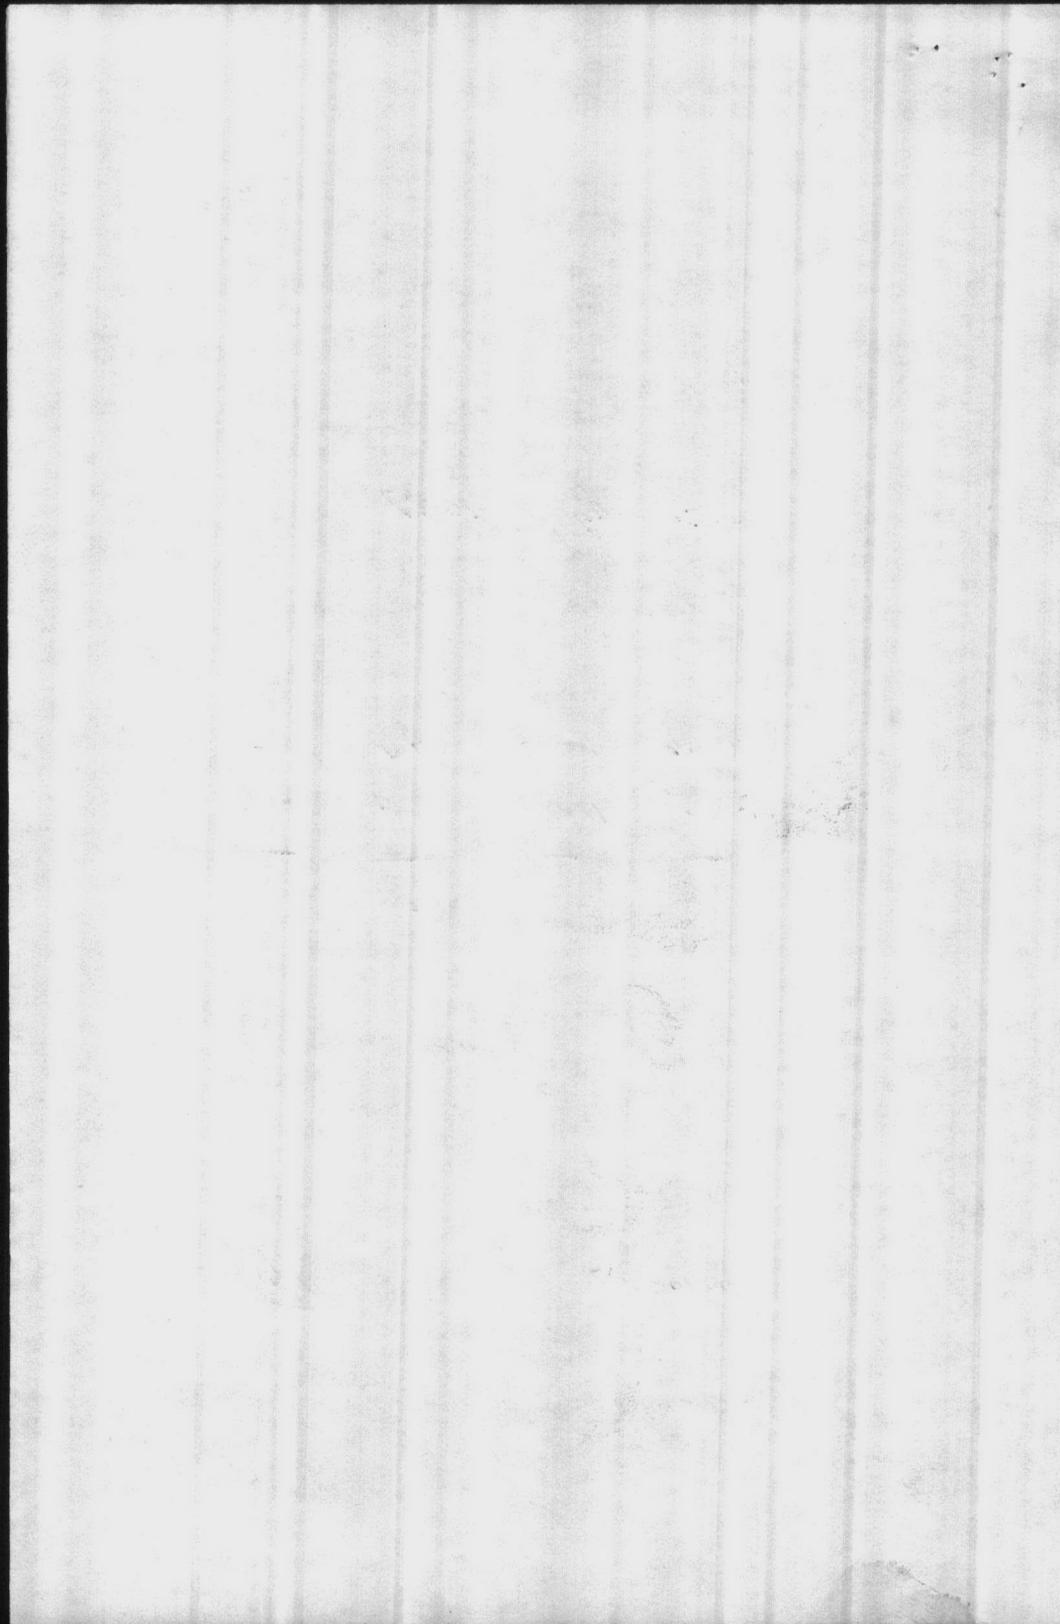

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-9-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	1.01	3.0	0.5
HOLCOMB BLVD	0.12	1.05	3.5	0.8
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10-9-87

ANALYST: JMS

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Sally

CALLED BY: JMS

TIME: 1140

DATE: 10-9



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-8-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.09	2.5	0.5
HOLCOMB BLVD	0.14	1.19	3.5	0.8
TARAWA TERRACE	<hr/>			

REMARKS:

---



---



---

ANALYSIS DATE: 10-8-87

ANALYST: Th Barber

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Made Frazelle

CALLED BY: Ths.

TIME: 1055

DATE: 10-8-87

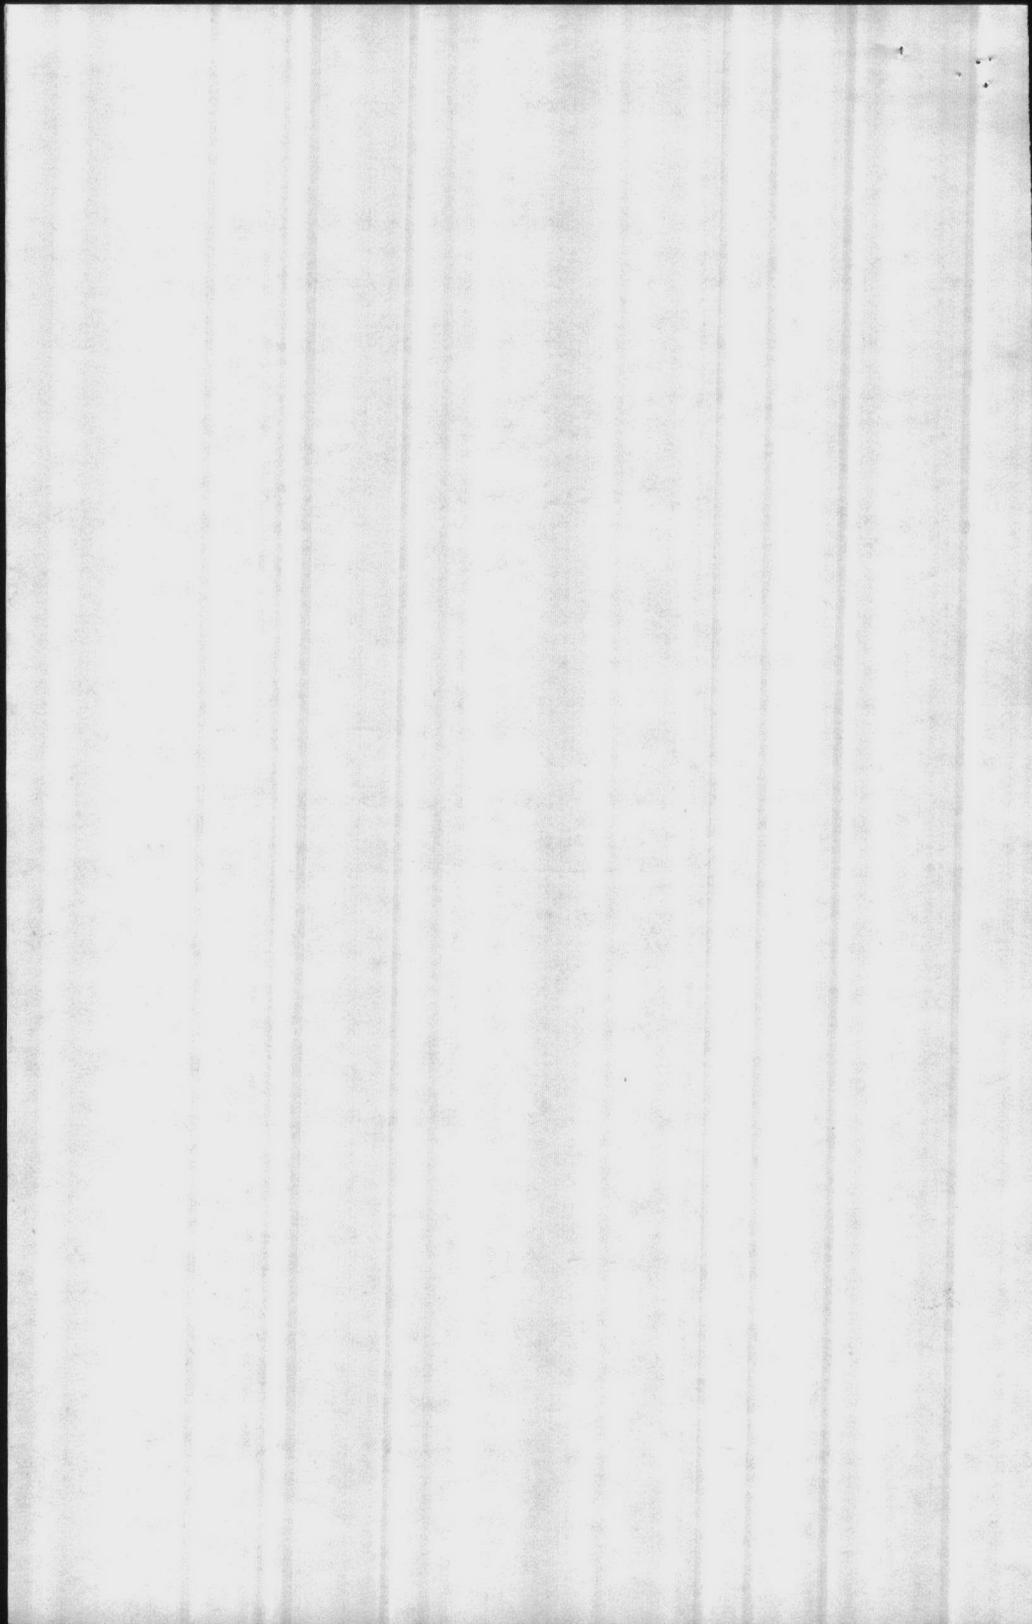

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-7-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	1.07	9.0	0.5
HOLCOMB BLVD	0.13	1.05	3.0	0.8
TARAWA TERRACE	—————		—————	

REMARKS:

---

---

---

ANALYSIS DATE: 10-7-87

ANALYST: Th Barber

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: THB

TIME: 1115

DATE: 10-7-87

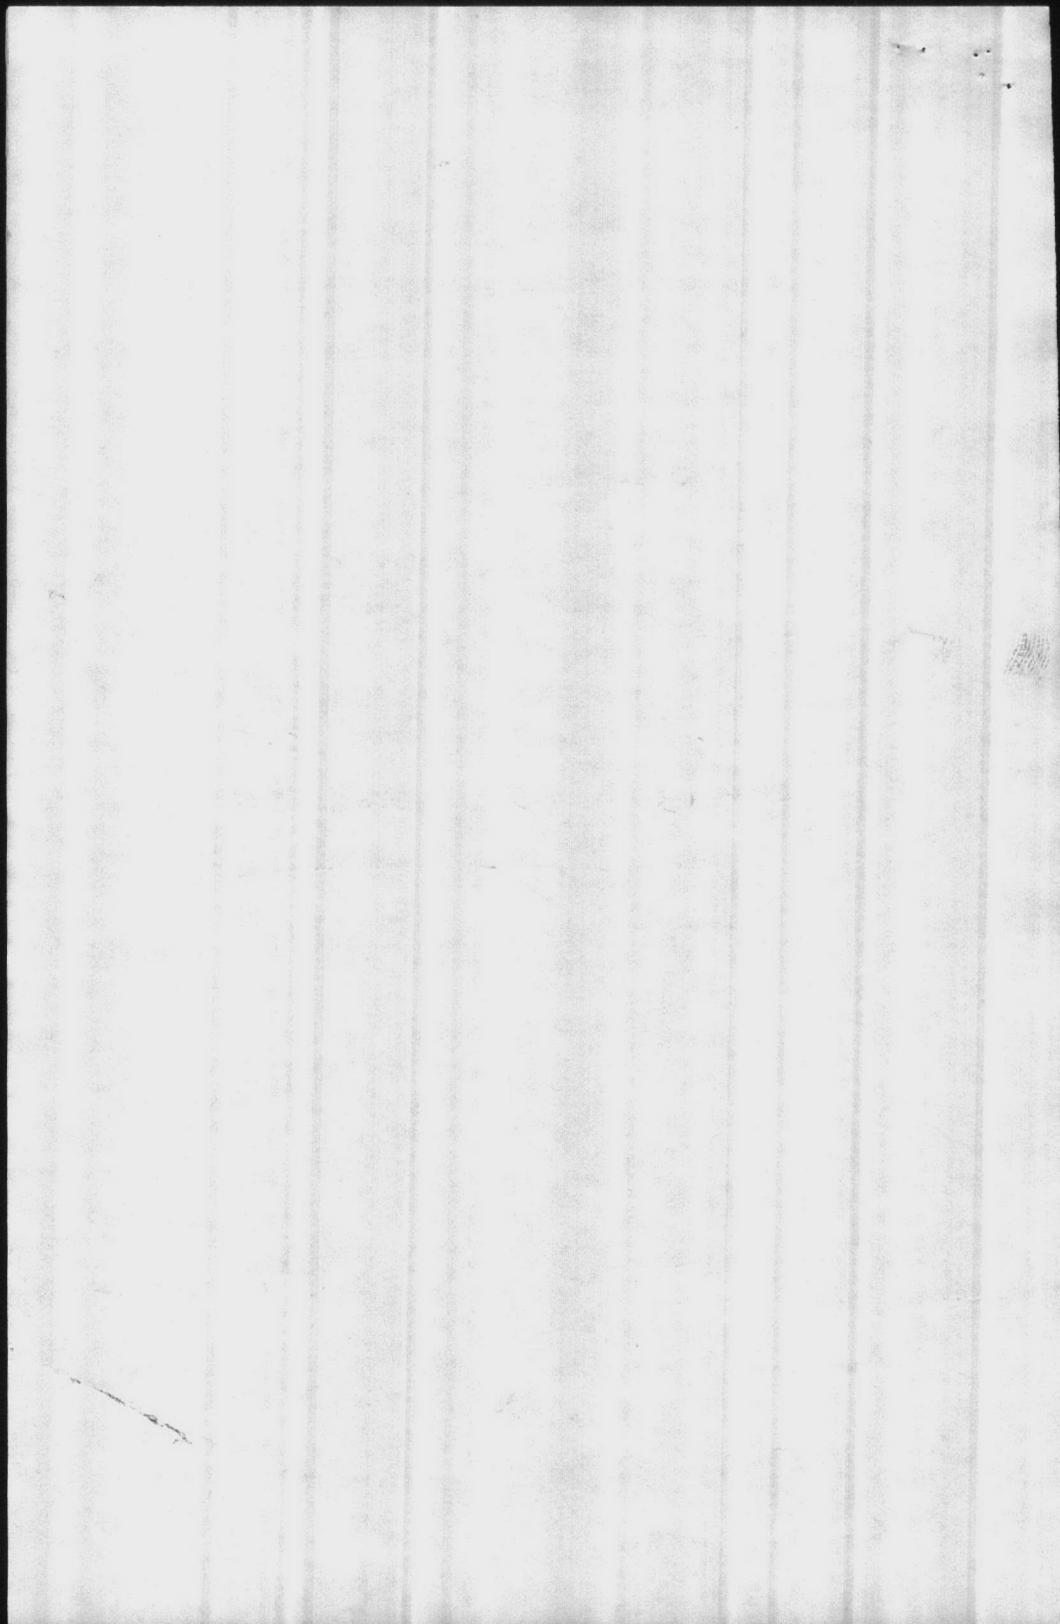

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-6-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.83	4.4	0.7
HOLCOMB BLVD	0.11	0.94	3.6	0.8
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 10/6/87

ANALYST: Carol Shum

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

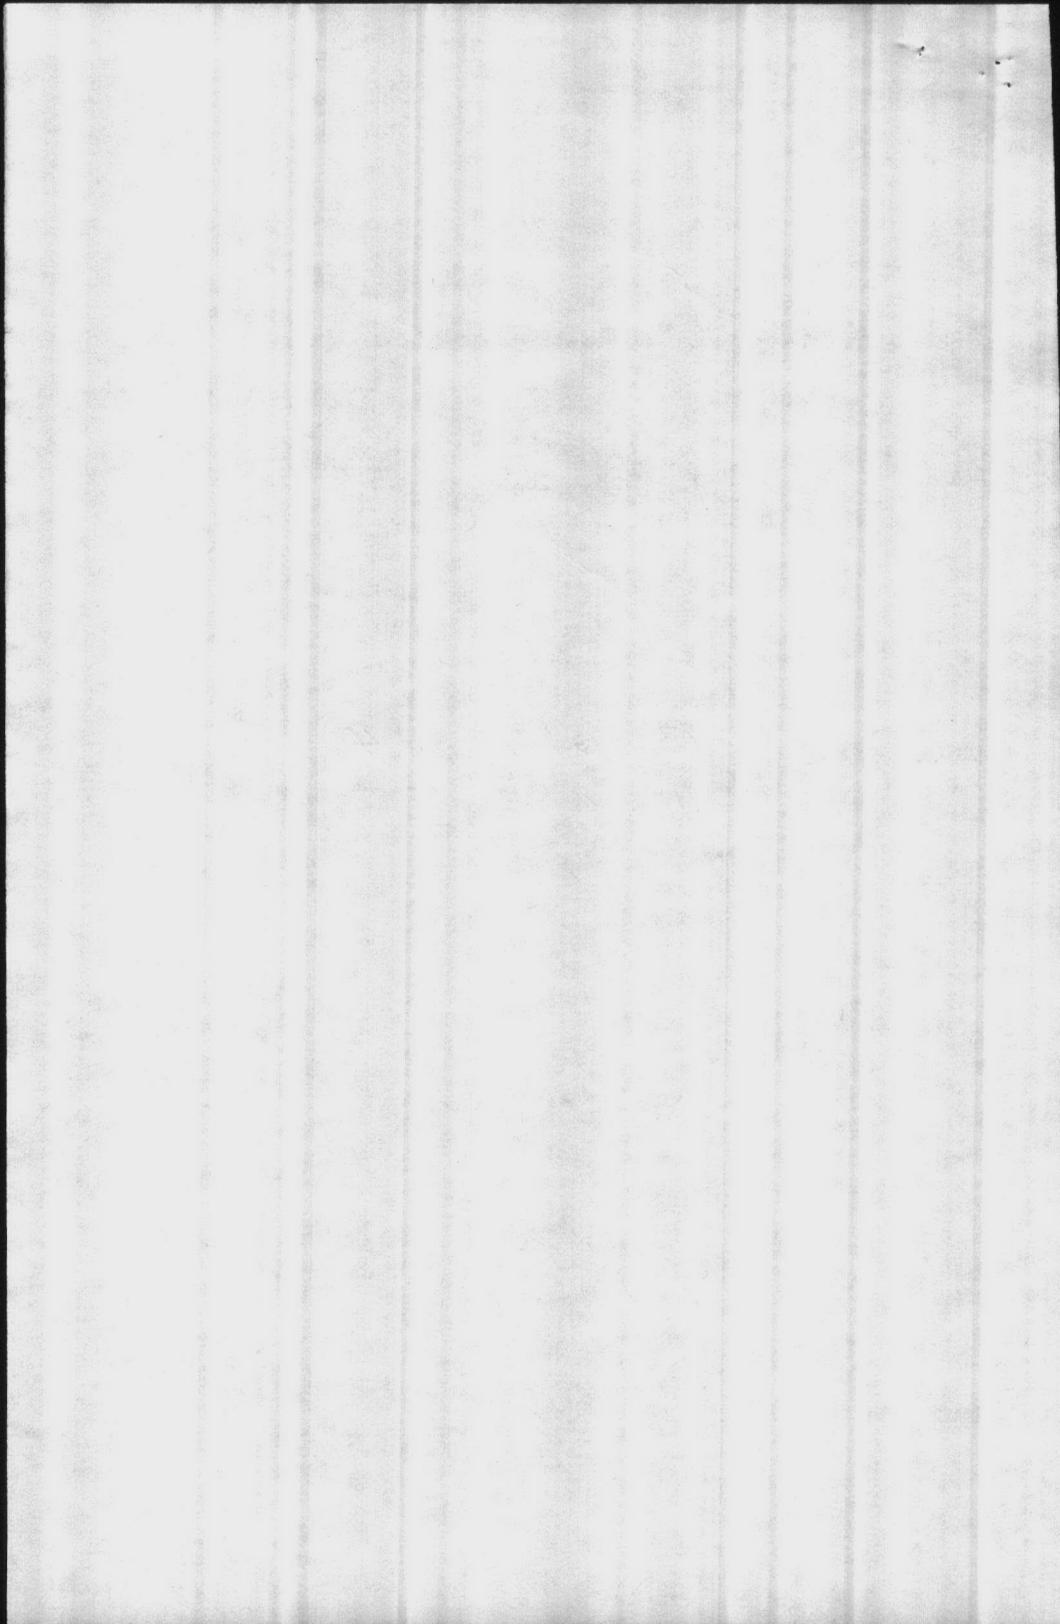

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 10-5-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.12	0.89	3.3	0.6
HOLCOMB BLVD	0.14	1.11	5.8	0.9
TARA WA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 10-5-87

ANALYST: BS

FLUORIDE PROCEDURE: PROBE


SPRINGS

CALLED TO: Sally

CALLED BY: BS

TIME: 11:20

DATE: 10-5-87

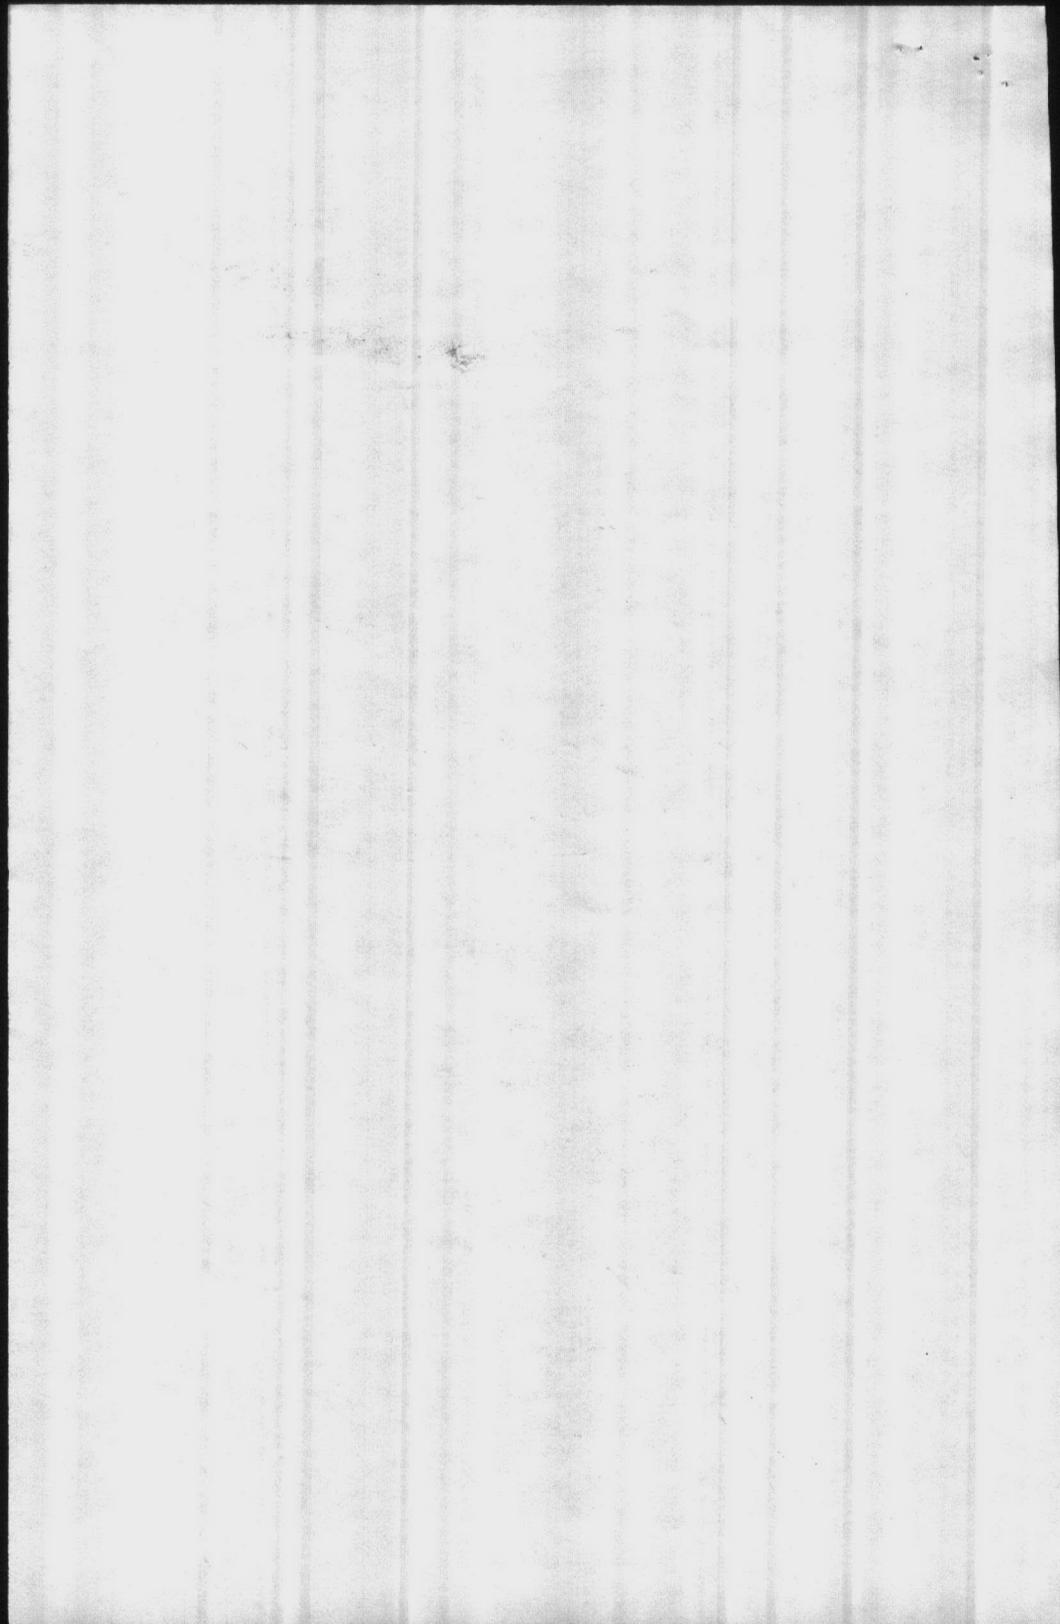

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 10-4-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.72	4.5	0.6
HOLCOMB BLVD	0.13	1.13	3.2	0.9
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 10-5-87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPAGNS

CALLED TO: Sally

CALLED BY: Bob

TIME: 11:20

DATE: 10-5-87

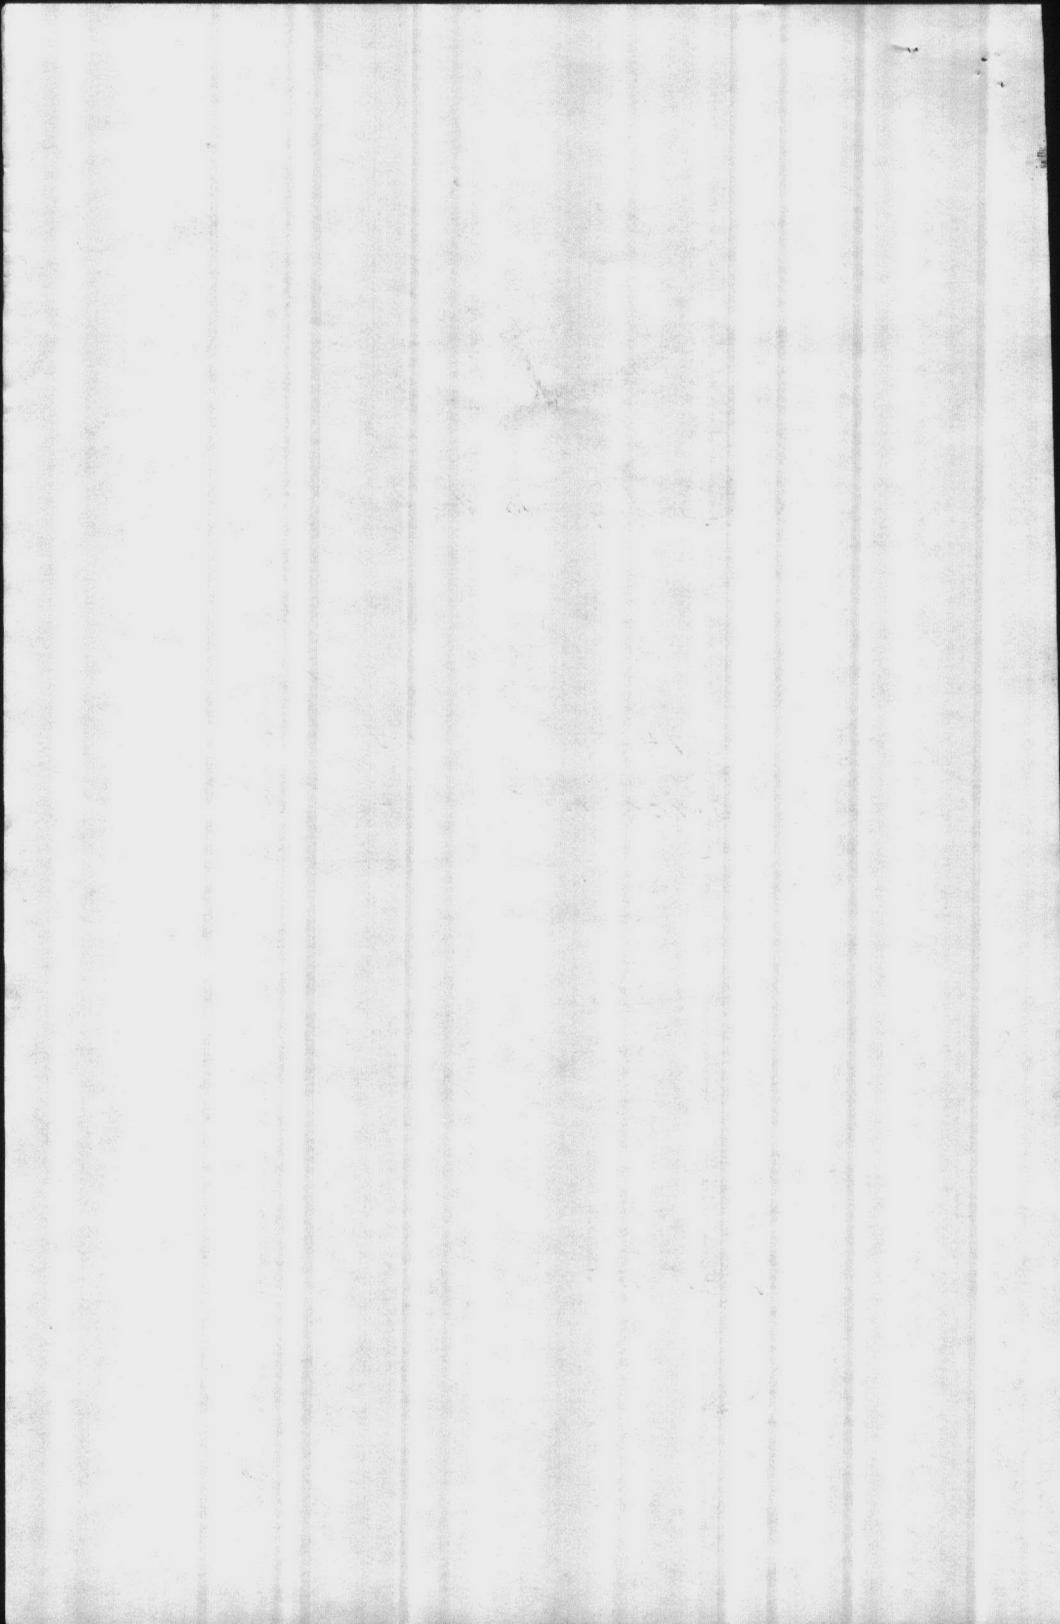

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-3-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.70	2.0	0.6
HOLCOMB BLVD	0.11	1.04	3.5	0.8
TARAWA TERRACE	<hr/>			

REMARKS:

---

---

---

ANALYSIS DATE: 10-3-87

ANALYST: McBarber

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Dunlap

CALLED BY: TRB

TIME: 1032

DATE: 10-3-87

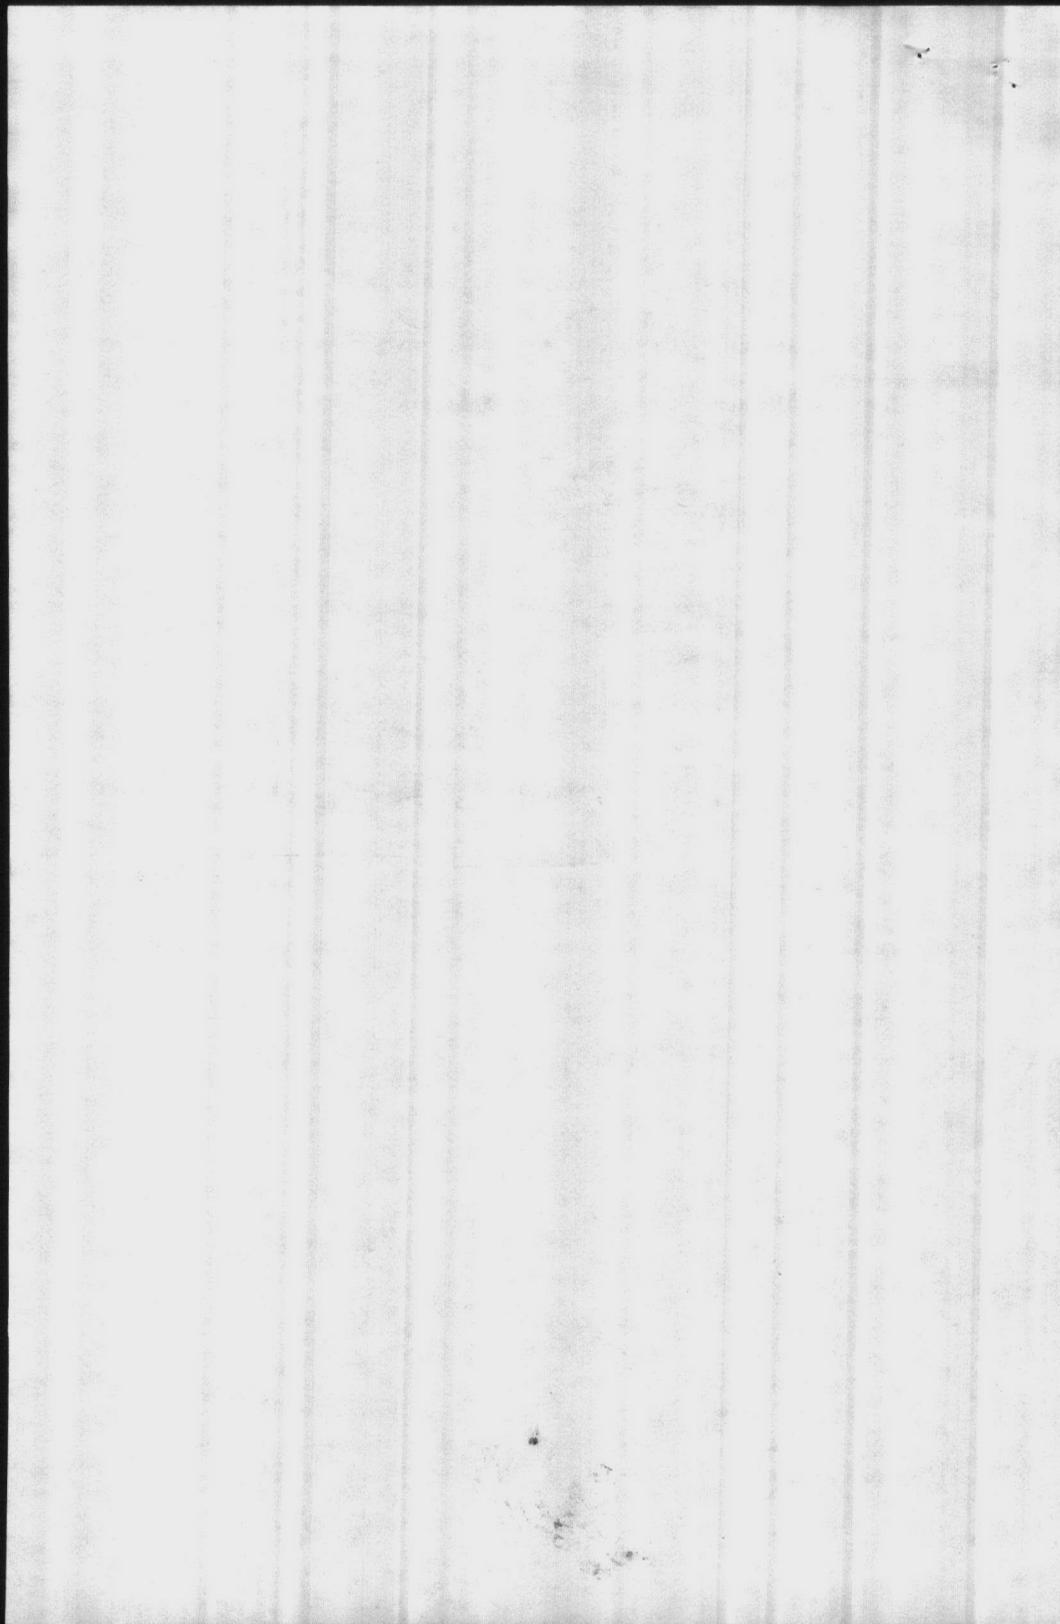

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-2-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.75	5.5	0.7
HOLCOMB BLVD	0.14	1.09	3.2	0.8
TARANNA TERRACE				

REMARKS:

ANALYSIS DATE: 10-2-87

ANALYST: BURNS

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

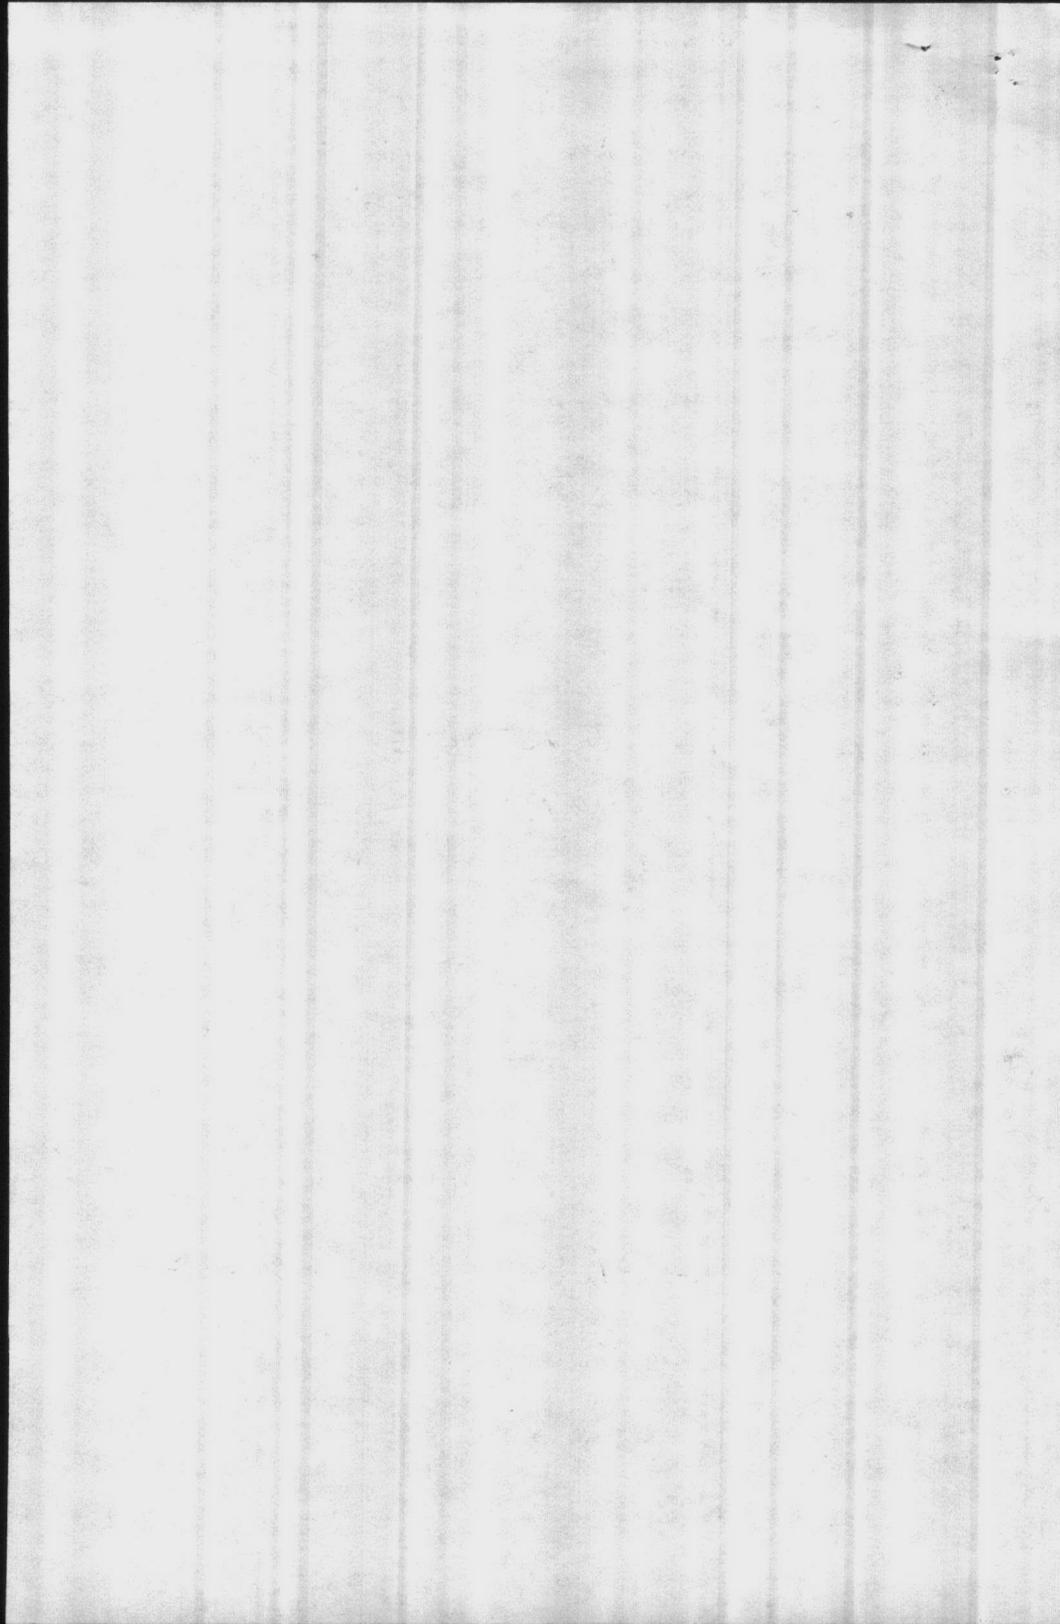

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 10-1-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.77	6.6	0.7
HOLCOMB BLVD	0.15	1.21	3.1	1.2
TARAWA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 10-1-87

ANALYST: BIVENS

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

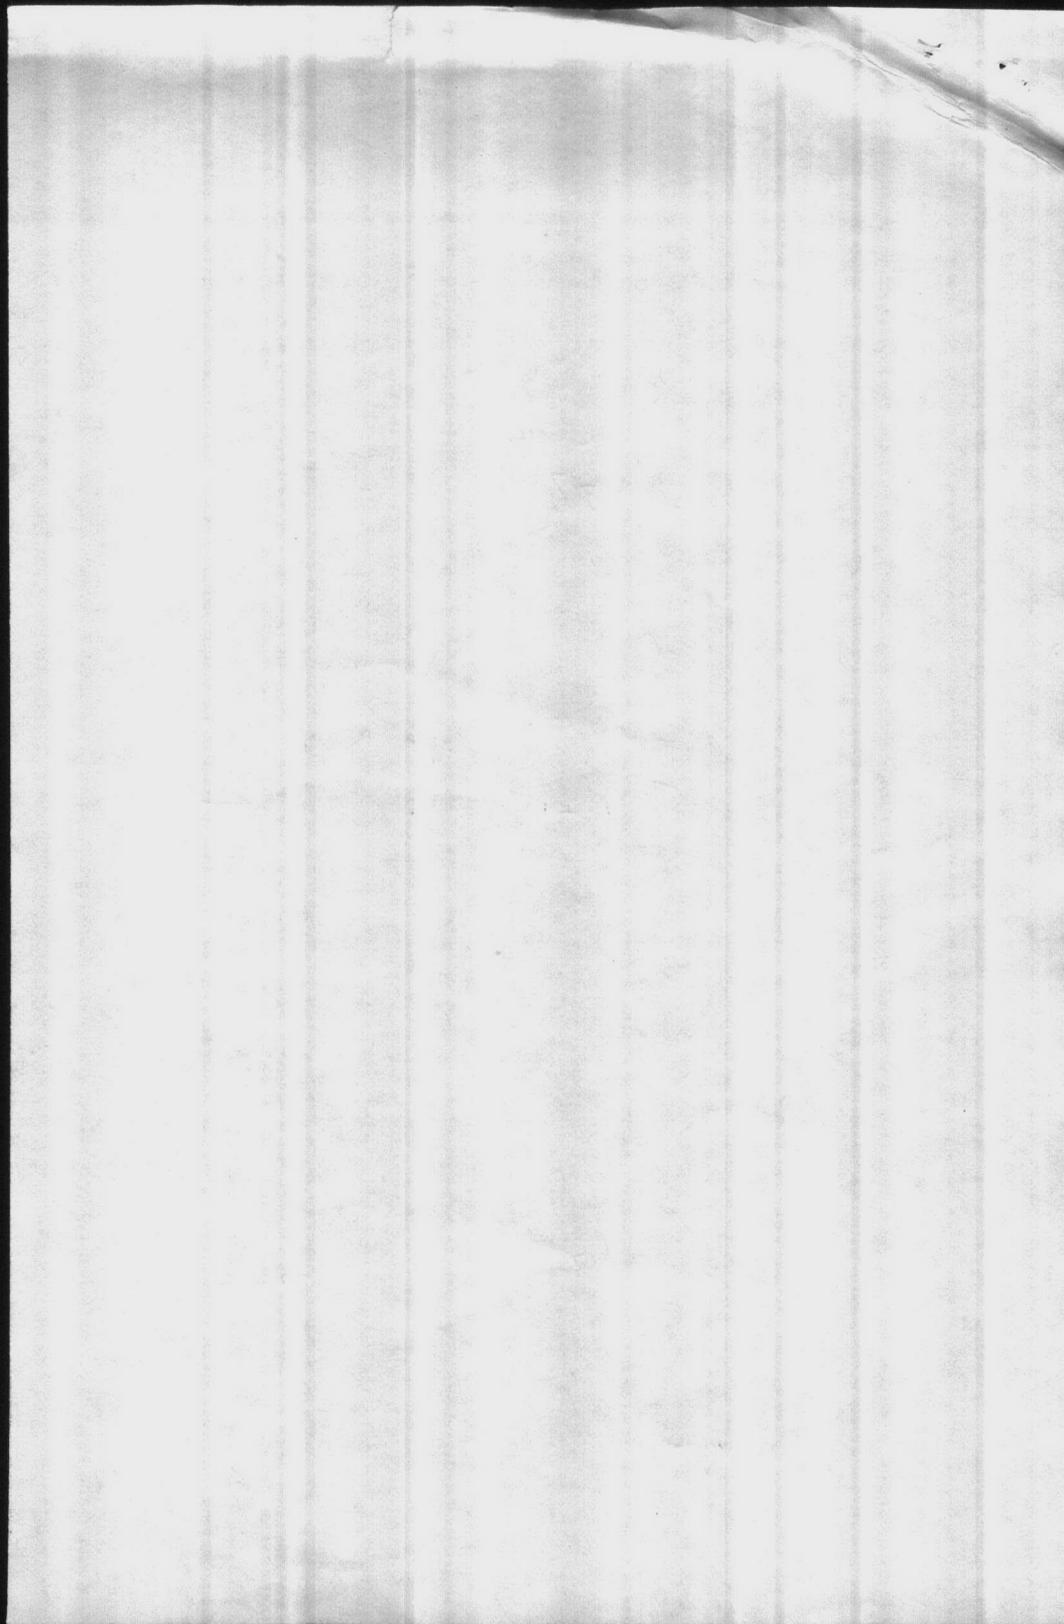

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday, 11-30-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.26	—	—
HOLCOMB BLVD	0.16	0.97	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-30-87

ANALYST: MS

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: MS

TIME: 0850

DATE: 11-30-87

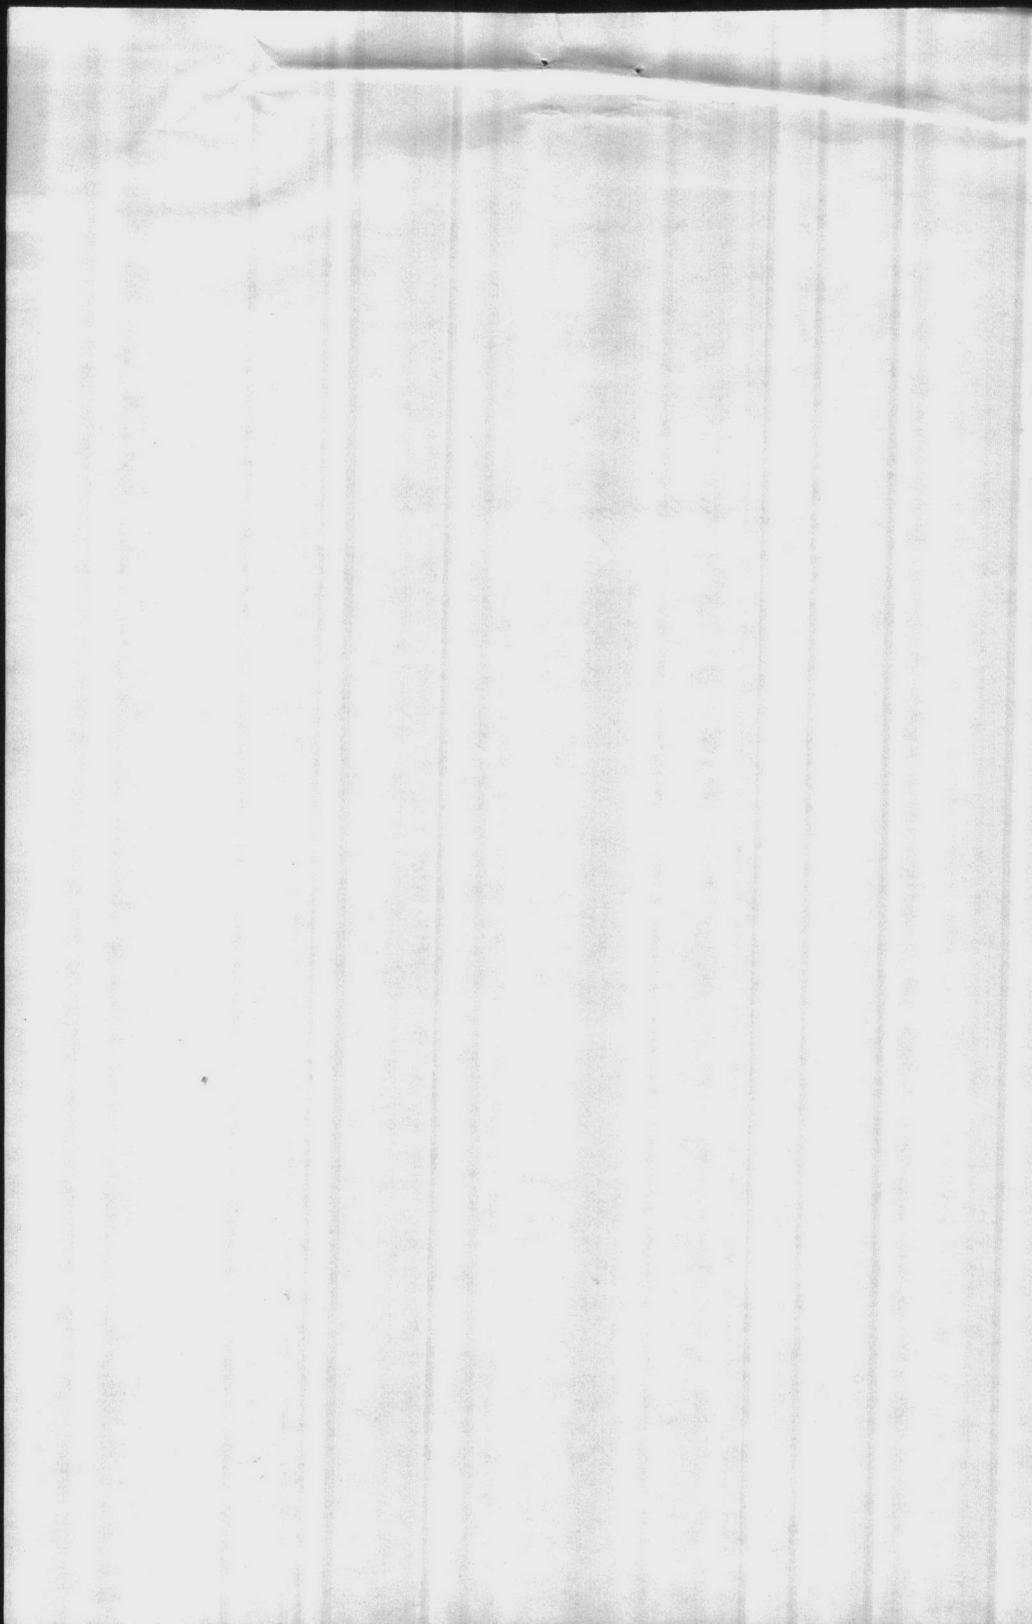

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 11-29-47

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.89	—	—
HOLCOMB BLVD	0.16	1.00	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 11-30-47

ANALYST: PCW

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Lally

CALLED BY: PCW

TIME: 0950

DATE: 11-30-47

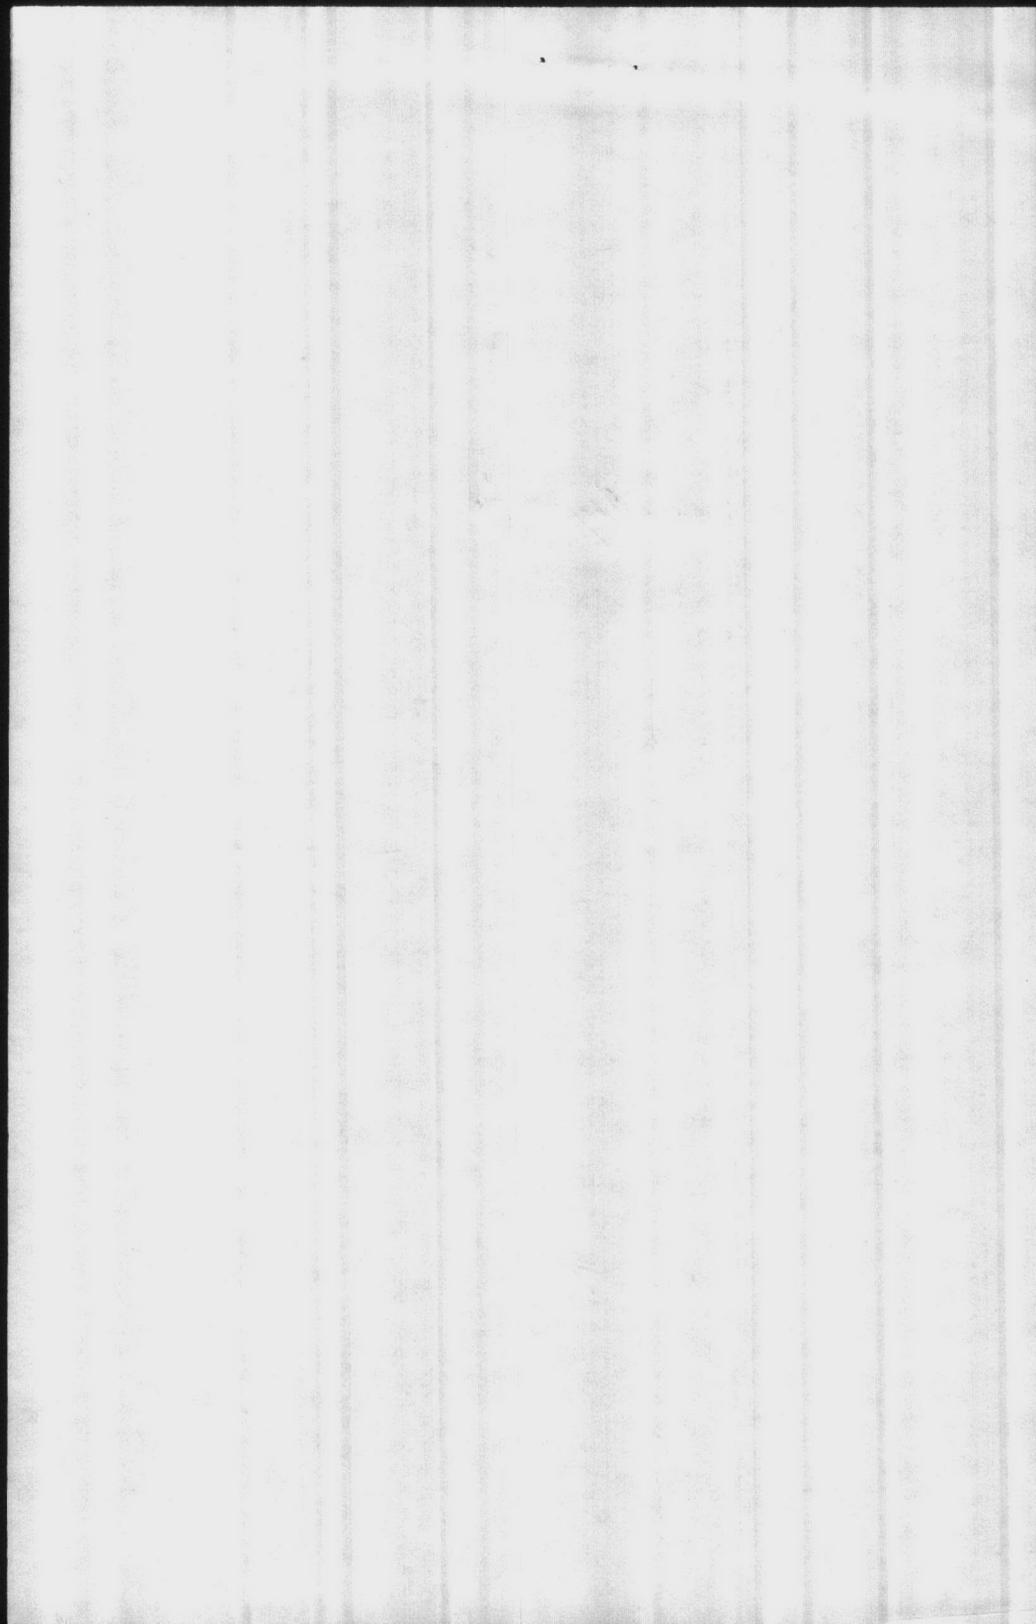

# DAILY FLUORIDE AND TURBIDITY REPORT

From: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

To: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-28-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.83	_____	_____
HOLCOMB BLVD	0.13	0.95	_____	_____
TREAWA TERRACE	_____	_____	_____	_____

REMARKS:

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

ANALYSIS DATE: 11-28-87

ANALYST: Th Barlow

FLUORIDE PROCEDURE: PROBE

SPRINGS

CALLED TO: Holland

CALLED BY: turb

TIME: 1120

DATE: 11-28-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-27-87 RUN DATE \_\_\_\_\_

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	<del>0.20</del> 0.19	<del>1.02</del> 0.96		
HOLCOMB BLVD	0.17	1.10	70	
TARAWA TERRACE				

REMARKS:

NO DATES ON  
SAMPLES

ANALYSIS DATE: 11-27-87

ANALYST: Carol Shaw

FLUORIDE PROCEDURE: PROBE


SPRINGS

CALLED TO: \_\_\_\_\_

CALLED BY: C. Shaw

TIME: \_\_\_\_\_

DATE: 11-27

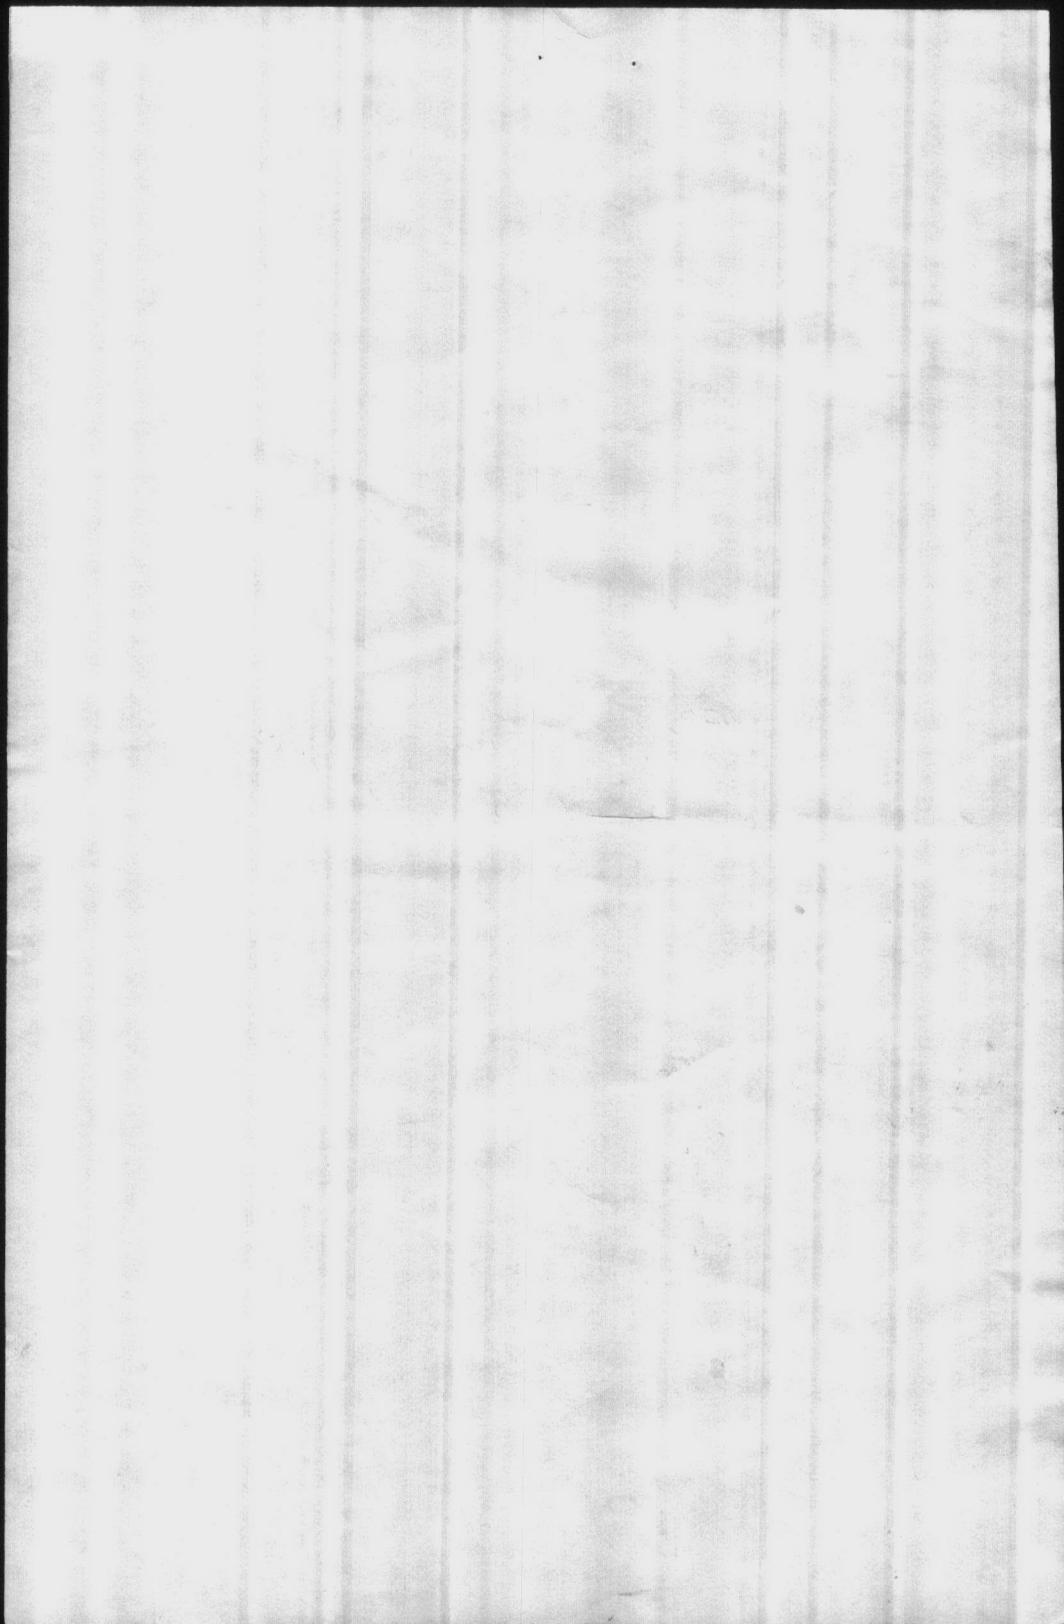

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-25-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	0.69		
HOLCOMB BLVD	0.16	1.06		
TARAWA TERRACE				

REMARKS:

---



---



---

ANALYSIS DATE: 11-25

ANALYST: Carol Shea

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

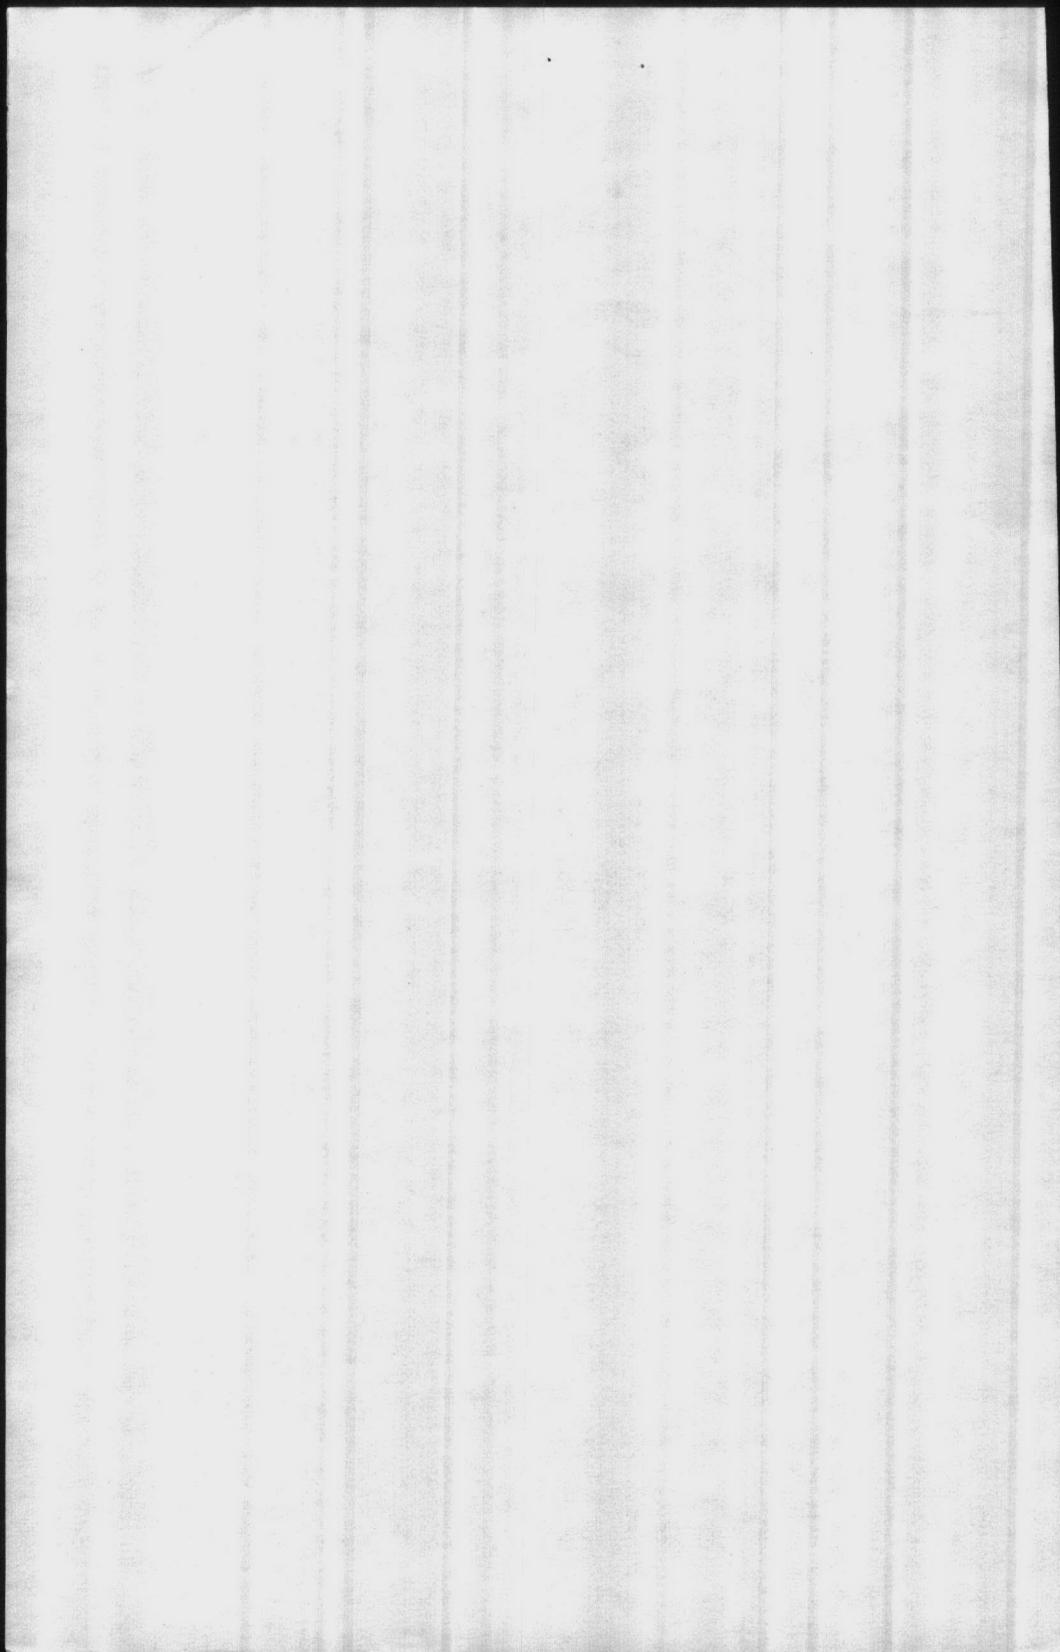

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-24-87

PLANT	FLUORIDE ppm		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.18		
HOLCOMB BLVD	0.15	1.04	X	
TACANA TERRACE	X	X		

REMARKS: TURB. MACHINES DOWN

ANALYSIS DATE: 11-24-87

ANALYST: G. Shores

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 11-23-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.18	—	—
HOLCOMB BLVD	0.14	0.94	—	—
TARANA TERRACE	—	—	—	—

REMARKS:

---



---



---

ANALYSIS DATE: 11-23-87

ANALYST: BN

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: farm

CALLED BY: BN

TIME: 10:22

DATE: 11-23-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 11-22-17

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.16	—	—
HOLCOMB BLVD	0.16	1.02	—	—
TARAWA TERRACE	—	—	—	—
	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-23-17

ANALYST: ML

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Frank

CALLED BY: ML

TIME: 10:22

DATE: 11-23-17



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-21-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.14	1.4	0.6
HOLCOMB BLVD	0.13	0.95	1.9	0.3
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: \_\_\_\_\_

ANALYST: \_\_\_\_\_

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Full

CALLED BY: BA

TIME: 09:21

DATE: 11-21-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-20-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.13	2.3	0.1
HOLCOMB BLVD	0.15	1.04	3.9	0.3
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 11-20-87

ANALYST: BL

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Sally

CALLED BY: BL

TIME: 10:25

DATE: 11-20-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-19-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	0.15	1.7	0.1
HOLCOMB BLVD	0.14	1.03	3.7	0.1
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

---

ANALYSIS DATE: 11-19-87

ANALYST: BSL

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: POW

CALLED BY: BSL

TIME: 11:15

DATE: 11-19-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-18-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HAGNOT POINT	0.16	0.29	2.4	0.1
HOLCOMB BLVD	0.14	1.03	3.6	0.2
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-18-87

ANALYST: BSL

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: Sally

CALLED BY: BSL

TIME: 10:30

DATE: 11-18-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-17-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	0.56	2.1	0.1
HOLCOMB BLVD	0.15	0.97	1.7	0.3
TARANA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 11-17-87

ANALYST: Bel

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Ram

CALLED BY: Bel

TIME: 10:49

DATE: 11-17-87



# DAILY FLUORIDE AND TURBIDITY REPORT

From: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

To: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 11-16-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.72	1.6	0.2
HOLCOMB BLVD	0.17	<del>1.02</del> <i>Repeat</i>	4.5	0.2
TARANA TERRACE	—	—	—	—

REMARKS: 0.17 Treated

ANALYSIS DATE: 11-16-87

ANALYST: BSL

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: Sally

CALLED BY: BSL

TIME: 0915

DATE: 11-16-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 11/05/87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.27	1.0	0.7
HOLCOMB BLVD	0.17	1.01	2.9	0.3
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-16-87

ANALYST: Bel

FLUORIDE PROCEDURE: PROBE

SPAGNS

CALLED TO: daily

CALLED BY: Bel

TIME: 0915

DATE: 11-16-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-14-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.76	1.2	0.5
HOLCOMB BLVD	0.14	0.95	3.9	0.3
TARAWA TERRACE				

REMARKS:

---

---

---

ANALYSIS DATE: 11-14

ANALYST: Carol Shore

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11/13/07

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	1.01	2.2	0.3
HOLCOMB BLVD	0.16	1.12	3.2	1.0
TARA WA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-13

ANALYST: AR

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Ellis

CALLED BY: AR

TIME: 09:30

DATE: 11-13-07



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-12-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	1.02	2.6	1.2
HOLCOMB BLVD	0.17	1.11	5.6	2.1
TREANA TERRACE				

REMARKS:

ANALYSIS DATE: 11-12-87

ANALYST: Buens

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

$$\begin{array}{r} 88 \\ 23 \\ \hline 65 \end{array}$$

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-11-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	1.02	2.6	0.6
HOLCOMB BLVD	0.17	1.16	2.9	0.6
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 11-12-87

ANALYST: BURNS

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

11

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11/10/97

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	1.12	2.3	0.5
HOLCOMB BLVD	0.20	1.29	3.3	0.7
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11/10/97

ANALYST: Bot

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Pam

CALLED BY: BR

TIME: 0910

DATE: 11/10/97



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 11-9-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.96	2.1	0.6
HOLCOMB BLVD	0.19	1.13	3.3	0.8
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-9-87

ANALYST: BJD

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Ram

CALLED BY: BJD

TIME: 09:40

DATE: 11-9-87

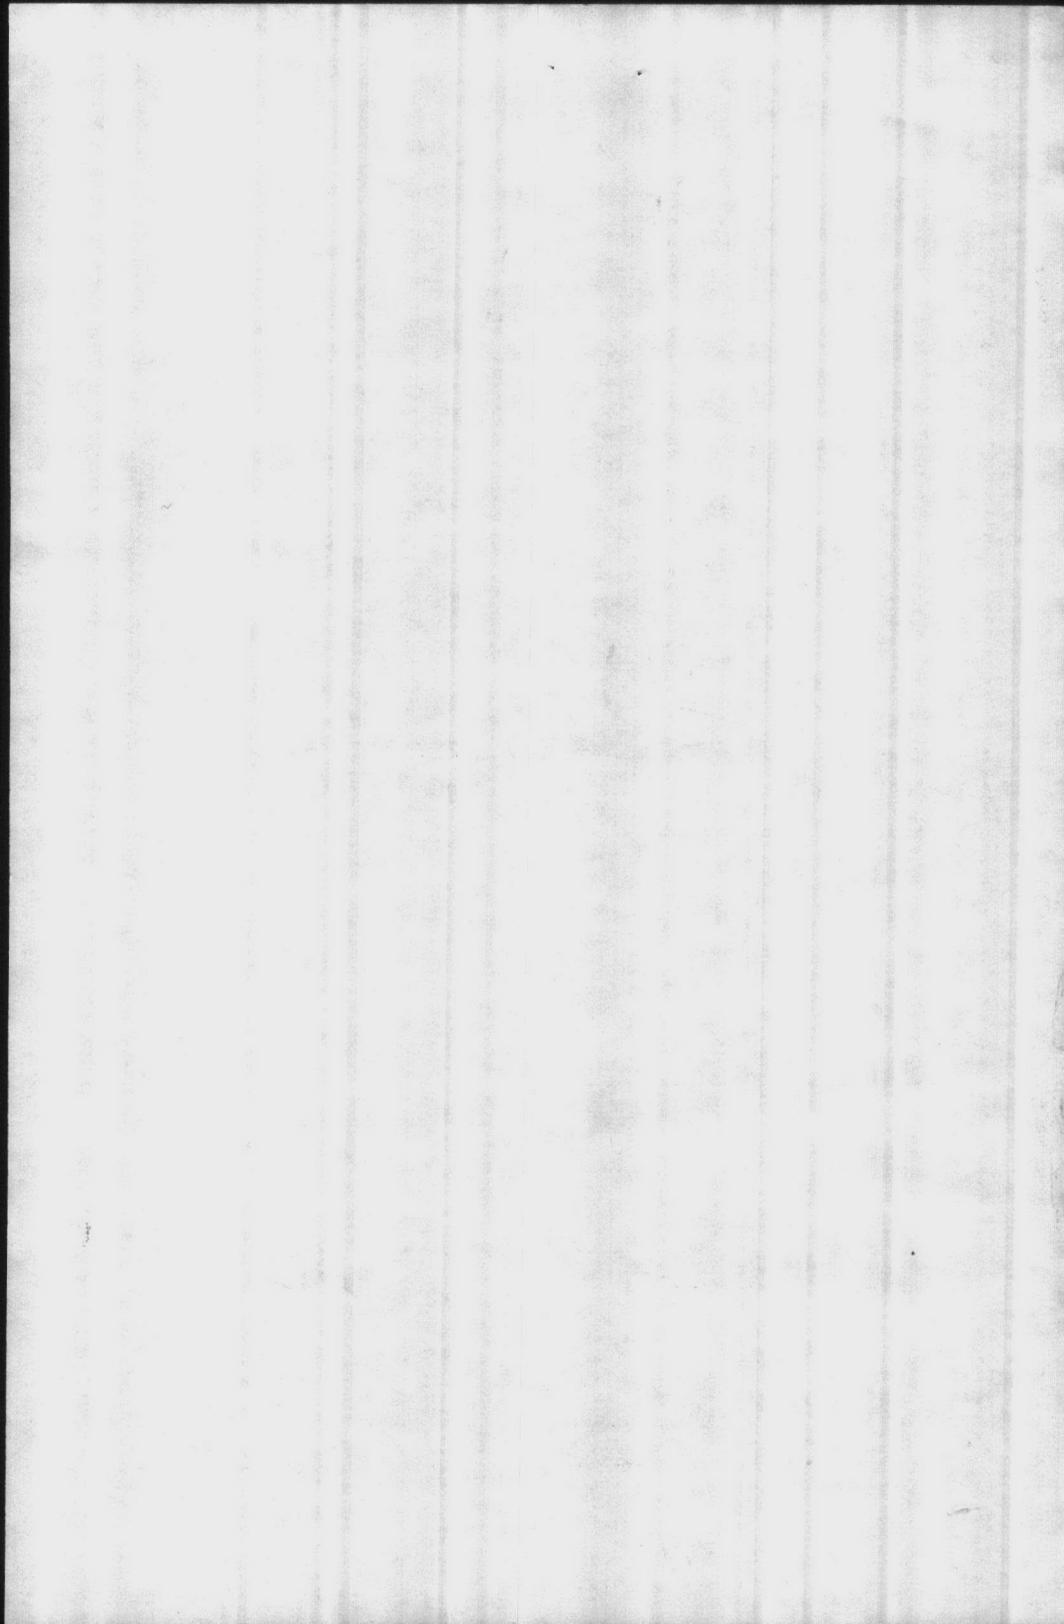

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 11-8-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	1.62	6.2	1.3
HOLCOMB BLVD	0.17	1.11	3.3	1.2
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

---

ANALYSIS DATE: 11-9-87

ANALYST: Bel

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Pam

CALLED BY: Bel

TIME: 09:50

DATE: 11-9-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-7-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.27	2.5	0.8
HOLCOMB BLVD	0.18	1.20	4.8	2.2
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 11-7-87

ANALYST: SPADNS

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: \_\_\_\_\_

CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_

DATE: \_\_\_\_\_

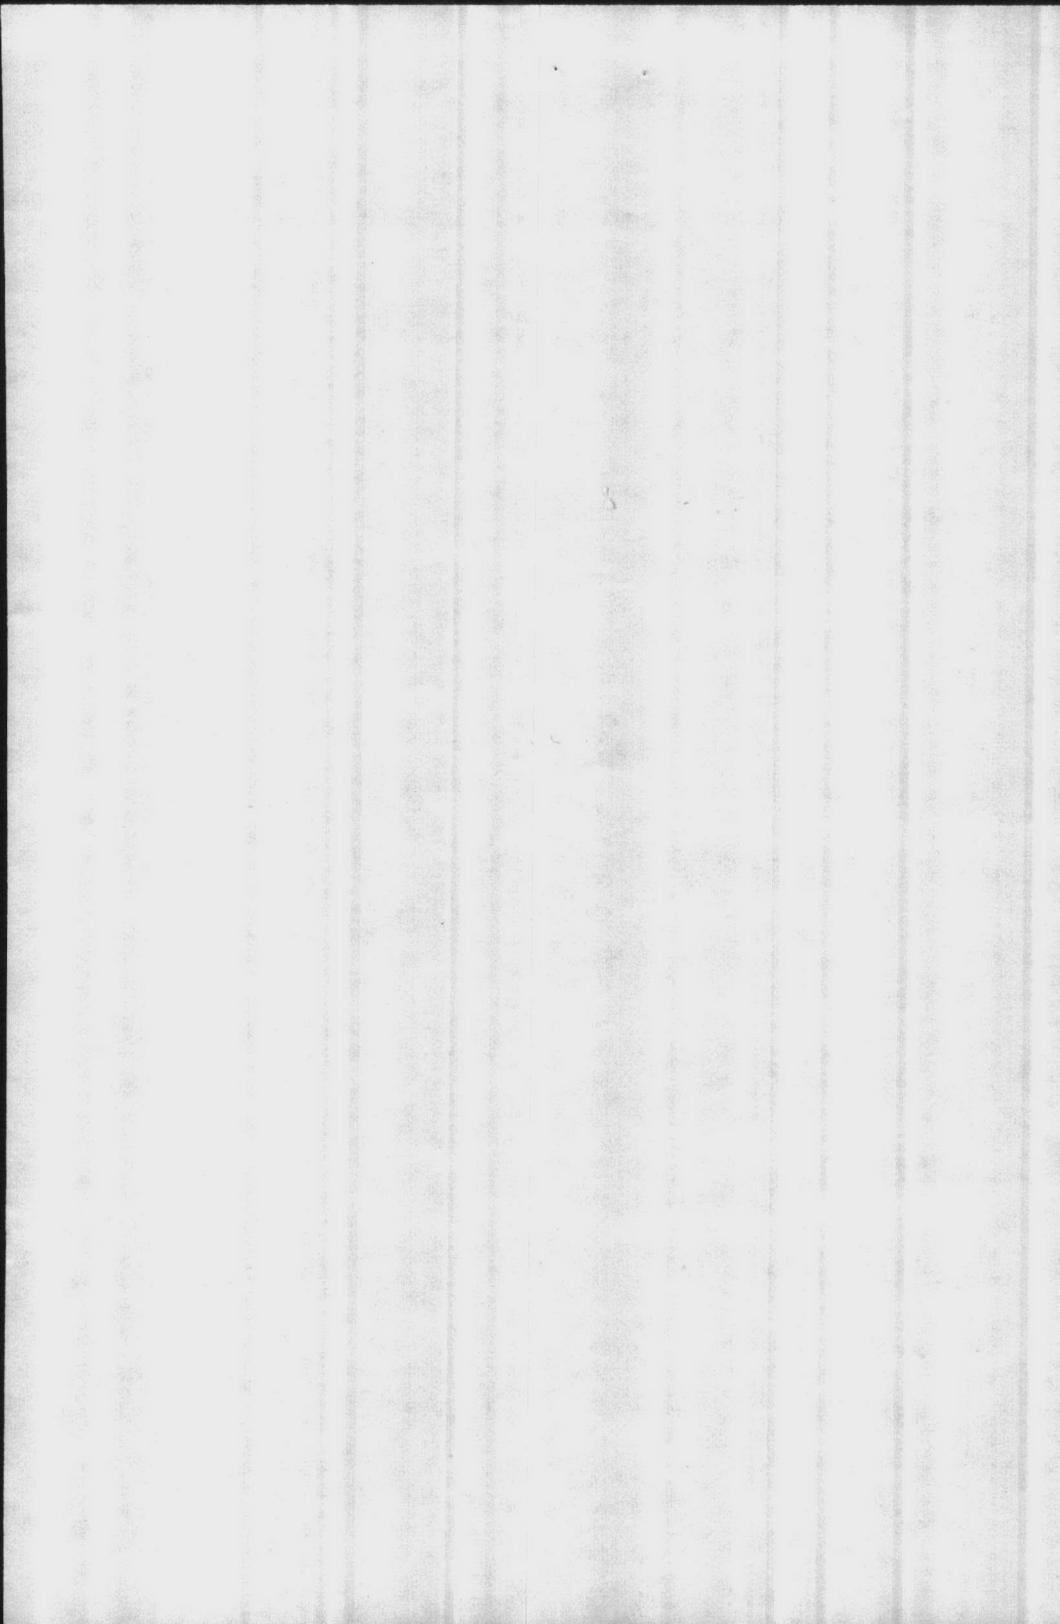

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-6-17

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.96	2.9	1.0
HOLCOMB BLVD	0.16	0.98	6.7	1.5
TARANA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11/6/17

ANALYST: Bel

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Hill

CALLED BY: Bel

TIME: 0920

DATE: 11-6-17

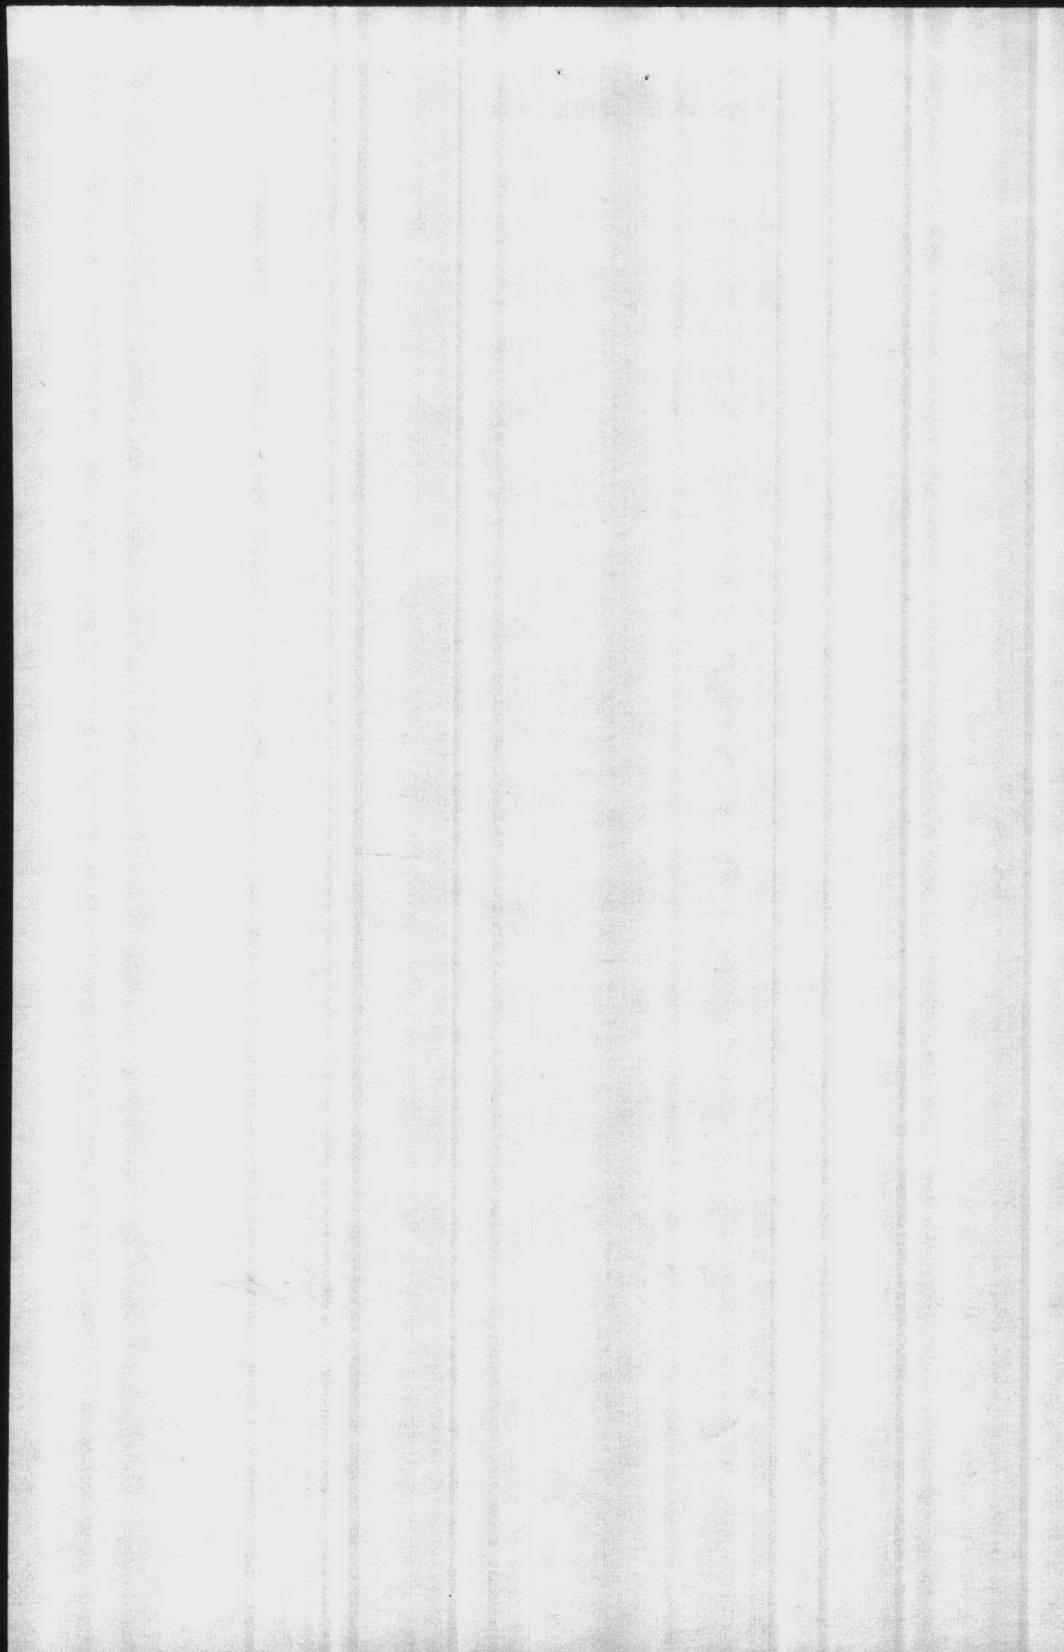

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH; BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-5-87

PLANT	FLUORIDE PPM		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.95	3.5	1.0
HOLCOMB BLVD	0.16	1.01	4.3	0.9
TARANA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11-5-87

ANALYST: Bej

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Sally

CALLED BY: Bej

TIME: 0903

DATE: 11-5-87



# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11-4-87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	0.94	2.3	0.7
HOLCOMB BLVD	0.16	1.00	3.5	1.2
TARAWA TERRACE				

REMARKS:

ANALYSIS DATE: 11-4-87

ANALYST: RSK

FLUORIDE PROCEDURE: PROBE


SPAGNS

CALLED TO: Sally

CALLED BY: RSK

TIME: 09:00

DATE: 11-4-87

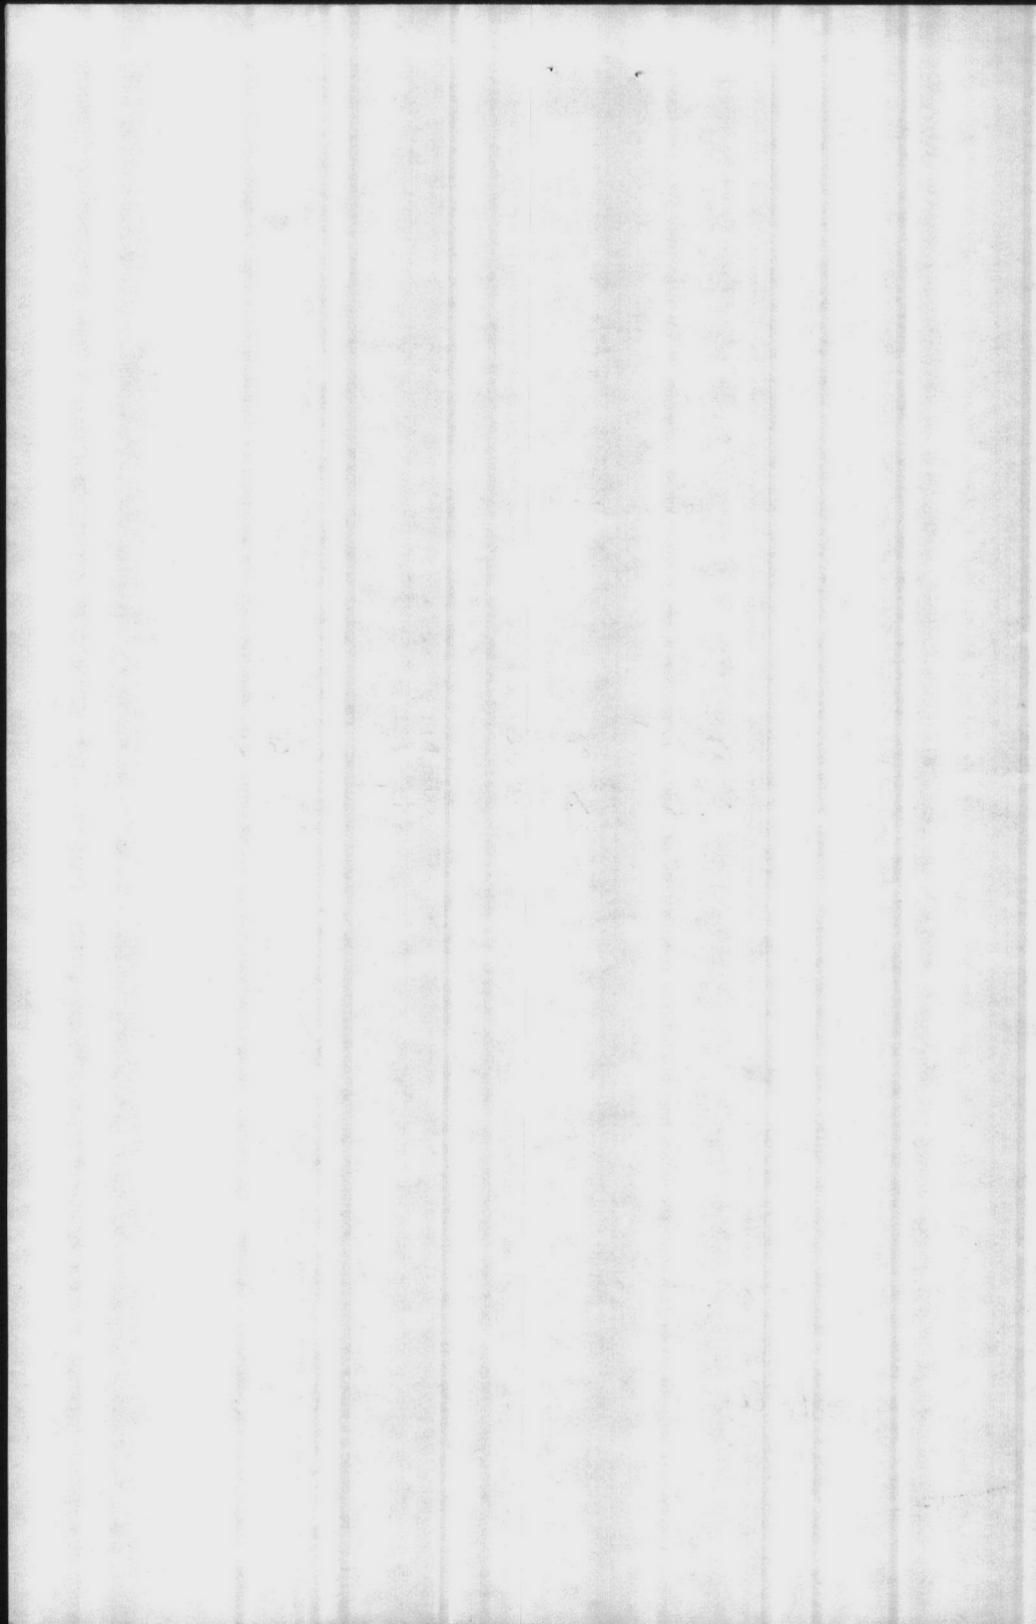

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11/3/87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	0.96	4.4	0.5
HOLCOMB BLVD	0.14	1.13	3.4	1.4
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 11-3-87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: Bob

TIME: 09:00

DATE: 11-3-87

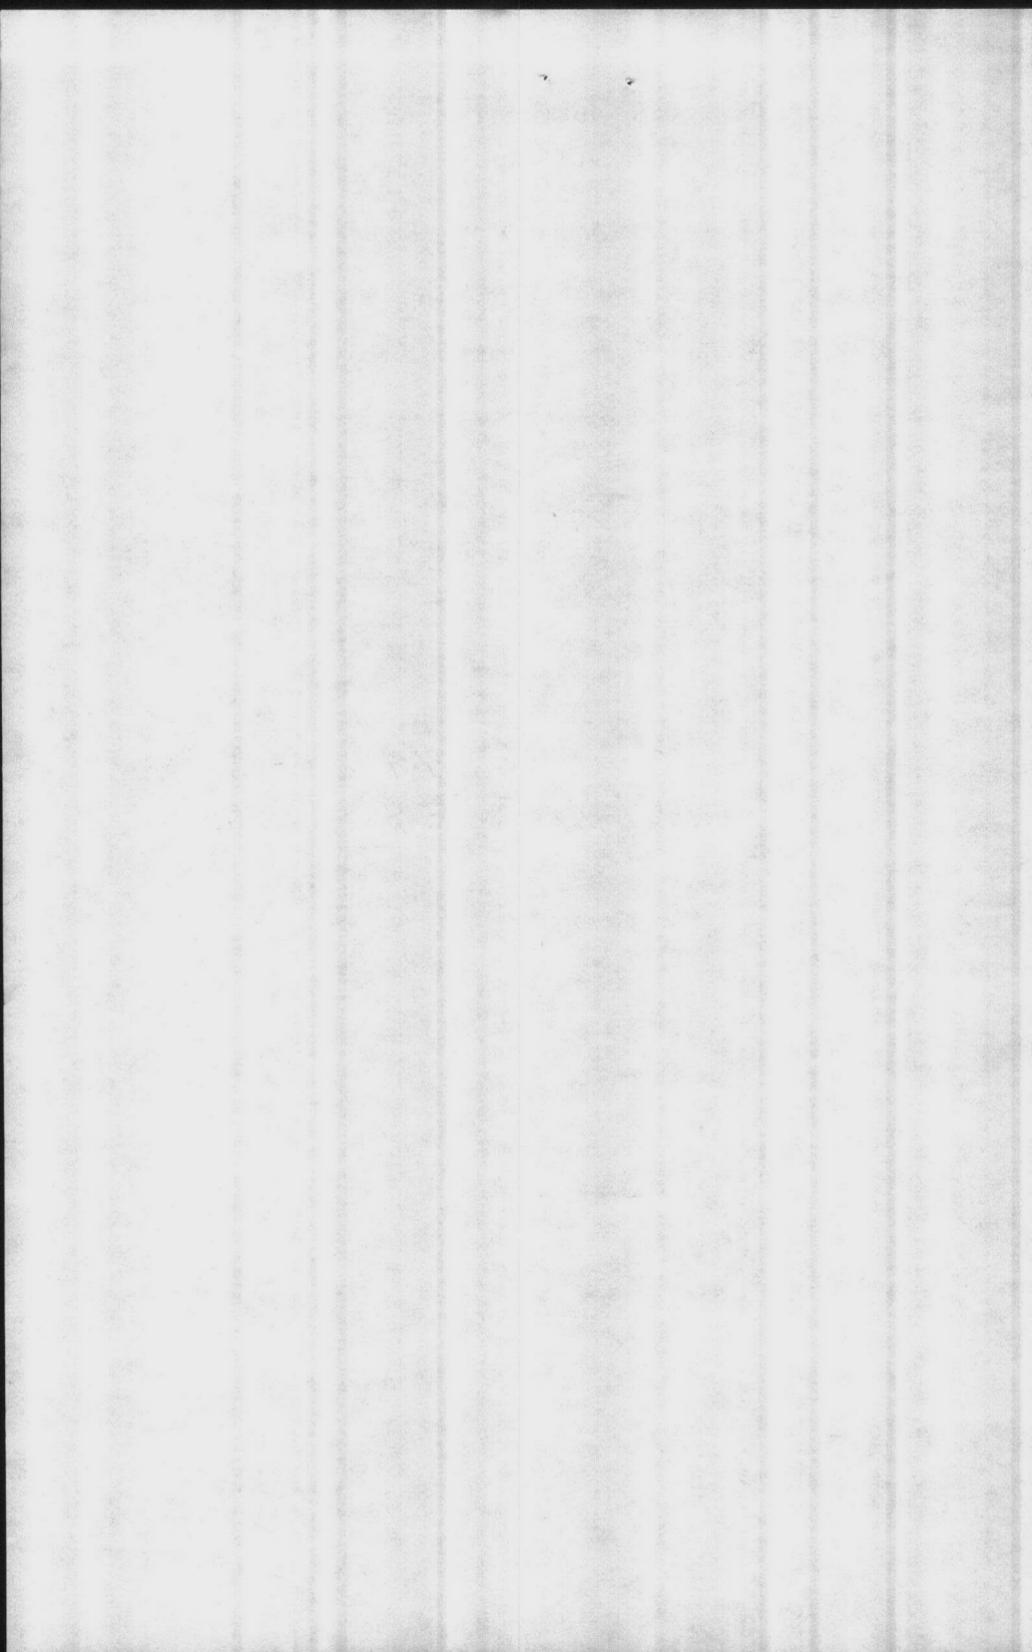

# DAILY FLUORIDE AND TURBIDITY REPORT

FROM: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 11/2/87

PLANT	FLUORIDE ppm		TURBIDITY NTUs	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	1.02	1.6	0.5
HOLCOMB BLVD	0.16	1.12	2.5	0.8
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11/2/87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: Bob

TIME: 09:45

DATE: 11/2/87

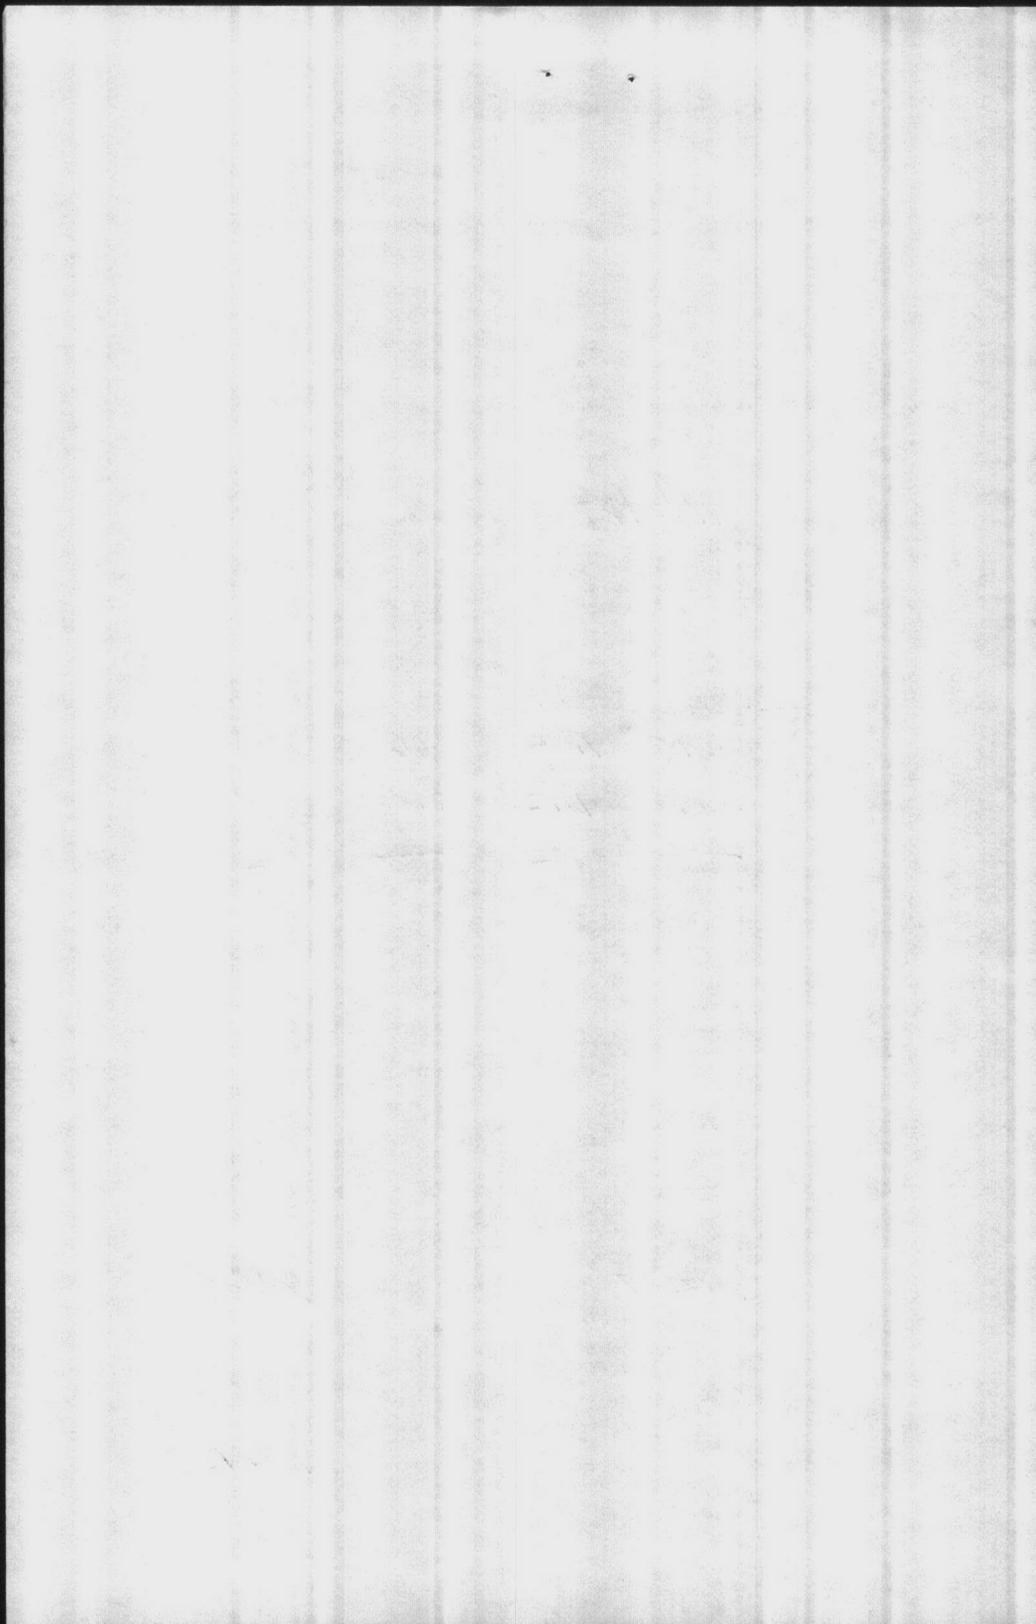

# DAILY FLUORIDE AND TURBIDITY REPORT

From: ENVIRONMENTAL CHEMISTRY + MICROBIOLOGY SECTION,  
NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

To: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT,  
UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 11-1-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	1.03	1.6	0.8
HOLCOMB BLVD	0.16	0.98	1.4	0.6
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 11/2/87

ANALYST: PSH

FLUORIDE PROCEDURE: PROBE


SPAGNS

CALLED TO: Sally

CALLED BY: PSH

TIME: 09:45

DATE: 11/2/87

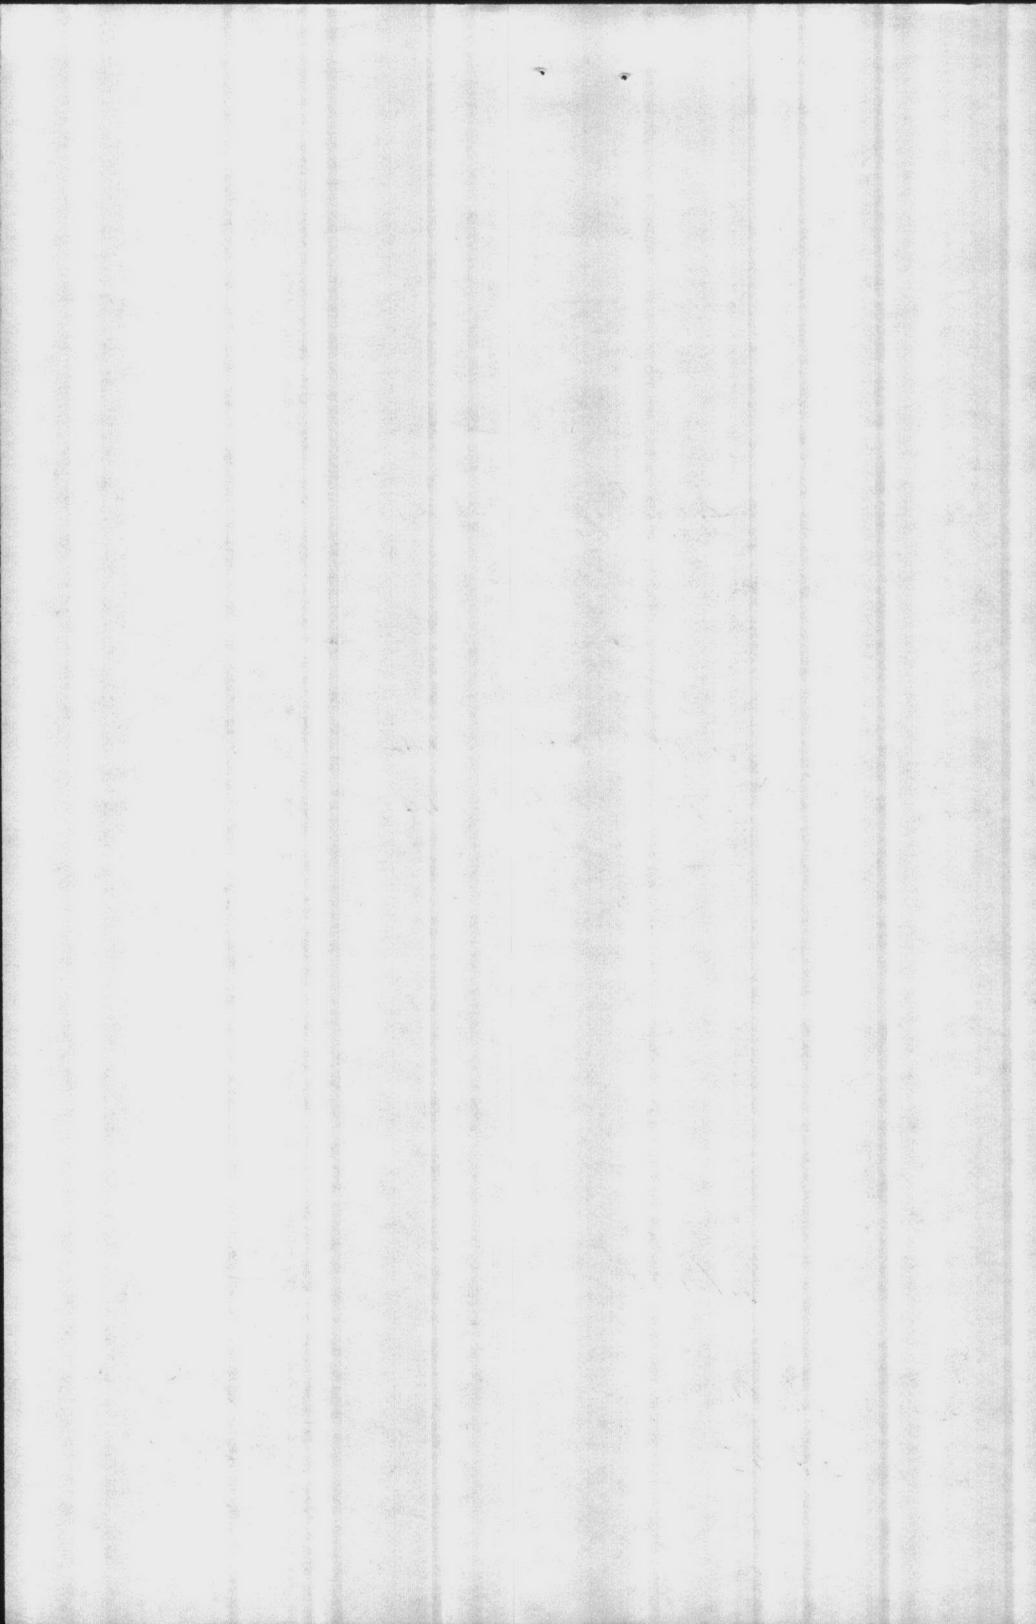

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-31-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.18	1.04			
HOLCOMB BLVD	0.20	0.96			
TARAWA TERRACE	—	—	—	—	—

REMARKS:

---

---


---

ANALYSIS DATE: 12-31-87 ANALYST: BURNS

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: SALTY CALLED BY: BURNS

TIME: \_\_\_\_\_ DATE: \_\_\_\_\_

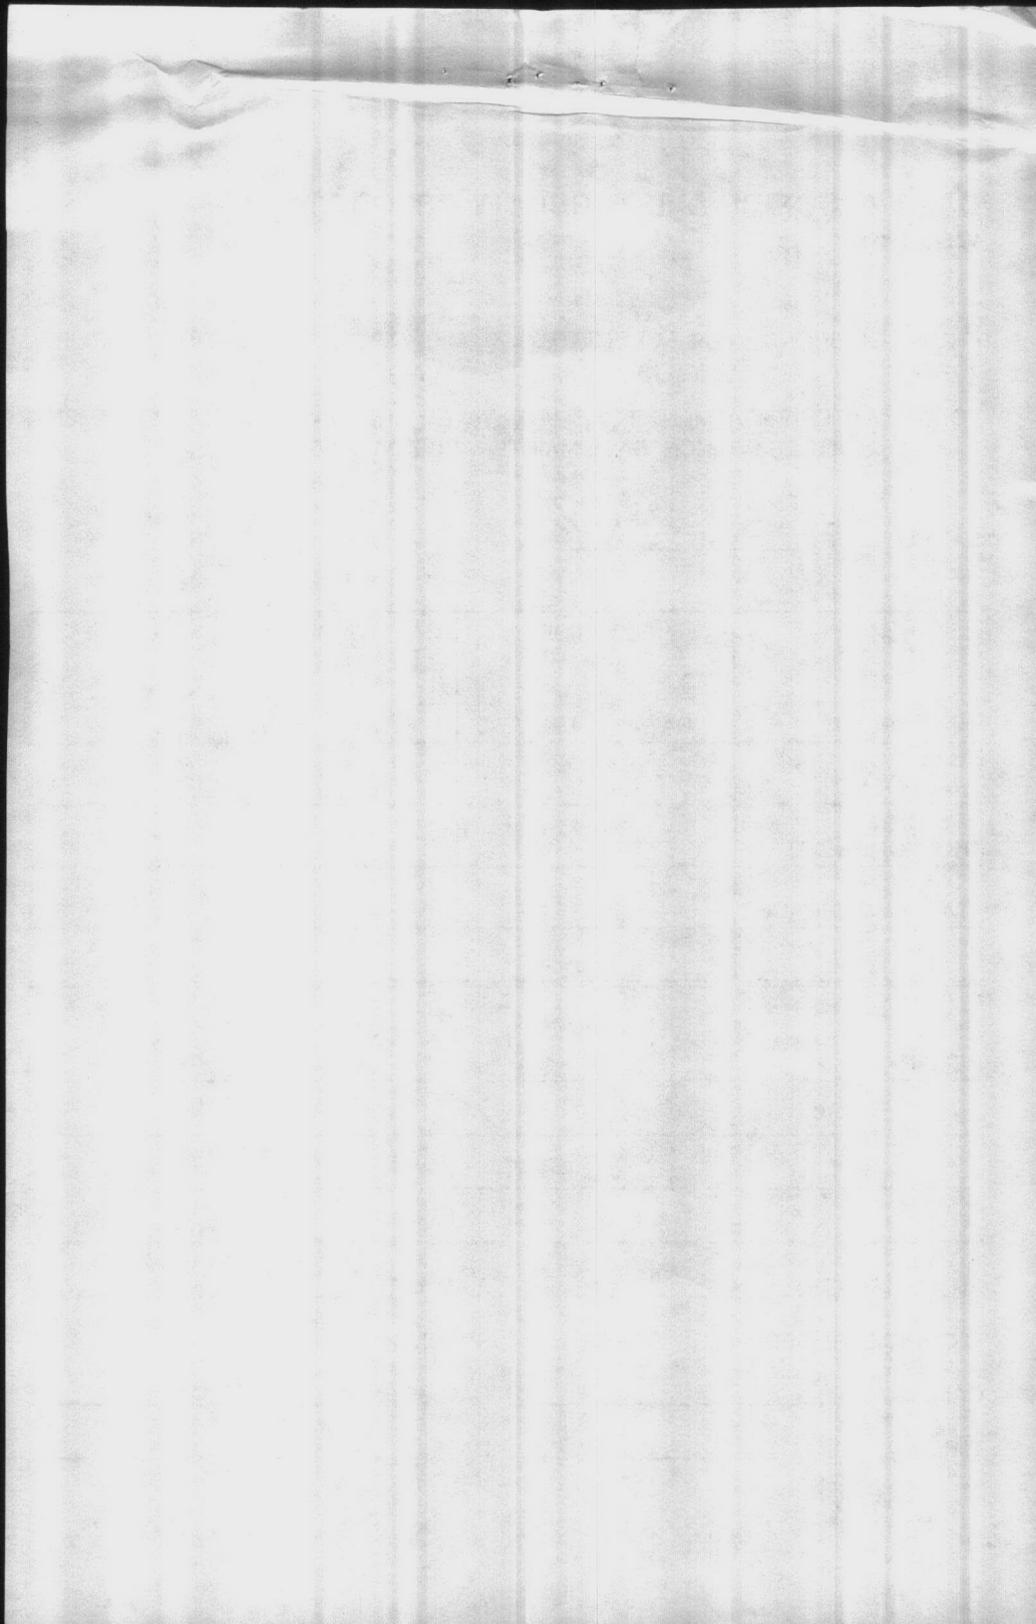

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-30-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.96	<del>                    </del>	<del>                    </del>
HOLCOMB BLVD	0.15	0.86		
TARAWA TERRACE				

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-30 ANALYST: Carol Shores

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: Case

TIME: 0935 DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-29-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.17	1.14	<del>          </del>	<del>          </del>	
HOLCOMB BLVD	0.17	0.91			
TARAWA TERRACE					

REMARKS:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-29

ANALYST: Carol Shone

FLOURIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: Carol

TIME: 925

DATE: \_\_\_\_\_

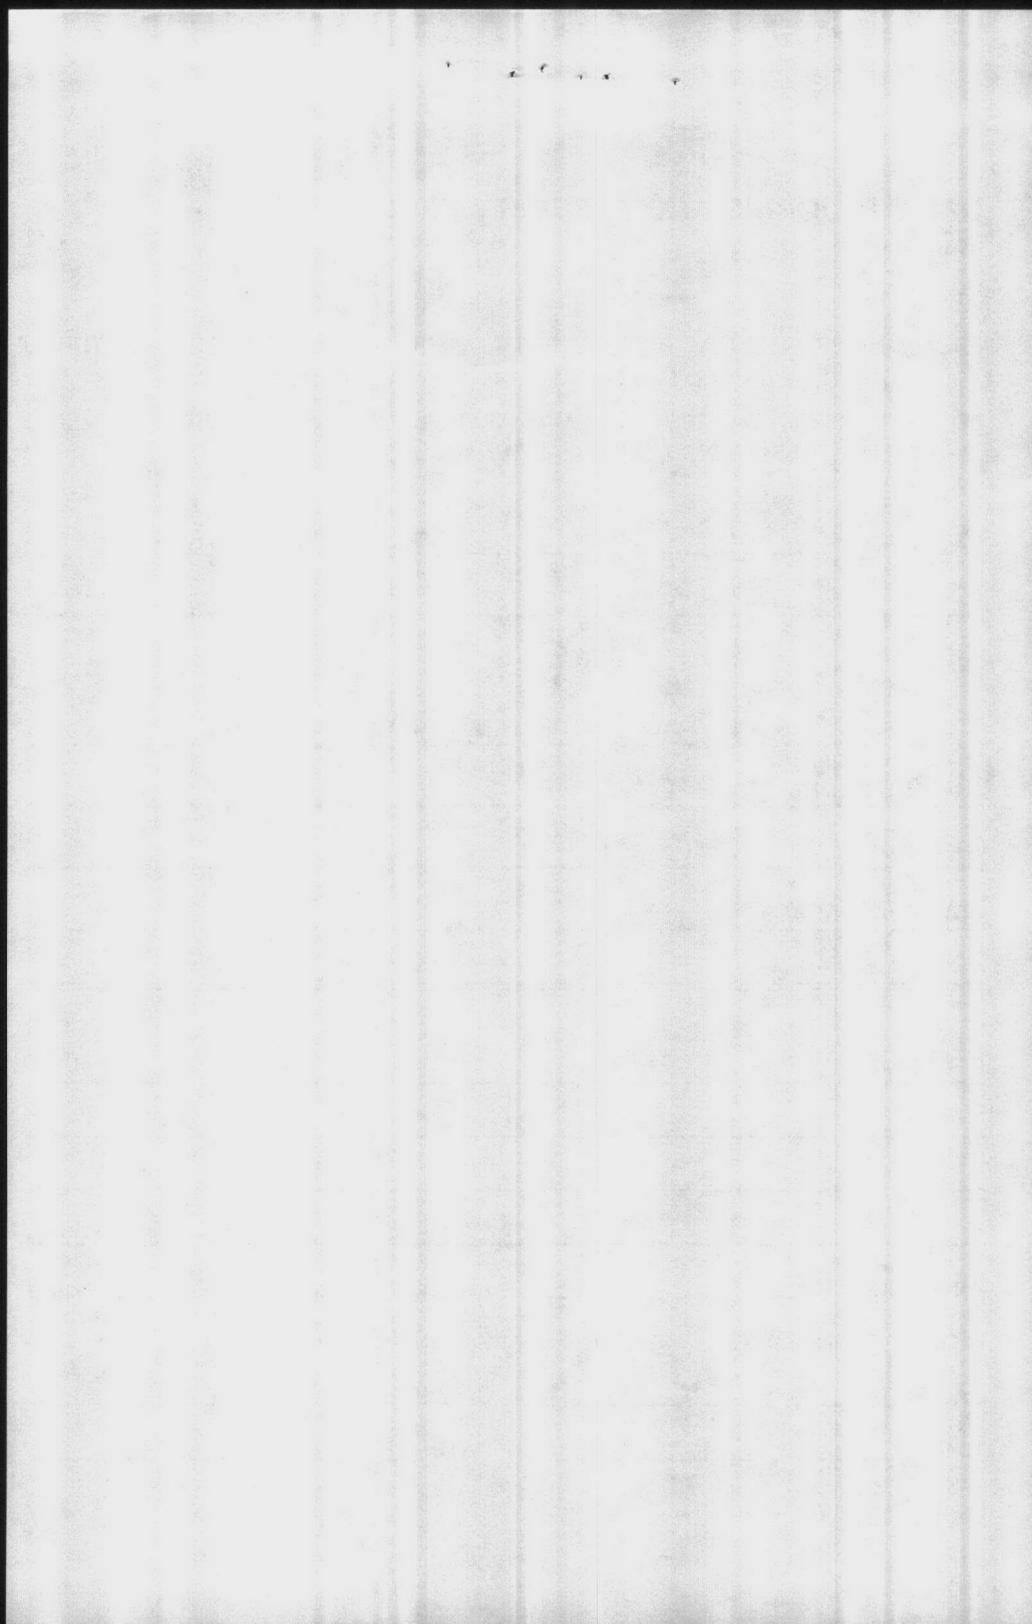

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Mon 12-20-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.15	0.94	—	—	
HOLCOMB BLVD	0.18	0.99	—	—	
TARAWA TERRACE	—	—	—	—	

REMARKS:

---

---

---

---

ANALYSIS DATE: 12-20-87

ANALYST: [Signature]

FLOURIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: [Signature]

TIME: 10:00

DATE: 12-20-87

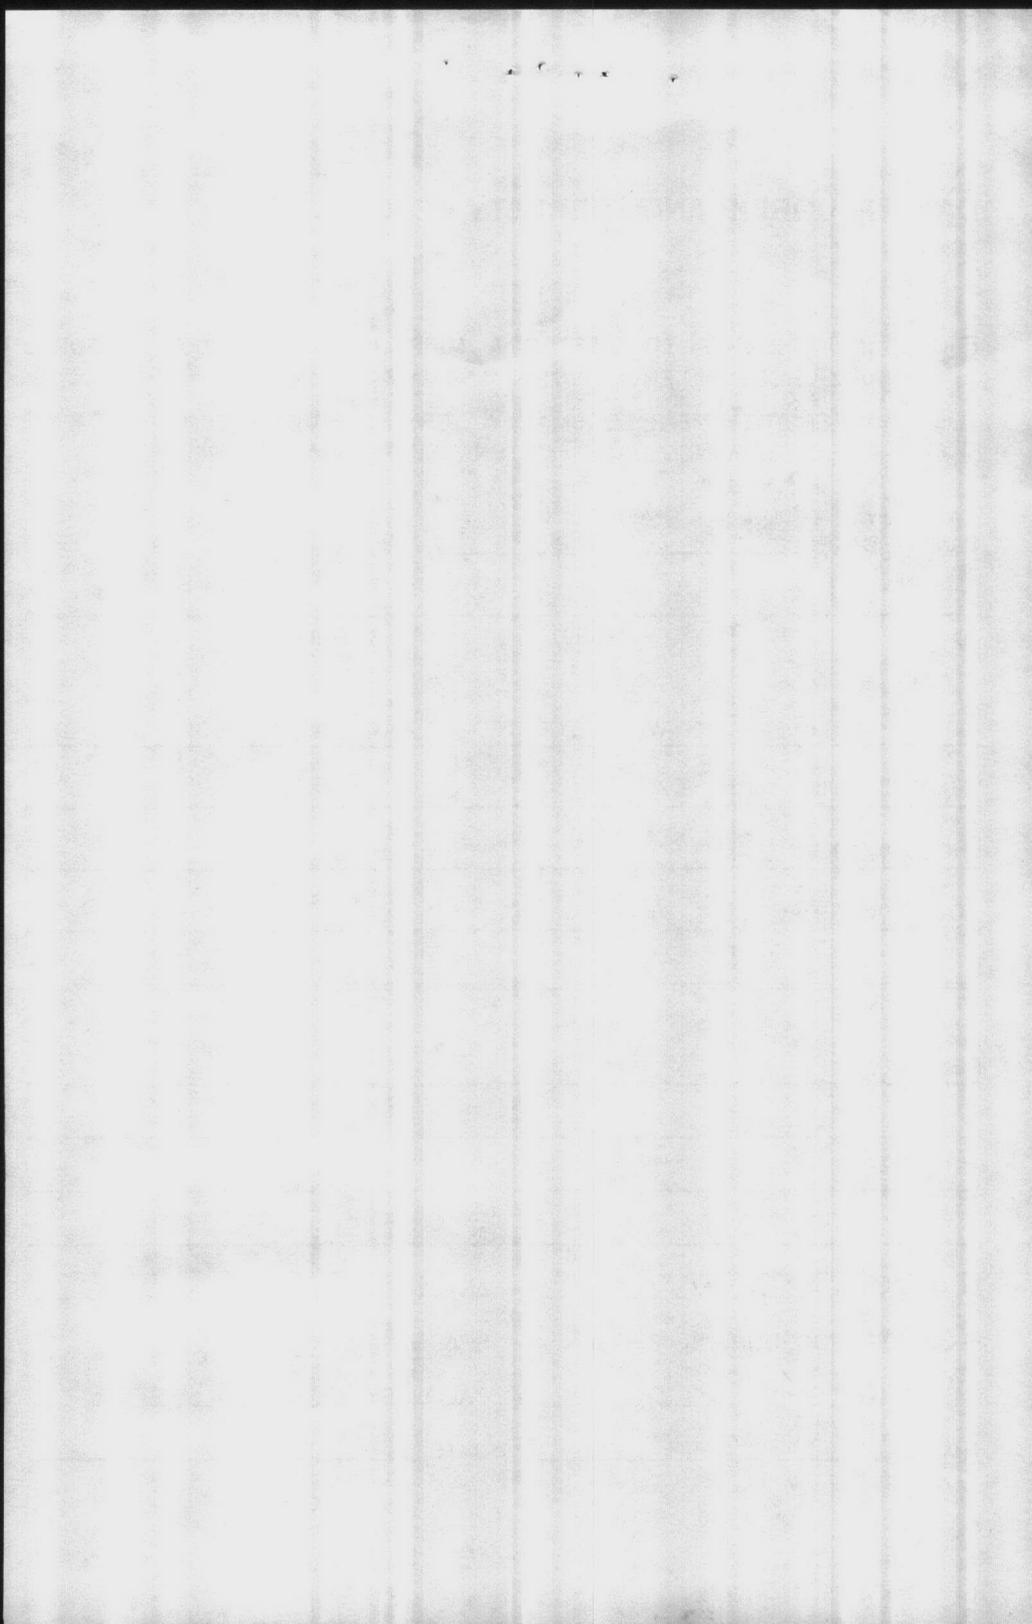

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Jan 12-27-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.70	—	—
HOLCOMB BLVD	0.18	0.90	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-28-87 ANALYST: B.S.

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: B.S.

TIME: 10:00 DATE: 12-28-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: sat 12-26-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.18	1.07	—	—	
HOLCOMB BLVD	0.17	0.93	—	—	
TARAWA TERRACE	—	—	—	—	

REMARKS:

---

---

---

ANALYSIS DATE: 12-28-87

ANALYST: AS

FLOURIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: AS

TIME: 16:50

DATE: 12-28-87

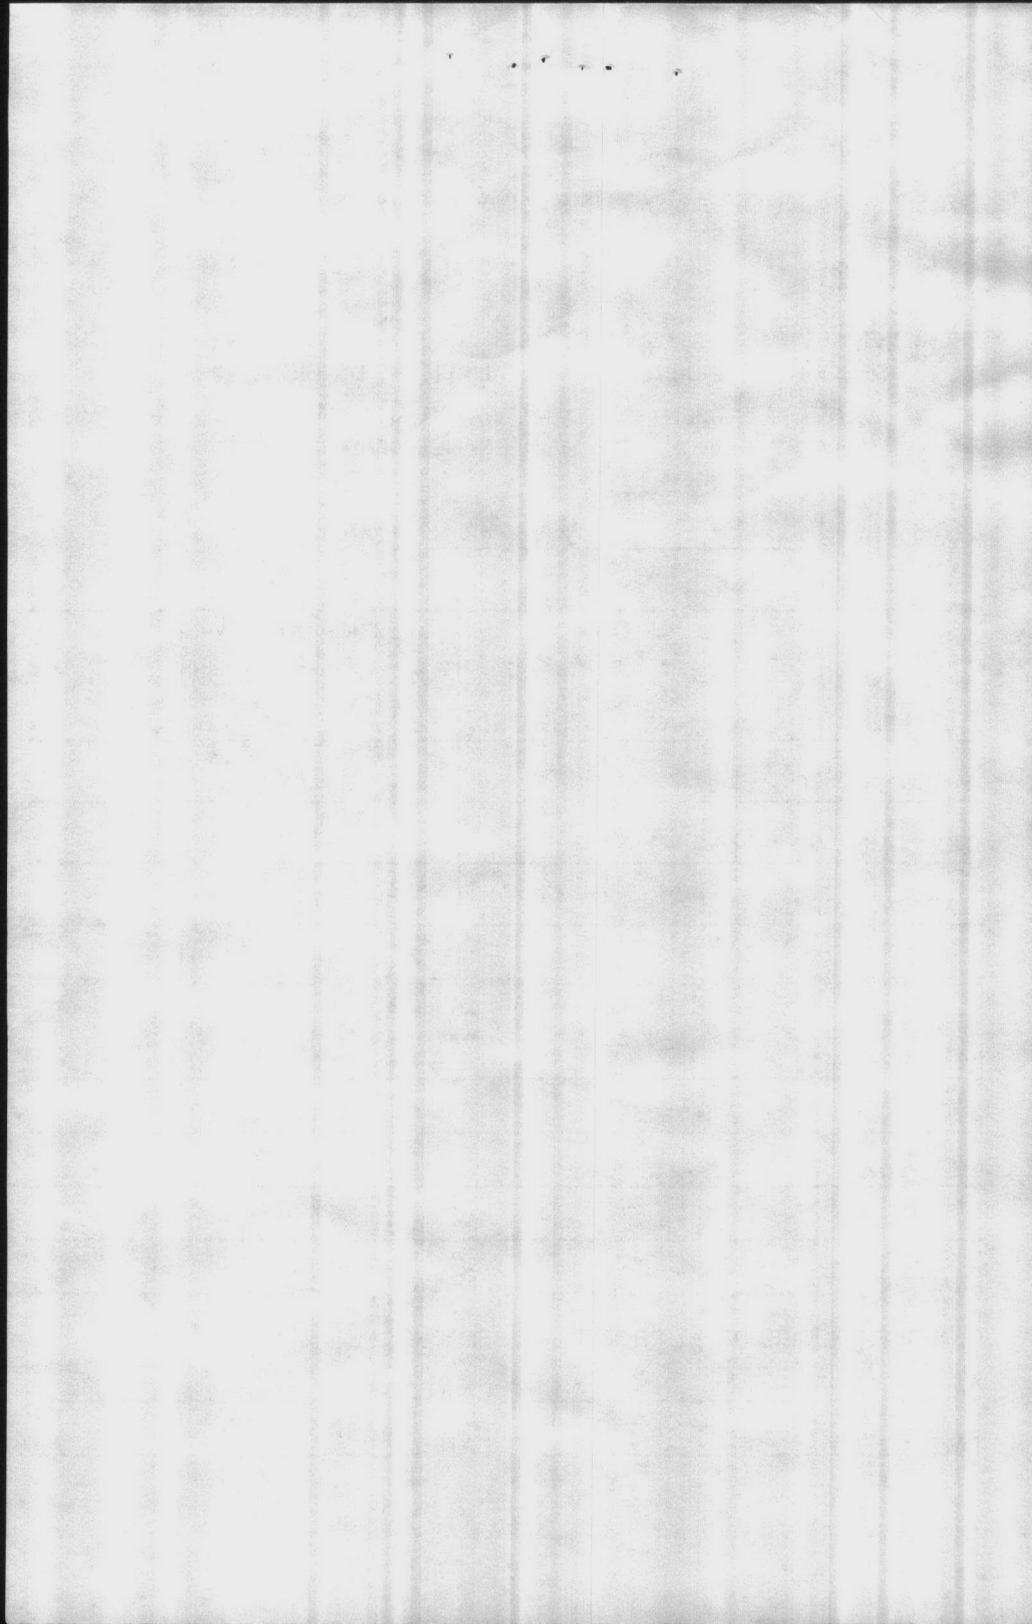

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-25-97

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.13	0.92			
HOLCOMB BLVD	0.16	0.85			
TARAWA TERRACE					

REMARKS:

---

---

---

ANALYSIS DATE: 12-25-97 ANALYST: Bel

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: [Signature] CALLED BY: Bel

TIME: 07:38 DATE: 12-25-97



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-24-07

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	0.99	—	—
HOLCOMB BLVD	0.15	0.80	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 12-24-07

ANALYST: RA

FLOURIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Pam

CALLED BY: RA

TIME: 09:30

DATE: 12-24-07



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-23-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	0.97	—	—
HOLCOMB BLVD	0.16	0.81	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-23-87 ANALYST: Bul

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: Bul

TIME: 13:25 DATE: 12-23-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-22-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.17	0.98	<del>                    </del>	<del>                    </del>	
HOLCOMB BLVD	0.17	0.94			
TARAWA TERRACE					

REMARKS:

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

ANALYSIS DATE: 12-22-87 ANALYST: Carol Shaw

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: \_\_\_\_\_ CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_ DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 12-21-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.44	—	—
HOLCOMB BLVD	0.18	1.11	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-21-87 ANALYST: BW

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: BW

TIME: 0921 DATE: 11-22-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 12-22-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.71	—	—
HOLCOMB BLVD	0.18	0.97	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-21-87 ANALYST: BSL

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Rally CALLED BY: BSL

TIME: 0.925 DATE: 12-21-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-19-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.15	1.01	<del>_____</del>	<del>_____</del>
HOLCOMB BLVD	0.17	1.06	<del>_____</del>	<del>_____</del>
TARAWA TERRACE	<del>_____</del>	<del>_____</del>	<del>_____</del>	<del>_____</del>

REMARKS: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-19-87 ANALYST: Hub

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Hartsne CALLED BY: Hub

TIME: 1255 DATE: 12-19-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-18-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.13	0.50	—	—
HOLCOMB BLVD	0.14	0.92	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

ANALYSIS DATE: 12-18-87

ANALYST: [Signature]

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Miller

CALLED BY: [Signature]

TIME: 0950

DATE: 12-18-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-17-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.99	—	—
HOLCOMB BLVD	0.15	0.80	—	—
TARAWA TERRACE	—	—	—	—


REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-17-87 ANALYST: ASL

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Shell CALLED BY: ASL

TIME: 10.06 DATE: 12-17-87

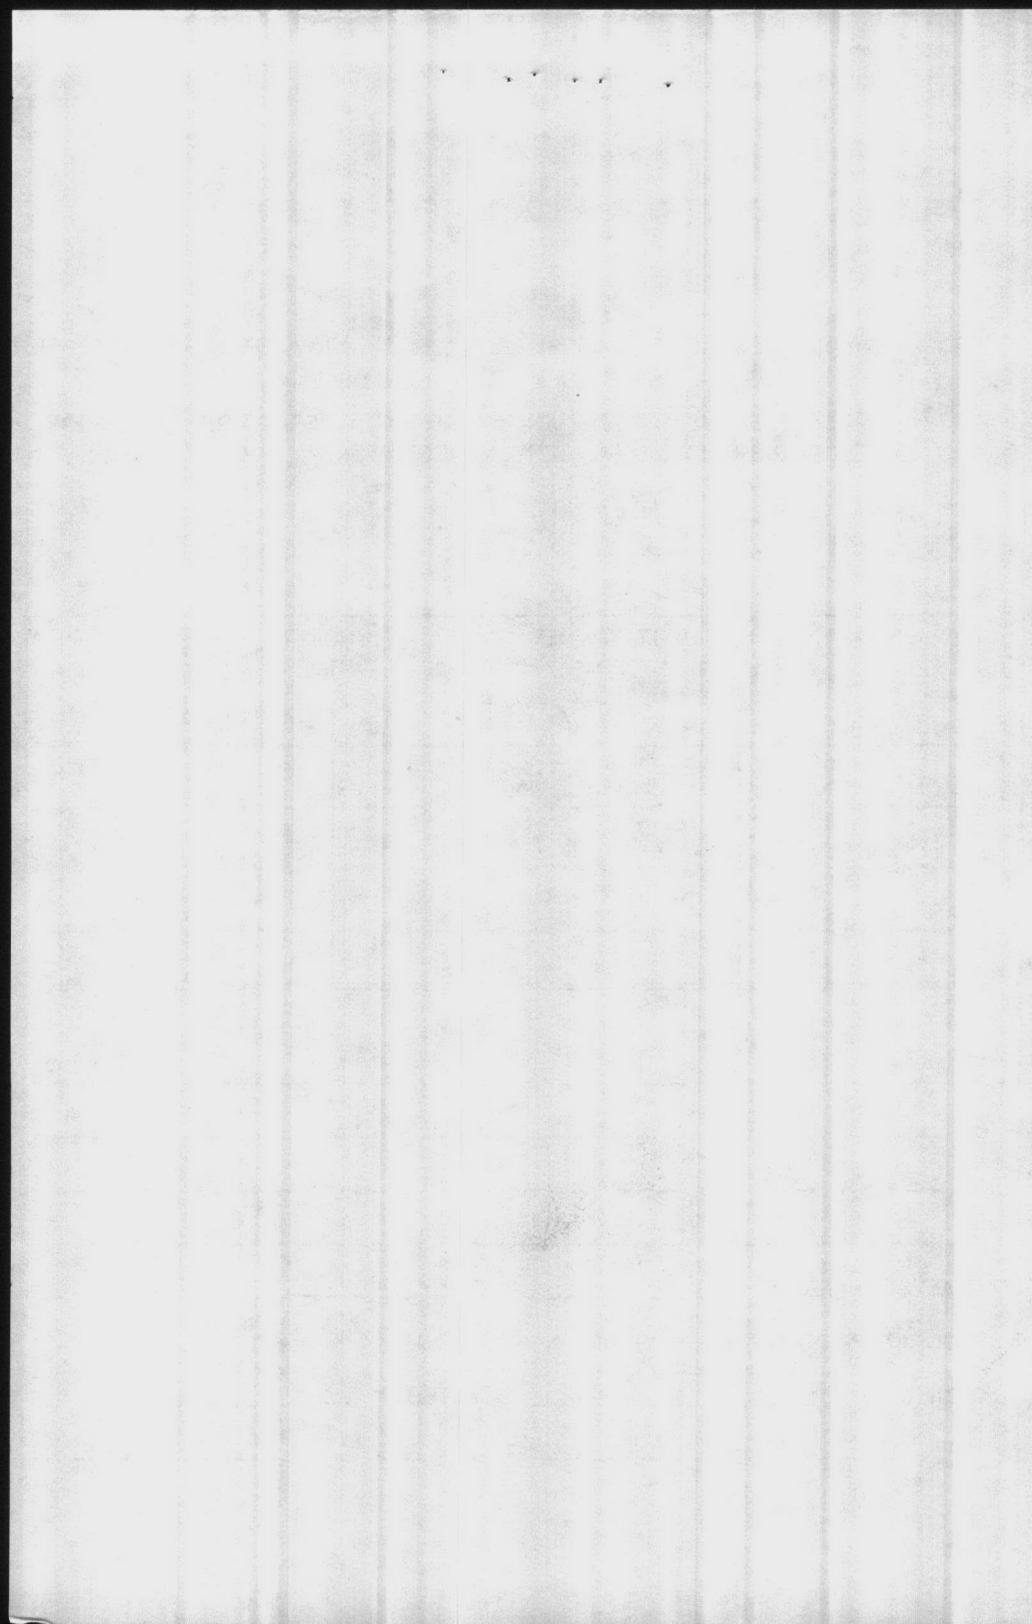

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-16-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.87	—	—
HOLCOMB BLVD	0.16	0.90	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 12-16-87

ANALYST: ASH

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Dollard

CALLED BY: ASH

TIME: 0930

DATE: 12-16-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION  
TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-15-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.97	—	—
HOLCOMB BLVD	0.18	0.98	—	—
TARAWA TERRACE	—	—	—	—


REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-15-87 ANALYST: [Signature]

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: [Signature] CALLED BY: [Signature]

TIME: 0911 DATE: 12-15-87

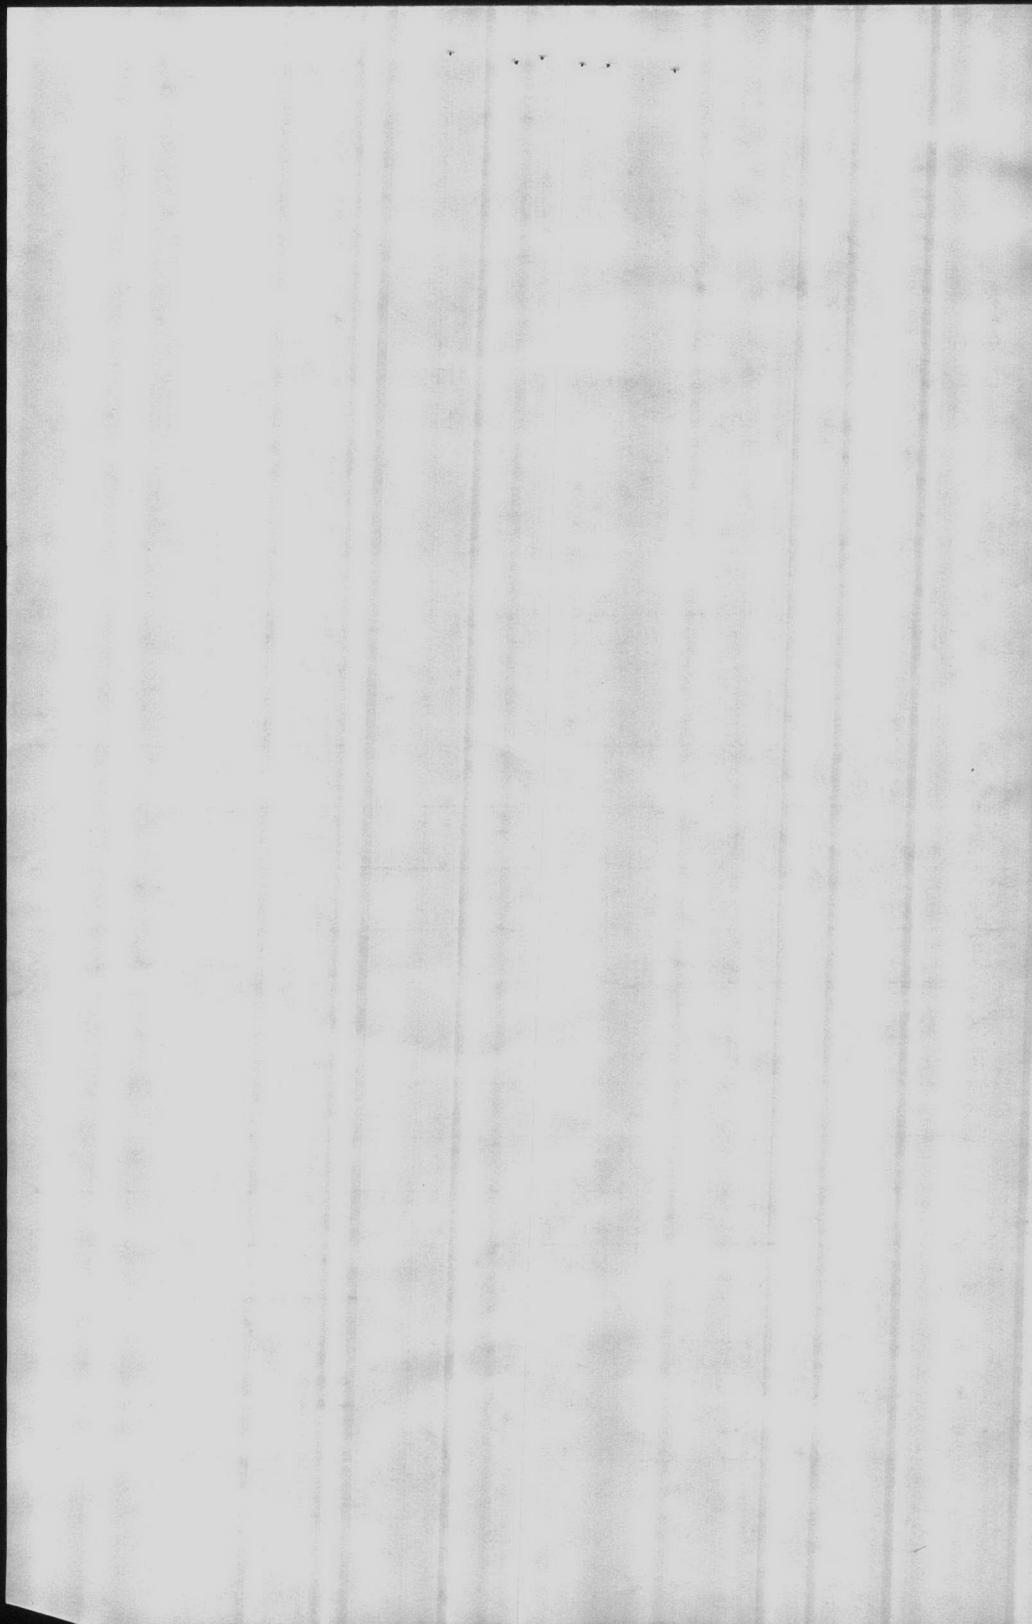

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 12-14-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.18	0.99	—	—
HOLCOMB BLVD	0.17	1.03	—	—
TARAWA TERRACE	—	—	—	—
	—			

REMARKS:

ANALYSIS DATE: 12-14-87

ANALYST: Bob

FLUORIDE PROCEDURE: PROBE


SPADNS

CALLED TO: Sally

CALLED BY: Bob

TIME: 09.25

DATE: 12-14-87

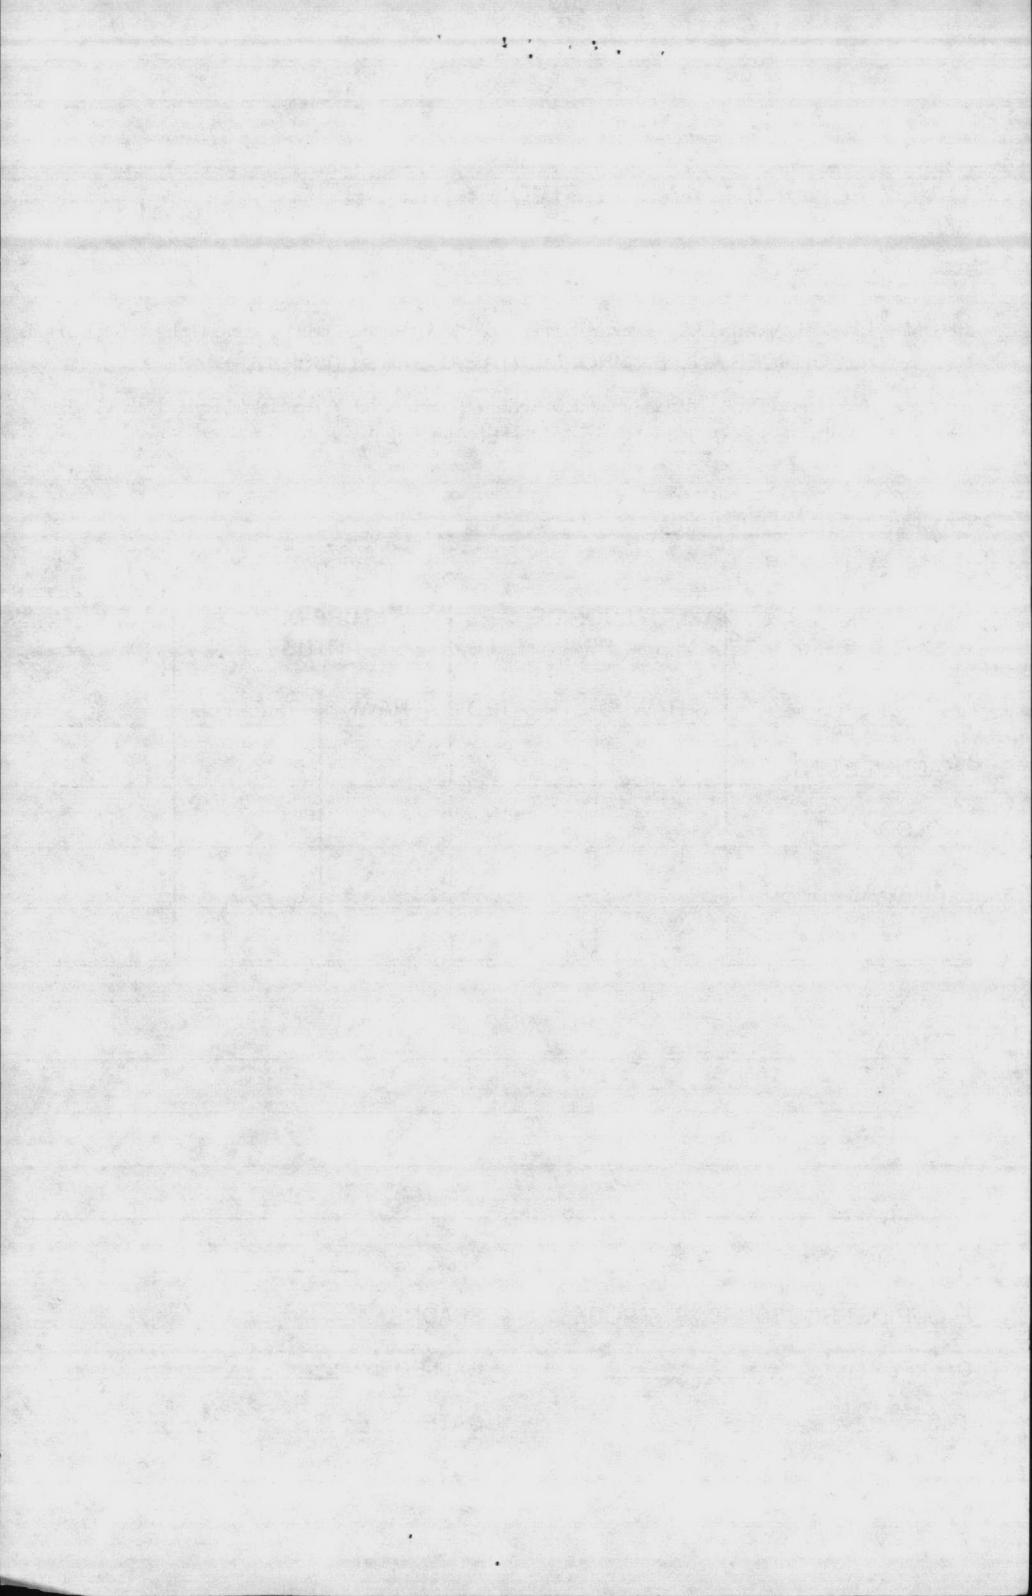

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 12-13-07

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	0.98	—	—
HOLCOMB BLVD	0.18	1.02	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-14-07 ANALYST: Bob

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: Bob

TIME: 09:25 DATE: 12-14-07



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-12-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.88	<del>X</del>	
HOLCOMB BLVD	0.16	0.99		
TARAWA TERRACE				


REMARKS:

ANALYSIS DATE: 12-12-87 ANALYST: Carol Shan

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: \_\_\_\_\_ CALLED BY: Carol

TIME: \_\_\_\_\_ DATE: 12-12

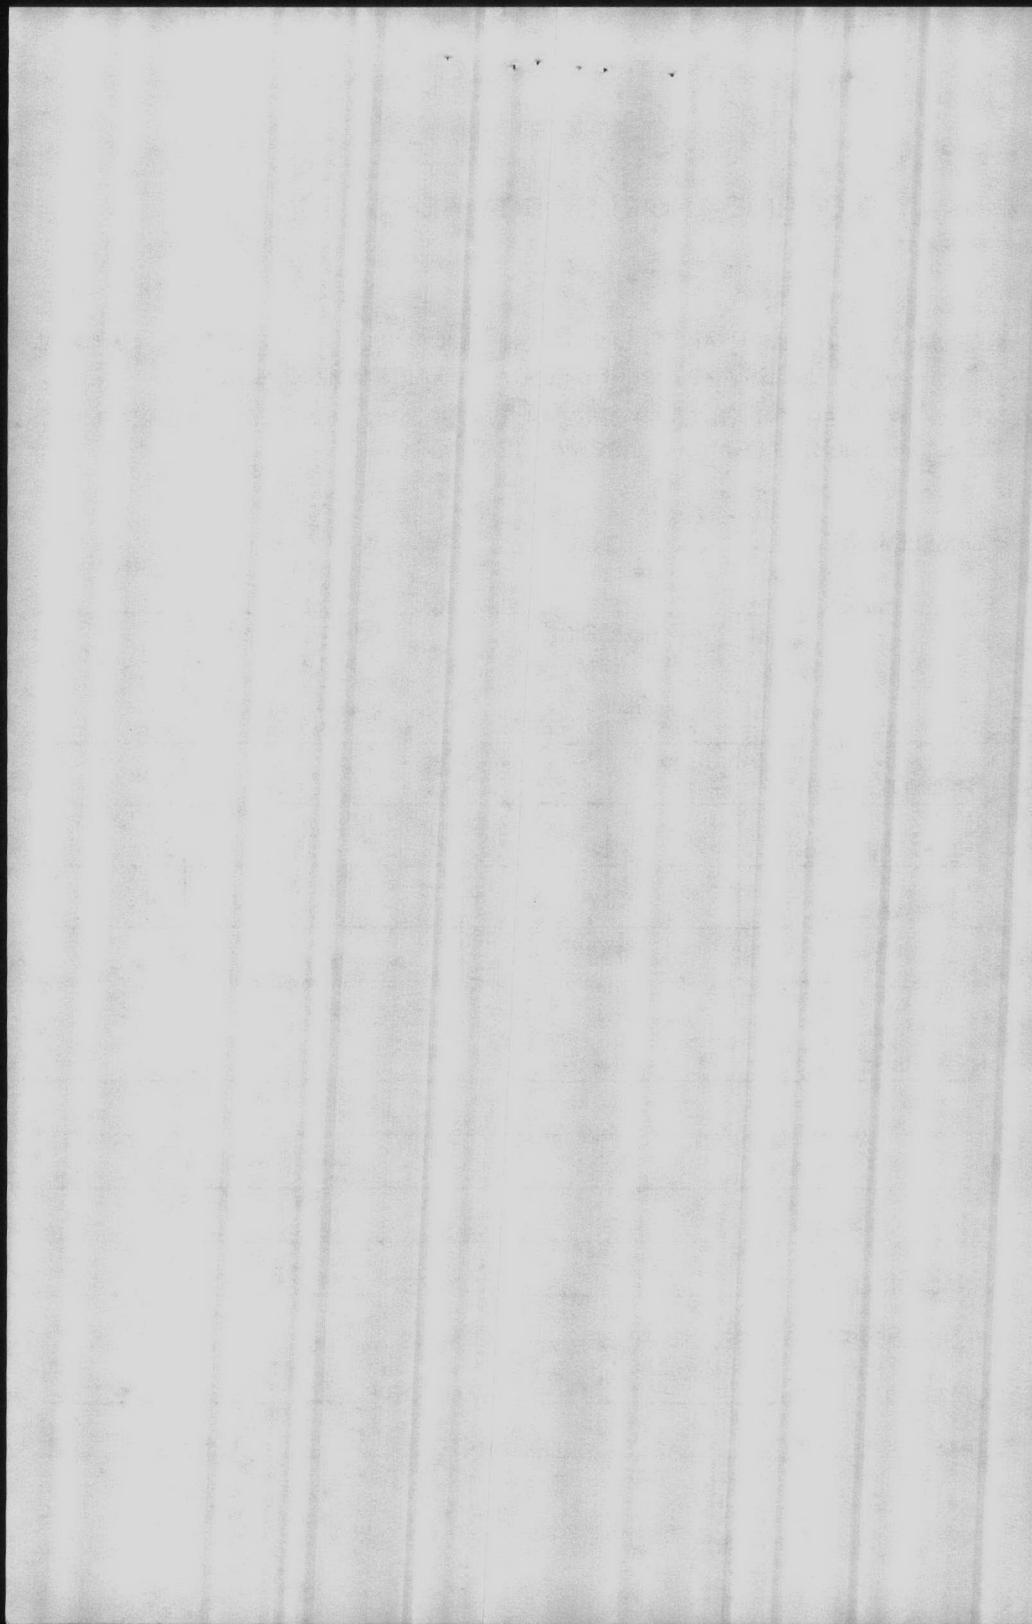

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-11-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	1.13	—	—
HOLCOMB BLVD	0.17	1.07	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-11-87 ANALYST: Bob

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: Kennedy CALLED BY: Bob

TIME: 09:30 DATE: 12-11-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-10-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.98	—	—
HOLCOMB BLVD	0.15	1.07	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-10-87 ANALYST: [Signature]

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: [Signature] CALLED BY: [Signature]

TIME: 0624 DATE: 12-10-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-9-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.16	0.83	—	—
HOLCOMB BLVD	0.14	1.01	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-9-87 ANALYST: [Signature]

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: [Signature]

TIME: 09:20 DATE: 12-9-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-8-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	0.86	—	—
HOLCOMB BLVD	0.16	1.21	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 12-8-87

ANALYST: [Signature]

FLOURIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Milton

CALLED BY: [Signature]

TIME: 09:05

DATE: 12-1-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Monday 12-7-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	0.91	—	—
HOLCOMB BLVD	0.16	1.30	—	—
TARAWA TERRACE	—	—	—	—

REMARKS: MCHS 110 PH 7.8

ANALYSIS DATE: 12-7-87

ANALYST: BS

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Sally

CALLED BY: BS

TIME: 09:40

DATE: 12-7-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: Sunday 12-6-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.14	0.89	—	—
HOLCOMB BLVD	0.14	1.27	—	—
TARAWA TERRACE	—	—	—	—


REMARKS:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ANALYSIS DATE: 12-7-87 ANALYST: Bed

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: BSA

TIME: 0940 DATE: 12-7-87

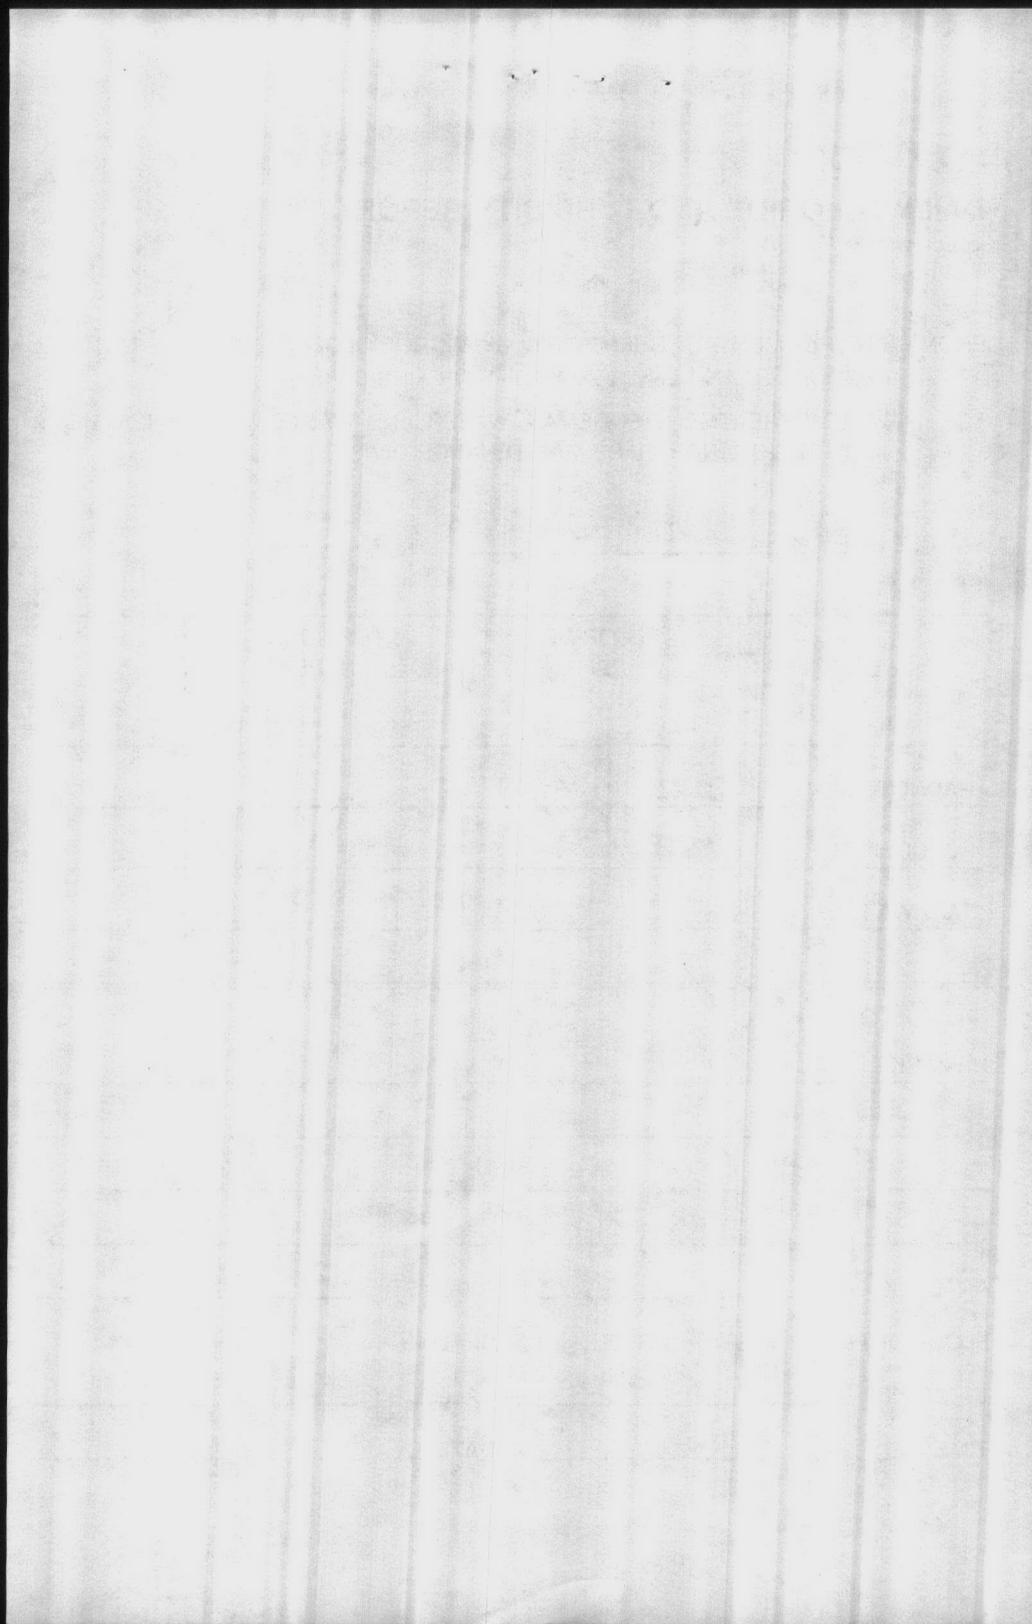

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-5-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.22	0.95	/	
HOLCOMB BLVD	0.18	1.25		
TARAWA TERRACE	0.18	1.25		

REMARKS:

---

---


---

ANALYSIS DATE: 12-5-87 ANALYST: BURNS

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: \_\_\_\_\_ CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_ DATE: \_\_\_\_\_

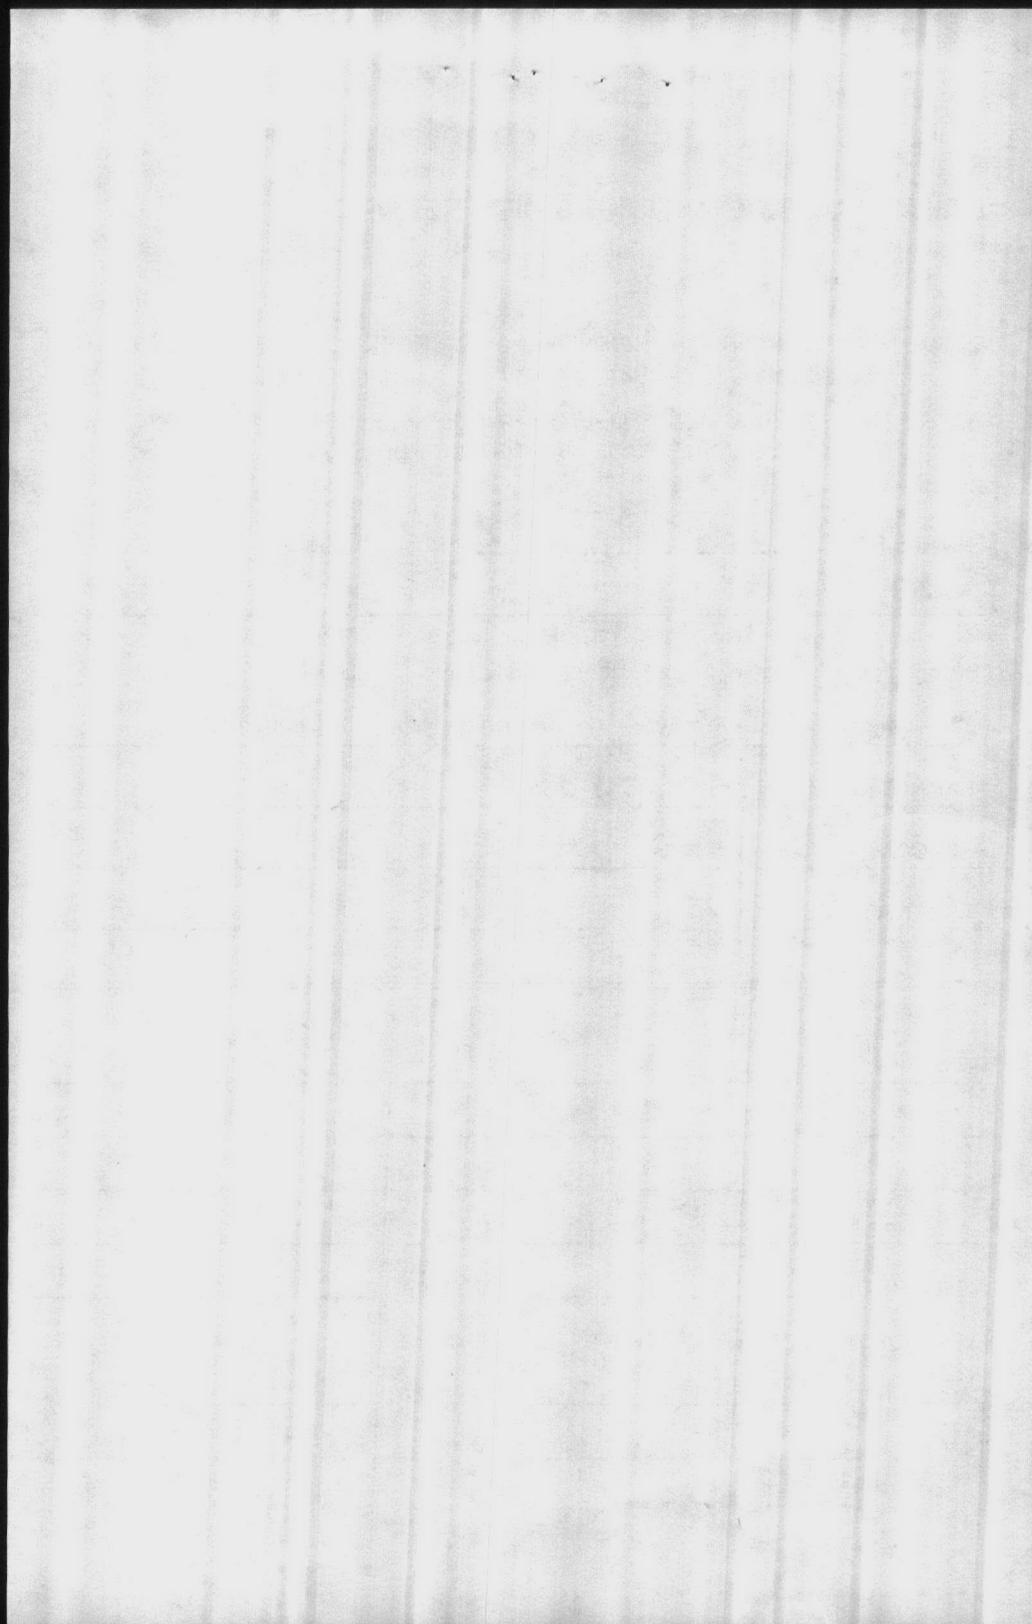

# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-4-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.18	0.90	—	—	
HOLCOMB BLVD	0.15	1.19	—	—	
TARAWA TERRACE	—	—	—	—	

REMARKS:

---

---

---

ANALYSIS DATE: 12-4-87 ANALYST: Bcl

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: Bcl

TIME: 09:00 DATE: 12-4-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-3-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.19	0.91	—	—
HOLCOMB BLVD	0.16	1.12	—	—
TARAWA TERRACE	—	—	—	—

REMARKS:

---

---

---

ANALYSIS DATE: 12-3-87

ANALYST: RSJ

FLUORIDE PROCEDURE: PROBE

SPADNS

CALLED TO: Dave

CALLED BY: RSJ

TIME: 09:15

DATE: 12-3-87



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-2-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS	
	RAW	TREATED	RAW	TREATED
HADNOT POINT	0.17	<sup>0.17</sup> 0.76	—	—
HOLCOMB BLVD	0.13	1.09	—	—
TARAWA TERRACE	—	—	—	—

REMARKS: called for a repeat sample from H.P. (treated)

ANALYSIS DATE: 12-2-87 ANALYST: Sok

FLUORIDE PROCEDURE: PROBE SPADNS

CALLED TO: \_\_\_\_\_ CALLED BY: \_\_\_\_\_

TIME: \_\_\_\_\_ DATE: \_\_\_\_\_



# DAILY FLUORIDE AND TURBIDITY REPORT

MCBCL 11330/17

FROM: ENVIRONMENTAL CHEMISTRY & MICROBIOLOGY SECTION, NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS DIVISION

TO: WATER TREATMENT FOREMAN, WATER AND WASTEWATER TREATMENT, UTILITIES BRANCH, BASE MAINTENANCE DIVISION

SAMPLE DATE: 12-1-87

PLANT	FLUORIDE PPM		TURBIDITY NTUS		
	RAW	TREATED	RAW	TREATED	
HADNOT POINT	0.17	0.80	—	—	
HOLCOMB BLVD	0.16	1.02	—	—	
TARAWA TERRACE	—	—	—	—	

REMARKS:

---

---

---

ANALYSIS DATE: 12-1-87 ANALYST: Bob

FLOURIDE PROCEDURE: PROBE SPADNS

CALLED TO: Sally CALLED BY: Bob

TIME: 09.05 DATE: 12-1-87

