

BACTERIOLOGICAL ANALYSIS OF WATER
MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.8	1455	MCAS - 3502	24	0	0.4	0915	TIME RECEIVED 13226 1521
RR - 15	2	0	0.5	1500	MCAS - 2002	25	0	0.5	0900	DATE RECEIVED 10-6-87
RR - 10	3	0	0.8	1505	MCAS - 4157	26	0	0.4	0930	ACCEPTED BY <i>Bob</i>
	4				MCAS - 1323	27	0	0.8	1030	DATE ANALYZED 10-6-87
A-47	5	0	0.2	1435		28				ANALYSIS STARTED 1430
BB - 7	6	0	0.9	1050	NRMC -	29	0	0.6	1140	ANALYSIS FINISHED 1530
BB - 49	7	0	1.0	1430	PP - 2615	30	0	0.6	1115	INCUBATOR TEMP 35.2
BB - 245	8	0	1.2	1415	PP - 2600	31	0	0.5	1125	PROCESSED BY <i>Bob</i>
	9				BM - 5400	32	0	0.6	1150	
BA - 103	10	0	1.0	1030	BM - 1985	33	0	0.6	1200	CUSTODY DATA
BA - 101	11	0	1.0	1048	LCH - 4022	34	0	0.9	1215	DATE
	12				LCH - 4000	35	0	0.9	1225	TIME
TT - 38	13	0	1.0	0900		36				SIGNATURE
TT - 43	14	0	1.0	0920	H - 1	37	0	0.7	1055	DATE
TT - 2465	15	0	1.0	0955	H - 16	38	0	0.7	1045	TIME
	16				FC - 303	39	0	0.6	0915	SIGNATURE
CK - 1012	17	0	0.8	1020	FC - 420	40	0	0.6	0925	
M - 139	18	* 0	1.0	1115	FC - 3235	41	0	0.6	0935	COPY TO:
M - 130	19	* 0	0.9	1045	HP - 236	42	0	0.8	1010	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.8	1030	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.3	0945	HP - 1300	44	0	0.7	0900	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22	0	0.8	1000	HP - 1202	45	0	0.7	0910	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC - D01	23	0	0.8	1015		46				<input type="checkbox"/> _____

REMARKS * # 18 = 35 Non-Coliforms
19 = 40 Non-Coliforms

SIGNATURE

Robert G. Dwyer

1871
1872
1873
1874
1875
1876
1877
1878
1879
1880
1881
1882
1883
1884
1885
1886
1887
1888
1889
1890
1891
1892
1893
1894
1895
1896
1897
1898
1899
1900

BACTERIOLOGICAL ANALYSIS OF WATER


NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0			1425
SH-8	0	0.5		0950
TT POOL				
M.P. POOL	0	0.6	7.4	1130
#2 POOL	0	0.8	7.4	1015
#5 POOL	0	1.0	7.4	1025
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 10-6-87	DATE ANALYZED 10-6-87	COPY TO: <input type="checkbox"/> UTIL DIR
COLLECTED BY	ANALYSIS STARTED 14:30	
TIME RECEIVED 15:21	ANALYSIS FINISHED 15:30	<input checked="" type="checkbox"/> WATER TREATMENT
DATE RECEIVED 10-6-87	INCUBATOR TEMP 35.2	<input checked="" type="checkbox"/> PMU <input type="checkbox"/> MCAS PMU
ACCEPTED BY	PROCESSED BY [Signature]	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
SIGNATURE [Signature]		<input type="checkbox"/> _____

REMARKS

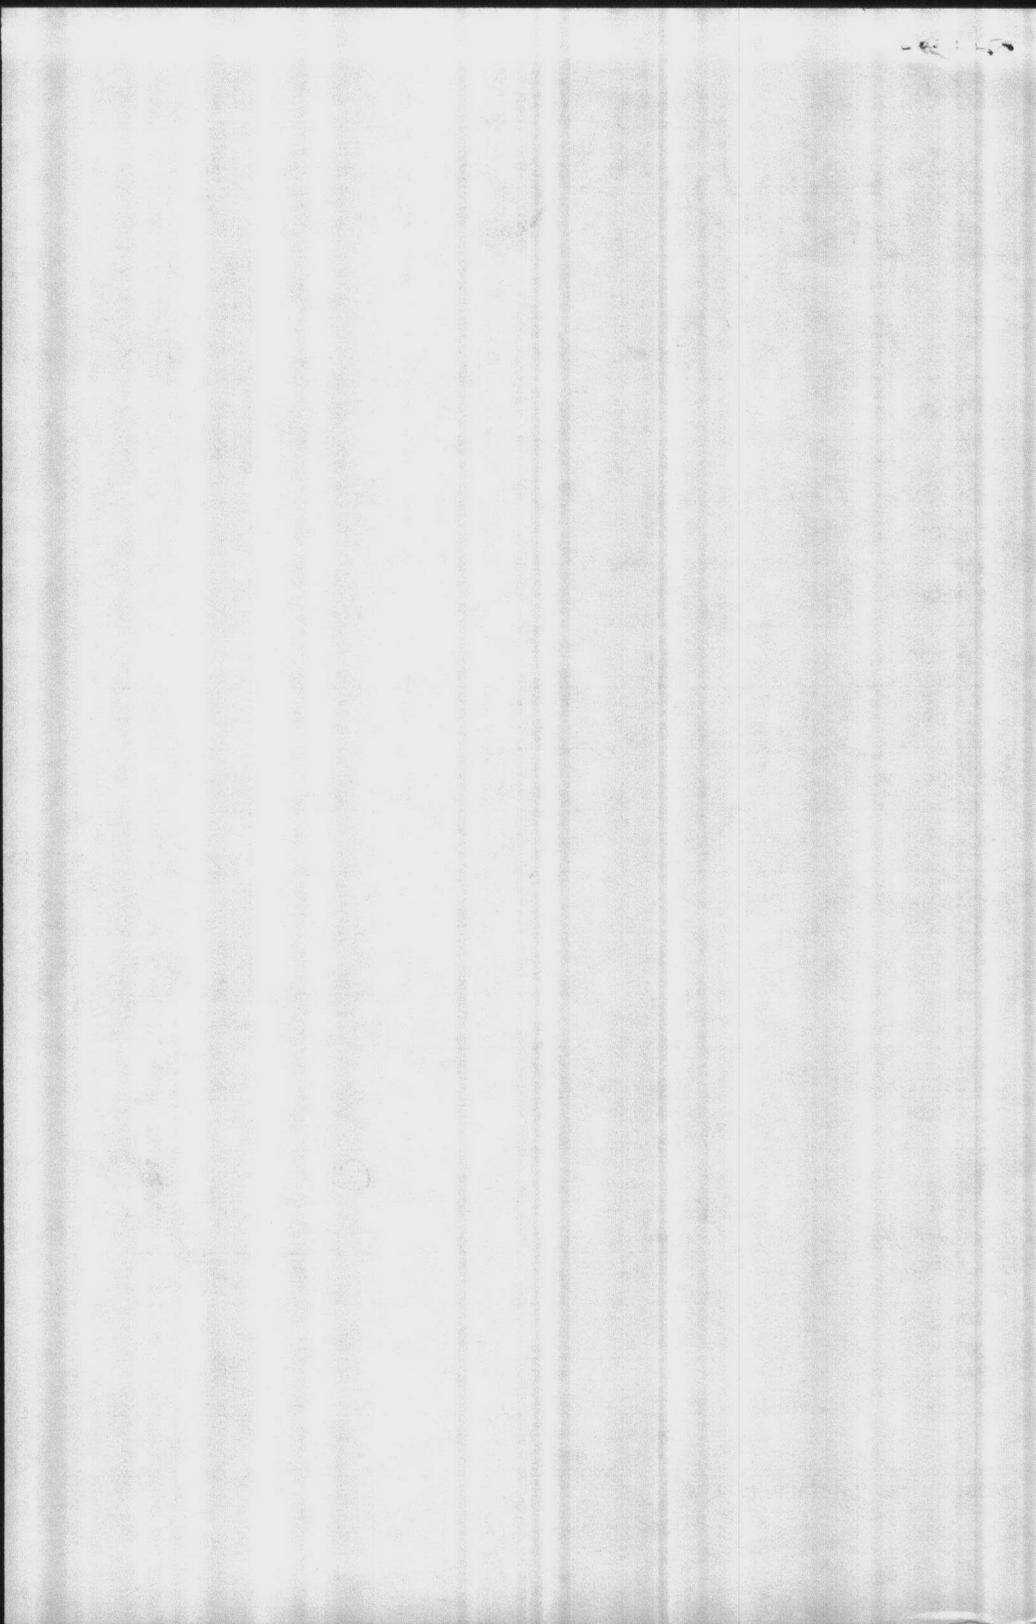

BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED
 10-13-87


REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.8	1000	MCAS - 3502	24	0	0.3	0935	TIME RECEIVED 1145-1245
RR - 15	2	0	0.8	1015	MCAS - 2002	25	0	0.5	0900	DATE RECEIVED 10-13-87
RR - 10	3	0	0.8	1025	MCAS - 4157	26	0	0.4	0950	ACCEPTED BY <i>Robert D. Dwyer</i>
	4				MCAS - 2075	27	0	0.5	0920	DATE ANALYZED 10-13-87
A-47	5	0	1.0	0940		28				ANALYSIS STARTED 1300
BB - 7	6	0	1.0	0905	NRMC - food service	29	0	0.7	1215	ANALYSIS FINISHED 1415
BB - 49 1265	7	0	1.0	1125	PP - 2615 o club	30	0	0.5	1135	INCUBATOR TEMP 25.2
BB - 245	8	0	1.1	0910	PP - 2613	31	0	0.5	1115	PROCESSED BY <i>AD</i>
	9				BM - 5400 school	32	0	0.5	1200	CUSTODY DATA
BA - 103	10	0	1.2	0900	BM - 1985	33	0	0.5	1230	
BA - 101	11	0	1.2	0930	LCH - 4022 fire station	34	0	0.7	1300	DATE
	12				LCH - 400	35	0	0.7	1315	TIME
TT - 38	13	0	1.1	0945		36				SIGNATURE
TT - 43	14	0	1.1	0910	H - 1 old hospital	37	0	0.7	1150	DATE
TT -	15	0	1.0	0950	H - 16	38	0	0.7	1015	TIME
	16				FC - 303	39	0	0.7	1000	SIGNATURE
CK -	17	0	0.9	1030	FC - 420	40	0	0.7	1015	COPY TO:
M - 139	18	0	1.0	1100	FC - 540	41	0	0.7	1030	
M -	19	0	1.0	1150	HP - 236	42	0	0.6	0945	<input type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.6	0900	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.3	1000	HP - 1300	44	0	0.7	0930	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22	0	0.8	1020	HP - 1204	45	0	0.7	0945	<input type="checkbox"/> NREAD <input type="checkbox"/> FILE
TC -	23	0	0.7	1015		46				<input type="checkbox"/>

REMARKS

SIGNATURE

Robert D. Dwyer

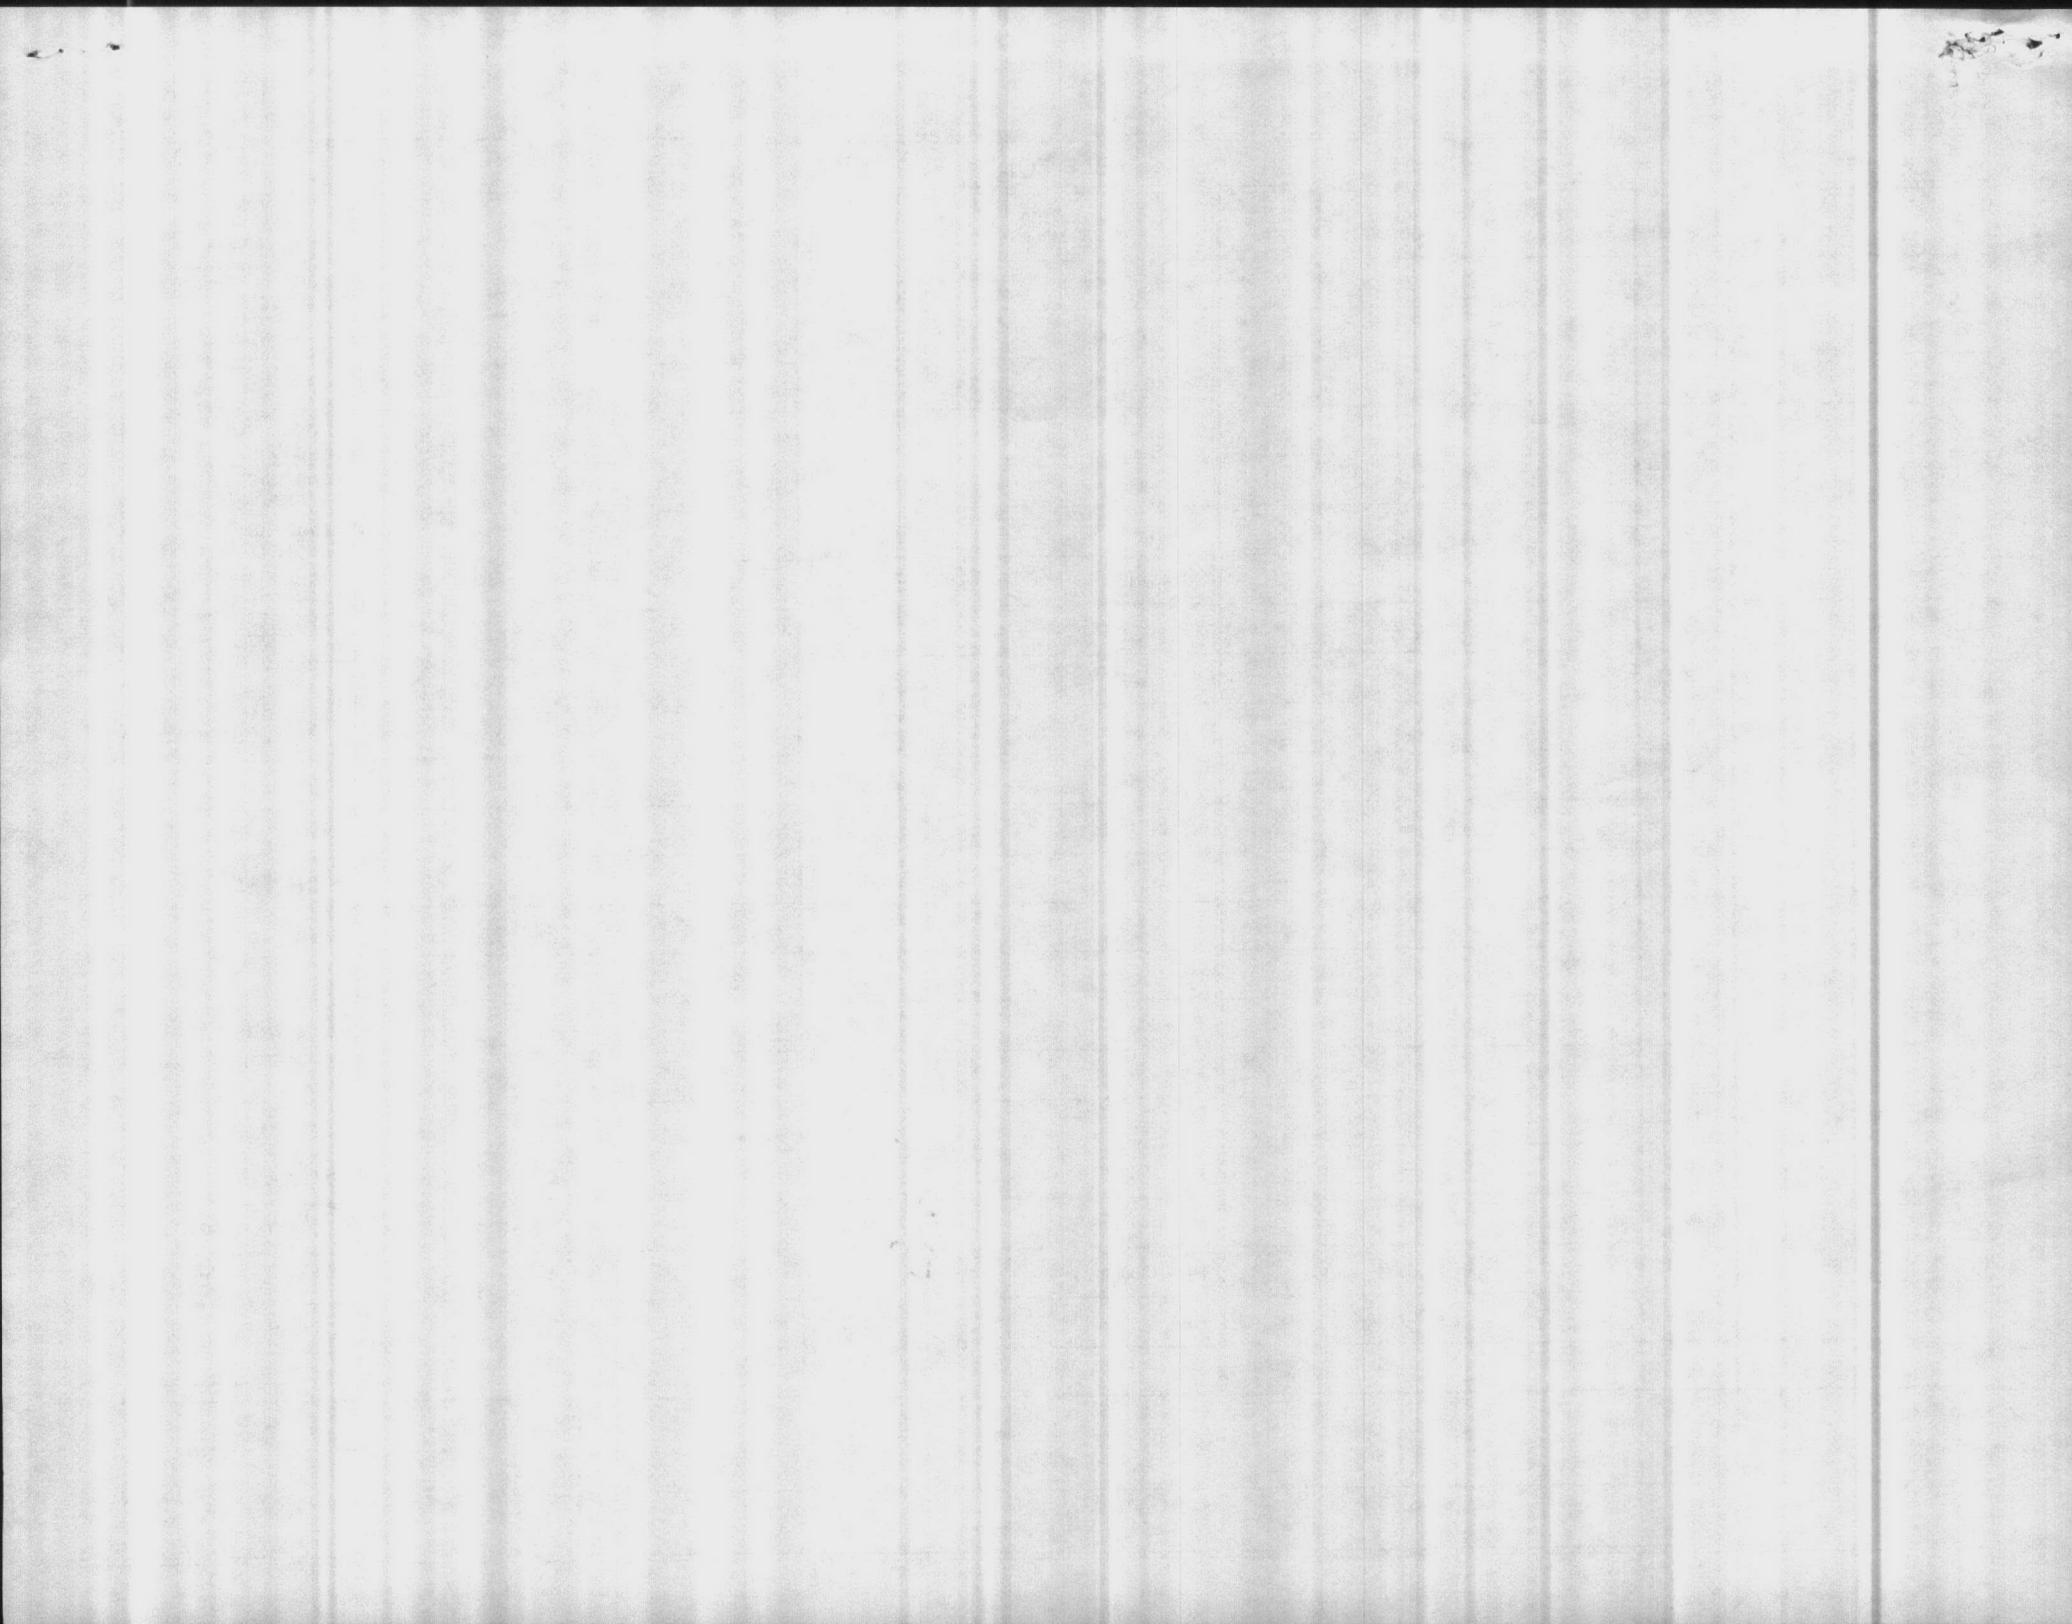

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	1.1		0930
SH-8	0	0.5		0915
TT POOL				
M.P. POOL	0	0.6	7.4	1115
#2 POOL	0	0.5	7.4	0945
#5 POOL	0	0.8	7.5	0900
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED	DATE ANALYZED 10-13-87	COPY TO: <input type="checkbox"/> UTIL DIR
COLLECTED BY	ANALYSIS STARTED 1300	
TIME RECEIVED 1145 - 1245	ANALYSIS FINISHED 1415	<input checked="" type="checkbox"/> WATER TREATMENT
DATE RECEIVED 10-13-87	INCUBATOR TEMP 35.2	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU
ACCEPTED BY <i>Robt. C. Dwyer</i>	PROCESSED BY <i>BD</i>	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
SIGNATURE <i>Robert C. Dwyer</i>		<input type="checkbox"/> _____

REMARKS

BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED
 12-29-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	★ 1	0	0.7	1030	MCAS - 3502	24	0	0.3	1040	TIME RECEIVED 12:45
RR - 15	2	0	0.5	1040	MCAS - 2002	25	0	0.5	1030	DATE RECEIVED 12-29-87
RR - 10	3	0	0.4	1050	MCAS - 4127	26	0	0.4	1050	ACCEPTED BY <i>Bob</i>
	4				MCAS - 1280	27	0	0.6	1100	DATE ANALYZED 12-29-87
A-1	5	0	0.4	0900		28				ANALYSIS STARTED 1245
BB - 7	6	0	0.7	0920	NRMC -	29	0	1.1	1215	ANALYSIS FINISHED 1350
BB - 49	7	0	0.8	0945	PP - 2615 2613	30	0	0.7	1145	INCUBATOR TEMP 35.6
BB - 245	8	0	0.8	0930	PP - 2600	31	0	0.6	1155	PROCESSED BY <i>Bob</i>
	9				BM - 5400	32	0	0.8	1045	
BA - 103	10	0	0.6	0920	BM - 920 MCX	33	0	0.8	1100	CUSTODY DATA
BA - 101	11	0	0.6	0930	LCH - 4022	34	0	1.0	1225	DATE
	12				LCH - 4003	35	0	1.0	1235	TIME
TT - 38	13	0	0.6	0840		36				SIGNATURE
TT - 43	14	0	0.7	0953	H - 1	37	0	0.6	1130	DATE
TT - 2677	15	0	0.7	0905	H - 16	38	0	0.6	1115	TIME
	16				FC - 303	39	0	0.7	0905	SIGNATURE
CK - 1412	17	0	0.5	0925	FC - 420	40	0	0.7	0920	
M - 139	18	0	0.8	1200	FC - 323	41	0	0.7	0920	COPY TO:
M - 625	19	0	0.4	0950	HP - 236	42	0	0.9	1005	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.9	1015	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.2	1110	HP - 1300	44	0	1.0	0950	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22	0	0.7	1120	HP - 1202	45	0	1.0	0940	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC - 701	23	0	0.7	1130		46				<input type="checkbox"/>

REMARKS ★ # 1. few Non-Coliforms

SIGNATURE

Robert G. Deppa


BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	1.0		0840
SH-8	0	0.5		0945
TT POOL				
M.P. POOL	0	0.5	7.3	1205
#2 POOL	0	0.8	7.4	1000
#5 POOL	0	0.9	7.4	1025
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 12-29-87	DATE ANALYZED 12-29-87	COPY TO: <input checked="" type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT
COLLECTED BY	ANALYSIS STARTED 12:45	
TIME RECEIVED 12:45	ANALYSIS FINISHED 1350	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU
DATE RECEIVED 11-29-87	INCUBATOR TEMP 35.6	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
ACCEPTED BY [Signature]	PROCESSED BY [Signature]	<input type="checkbox"/> _____
SIGNATURE Robert H. Dwyer		
REMARKS		

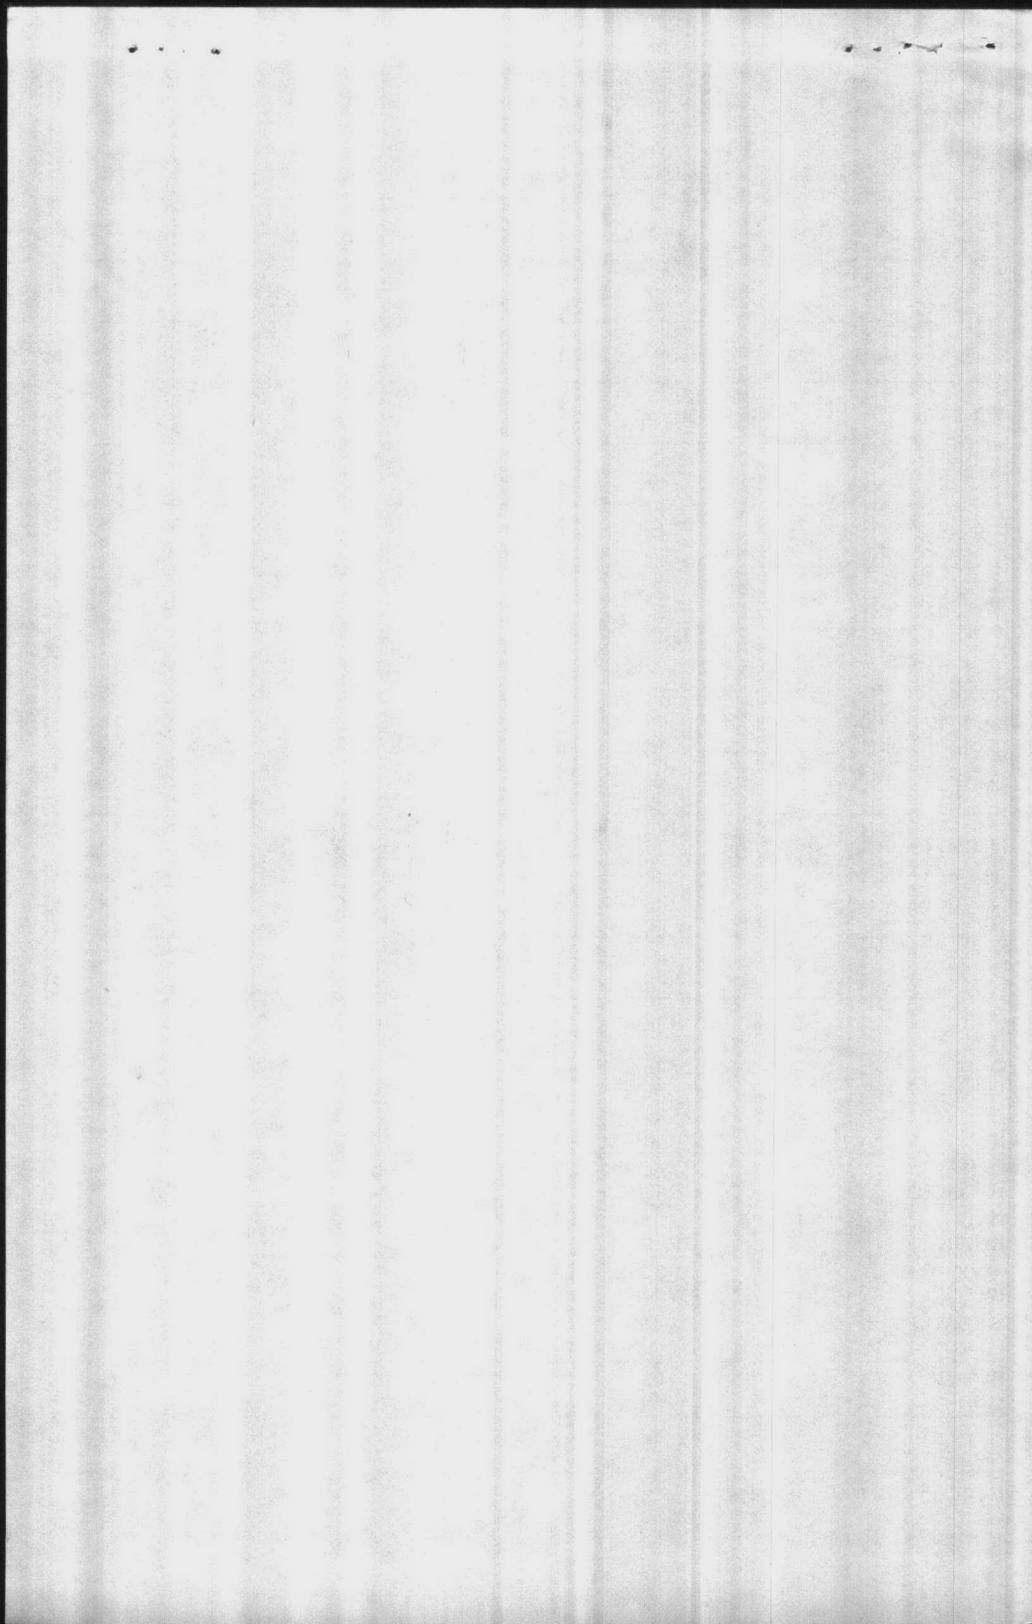

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.6	1140	MCAS - 3502	24	0.4	0.3	0940	TIME RECEIVED 1320-1345
RR - 15	2		0.7	1150	MCAS - 2002	25		0.5	0910	DATE RECEIVED 12-22-87
RR - 10	3		0.5	1200	MCAS - 4157	26		0.4	0955	ACCEPTED BY C/B
	4				MCAS - 2034	27		0.5	0925	DATE ANALYZED 12-22
A-1	5		0.8	1115		28				ANALYSIS STARTED 1325
BB - 7	6		0.9	0850	NRMC - FOODSERVICE	29	0.4	0.7	1135	ANALYSIS FINISHED 1415
BB - 49	7		0.8	0910	PP - 2615	30	CLOSED REMOVED			INCUBATOR TEMP 35.8
BB - 9	8		0.8	0920	PP - 2613	31		0.7	1140	PROCESSED BY C. SHORES
	9				BM - 5400	32		0.7	1125	
BA - 103	10		1.1	1040	BM - 820	33		0.7	1115	CUSTODY DATA
BA - 101	11		1.0	1055	LCH - 4022	34		0.7	1150	DATE
	12				LCH - 4070	35		0.6	1205	TIME
TT - 38	13		1.1	0845		36				SIGNATURE
TT - 43	14		1.1	0910	H - 1	37		0.6	1045	DATE
TT - 451	15		1.0	0945	H - 16	38		0.6	1035	TIME
	16				FC - 303	39		0.7	0935	SIGNATURE
CK - 1406	17		0.9	1015	FC - 420	40		0.7	0945	
M - 139	18		0.9	1045	FC - 540	41		0.7	0955	COPY TO:
M - 128	19		0.8	1120	HP - 236	42		0.7	1025	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43		0.7	0925	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21		0.2	1010	HP - 1300	44		0.6	0910	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22		0.8	1020	HP - 1400	45		0.7	0900	<input type="checkbox"/> NREAD <input type="checkbox"/> FILE
TC - 701	23		0.8	0845		46				<input type="checkbox"/>

REMARKS

SIGNATURE

#24 - 9 TINY NON-COLIFORMS

#29 - NUMEROUS TINY NON-COLIFORMS

12/23/87 *C. Shores*

[Faint, illegible handwriting on lined paper]

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.6		0935
SH-8	0	0.8		1010
TT POOL				
M.P. POOL	0	0.5	7.6	1035
#2 POOL	0	0.7	7.6	1025
#5 POOL	0	0.6	7.5	0925
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 12-22-87	DATE ANALYZED 12-22-87	COPY TO: <input checked="" type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY C/B	ANALYSIS STARTED 1325	
TIME RECEIVED 1320-1345	ANALYSIS FINISHED 1415	
DATE RECEIVED 12-22	INCUBATOR TEMP 35.8	
ACCEPTED BY C/B	PROCESSED BY C. SHORES	
SIGNATURE 12/23/87 Carol Shores		
REMARKS		

BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED

12-15-87


REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.7	1100	MCAS - 3502	24	0	0.3	0710	TIME RECEIVED
RR - 15	2	0	0.6	1115	MCAS - 2002	25	0	0.5	0840	DATE RECEIVED
RR - 10	3	0	0.7	1125	MCAS - 4157	26	0	0.4	0856	ACCEPTED BY
	4				MCAS - 1112	27	0	0.5	1000	DATE ANALYZED
A-1	5	0	0.8	0830		28				ANALYSIS STARTED
BB - 7	6	0	1.0	0845	NRMC -	29	0	0.6	0830	ANALYSIS FINISHED
BB - 49	7	0	0.9	0855	PP - 2615	30	0	0.7	0845	INCUBATOR TEMP
BB - 245	8	0	0.8	0905	PP - 3611	31	0	0.7	1035	PROCESSED BY
	9				BM - 5400	32	0	0.7	1120	
BA - 103	10	0	0.6	1015	BM - 5074	33	0	0.7	0910	CUSTODY DATA
BA - 101	11	0	0.9	1025	LCH - 4022	34	0	0.7	1015	DATE
	12				LCH - 1082	35	0	0.7	1050	TIME
TT - 38	13	0	1.1	0915		36				SIGNATURE
TT - 43	14	0	1.1	0920	H - 1	37	0	0.6	1100	DATE
TT - 2465	15	0	1.0	0955	H - 10	38	0	0.7	1115	TIME
	16				FC - 303	39	0	0.6	1200	SIGNATURE
CK - 1306	17	0	0.8	1115	FC - 420	40	0	0.6	1215	
M - 139	18	0	0.9	0940	FC - 360	41	0	0.6	1225	COPY TO:
M - 110	19	0	0.9	1055	HP - 236	42	0	0.7	1245	<input type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.6	1255	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.2	0930	HP - 1300	44	0	0.7	1110	<input type="checkbox"/> PMU <input type="checkbox"/> MCAS PMO
TC - 830	22	0	0.6	0940	HP - 18	45	0	0.6	1250	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC - 701	23	0	0.6	0950		46				<input type="checkbox"/> _____

REMARKS

SIGNATURE

Robert G. Dyer

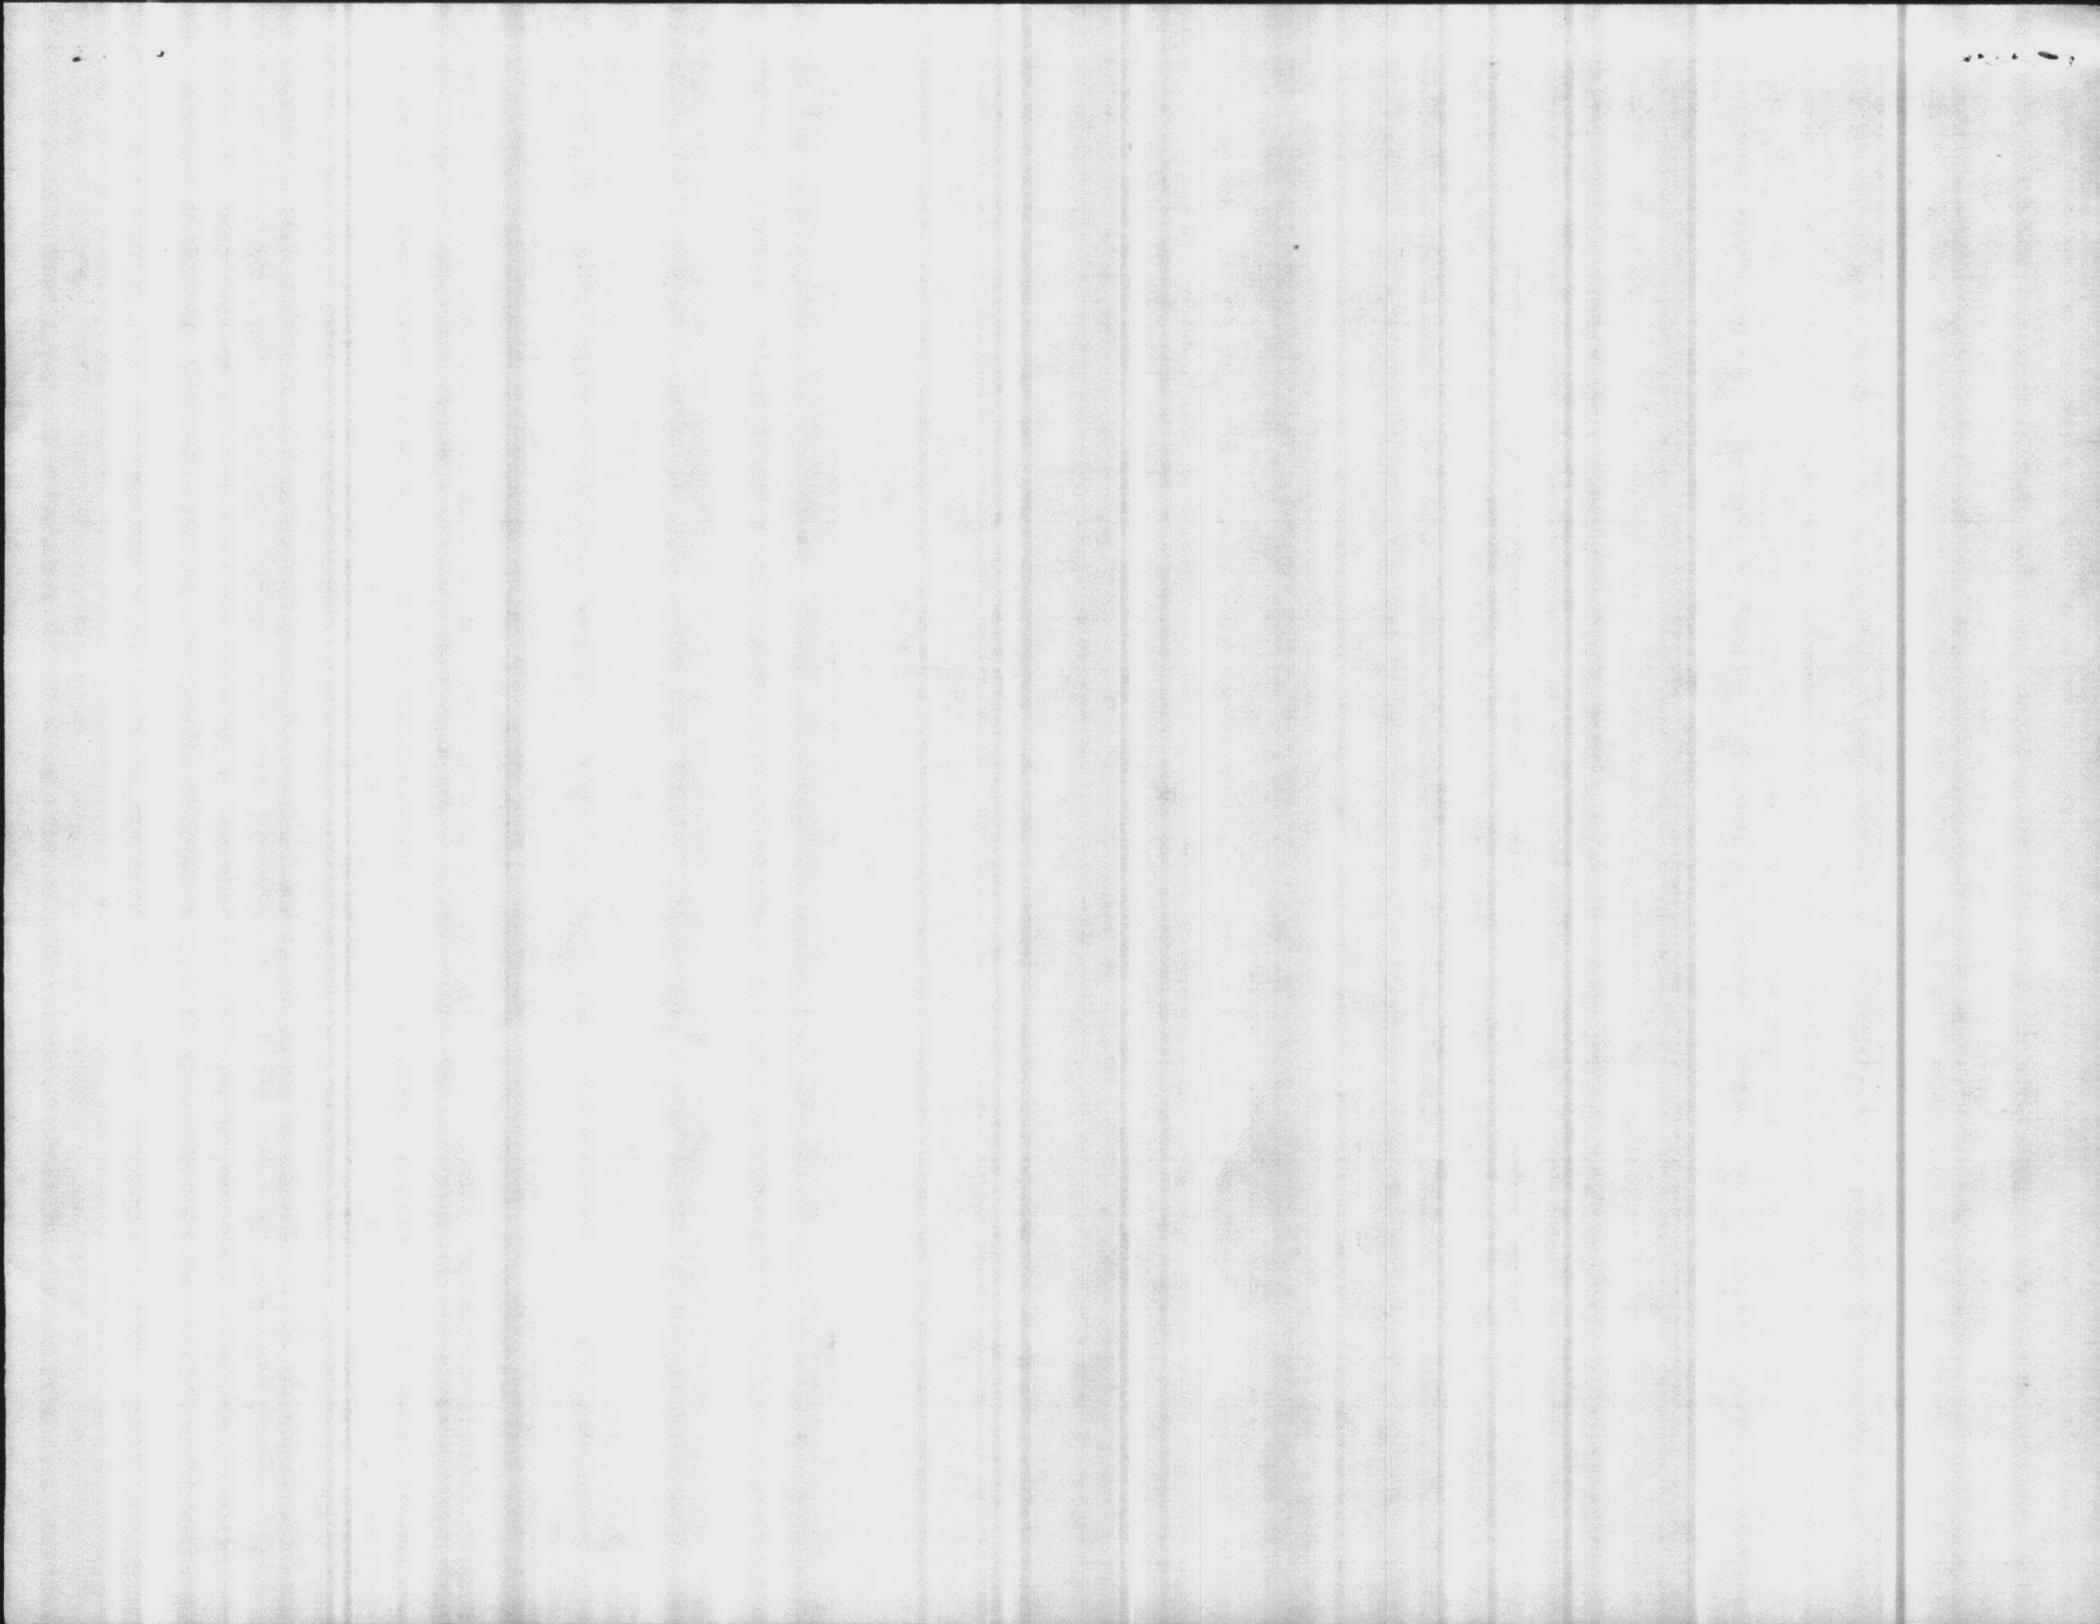

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.6		0930
SH-8	0	0.6		1005
TT POOL				
M.P. POOL	0	0.6	7.6	1115
#2 POOL	0	0.7	7.4	0925
#5 POOL	0	0.8	7.3	0940
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 12-15-87	DATE ANALYZED 12-15-87	COPY TO:
COLLECTED BY	ANALYSIS STARTED 1300	
TIME RECEIVED 1300	ANALYSIS FINISHED 1415	<input checked="" type="checkbox"/> WATER TREATMENT
DATE RECEIVED 12-15-87	INCUBATOR TEMP 35.8	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU
ACCEPTED BY <i>BA</i>	PROCESSED BY <i>BA</i>	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
SIGNATURE <i>Robert C. Deppen</i>		<input type="checkbox"/> _____
REMARKS		

1890
1891
1892

1893
1894

1895
1896
1897

1898
1899
1900

1901

1902

1903

1904

1905

1906

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.5		0900
SH-8	0	1.0		0915
TT POOL				
M.P. POOL	0	0.7	7.3	1045
#2 POOL	0	0.6	7.4	1005
#5 POOL	0	0.5	7.4	1030
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 12-8-87	DATE ANALYZED 12-8	COPY TO: <input type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY	ANALYSIS STARTED 1342	
TIME RECEIVED 1317-B20	ANALYSIS FINISHED 1430	
DATE RECEIVED 12-8	INCUBATOR TEMP 35.5	
ACCEPTED BY BOB	PROCESSED BY SHURES	
SIGNATURE <i>Carol Shures 12/9/87</i>		
REMARKS		



12-8-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	1.0	1100	MCAS - 3502	24	0	0.3	0910	TIME RECEIVED 1317-1320
RR - 15	2		1.0	1115	MCAS - 2002	25		0.5	0840	DATE RECEIVED 12-8-87
RR - 10	3		1.0	1125	MCAS - 4157	26		0.4	0920	ACCEPTED BY BJB
	4				MCAS - 2066	27		0.5	0855	DATE ANALYZED 12-8
A-1	5		1.0	0915		28				ANALYSIS STARTED 1342
BB - 7	6		1.0	0840	NRMC -	29		0.8	1145	ANALYSIS FINISHED 1430
BB - 49	7		1.1	0910	PP - 2615	30		0.6	1120	INCUBATOR TEMP 35.5
BB - 245	8		1.1	0850	PP - 2600	31		0.8	1130	PROCESSED BY SHORES
	9				BM - 5400	32		0.8	1210	
BA - 103	10		0.9	1230	BM - 820	33		0.8	1225	CUSTODY DATA
BA - 101	11		1.0	1240	LCH - 4022	34		1.0	1235	DATE
	12				LCH - 4003	35		1.0	1245	TIME
TT - 38	13		1.2	0945		36				SIGNATURE
TT - 43	14		1.2	0900	H - 1	37		0.6	1100	DATE
TT - 1004	15		1.1	0915	H - 16	38		0.6	1050	TIME
	16				FC - 303	39		0.7	0840	SIGNATURE
CK - 1602	17		1.0	1015	FC - 420	40		0.7	0850	
M - 139	18		1.0	1100	FC - 323	41		0.6	0900	COPY TO:
M - 231	19		0.9	1030	HP - 236	42		0.8	1000	<input type="checkbox"/> UTIL DIR
	20				HP - 540	43		0.8	1035	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21		0.3	0935	HP - 1300	44		0.6	0940	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22		0.6	1000	HP - 1202	45		0.9	0930	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC - 701	23	✓	0.6	0950		46				<input type="checkbox"/>

REMARKS

0523 - 1 NON-COLIFORM

SIGNATURE

Carol Shore 12/9/87

BACTERIOLOGICAL ANALYSIS OF WATER
MCBCL 11330/4 (REV. 7-83)


DATE COLLECTED
12-1-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.6	0940	MCAS - 3502	24	0	0.3	0900	TIME RECEIVED 1135-1336
RR - 15	2	4	0.3	0945	MCAS - 2002	25	0	0.5	0845	DATE RECEIVED 12-1-87
RR - 10	3		0.7	0950	MCAS - 4157	26	0	0.4	0910	ACCEPTED BY S/R/D
	4				MCAS - 1037	27	0	0.8	1000	DATE ANALYZED 12-1
A-47	5		0.3	0915		28	0			ANALYSIS STARTED 1258
BB - 7	6		1.0	0840	NRMC -	29	0	0.7	1120	ANALYSIS FINISHED 1404
BB - 49	7		1.1	0905	PP - 2615	30	0	0.7	1040	INCUBATOR TEMP 35.6
BB - 245	8		1.0	0850	PP - 2611	31	0	0.6	1030	PROCESSED BY SHORES
	9				BM - 5400	32	0	0.7	1105	
BA - 103	10		0.4	1100	BM - 820	33	0	0.6	1055	CUSTODY DATA
BA - 101	11		0.3	1050	LCH - 4022	34	0	0.7	1140	DATE
	12				LCH - 4000	35	0	0.6	1150	TIME
TT - 38	13		1.0	0930		36	0			SIGNATURE
TT - 43	14	✓	1.0	0845	H - 1	37	0	0.7	1015	DATE
TT - 2650	15	1144	0.9	0900	H - 16	38	0	0.6	1005	TIME
	16				FC - 303	39	0	0.7	0910	SIGNATURE
CK - 1005	17		0.8	0930	FC - 420	40	0	0.6	0920	
M - 139	18		0.8	1055	FC - 540	41	0	0.7	0930	COPY TO:
M - 440	19		0.9	1130	HP - 236	42	0	0.6	0955	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.7	0945	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	4	0.3	0925	HP - 1300	44	0	0.5	0840	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22	8	0.8	0940	HP - 1400	45	0	0.6	0830	<input type="checkbox"/> NREAD <input type="checkbox"/> FILE
TC - 701	23	✓	0.8	0830		46	0			<input type="checkbox"/>

REMARKS
 # 21 - 4 NON-COLIFORMS
 # 22 - 1 NON-COLIFORM
 # 19 - SOME NON-COLIFORMS
 # 15 - COMPLAINT - ALSO NUMEROUS NON-COLIFORMS
 CONFIRMATION OF COLONIES PENDING
 RE-SAMPLING IN PROGRESS

SIGNATURE
 12/2/87 [Signature]

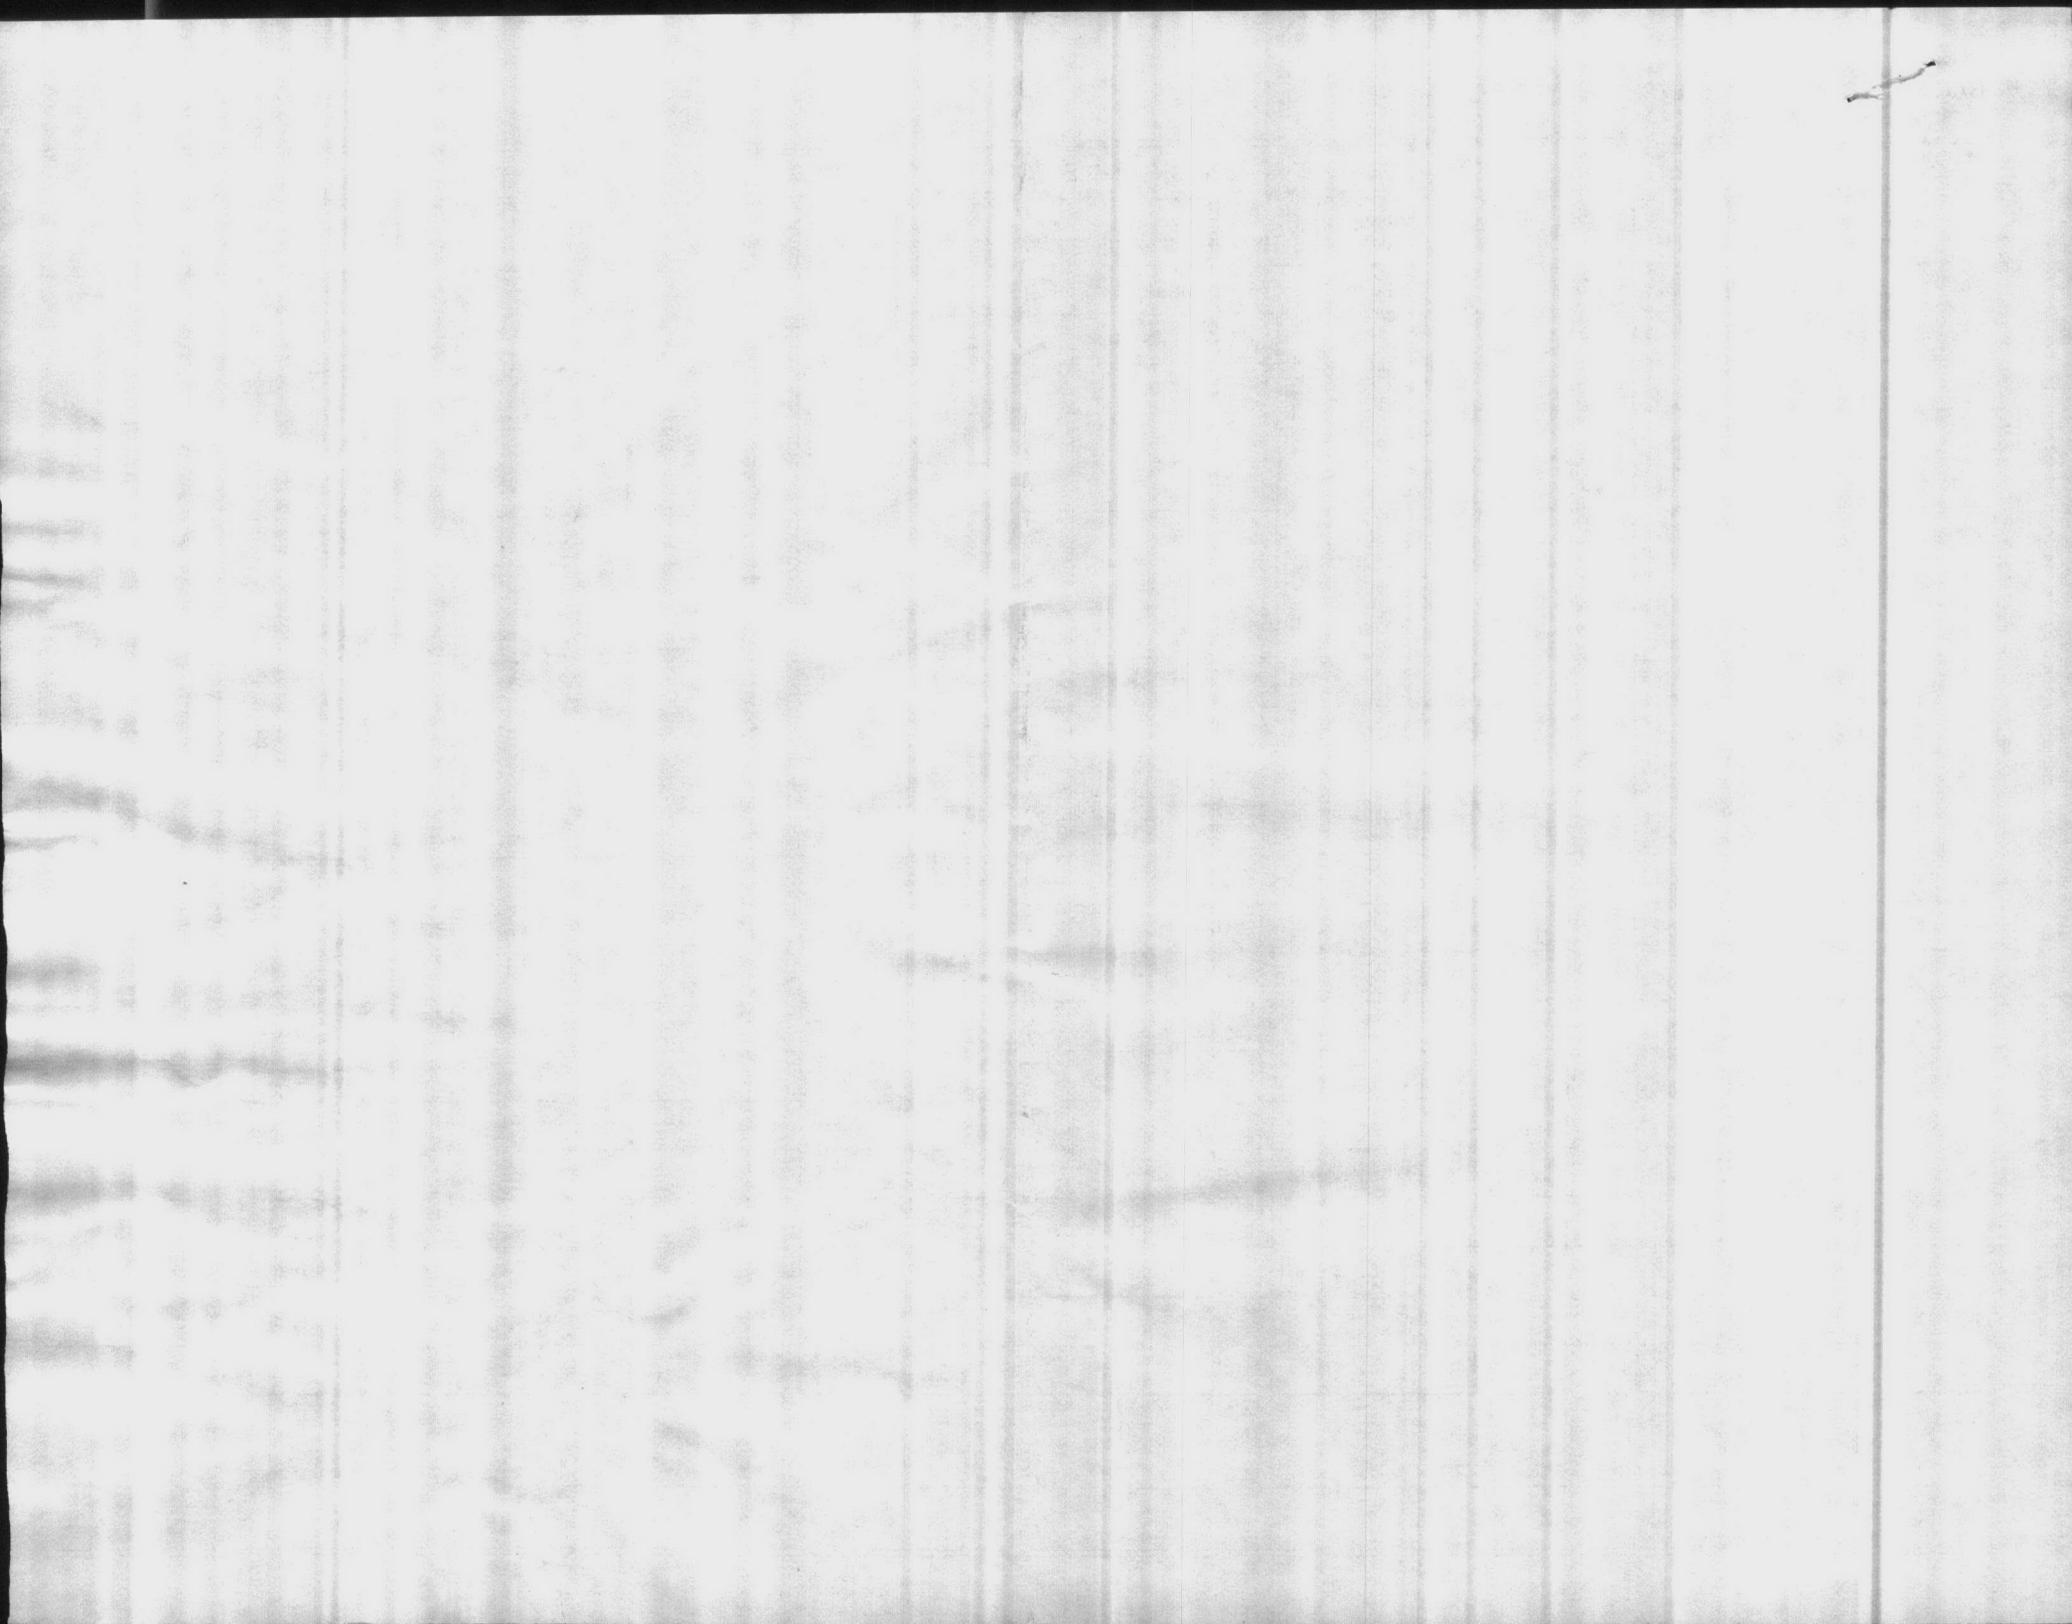


BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	2.0		0908
SH-8	0	0.4		0855-
TT POOL				
M.P. POOL	0	0.7	7.8	1115
#2 POOL	0	0.7	7.6	0955
#5 POOL	0	0.6	7.6	0945
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 12-1-87	DATE ANALYZED 12-1	COPY TO: <input type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input type="checkbox"/> PMU <input type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY	ANALYSIS STARTED 1258	
TIME RECEIVED 1135-1336	ANALYSIS FINISHED 1404	
DATE RECEIVED 12-1	INCUBATOR TEMP 35.6	
ACCEPTED BY 5/10/0	PROCESSED BY SHORES	
SIGNATURE 12/2/87 Carl Shores		
REMARKS		

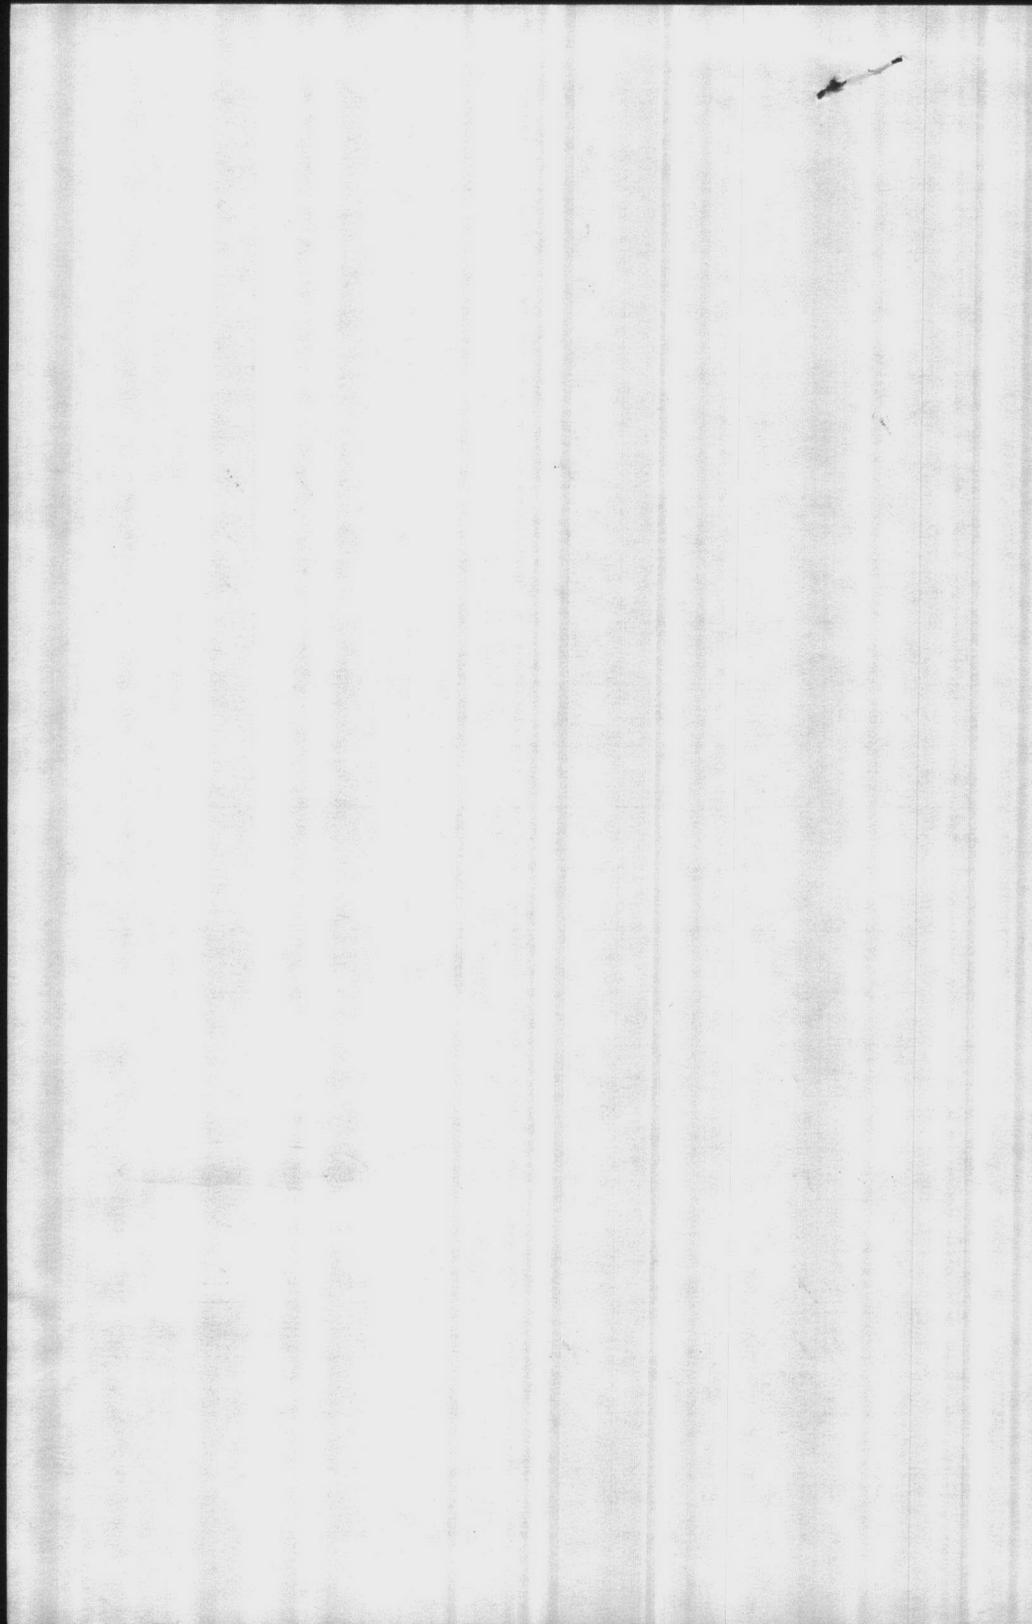

BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)


DATE COLLECTED
 11-24-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.6	1130	MCAS - 3502	24	0	0.4	0155	TIME RECEIVED 1250
RR - 15	2	0	0.7	1140	MCAS - 2002	25	0	0.6	0240	DATE RECEIVED 11-24-87
RR - 10	3	0	0.6	1150	MCAS - 4157	26	0	0.4	0915	ACCEPTED BY <i>Shrus</i>
	4				MCAS - 2037	27	0	0.5	0930	DATE ANALYZED 11-24-87
A-1	5	0	0.8	1000		28				ANALYSIS STARTED 1300
BB - 7	6	0	1.0	0145	NRMC -	29	0	1.0	1230	ANALYSIS FINISHED 1430
BB - 49	7	0	1.0	0900	PP - 2615	30	0	1.0	1130	INCUBATOR TEMP 35.9
BB - 9	8	0	0.9	0920	PP - 3111	31	0	0.9	1045	PROCESSED BY <i>Shrus/Dypp</i>
	9				BM - 5400	32	0	0.9	1150	
BA - 103	10	0	0.8	1040	BM - 820	33	0	0.9	1210	CUSTODY DATA
BA - 101	11	0	0.9	1050	LCH - 4022	34	0	0.7	1245	DATE
	12				LCH - 4006	35	0	0.7	1300	TIME
TT - 38	13	0	1.0	0900		36				SIGNATURE
TT - 43	14	0	1.0	0920	H - 1	37	0	0.9	1100	DATE
TT - 44	15	0	1.0	0930	H - 16	38	0	0.9	1115	TIME
	16				FC - 303	39	0	0.9	0945	SIGNATURE
CK - 1001	★ 17	0	0.9	0945	FC - 420	40	0	0.9	0930	
M - 139	★ 18	0	0.9	1030	FC - 540	41	0	0.9	0945	COPY TO:
M - 129	★ 19	0	0.9	1130	HP - 236	42	0	1.0	0145	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.9	0900	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.4	0945	HP - 1300	44	0	0.7	1010	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22	0	0.8	1015	HP - 1202	45	0	0.7	1025	<input type="checkbox"/> NREAD <input type="checkbox"/> FILE
TC - 701	23	0	0.8	0945		46				<input type="checkbox"/>

REMARKS ★ 17 - TNTC Non-Coliforms
 18 > few Non-Coliforms
 19 > few Non-Coliforms

SIGNATURE
Robert G. Dypp

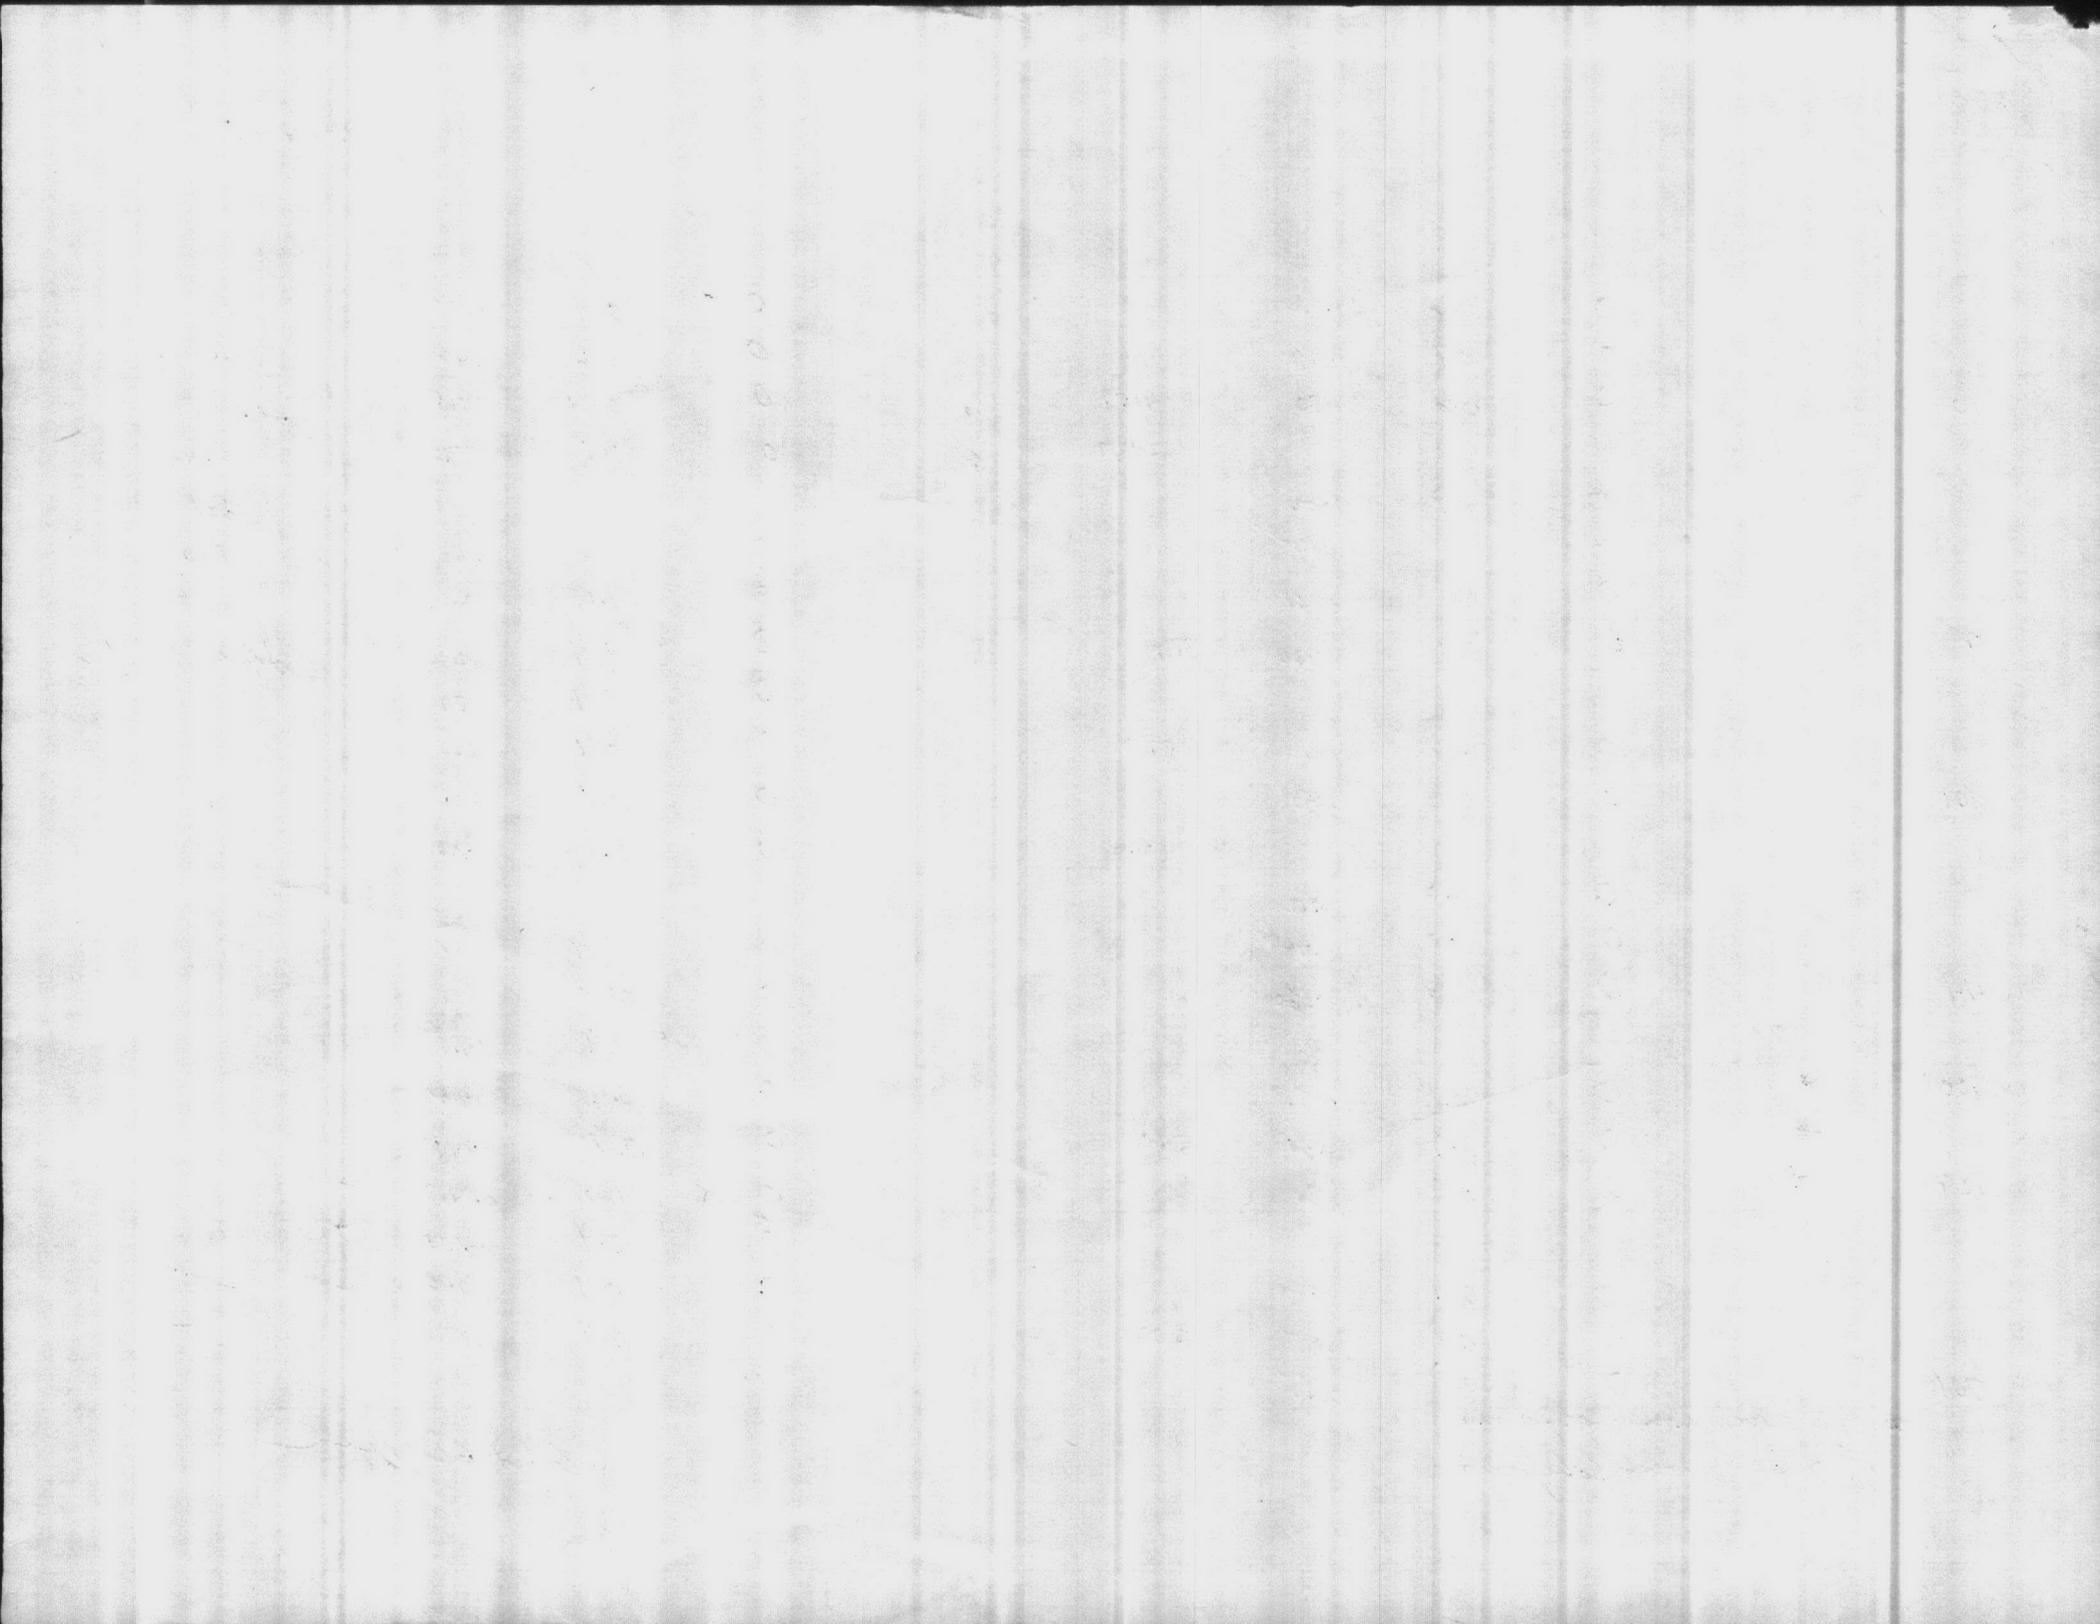

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
★ BB-97	0	0.8		0915
SH-8	0	1.0		1030
TT POOL				
M.P. POOL	0	0.7	7.4	1045
#2 POOL	0	0.9	7.4	0950
#5 POOL	0	0.7	7.4	0905
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				
* few Non-Coliforms				

LABORATORY DATA

DATE COLLECTED 11-24-87	DATE ANALYZED 11-24-87	COPY TO:
COLLECTED BY	ANALYSIS STARTED 1300	
TIME RECEIVED 1250	ANALYSIS FINISHED 1830	<input checked="" type="checkbox"/> WATER TREATMENT
DATE RECEIVED 11-24-87	INCUBATOR TEMP 35.9	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU
ACCEPTED BY <i>Shores/Dapper</i>	PROCESSED BY <i>Shores</i>	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
SIGNATURE <i>Robert G. Dapper</i>		<input type="checkbox"/> _____

REMARKS

1887

11

100

100

100

100

100

100

100

BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED
 11-17-87


REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.8	1140	MCAS - 3502	24	0	0.3	0945	TIME RECEIVED 1245 & 1100
RR - 15	2	0	0.8	1135	MCAS - 2002	25	0	0.5	0930	DATE RECEIVED 11-17-87
RR - 6	3	0	0.8	1145	MCAS - 4157	26	0	0.4	0900	ACCEPTED BY JCH
	4				MCAS - 1042	27	0	0.6	0950	DATE ANALYZED 11-17-87
A-147	5	0	1.0	1015		28				ANALYSIS STARTED 1400
BB - 7	6	0	1.0	0940	NRMC -	29	0	0.7	1125	ANALYSIS FINISHED 1450
BB - 40 270	7	0	1.0	1005	PP - 2615	30	0	0.5	1105	INCUBATOR TEMP 35.1
BB - 45	8	0	1.0	0930	PP - 2600 Fire Sta	31	0	0.5	1115	PROCESSED BY JCH
	9				BM - 5400	32	0	0.8	1200	
BA - 103	10	0	1.0	1040	BM - 1985	33	0	0.8	1150	CUSTODY DATA
BA - 101	11	0	1.0	1045	LCH - 4022	34	0	0.8	1230	DATE
	12				LCH - 4003	35	0	0.8	1215	TIME
TT - 38	13	0	1.0	0915		36				SIGNATURE
TT - 43	14	0	1.0	0925	H - 1 Old Hosp	37	0	0.6	1040	DATE
TT - 2465	15	0	1.0	0955	H - 16	38	0	0.6	1050	TIME
	16				FC - 303	39	0	0.6	0905	SIGNATURE
CK - 1513	17	0	0.9	1015	FC - 420	40	0	0.6	0915	
M - 139	18	0	0.9	1105	FC - 123	41	0	0.6	0925	COPY TO:
M - 128	19	0	0.9	1045	HP - 236	42	0	0.7	0950	<input type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.8	1015	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.4	0915	HP - 1300	44	0	0.7	0950	<input type="checkbox"/> PMU <input type="checkbox"/> MCAS PMO
TC - 830	22	0	0.7	0930	HP - 1202	45	0	0.7	0940	<input type="checkbox"/> NREAD <input type="checkbox"/> FILE
TC - 701	23	0	0.7	0925		46				<input type="checkbox"/>

REMARKS

SIGNATURE

Robert G. Dyer

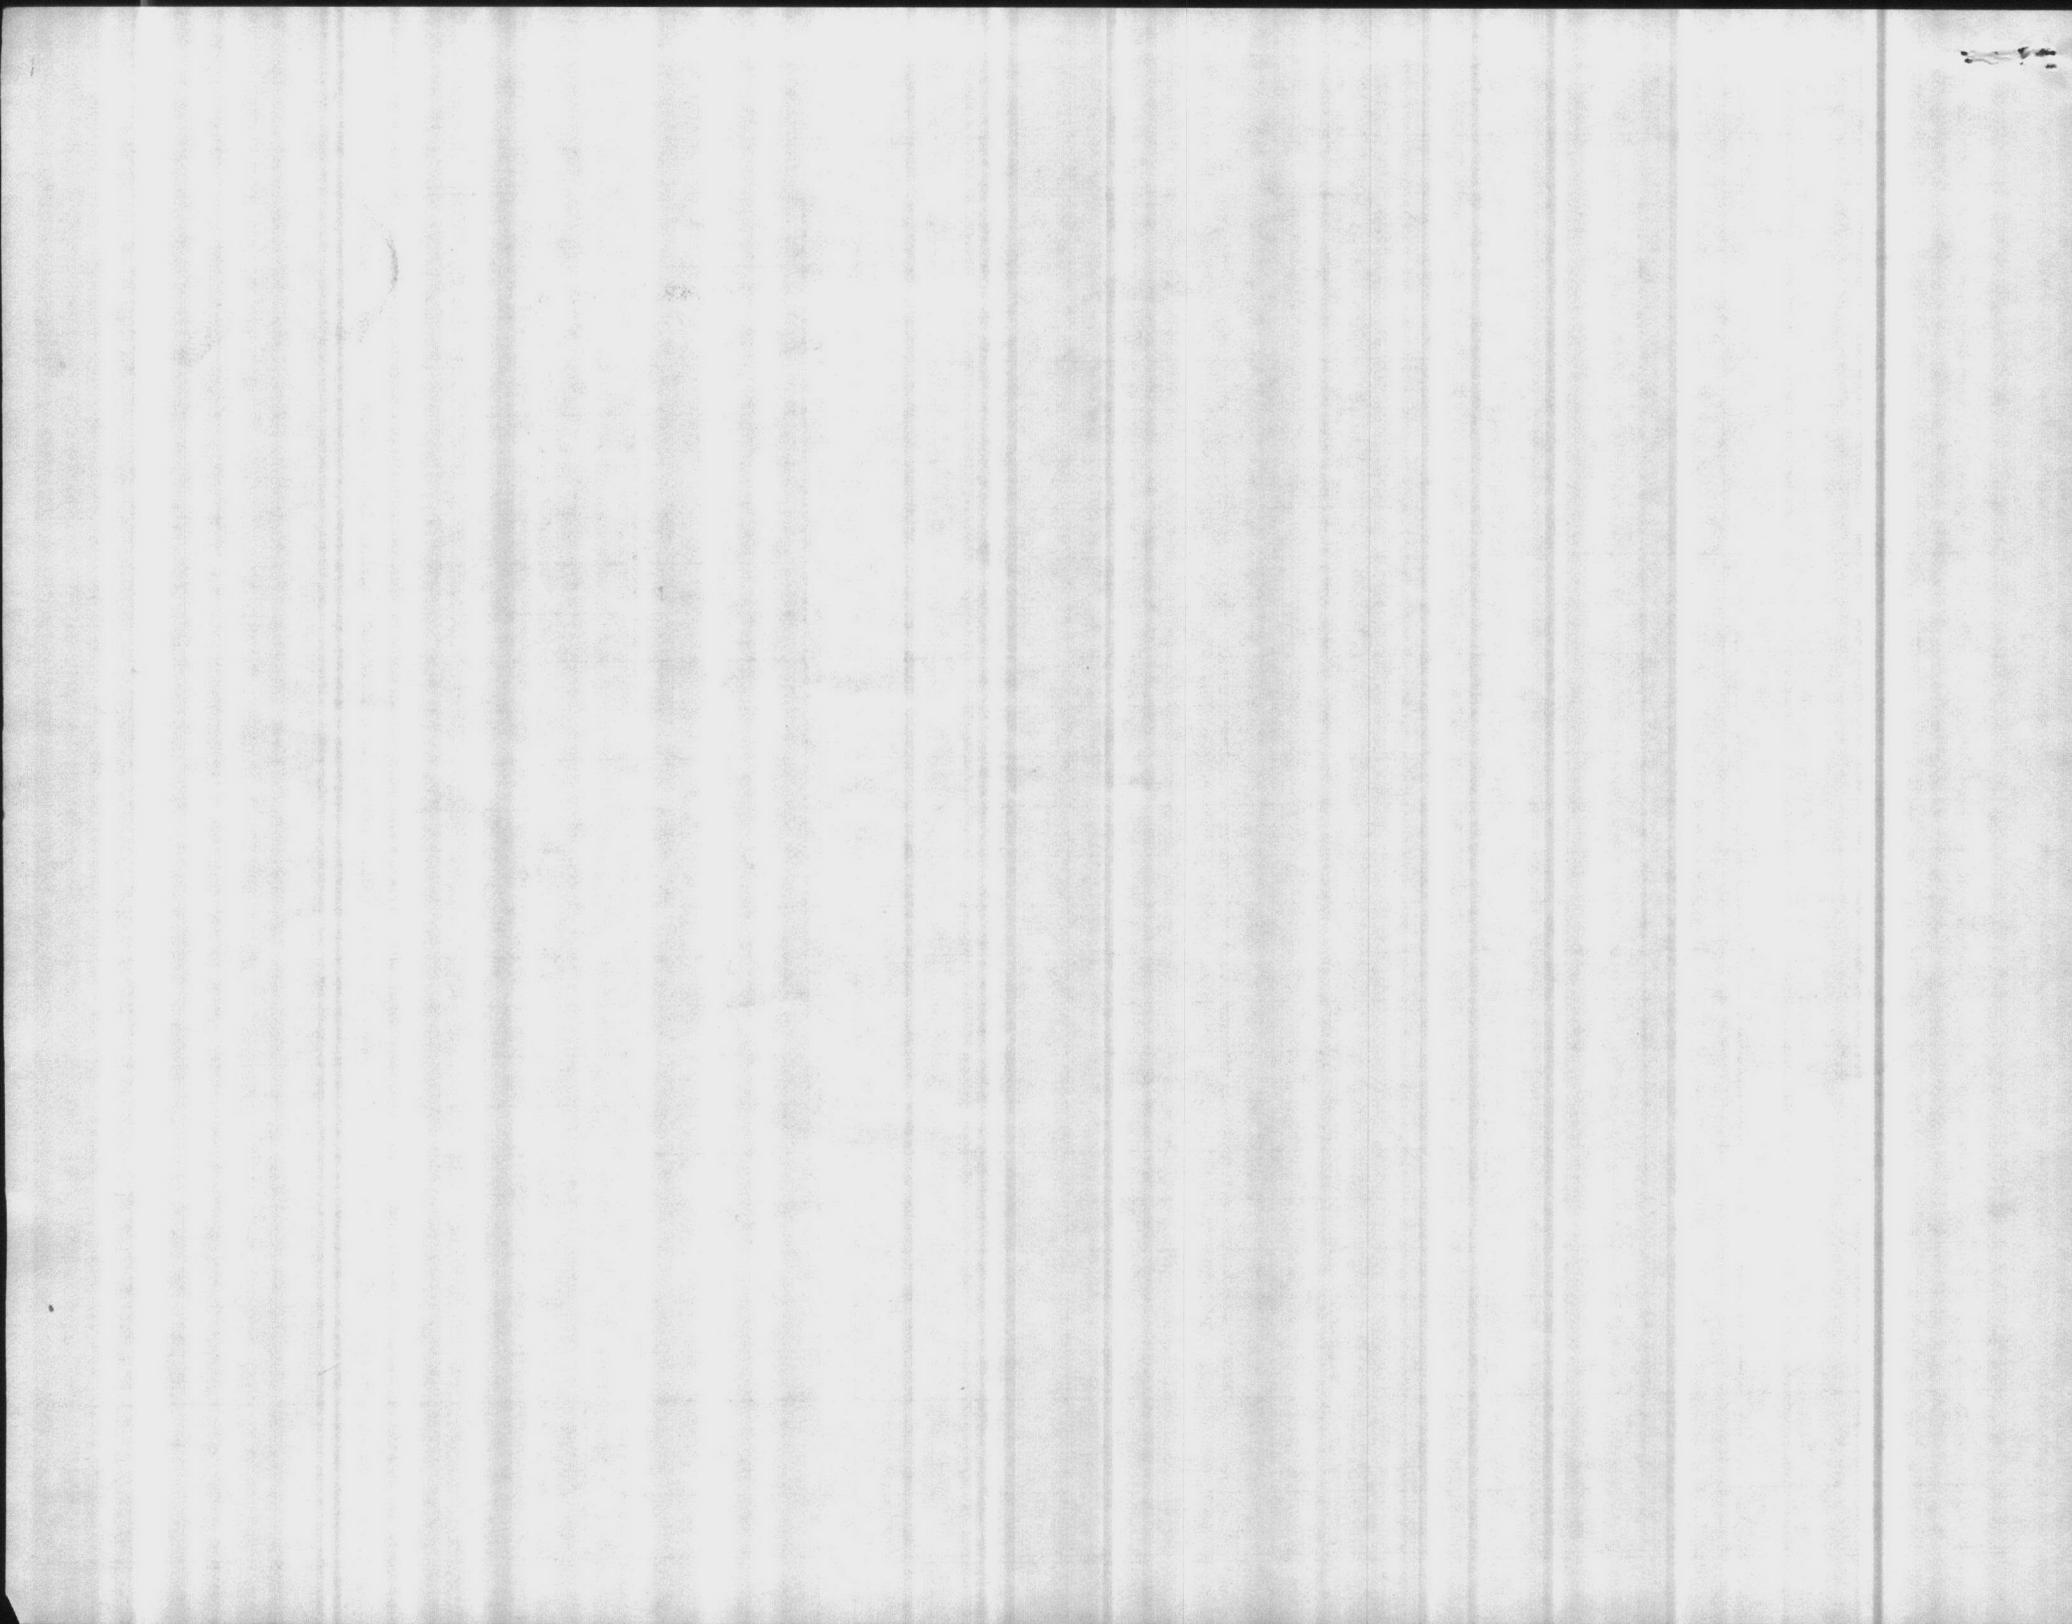

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.8		0955
SH-8	0	1.0		0940
TT POOL				
M.P. POOL	0	0.7	7.2	1115
#2 POOL	0	0.7	7.4	1000
#5 POOL	0	0.8	7.4	1020
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED <i>11-17-87</i>	DATE ANALYZED <i>11-17-87</i>	COPY TO: <input type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT
COLLECTED BY	ANALYSIS STARTED <i>1400</i>	
TIME RECEIVED <i>1245 1400</i>	ANALYSIS FINISHED <i>1450</i>	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU
DATE RECEIVED <i>11-17-87</i>	INCUBATOR TEMP <i>35.7</i>	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
ACCEPTED BY <i>[Signature]</i>	PROCESSED BY <i>[Signature]</i>	<input type="checkbox"/> _____
SIGNATURE <i>Robert H. Deffen</i>		
REMARKS		

00

000

00

00

000

00

000

00

00

000

00

000

00

BACTERIOLOGICAL ANALYSIS OF WATER

MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED

11-10-87

REPORTABLE POINTS FOR SDWA


WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.8	1115	MCAS - 3502	24	0	0.3	0920	TIME RECEIVED 1150-1310
RR - 15	2		0.8	1125	MCAS - 2002	25		0.4	0855	DATE RECEIVED 11-10-87
RR - 10	3		0.7	1130	MCAS - 4157	26		0.3	0930	ACCEPTED BY SHANE S
	4				MCAS - 2026	27		0.4	0910	DATE ANALYZED 11/10
A-47	5	CLOSED				28				ANALYSIS STARTED 1300
BB - 7	6		1.3	0800	NRMC - FOOD SERVICE	29		0.7	1145	ANALYSIS FINISHED 1400
BB - 49	7		1.3	0825	PP - 2615	30		0.6	1110	INCUBATOR TEMP 35.5
BB - 245	8		1.2	0815	PP - 2613	31		0.5	1100	PROCESSED BY BUR
	9				BM - 5400	32		0.5	1135	
BA - 103	10		1.0	1015	BM - 820	33		0.5	1125	CUSTODY DATA
BA - 101	11		1.0	1030	LCH - 4022	34		0.6	1155	DATE
	12				LCH - 4000	35		0.5	1200	TIME
TT - 38	13		1.1	0900		36				SIGNATURE
TT - 43	14		1.0	0925	H - 1	37		0.4	1045	DATE
TT - 2465	15		1.0	1000	H - 16	38		0.4	1035	TIME
	16				FC - 303	39		0.5	0955	SIGNATURE
CK - 1614	17		0.9	1030	FC - 420	40		0.5	0945	
M - 139	18		0.9	1100	FC - 540	41		0.5	0935	COPY TO:
M - 130	19		0.9	1115	HP - 236	42		0.5	1025	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43		0.5	0925	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21		0.3	0940	HP - 1300	44		0.4	0910	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22		0.9	1005	HP - 1400	45		0.5	0900	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC -	23		0.9	0955		46				<input type="checkbox"/>

REMARKS

#18, #19 - NUMEROUS NON-COLIFORMS

SIGNATURE

Carroll S. Jones 11/13/87

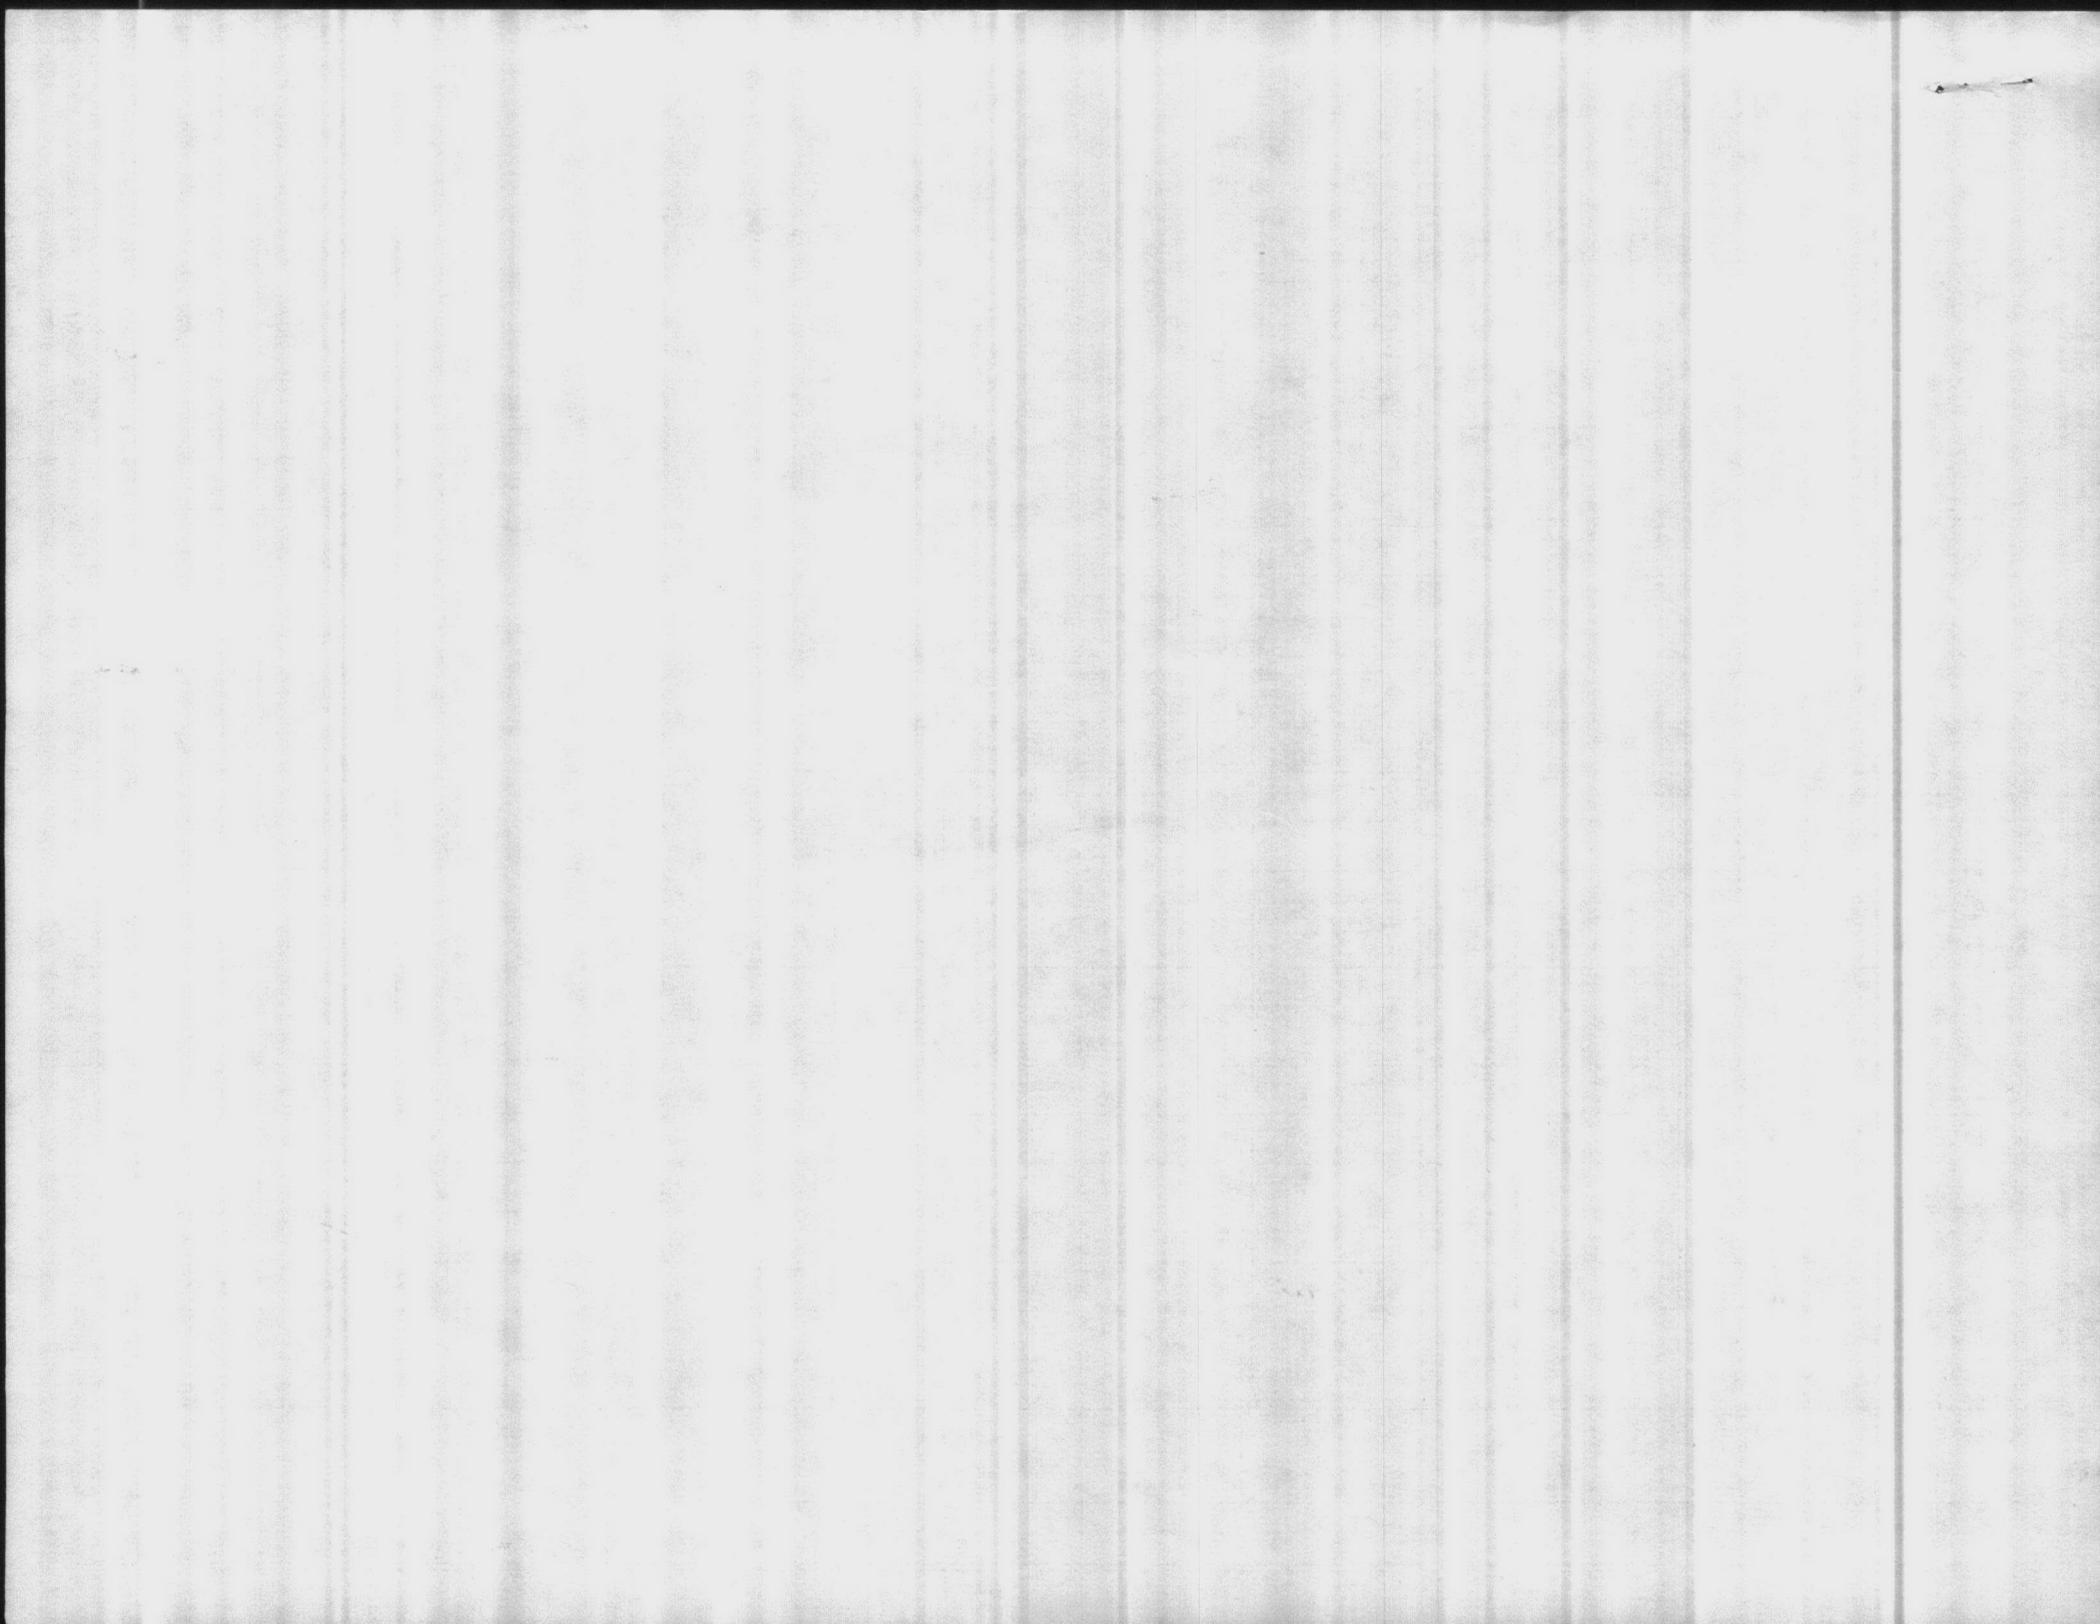


BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.8		0900
SH-8	0	1.2		1010
TT POOL				
M.P. POOL	0	0.6	7.6	1045
#2 POOL	0	0.8	7.4	1025
#5 POOL	0	0.6	7.4	0925
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 11-10-87	DATE ANALYZED 11-10-87	COPY TO: <input type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY 1234	ANALYSIS STARTED 1200	
TIME RECEIVED 1234 / 1310	ANALYSIS FINISHED 1400	
DATE RECEIVED 11-10-87	INCUBATOR TEMP 35°	
ACCEPTED BY BSE	PROCESSED BY [Signature]	
SIGNATURE Robert G. Dwyer		
REMARKS		

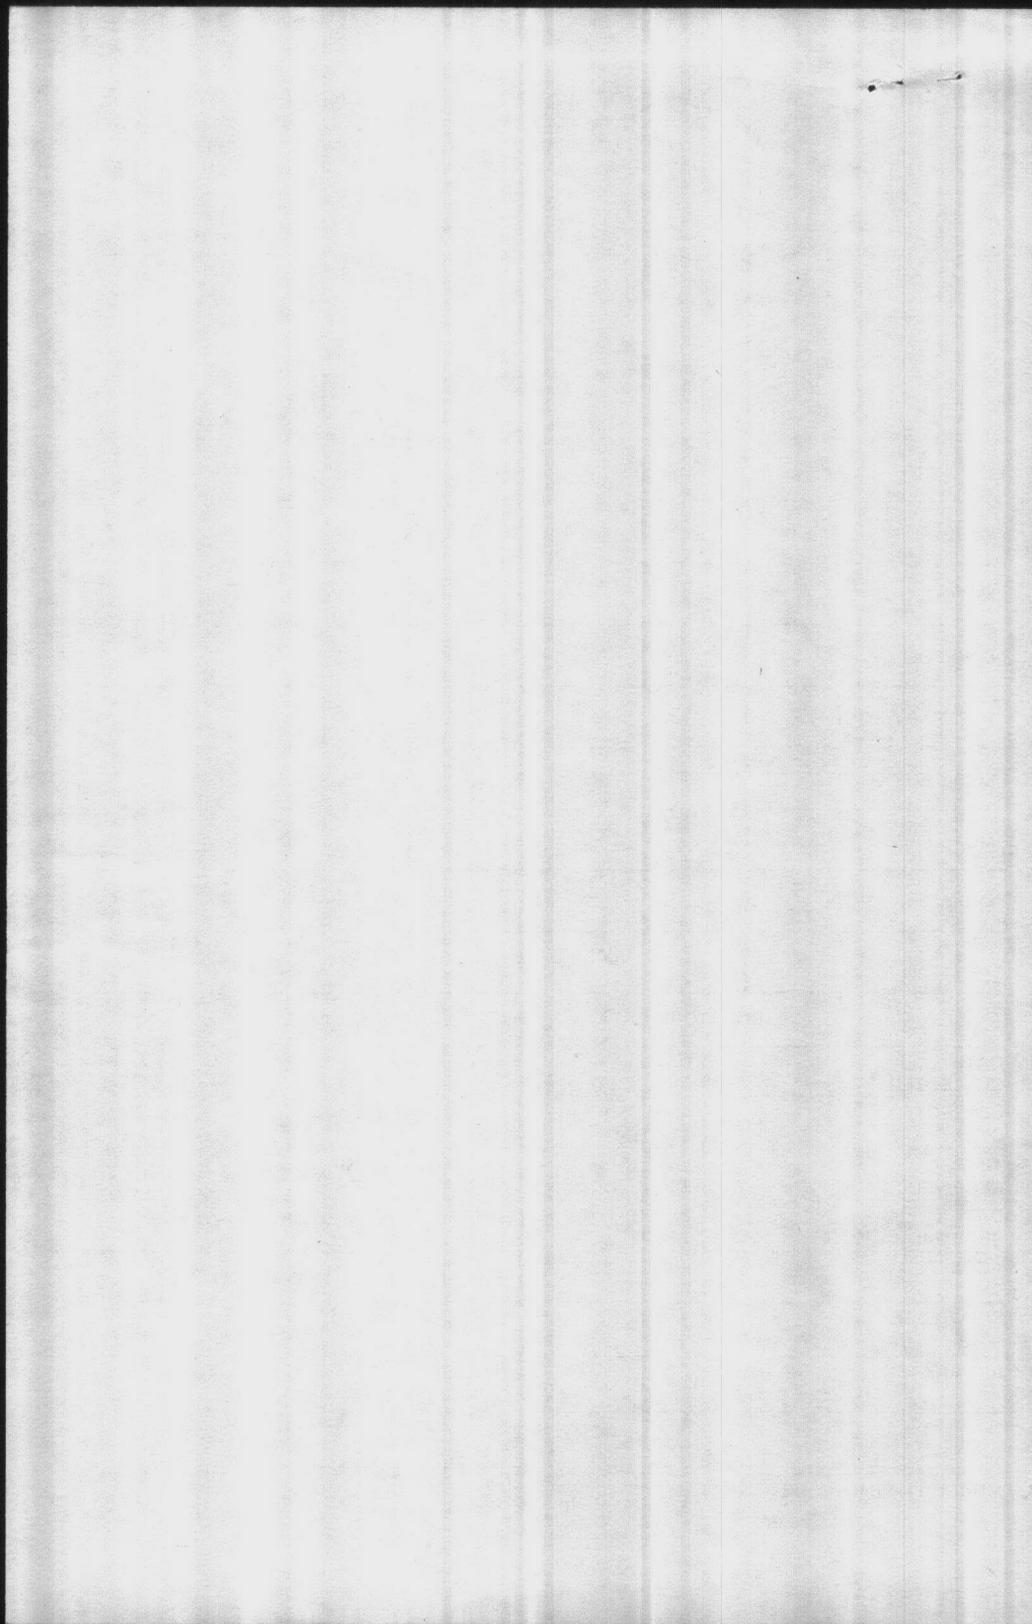

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	1.1		0910
SH-8	0	1.5		0935
TT POOL				
M.P. POOL	0	0.7	7.4	1130
#2 POOL	0	7.4	0.8	0905
#5 POOL	0	7.4	0.6	0848
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED 11-3-87	DATE ANALYZED 11-3-87	COPY TO: <input checked="" type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY	ANALYSIS STARTED 1250	
TIME RECEIVED 1205-1330	ANALYSIS FINISHED 1350	
DATE RECEIVED 11-3	INCUBATOR TEMP 35.7	
ACCEPTED BY shms	PROCESSED BY Shms	
SIGNATURE Carol Shms 11/5/87		
REMARKS	* mp pool - 2 NON-COLIFORMS	

BACTERIOLOGICAL ANALYSIS OF WATER

MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED

11-3-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	1.1	0950	MCAS - 3502	24	0	0.5	1010	TIME RECEIVED 1205-1330
RR - 15	2		1.1	1000	MCAS - 2002	25		0.6	1025	DATE RECEIVED 11-3-87
RR - 10	3		1.2	1005	MCAS - 4157	26		0.5	1120	ACCEPTED BY SHORES
	4				MCAS - 2049	27		0.5	1115	DATE ANALYZED 11-3
A-1	5		0.4	0920		28				ANALYSIS STARTED 1250
BB - 7	6		1.0	0830	NRMC - FOOD SERVICE	29		0.6	1215	ANALYSIS FINISHED 1350
BB - 49	7		1.1	0850	PP - 2615	30		0.7	1110	INCUBATOR TEMP 35.7
BB - 245	8		1.0	0840	PP - 2613	31		0.7	1120	PROCESSED BY SHORES
	9				BM - 5400	32		0.6	1140	
BA - 103	10		0.4	1100	BM - 1985	33		0.6	1155	CUSTODY DATA
BA - 101	11		0.5	1120	LCH - 4022	34		0.8	1245	DATE
	12				LCH - 4020	35		0.8	1300	TIME
TT - 38	13		1.0	0900		36				SIGNATURE
TT - 43	14		0.9	0950	H - 1	37		0.7	1045	DATE
TT - 377	15		0.9	0930	H - 16	38		0.7	1100	TIME
	16				FC - 303	39		0.7	0915	SIGNATURE
CK - 1501	17	*	0.7	1015	FC - 420	40		0.7	0930	
M - 139	18	*	1.0	1115	FC - 540	41		0.7	0945	COPY TO:
M - 129	19	*	0.8	1145	HP - 236	42		0.7	0830	<input checked="" type="checkbox"/> UTIL DIR
	20				HP - 540	43		0.7	0900	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21		0.5	0935	HP - 1000 1400	44		0.9	1000	<input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMO
TC - 830	22		0.7	0950	HP - 1202	45		0.9	1015	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC - 501	23		0.6	0900		46				<input type="checkbox"/>

REMARKS

* # 17, 18, 19 - TNTC NON-COLIFORMS

SIGNATURE

Carl S. Shores 11/5/87



BACTERIOLOGICAL ANALYSIS OF WATER
 MCBCL 11330/4 (REV. 7-83)

DATE COLLECTED


10-27-87

REPORTABLE POINTS FOR SDWA

WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	WATER SAMPLES	MARKED	COLIFORM MF/100 ML	RESIDUAL CHLORINE	TIME	LABORATORY DATA
RR - 3	1	0	0.6	1000	MCAS - 3502	24	0	0.3	0940	TIME RECEIVED 1150 1430
RR - 15	2	0	0.8	1015	MCAS - 2002	25	0	0.4	0910	DATE RECEIVED 10-27-87
RR - 10	3	0	0.6	1025	MCAS - 4157	26	0	0.4	0950	ACCEPTED BY 156
	4				MCAS - 2102	27	0	0.4	0920	DATE ANALYZED 10-27-87
A-1	5	0	1.1	0925		28				ANALYSIS STARTED 1320
BB - 7	6	0.2	0.9	0945	NRMC - Fuel services	29	0	0.6	1140	ANALYSIS FINISHED 1445
BB - 49	7	0	1.0	0900	PP - 2615	30	0	0.5	1120	INCUBATOR TEMP 35.2
BB - 9	8	0	1.0	0915	PP - 2600	31	0	0.5	1130	PROCESSED BY 156
	9				BM - 5400	32	0	0.5	1150	
BA - 103	10	0	0.5	1140	BM - 1995	33	0	0.5	1200	CUSTODY DATA
BA - 104	11	0	0.4	1200	LCH - 4022	34	0	0.8	1220	DATE
	12				LCH - 4000	35	0	0.8	1230	TIME
TT - 38	13	0	1.1	0945		36				SIGNATURE
TT - 43	14	0	1.0	0920	H - 1 1015	37	0	0.6	1100	DATE
TT - 2465	15	0	1.1	0925	H - 16	38	0	0.6	1045	TIME
	16				FC - 303	39	0	0.7	0940	SIGNATURE
CK - 1108	17	0	0.9	1015	FC - 420	40	0	0.7	0920	
M - 139	18	0	1.0	1100	FC - 323	41	0	0.5	0930	COPY TO:
M - 231	19	0	0.9	1145	HP - 236	42	0	0.6	1000	<input type="checkbox"/> UTIL DIR
	20				HP - 540	43	0	0.6	1020	<input checked="" type="checkbox"/> WATER TREATMENT
CG - 1	21	0	0.3	1000	HP - 1300	44	0	0.6	0915	<input checked="" type="checkbox"/> PMU <input type="checkbox"/> MCAS PMO
TC - 830	22	0	1.0	1005	HP - 1202	45	0	0.6	0945	<input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE
TC 701	23	0	1.0	1015		46				<input type="checkbox"/>

REMARKS # 5 few Non-Coliforms
 # 6 Resampled

SIGNATURE Robert G. Dyer

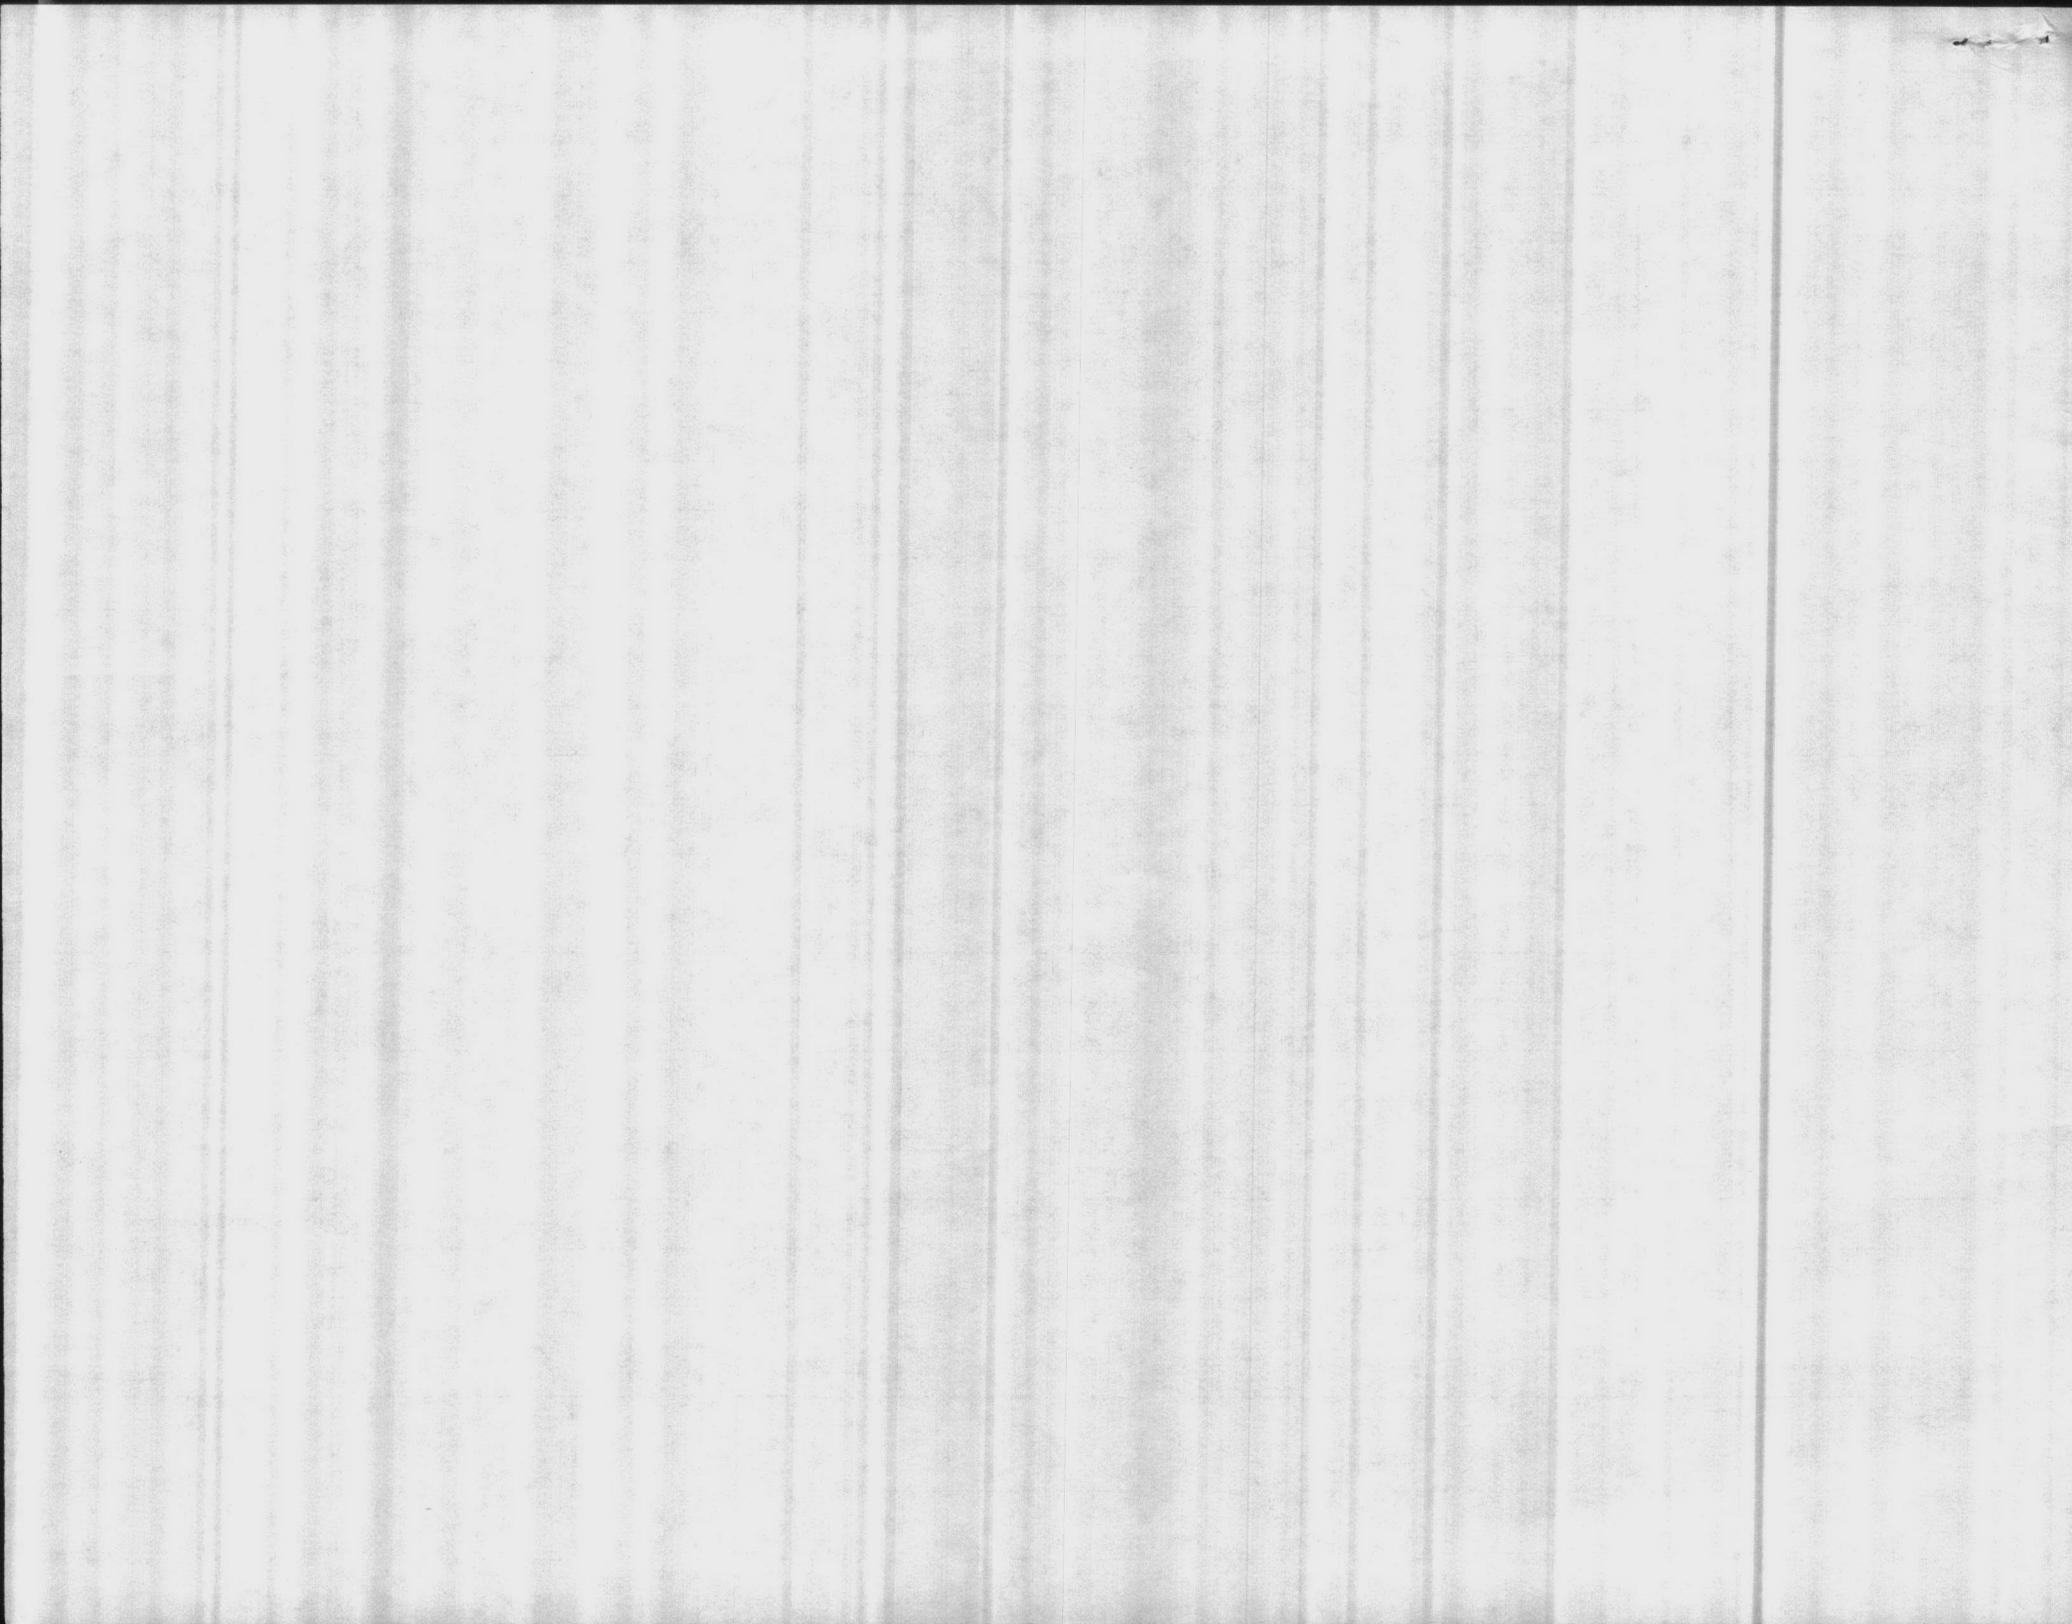

BACTERIOLOGICAL ANALYSIS OF WATER

NON-REPORTABLE

WATER SAMPLES	TOTAL COLIFORM COUNT MF/100 ML M-ENDO MEDIA	RESIDUAL CHLORINE	pH	TIME
BB-97	0	0.4		0850
SH-8	0	0.3		0945
TT POOL				
M.P. POOL	0	0.7	7.6	1045
#2 POOL	0	0.7	7.4	1005
#5 POOL	0	0.8	7.5	1015
P. P. POOL				
P. P. BABY POOL				
MCAS E-POOL				
MCAS O-POOL				
MCAS BABY POOL				

LABORATORY DATA

DATE COLLECTED <i>10-27-87</i>	DATE ANALYZED <i>10-27-87</i>	COPY TO: <input checked="" type="checkbox"/> UTIL DIR <input checked="" type="checkbox"/> WATER TREATMENT <input checked="" type="checkbox"/> PMU <input checked="" type="checkbox"/> MCAS PMU <input type="checkbox"/> NREAD <input checked="" type="checkbox"/> FILE <input type="checkbox"/> _____
COLLECTED BY	ANALYSIS STARTED <i>1330</i>	
TIME RECEIVED <i>1330 & 1445</i>	ANALYSIS FINISHED <i>1445</i>	
DATE RECEIVED <i>10-27-87</i>	INCUBATOR TEMP <i>35.2</i>	
ACCEPTED BY <i>BSL</i>	PROCESSED BY <i>BSL</i>	
SIGNATURE <i>Robert G. Dwyer</i>		
REMARKS		

