


6240
NREAD
14 Jun 86

From: Commanding General, Marine Corps Base, Camp Lejeune
To: Defense Reutilization and Marketing Officer, Camp Lejeune
Subj: INSPECTION REPORT ON LONG TERM HAZARDOUS WASTE STORAGE
FACILITIES AT BUILDINGS TP-451 and TC-863
Ref: (a) Onsite inspection by Mr. Becker, NREAD, and Mr. Eggers,
DRMO
(b) CG MCB ltr FAC/REA/hf 6280 of 15 Jul 83
Encl: (1) Inspection Checklist for Long Term Hazardous Waste
Storage Facilities at Buildings TP-451 and TC-863

1. The enclosure provides results of reference (a) as required by reference (b). No discrepancies were noted. Point of contact is Mr. Danny Becker, NREAD, extensions 5003/2083.

D. D. SHARPE
By direction

Copy to:
AC/S PAC
BFIRECHIEF
SJA
BMO
BSAFETYNGR

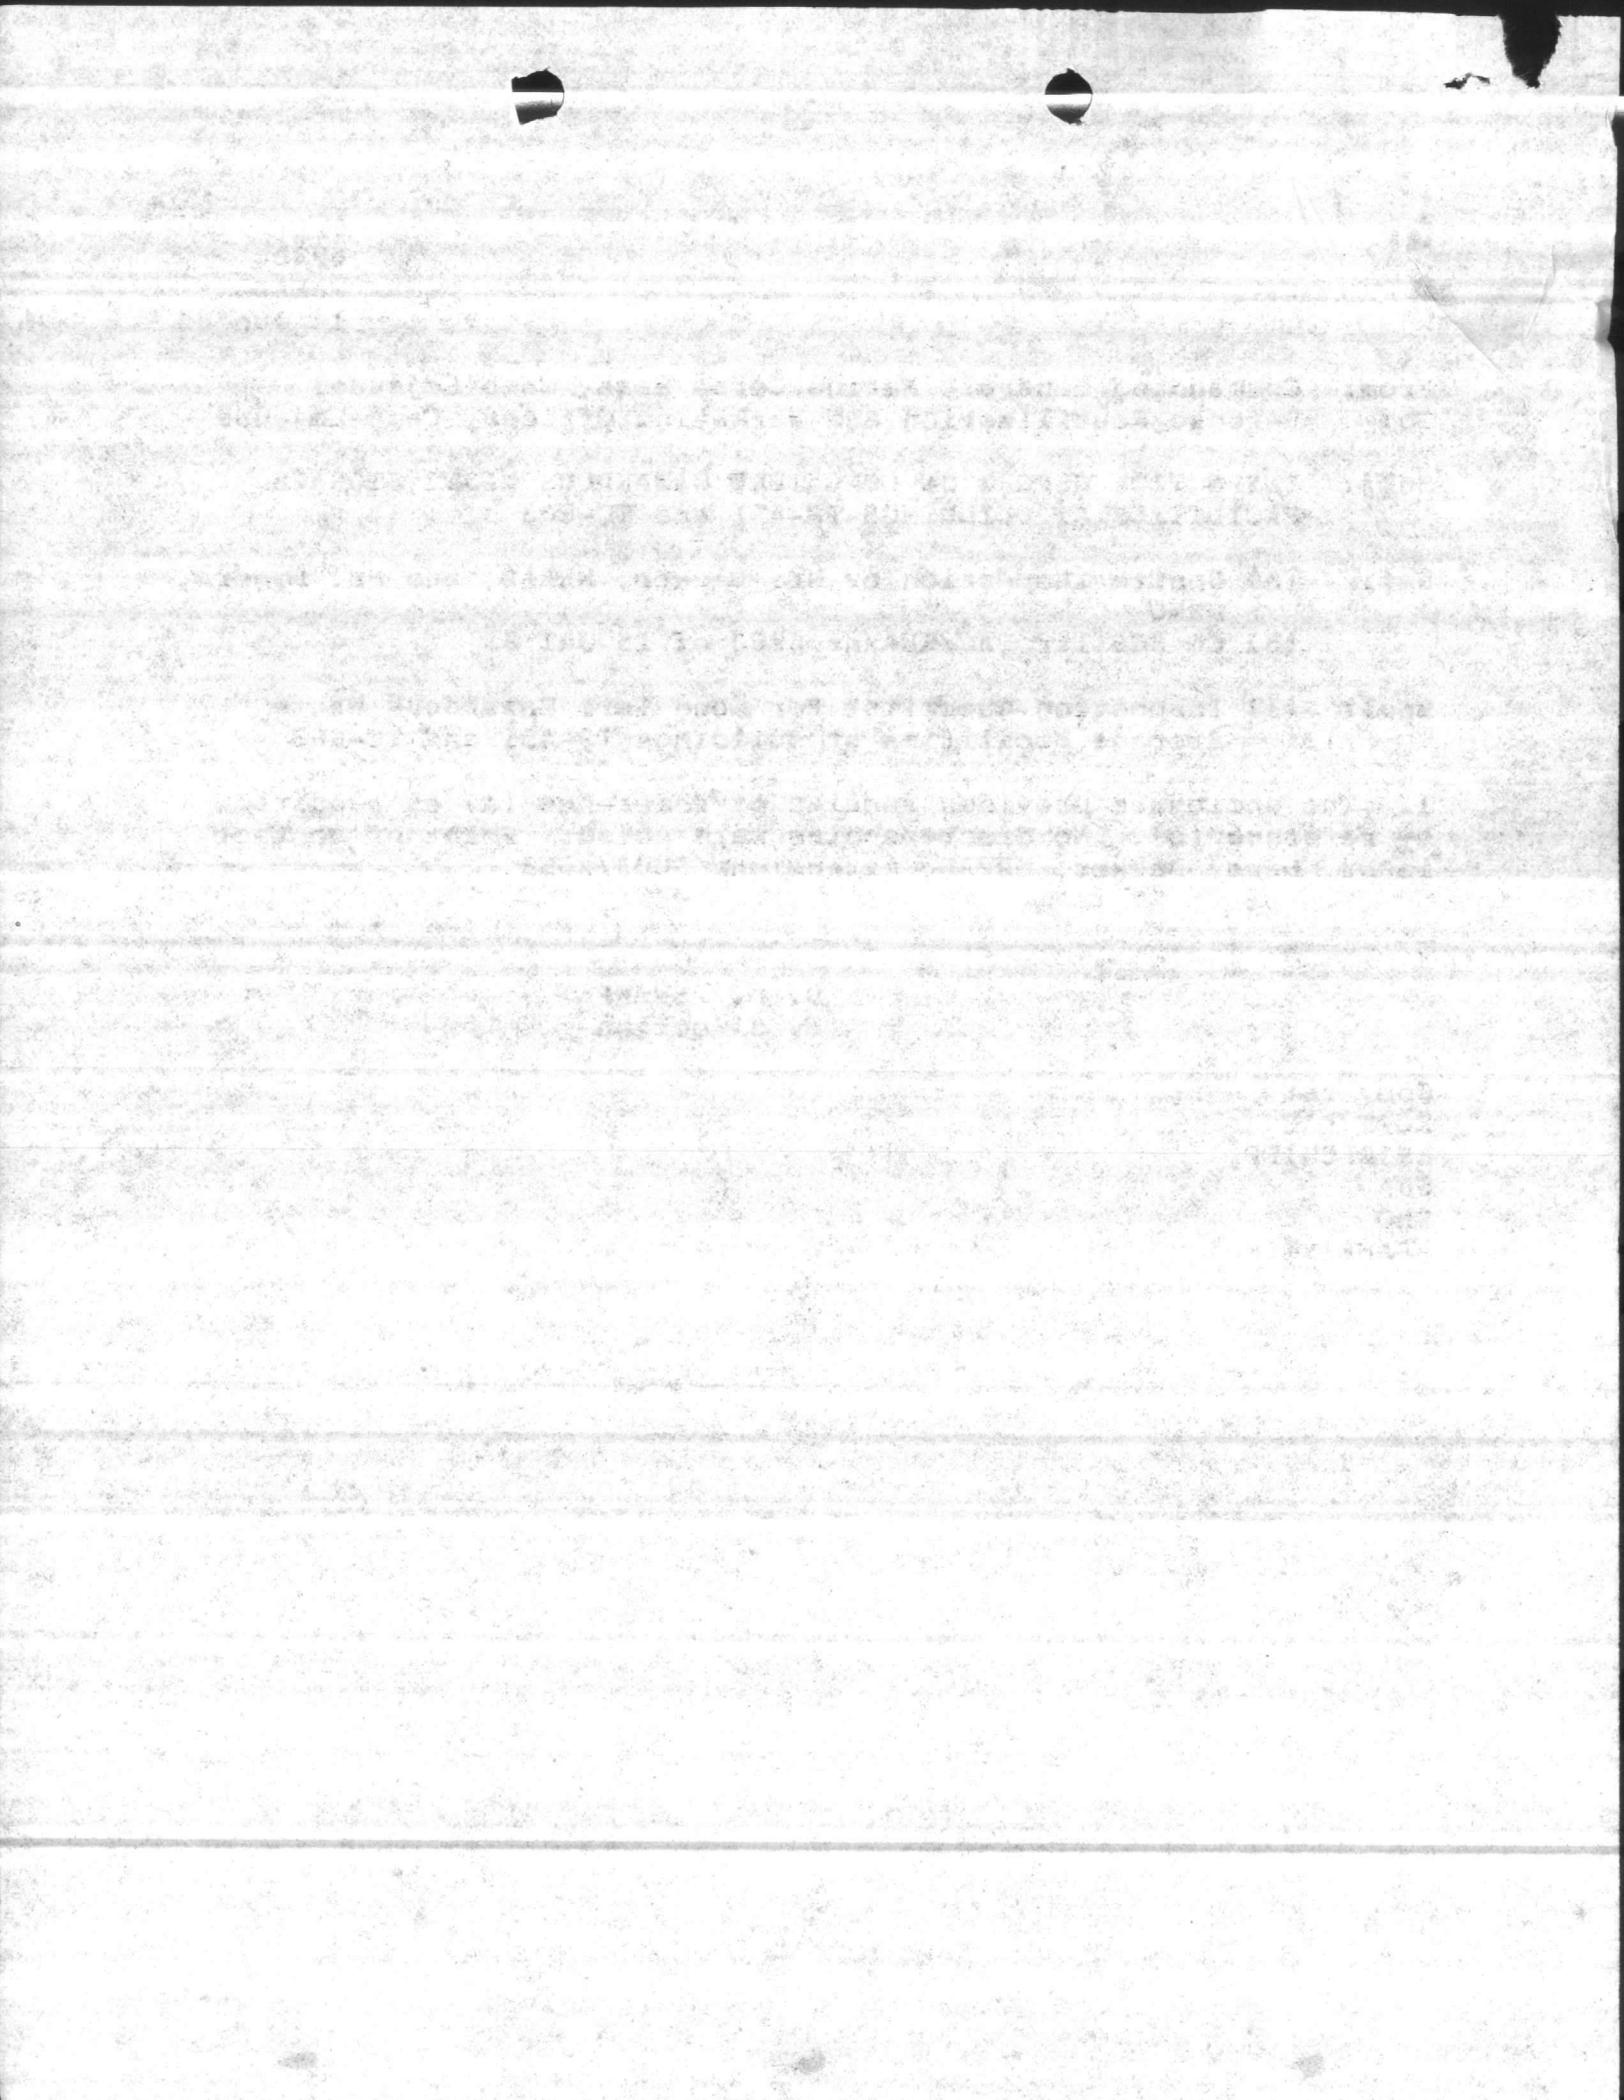

INSPECTION CHECKLIST FOR LONG TERM HAZARDOUS WASTE/MATERIALS STORAGE FACILITIES AT TP-451/TC/863

DATE: 11 July 86

PARTICIPANTS

| FACILITIES AND EQUIPMENT | SAT | UNSAT | COMMENTS |
|---|-----|-------|---|
| 1. FACILITY GROUNDS | X | | |
| 2. FACILITY SECURITY (LOCKS, DOORS, SIGNS, ETC.) | X | | |
| 3. EMERGENCY TELEPHONE AND FIRE ALARMS | X | | |
| 4. UNLOADING PAD DRAIN VALVE | X | | |
| 5. EXHAUST FANS | X | | |
| 6. INTERIOR LIGHTING AND ELECTRICAL OUTLETS | X | | One of the overhead lights in TP-451 is not working |
| 7. SAFETY SHOWERS/ EYE LAVAGES | X | | |
| 8. CURBS, GRATES, OTHER FIXTURES | X | | |
| 9. NON-SPARKING SHOVELS (2) | X | | |
| 10. ABSORBENT (EQUIVALENT OF FOUR 55-GAL BARRELS) | X | | |
| 11. HAZ MAT PUMPS OR EQUIVALENT | X | | |
| 12. FIRE EXTINGUISHERS | X | | |
| 13. PROTECTIVE GEAR AND EQUIPMENT | X | | |
| 14. EMPTY CONTAINERS AND OVERRACK DRUMS | X | | |

| OPERATIONAL CONSIDERATIONS | SAT | UNSAT | COMMENTS |
|---|-----|-------|---------------|
| 1. Required operator inspections and Inspection Log | X | | |
| 2. Emergency Contingency Plan Posting & Operator Familiarity | X | | |
| 3. Fire Department Phone number posting | X | | |
| 4. Condition of containers in use | X | | |
| 5. Presence of odors/vapors, residues in sumps, deck, etc. | X | | |
| 6. Unloading Pad Valve Operation | X | | |
| 7. Compatibility of Material Storage | X | | |
| 8. Implementation of previously recommended corrective action | X | | |
| 9. Facility Operators since last inspection | X | | George Eggers |

ADDITIONAL COMMENTS, EXPLANATIONS, ETC:

6240
NREAD
8 Aug 86

From: Commanding General, Marine Corps Base, Camp Lejeune
To: Defense Reutilization and Marketing Officer, Camp Lejeune

Subj: INSPECTION REPORT ON LONG TERM HAZARDOUS WASTE STORAGE
FACILITIES AT BUILDINGS TP-451 and TC-863

Ref: (a) Onsite inspection by Mr. Becker, NREAD, and Mr. Eggers,
DRMO
(b) CG MCB ltr FAC/REA/hf 6280 of 15 Jul 83

Encl: (1) Inspection Checklist for Long Term Hazardous Waste
Storage Facilities at Buildings TP-451 and TC-863

1. The enclosure provides results of reference (a) as required
by refernce (b). No discrepancies were noted. Point of contact
is Mr. Danny Becker, NREAD, extensions 5003/2083.

P. E. BLACK
By direction

Copy to:
AC/S FAC
BFIRECHIEF
SJA
BMO
BSAFETYMGR

100
100
100

The following information was obtained from the records of the
Department of the Interior, Bureau of Land Management, on
the subject of the land described in the foregoing.

The land described in the foregoing is situated in the
County of [] State of [] and is owned by []

and is subject to the following conditions, to-wit:

1. The land is subject to the right of eminent domain
of the State of [] and the County of []

2. The land is subject to the right of eminent domain
of the County of [] and the State of []

3. The land is subject to the right of eminent domain
of the State of [] and the County of []

4. The land is subject to the right of eminent domain
of the County of [] and the State of []

5. The land is subject to the right of eminent domain
of the State of [] and the County of []

6. The land is subject to the right of eminent domain
of the County of [] and the State of []

7. The land is subject to the right of eminent domain
of the State of [] and the County of []

8. The land is subject to the right of eminent domain
of the County of [] and the State of []

9. The land is subject to the right of eminent domain
of the State of [] and the County of []

10. The land is subject to the right of eminent domain
of the County of [] and the State of []

11. The land is subject to the right of eminent domain
of the State of [] and the County of []

12. The land is subject to the right of eminent domain
of the County of [] and the State of []

INSPECTION CHECKLIST FOR LONG TERM HAZARDOUS WASTE/MATERIALS STORAGE FACILITIES AT TP-45171C/805

PARTICIPANTS

Becker, Sharpe, Fipp, & Eggers

DATE: 1 Aug 86

| FACILITIES AND EQUIPMENT | SAT | UNSAT | COMMENTS |
|---|-----|-------|--|
| 1. FACILITY GROUNDS | X | | |
| 2. FACILITY SECURITY (LOCKS, DOORS, SIGNS, ETC.) | X | | |
| 3. EMERGENCY TELEPHONE AND FIRE ALARMS | X | | |
| 4. UNLOADING PAD DRAIN VALVE | X | | |
| 5. EXHAUST FANS | X | | |
| 6. INTERIOR LIGHTING AND ELECTRICAL OUTLETS | X | | The inoperative light noted in the July inspection is undergoing repair. |
| 7. SAFETY SHOWERS/ EYE LAVAGES | X | | |
| 8. CURBS, GRATES, OTHER FIXTURES | X | | |
| 9. NON-SPARKING SHOVELS (2) | X | | |
| 10. ABSORBENT (EQUIVALENT OF FOUR 55-GAL BARRELS) | X | | |
| 11. HAZ MAT PUMPS OR EQUIVALENT | X | | |
| 12. FIRE EXTINGUISHERS | X | | |
| 13. PROTECTIVE GEAR AND EQUIPMENT | X | | |
| 14. EMPTY CONTAINERS AND OVERPACK DRUMS | X | | |

ENCLOSURE (1)

| OPERATIONAL CONSIDERATIONS | SAT | UNSAT | COMMENTS |
|---|-----|-------|---------------|
| 1. Required operator inspections and Inspection Log | X | | |
| 2. Emergency Contingency Plan Posting & Operator Familiarity | X | | |
| 3. Fire Department Phone number posting | X | | |
| 4. Condition of containers in use | X | | |
| 5. Presence of odors/vapors, residues in sumps, deck, etc. | X | | |
| 6. Unloading Pad Valve Operation | X | | |
| 7. Compatibility of Material Storage | X | | |
| 8. Implementation of previously recommended corrective action | X | | |
| 9. Facility Operators since last Inspection | X | | George Eggers |

ADDITIONAL COMMENTS, EXPLANATIONS, ETC:
