


UNIT CONTROL BOX NO.1  
ASSEMBLY DWG. E-112368

UNIT CONTROL BOX NO.2  
ASSEMBLY DWG. E-112368

SCHMATIC WIRING DIAGRAM DWG. E-112296

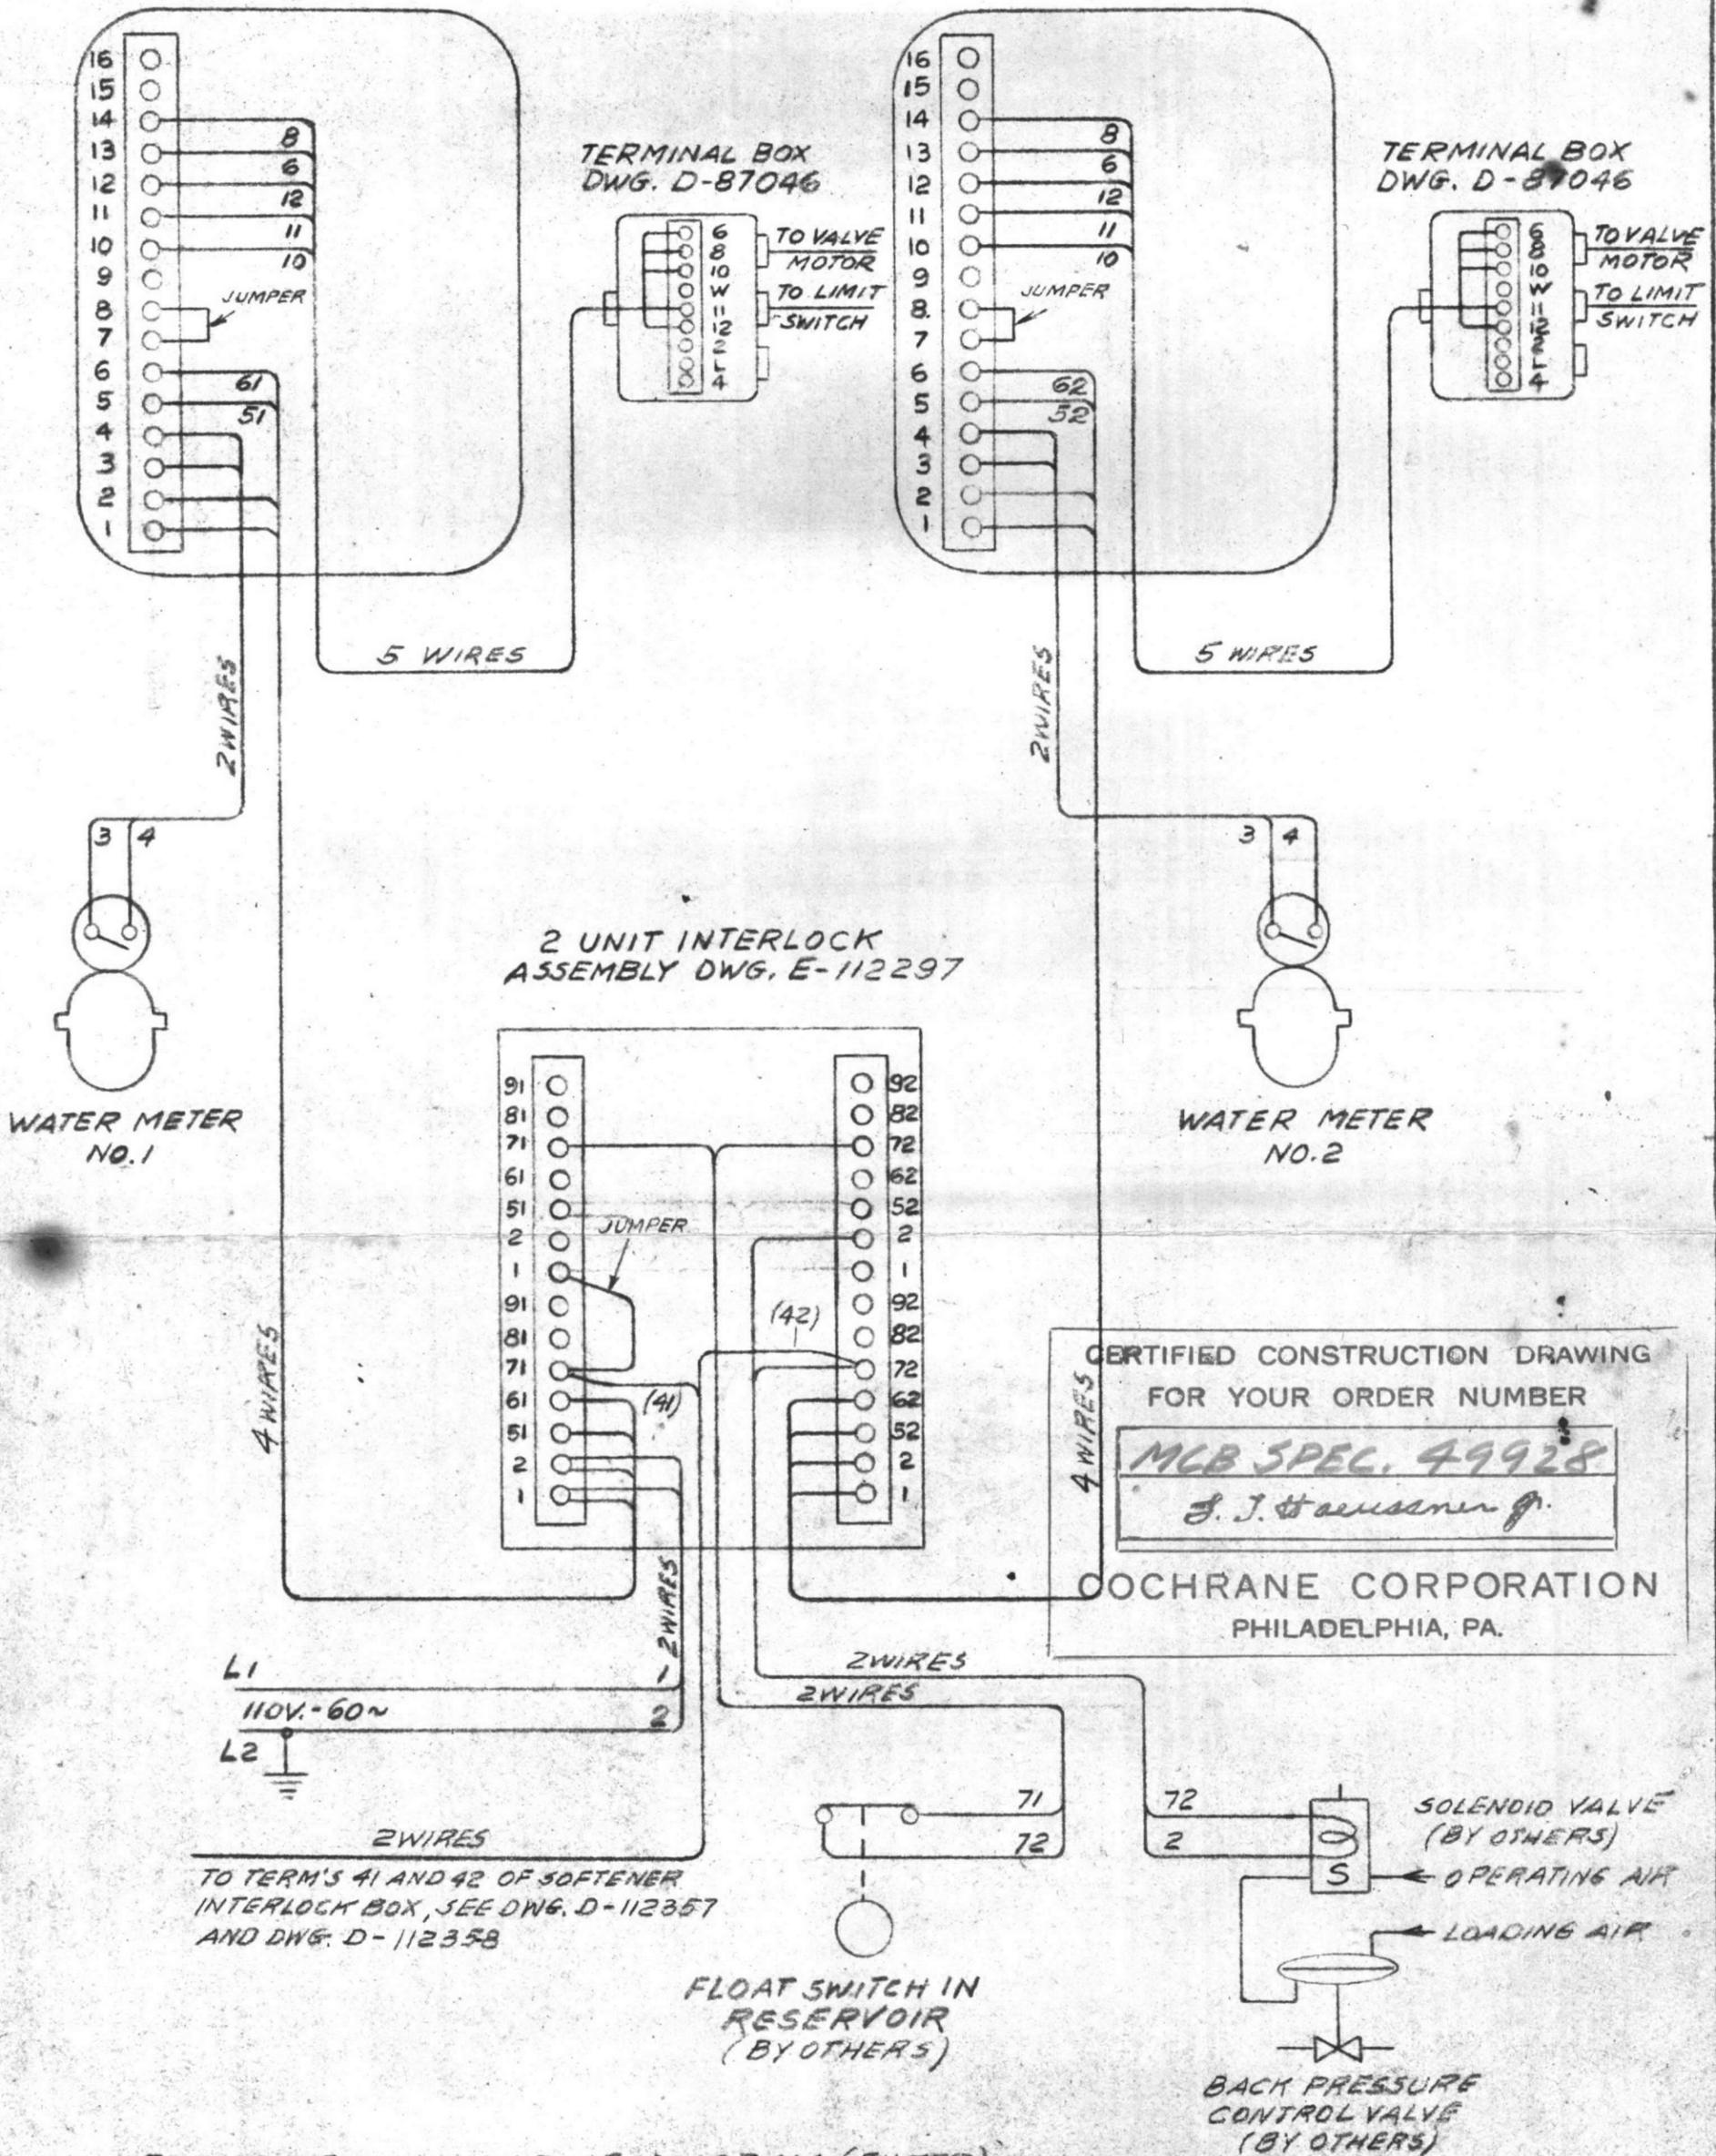

CERTIFIED CONSTRUCTION DRAWING  
FOR YOUR ORDER NUMBER  
**MCB SPEC. 49928**  
*J. J. Haussener*  
COCHRANE CORPORATION  
PHILADELPHIA, PA.

FOR SCHEMATIC WIRING DIAGRAM (FILTER)  
SEE DWG. C-112295

This print is our property and is loaned subject to return on demand and with the express condition that it is not to be used directly or indirectly detrimental to our interests.

NOV 5 1956

ENGINEERING DEPT. - Cochrane Corp.

SCALE	DRAWN	DATE	CHKD.	FIRST USED ON S.O.	APPD.	LTR.	DATE	REVISION	DFT. APP.	ENG. APP.
	EP	9-9-56	JLU	3202-56						

COCHRANE CORPORATION PHILADELPHIA, PA.		CONNECTIONS FOR DOUBLE UNIT FILTER (HYDROMATIC VALVE)		SIZE	NUMBER	CHG. LTR.
S.O. 3202 56				D	112294	

3505 20

NOV 9 1922

RECORDED BY  
COCKBURN CORPORATION

2 1 1922

FOR ALL OTHER MATTERS  
CONTACT COCKBURN CORPORATION

NOV 9 1922