


10-10-8

DANNY,

I TALKED TO PMU ~~ON~~ ABOUT
THIS. LT. CURLEY WENT OUT TO
INSPECT THE AREA. HIS
RECOMMENDATION WAS THAT THEY
NOT USE THE WATER FOR POTABLE
USE. HE MADE HIS RECOMMENDATION
DIRECTLY TO BASE MAINTENANCE.
CHLORINATION WAS ERRATIC. NOT
POTABLE SIGNS ARE BEING POSTED.
FOR INFO YESTERDAY'S BACT WAS
OVERGROWN.

BETSY.

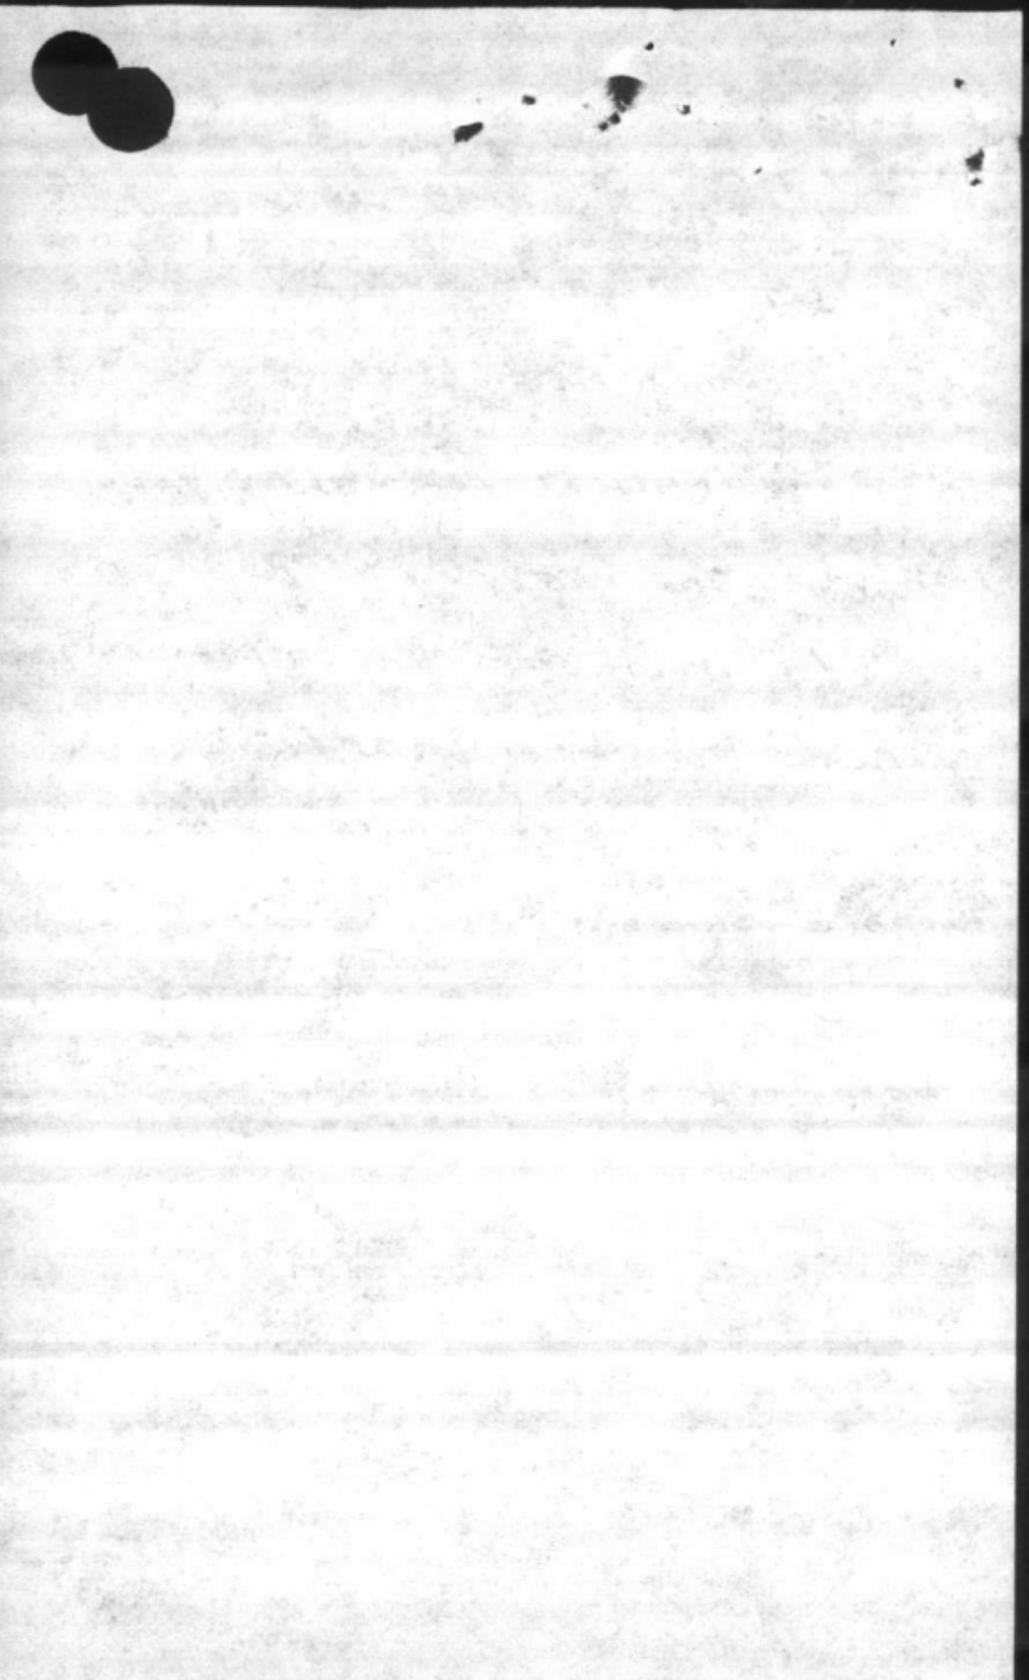

DEPARTMENT OF THE NAVY SELF-DUPLICATING NOTE

Use only for an informal, preferably hand-written note. Make duplicate only when required for follow-up or working file. See correspondence manual for formal, official memoranda.

TO:

DIRECTOR, NREAD

- | | | |
|--|--|--|
| <input type="checkbox"/> ACTION | <input type="checkbox"/> COORDINATE | <input type="checkbox"/> PREPARE FOR SIGNATURE |
| <input type="checkbox"/> AS DISCUSSED | <input type="checkbox"/> CORRECTION | <input type="checkbox"/> REPORT BACK |
| <input type="checkbox"/> CALL/SEE ME | <input type="checkbox"/> INFORMATION | <input type="checkbox"/> RETURN |
| <input type="checkbox"/> COMMENT/CLEAR | <input type="checkbox"/> PREPARE DRAFT | <input type="checkbox"/> |

JULIAN:

COULD YOU HAVE ONE OF YOUR WATER QUALITY PEOPLE CHECK THE WATER SOURCE AT THE LANDFILL TO SEE IF THE WATER COMING FROM THE TAP IS CONTAMINATED OR NOT AND LET ME KNOW THE RESULTS. I AM NOT SURE IF THERE IS A PROBLEM OR NOT AT THIS POINT - IT MAY BE NOTHING MORE THAN A HOUSEKEEPING PROBLEM.

Thompson

Ron

FROM:

R. E. SCALES
BASE MAINT

DATE

9/21

EXT.

INJECT R. REEDS

WILL YOU HAVE US OF THE WATER MAINS

LET ME KNOW THE RESULTS. I AM NOT SURE IF THERE IS

THE NEW WASHINGTON WORLD

Handwritten signature

Handwritten initials

NATURAL RESOURCES AND ENVIRONMENTAL AFFAIRS

Marine Corps Base
Camp Lejeune, North Carolina 28542.

9-24-84

Date

From: Director

To: *Danny*


Subj:

As I recall the Sanitary
landfill water Run is
advisory is not potable.

Julian

Betsy - Your Action
Please expedite.

Danny

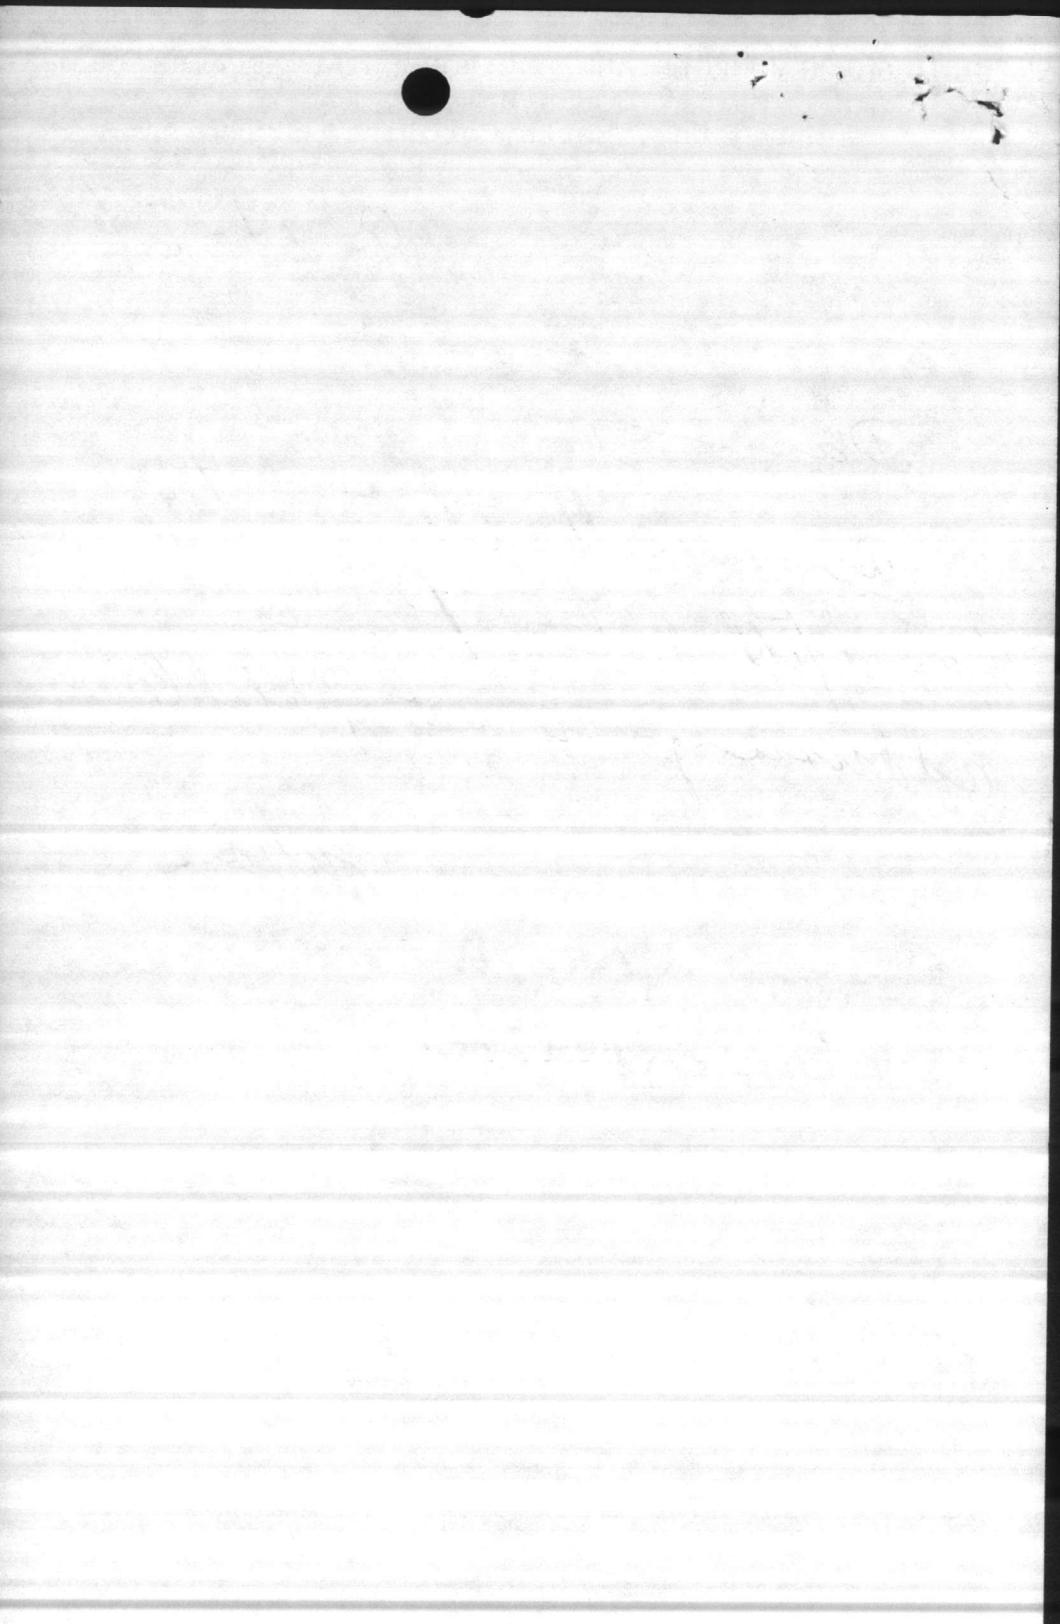

6280
NREAD
10 Oct 1984

From: Director, Natural Resources and Environmental Affairs
Division, Marine Corps Base, Camp Lejeune
To: Base Maintenance Officer, Marine Corps Base, Camp Lejeune
(Attn: Mr. Ron Scales)

Subj: DRINKING WATER QUALITY; SANITARY LANDFILL

Encl: (1) Mr. Ron Scales' memo of 21 Sep 1984

1. NREAD and Preventive Medicine personnel have evaluated the onsite water supply at the Base Landfill as requested by the enclosure. The supply has been determined by Preventive Medicine personnel to be unsatisfactory and appropriate action has been taken by PMU to prevent use of the water for human consumption.
2. It is NREAD's understanding that treated water will be available in the area in the relatively near future due to military construction projects just across Sneads Ferry Road. It is recommended that Base Maintenance determine the feasibility of extending this water to the landfill. In the meantime, bottled water or equivalent should be used.

J. I. WOOTEN

Copy to:
PWO

Blind copy to:
SupvChem

Writer: D. Sharpe, NREAD, 5003
Typist: J. Cross, 10Oct84, 5003



1952

The following information was obtained from the records of the
 Department of the Interior, Bureau of Land Management, and the
 Bureau of Reclamation, regarding the land parcels described
 herein. The parcels are located in the State of California,
 County of [County Name], and are situated in the [Area Name].
 The parcels are described as follows:

Parcel 1: [Parcel Description]
 Parcel 2: [Parcel Description]
 Parcel 3: [Parcel Description]

The parcels are owned by [Owner Name], and are subject to
 the following conditions:

1. [Condition 1]
 2. [Condition 2]
 3. [Condition 3]

This document is a true and correct copy of the original
 records of the Department of the Interior, Bureau of Land
 Management, and the Bureau of Reclamation, regarding the
 land parcels described herein. It is certified that the
 information contained herein is true and correct to the best
 of the knowledge of the undersigned.

[Signature]
 [Title]
 [Department]

Date: [Date]

5100
MAIN
06 Sep 84

2375 (Sanitation) employees present

R. Ellis, J. Jones, R. Nelson, M. Gibbs, W. Andrews, M. Lee,
E. Langston, D. Adkins, D. Richardson, W. Jakubowski, P. Deaver,
T. Elliott, G. Price, D. Baxley, D. Bush, Jr.

The September safety meeting was called to order by the chairman, Mr. Maceo Gibbs, at 0800 in Building 1105. The meeting was opened for general discussion and comments.

The chairman stated that the contractors are still washing asbestos onto the ground at the landfill. He suggested that a special area be designated to wash down asbestos.

Mr. Thomas Elliott suggested that fire extinguishers be placed on all dumpmaster vehicles due to the fire hazard created by trash falling onto the motor. He also suggested that a protective steel screen or mask be install to cover the back cab window. This would help protect the driver from flying debris which often strikes against the window.

Mr. David Richardson recommended that corrective actions be administered to correct the water and drainage problem at the Sanitary Landfill. He stated that the water needs to be cleaned up so that the employees will be able to at least wash their hands prior to lunch. The drainage area of the wash rack needs to be pumped out at least twice a week to prevent the filthy water from backing up into the wash rack and getting into the water system.

There were no further questions or comments; the meeting was adjourned at 0830.

MACEO GIBBS

Copy to:
Dir, M&RBr
M&RrSafeO
→ BMainSafeO
GrdStrucGenFore

