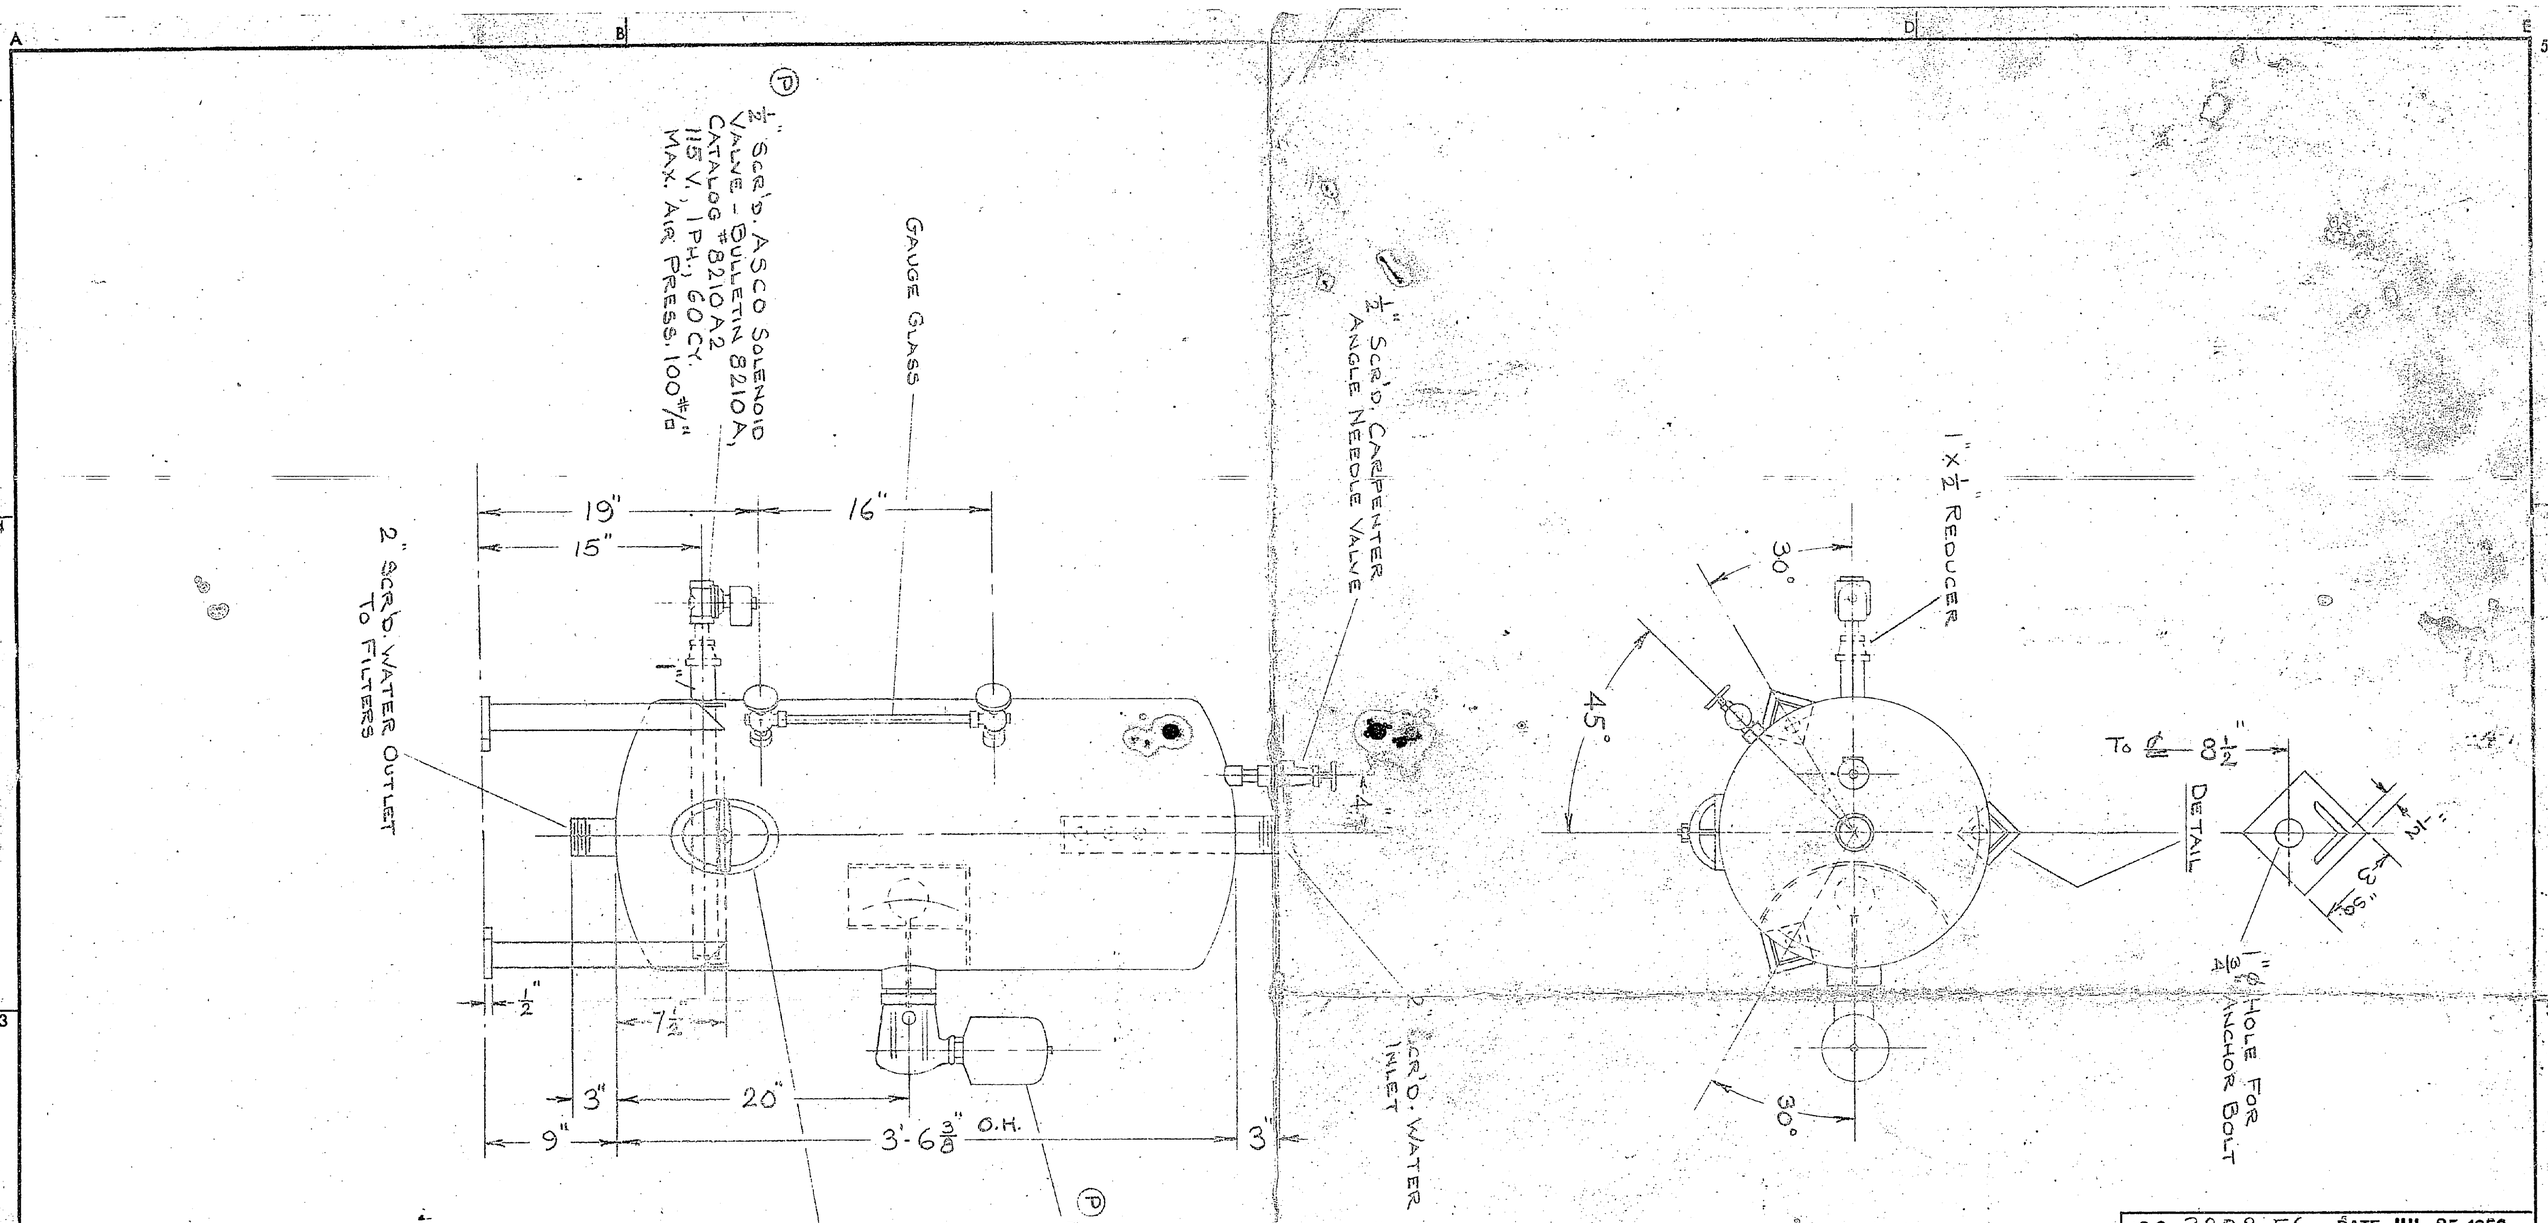

NOTES

NOTHING SHOWN ON THIS DRAWING IS TO BE CONSTRUED AS INCREASING THE MATERIALS TO BE SUPPLIED BY THE COCHRANE CORPORATION OVER THAT SPECIFIED IN THEIR CONTRACT.

DESIGN PRESS. - 100#/□" - 1952 CODE

TEST PRESS. - 244#/□"

(P) - INDICATES CERT. DIMENSION PRINTS WILL BE FURNISHED BY COCHRANE.

PIPING SHOWN IN DOT & DASH LINES NOT FURNISHED BY COCHRANE.

DISTRICT PUBLIC WORKS OFFICE
NAVAL BASE NORFOLK, VA.

APPROVED ONLY

SUBJECT TO THE REQUIREMENTS OF NOY 93544

CONTRACT NO. _____ SPEC. 49928

APPROVAL OF MATERIALS AND/OR EQUIPMENT INDICATES COMPLIANCE WITH SPECIFICATION REQUIREMENTS ONLY - THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS & WEIGHTS, COORDINATION OF TRADES, ETC., AS REQUIRED.

DATE 8-3-56

W. SIHLER
Rear Admiral, CEC, USN
District Public Works Officer

S.O. 3202-56 DATE JUL 25 1956

THIS DRAWING IS FOR APPROVAL
RETURN ONE PRINT IMMEDIATELY TO AVOID DELAY IN FABRICATION

CERTIFIED CONSTRUCTION DRAWING
FOR YOUR ORDER NO.

J. T. Haessner Jr.

DESTROY PREVIOUS COPIES
THIS PRINT DUPLICATES PRINTS PREVIOUSLY FORWARDED YOU EXCEPT FOR CHANGES AS SPECIFIED IN REVISION BLOCK

AERATOR TANK ASSEMBLY

COCHRANE CORPORATION

MANUFACTURING ENGINEERS
PHILADELPHIA 32 PENNSYLVANIA

DESIGNERS AND MANUFACTURERS OF
HOT PROCESS SOFTENERS-DEAERATING HEATERS-DEMINERALIZERS
ZEOLITE SOFTENERS-STEAM SPECIALTIES-DEALKALIZERS
FILTERS-CONDENSATE DRAINAGE CONTROL UNITS-REACTORS
CONTINUOUS BLOWDOWN SYSTEMS

SIZE	NUMBER	CHG. LTR.
E	111357	

LTR.	DATE	REVISION	DFT. APP.	ENG. APP.

SCALE	DRAWN	DATE	CHKD.	FIRST US
1 1/2" = 1 Ft.	T.B.S	7-25-56	[illegible]	3202-56

This drawing, property of COCHRANE CORPORATION is conditionally loaned to the customer and/or his authorized engineers, who by receiving it agree not to reproduce or copy it, in whole or in part, or to make any use of it that is or may be injurious to COCHRANE CORPORATION and to return it upon request.
COCHRANE CORPORATION

Form 5535 A. E. P. Inc.