

MAIN/JIW/th  
6240  
24 Jan 1979

From: Commanding General  
To: Commander, Atlantic Division, Naval Facilities Engineer-  
ing Command, Norfolk, Virginia 23511 (Code 114)

Subj: Chemical and solid waste landfills; well water samples  
from

Ref: (a) LantDiv ltr 114:PPC 6280 of 7 Sep 78

Encl: (1) Test Well Map  
(2) Well Depths

1. As requested in reference (a), subject water samples have been collected by Base Maintenance Department personnel and are forwarded for your chemical analysis. Bottle numbers can be correlated with test well numbers on enclosure (1). Test well data is forwarded as enclosure (2).

B. W. ELSTON  
By direction

SECRET

CONFIDENTIAL - SECURITY INFORMATION

ALL INFORMATION CONTAINED HEREIN IS UNCLASSIFIED


DATE 10/15/01 BY 60322 UC/STP/STP

EXCEPT WHERE SHOWN OTHERWISE

THIS DOCUMENT IS UNCLASSIFIED EXCEPT WHERE SHOWN OTHERWISE


CONFIDENTIAL

MAIN  
LANDFILL  
(SNEADS FERRY  
ROAD)

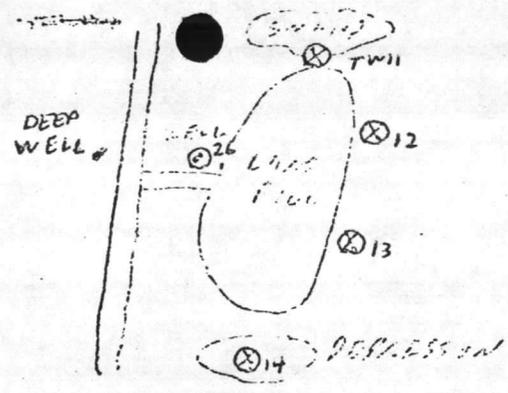


2 EXISTING WELLS (0)  
4 NEW WELLS  
5 SAMPLES

HAZARDOUS  
WASTES  
DUMP  
(NEAR VIETNAM  
VILLAGE)

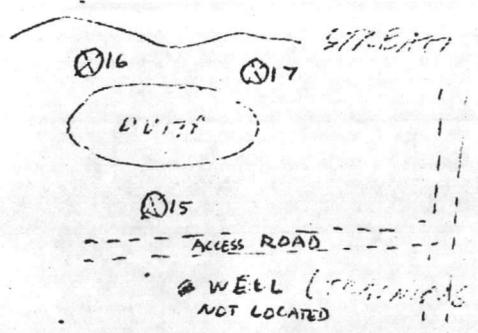


1 EXISTING WELLS  
3 NEW WELLS  
3 SAMPLES  
(ONE NOT FOUND)

MICAS DUMP:  
(OLD CAMP COCKER)

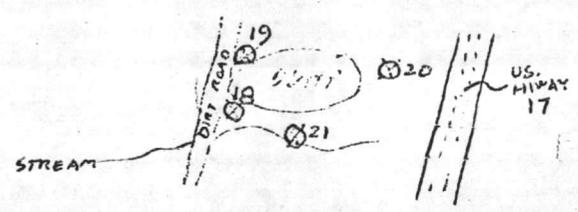

4 NEW WELLS  
4 SAMPLES


ABANDONED  
BURN DUMP  
(NEAR HADNOT POINT  
SEWAGE TREATMENT PLANT)

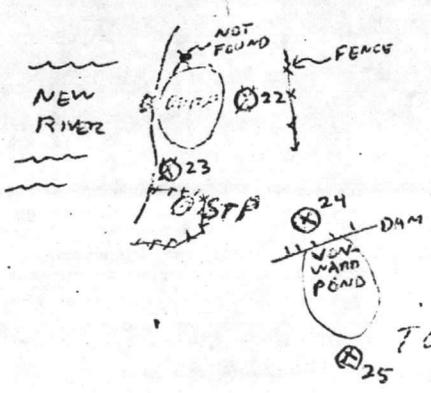

1 EXISTING WELL  
3 NEW WELLS  
4 SAMPLES

TOTAL: 3 EXISTING WELLS  
14 NEW WELLS \*  
17 SAMPLES (PER YEAR)

\* \$ 2,000 TO 7,000

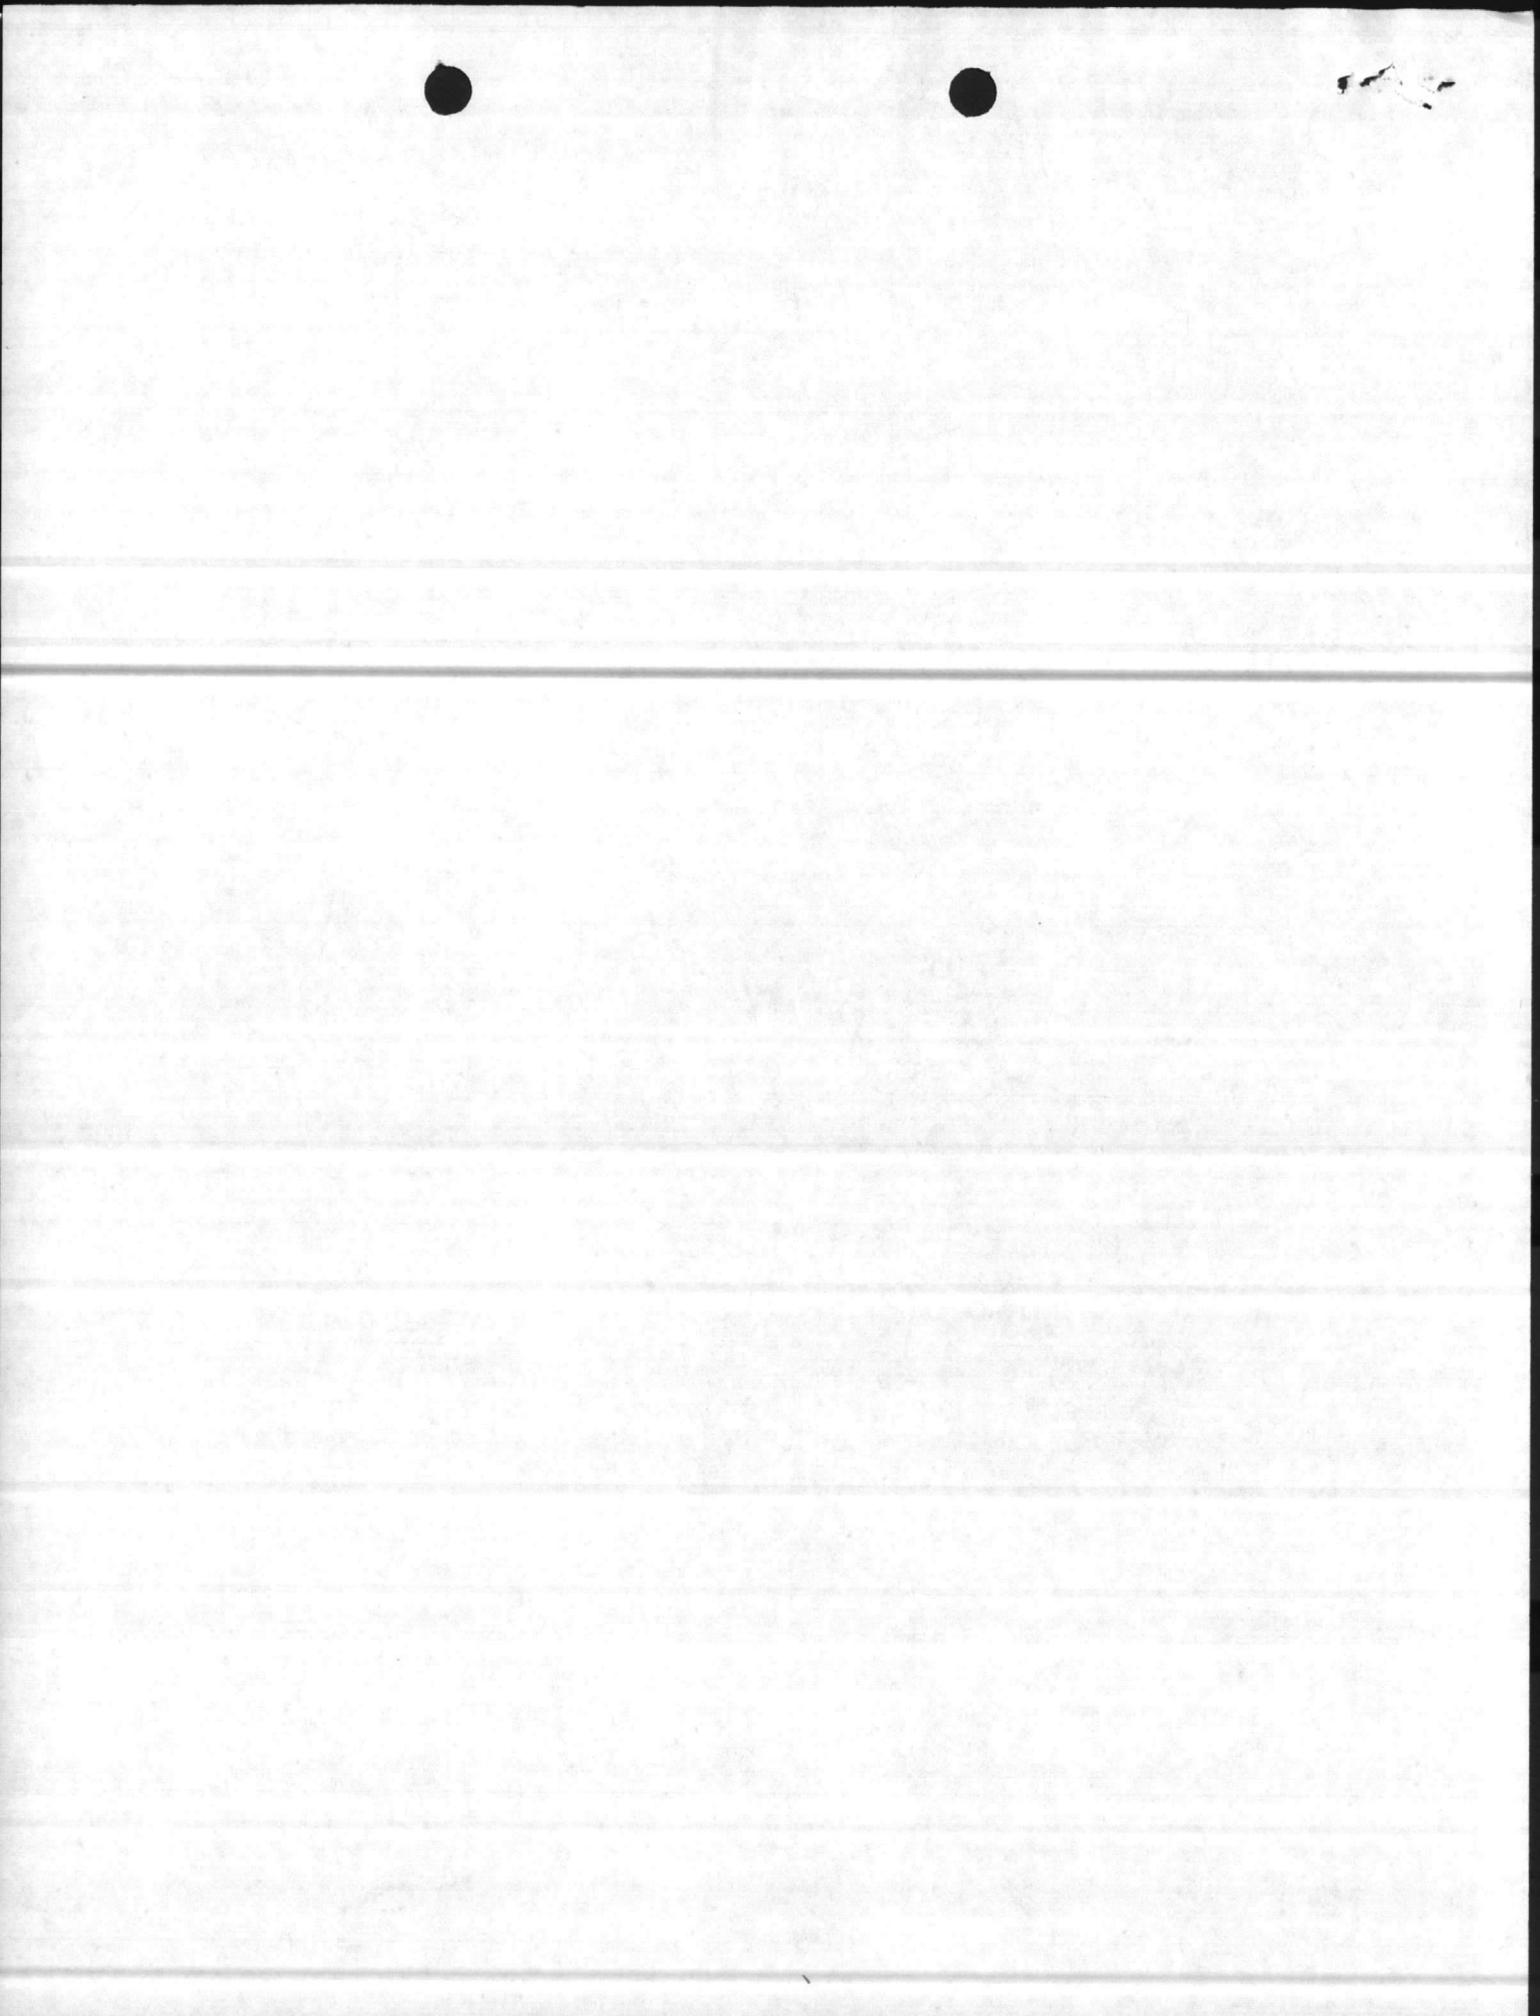

WELL DEPTHS

<u>Wells</u>	<u>Depth from Surface to Water</u>
TW11	6"
TW12	10'
TW13	12'
TW14	Less than 5'
TW15	Estimated 5'
TW16	3'
TW17	Uncollected (Could not Pump)
TW18	3'
TW19	5 1/2'
TW20	Estimated 4'
TW21	4'
TW22	21'
TW23	3'
TW24	Estimated 20'
TW25	Greater than 25 (Unknown)
TW26	Greater than 25 (Unknown)

