

DATE OF INSPECTION  
 28 MAY 1982

TYPE OF INSPECTION  
 A  INTERNAL & EXTERNAL B  INTERNAL & EXTERNAL WITH PRESSURE TEST C  OPERATIONAL

1. FROM BASE MAINT. OFFICER  
 CAMP LEJEUNE, N. C.  
 2. TO NAVFACENGCOM  
 NORFOLK, VA

14. CERTIFICATE ISSUED  YES  NO

15. BOILER INSPECTOR  
*Thomas L. Lancia*  
 NAVY OR NATIONAL BOARD NO.

16. REASON FOR NOT ISSUING CERTIFICATE  
 NAVFAC 239  
 DRY LAY UP

BOILER DATA

3. MANUFACTURER

CRANE

4. PROPERTY NO. 70 5. MFG. SERIAL NO. 133433 6. MFG. MODEL NO. P3903-25

7. BUILDING NO. SB-215 8. YEAR BUILT 9. CAPACITY

10. FUEL (Check) 11. PRESSURE

COAL  OIL  GAS 15 psig DESIGNED OPERATING TEST

12. FEED WATER TREATMENT 13. TYPE

SATISFACTORY  UNSATISFACTORY  WATER TUBE  FIRE TUBE  C. I.

17. BOILER USE  
 HEATING

18. COMBUSTION CONTROL (Mfg. Name)  
 HONEYWELL

19. COMBUSTION

20. FLUE GAS TEMPERATURE

% CO<sub>2</sub> % EXCESS O<sub>2</sub> AFTER BOILER °F ; AFTER HEAT TRAP °F

SAFETY DEVICES  
 SAFETY VALVES

21. MANUFACTURER 22. NUMBER AND SIZE 23. PSI SETTING 24. CONDITION

Consolidated 1-2"

STEAM PRESSURE GAUGE

25. MANUFACTURER 26. CORRECTIONS

ASHCROFT WATER LEG CONSTANT \_\_\_\_\_ psi; OTHER \_\_\_\_\_ psi

27. REASON IF NOT TESTED

FIRING EQUIPMENT


ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER		
29. TYPE	NOZZLE SPRAY	
30. FUEL GRADE	#2	

31. INSPECTOR'S COMMENTS

32. ATTACHMENT(S) (Check)

COPY OF INSPECTOR'S REPORT  SPECIAL COMMENTS

33. SIGNATURE  
*R. M. O'Brien*  
 BY DIRECTION

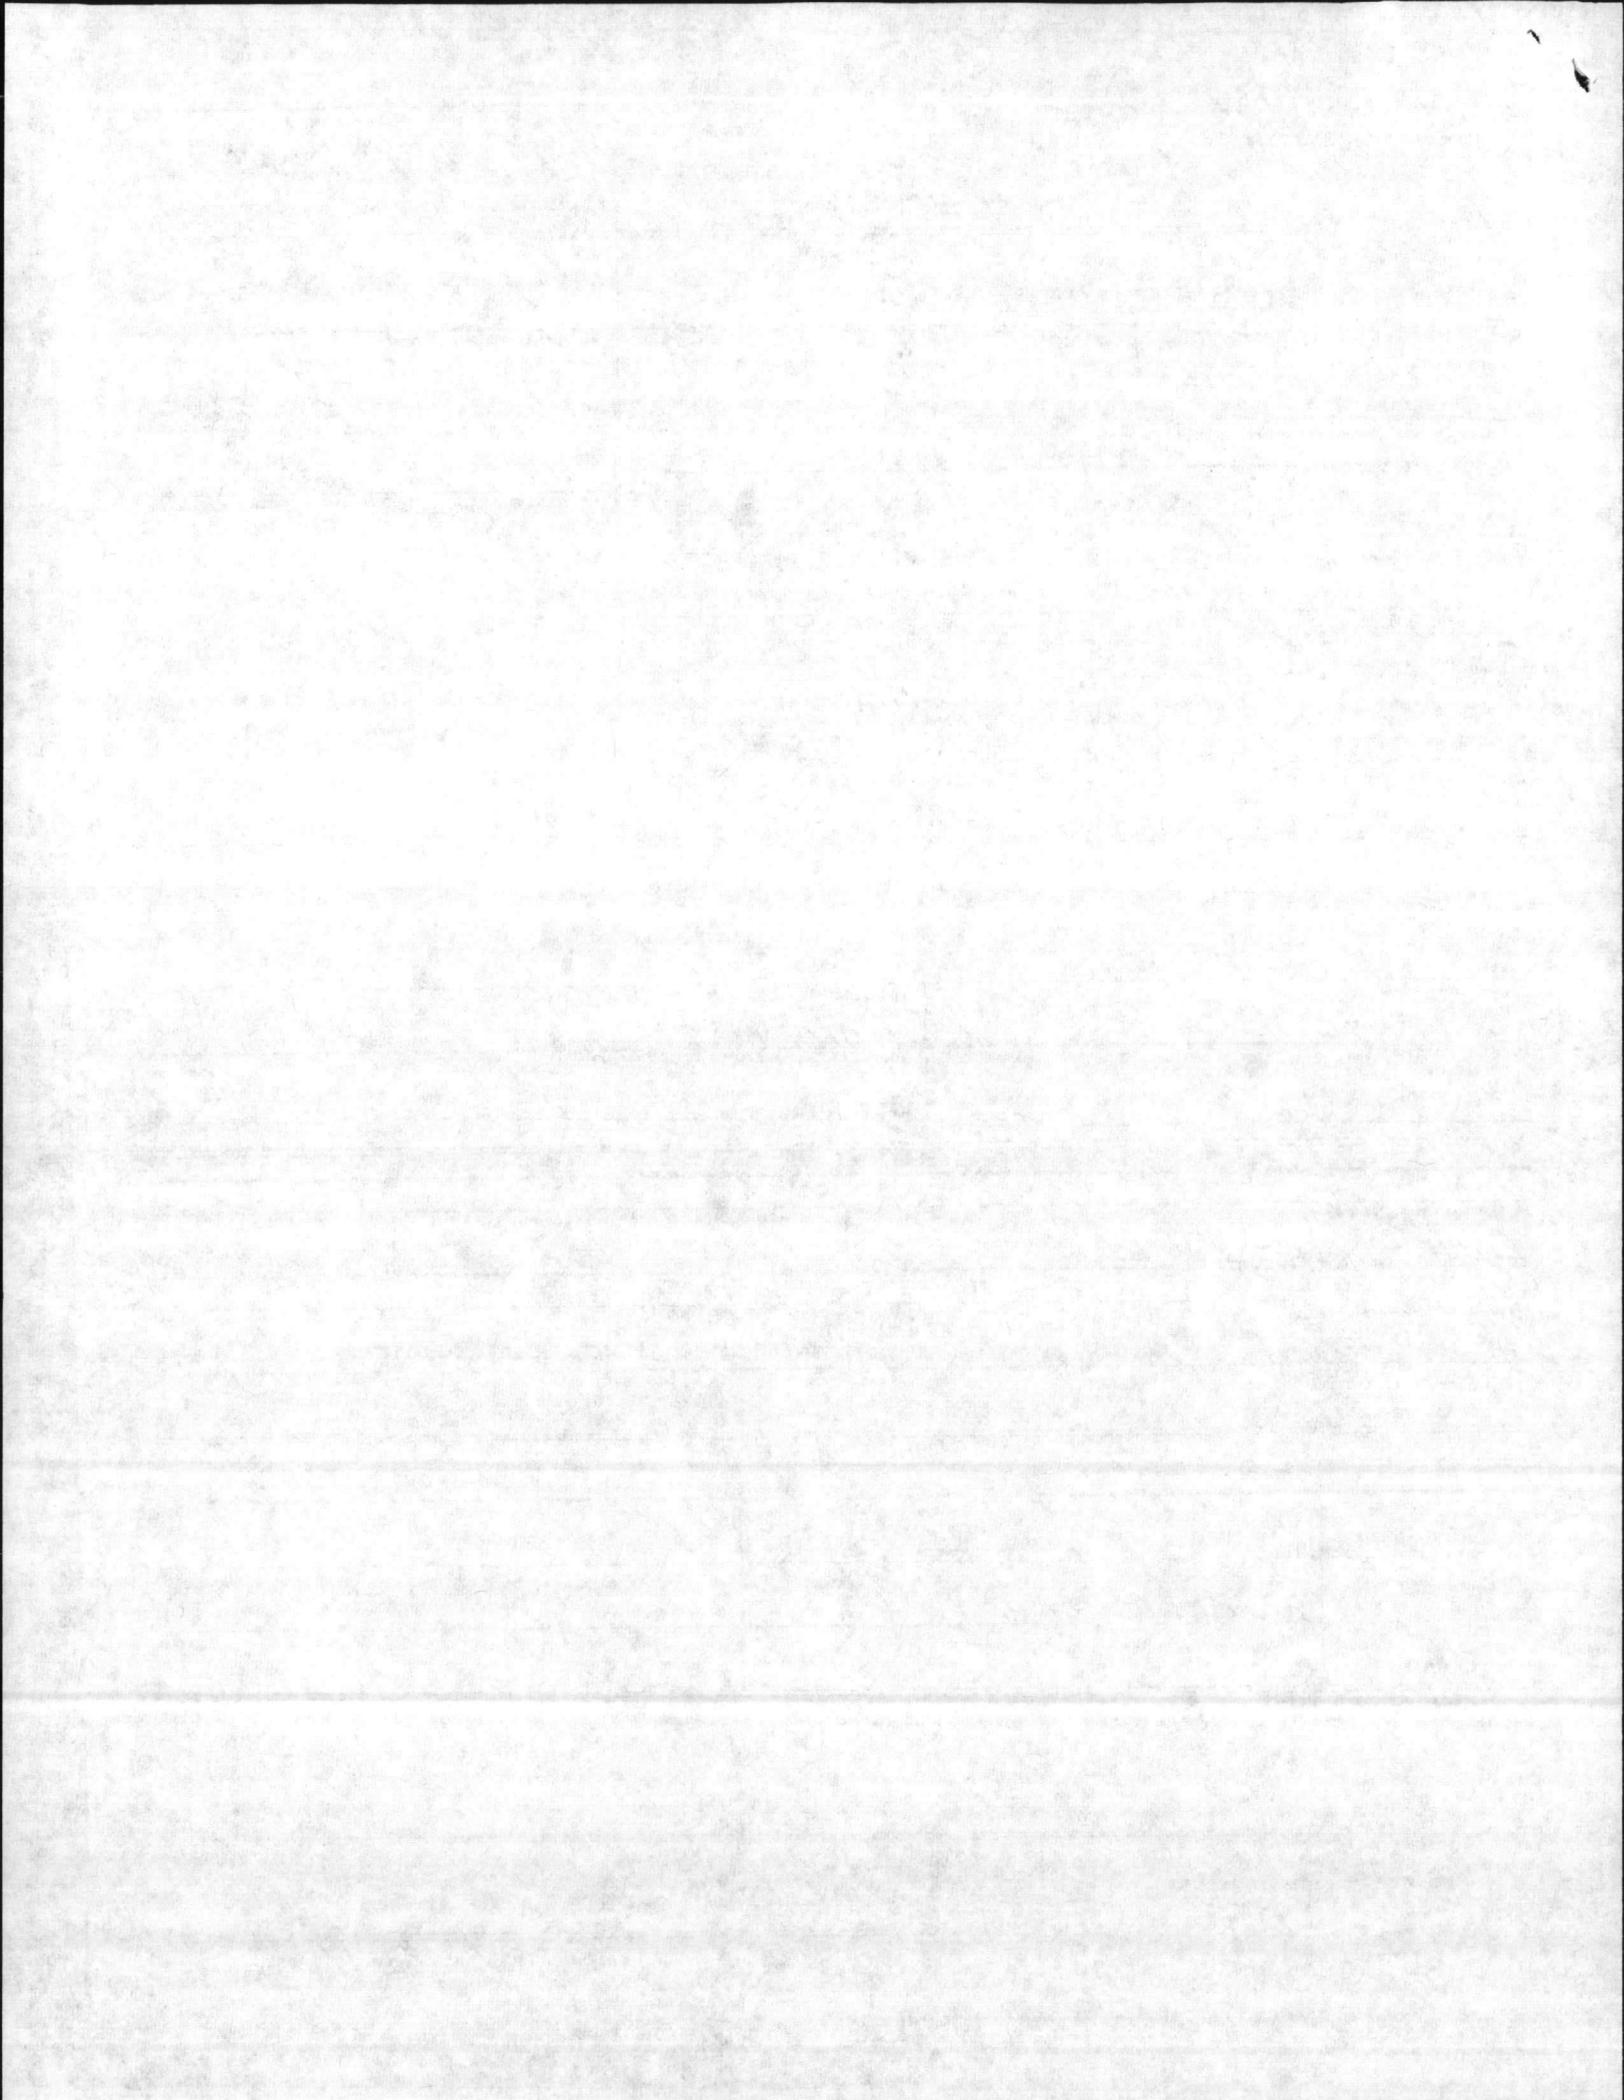

DATE: 11 June 1982

ACTIVITY: Marine Corps Base, Camp Lejeune, North Carolina

BUILDING NO: 215 BOILER NO: 70

Based on the existing condition and present rate of deterioration, it is estimated that the boiler has a remaining life of

5 or more years

( ) years

The following corrective action is recommended:

The below listed boilers located in the Stone Bay Area

have been on dry lay up for about 11 years. The last

inspection shows that the boilers have been cannibalized

for parts to be used on other units. Burners assemble,

pressure gages, low water cutoff or floats and valves are

missing. The outer casings are deteriorated.


In view of the above information, it is requested that the

following boilers be surveyed and removed from the list of

boilers at Camp Lejeune.

<u>Building #</u>	<u>Boiler #</u>
RR-211	67
RR-212	68
RR-213	69
RR-215	70
RR-216	71
RR-217	72

*Thomas L. Lanier*  
NAVFAC 239

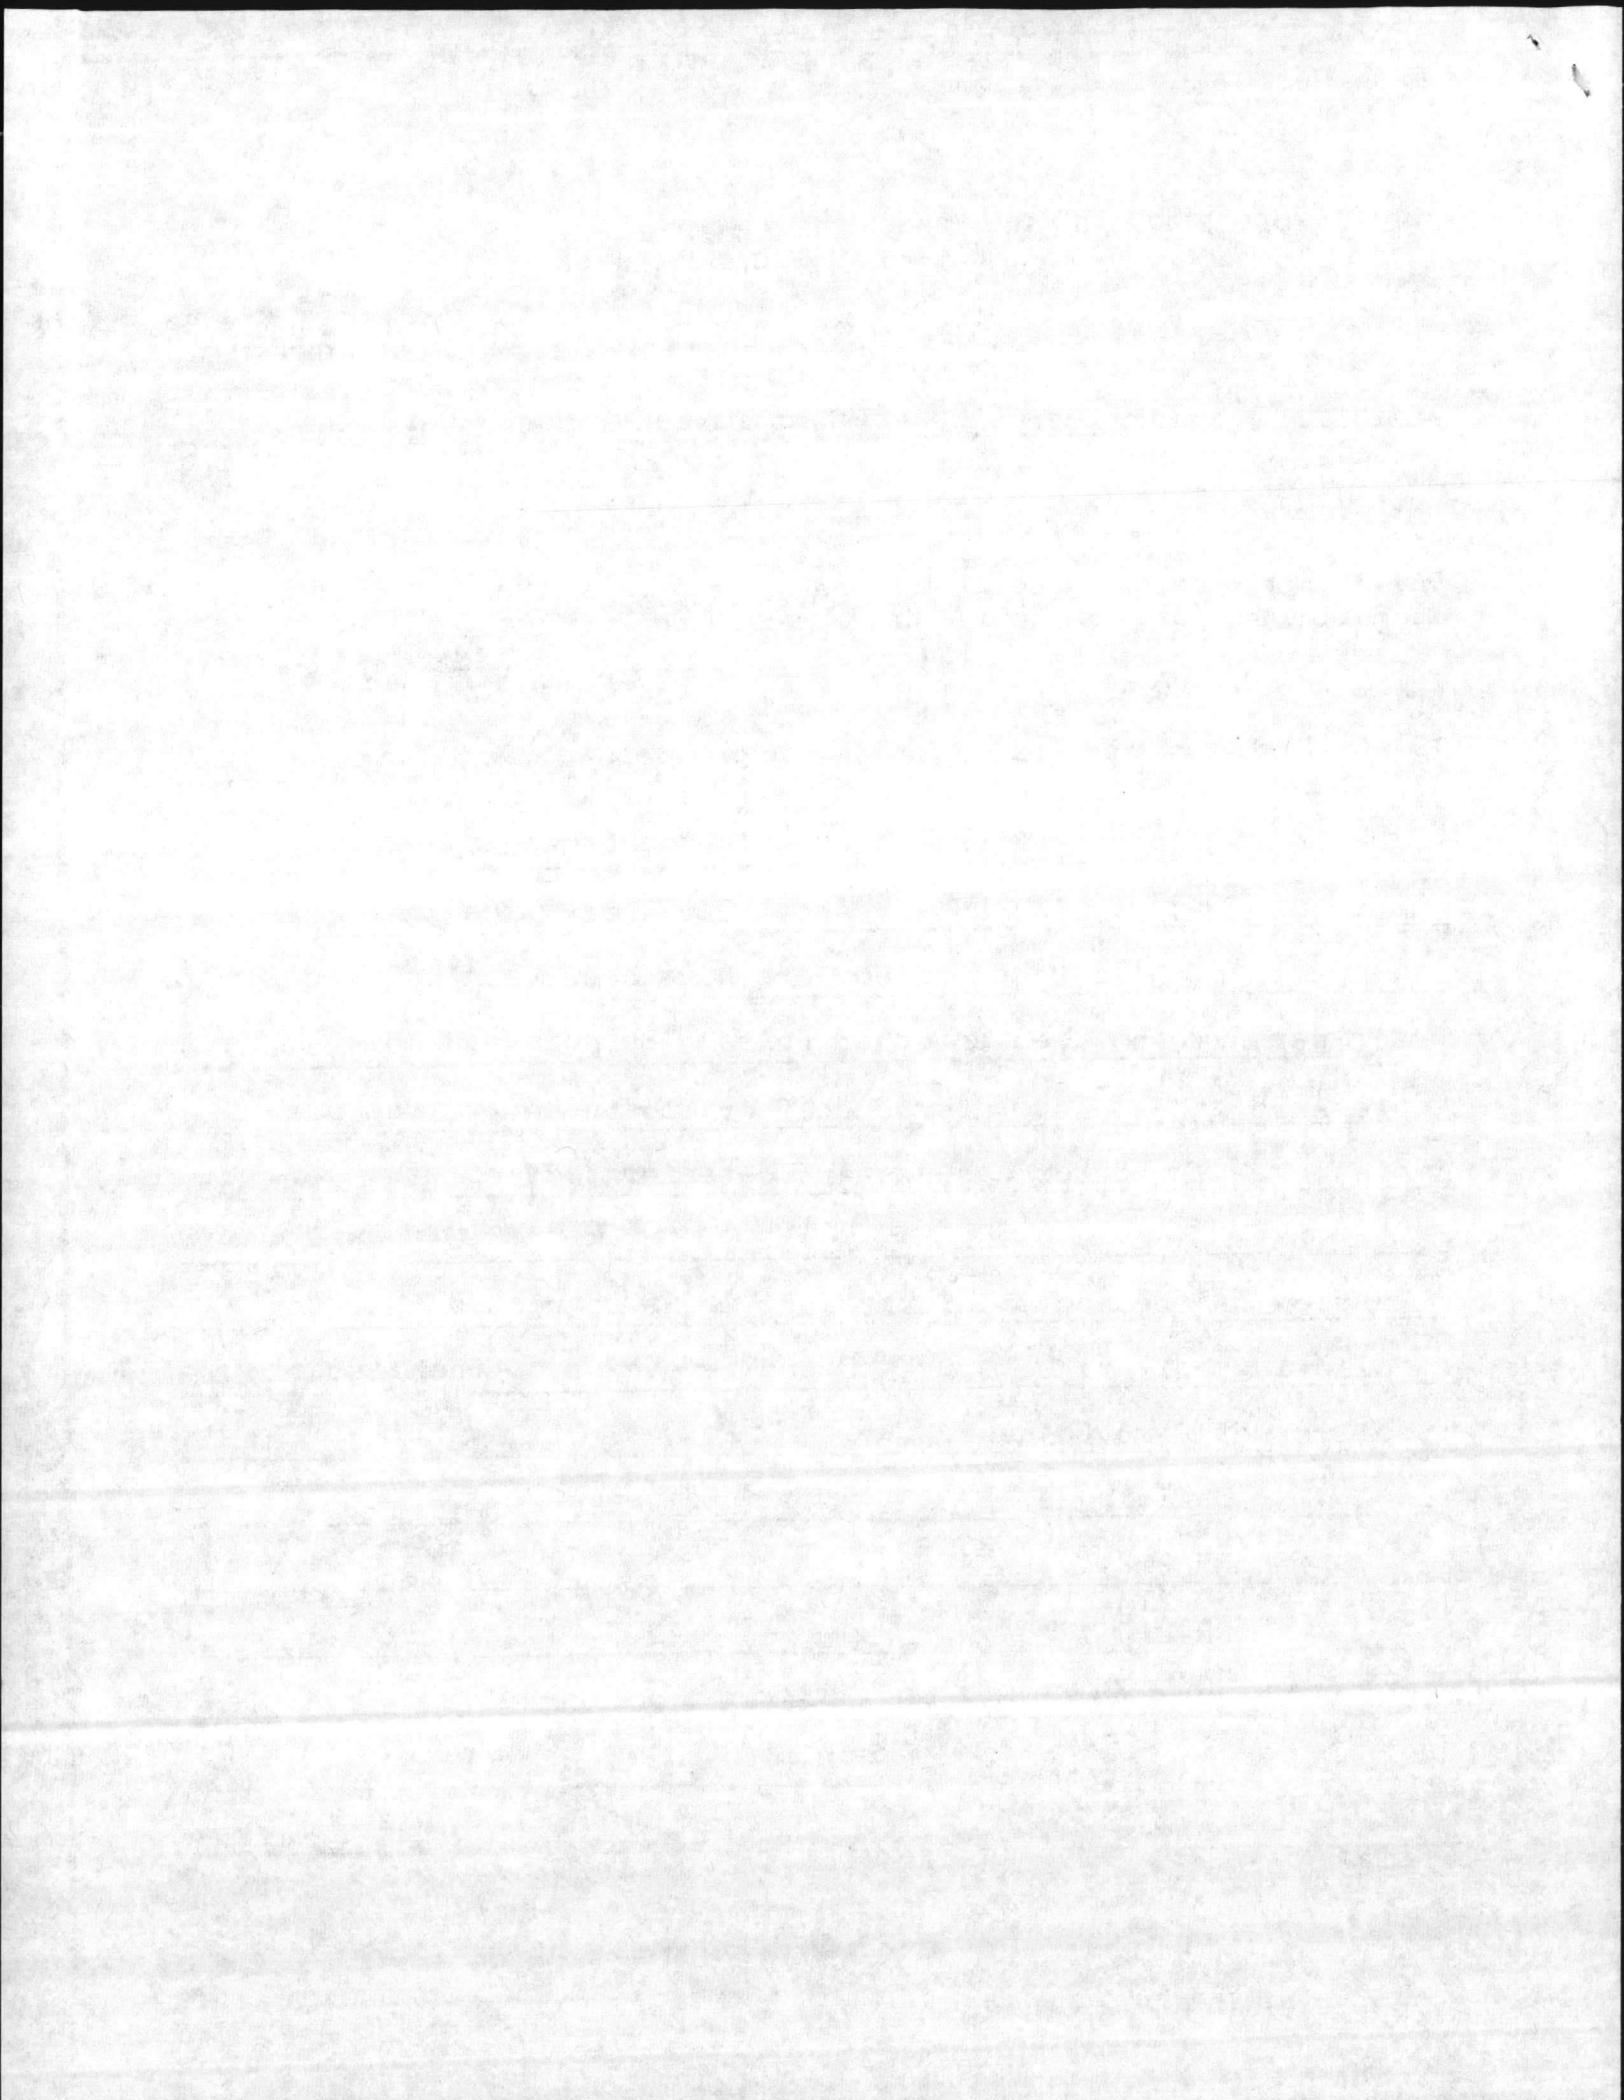

INSPECTION REPORT-BOILERS  
 NAVFAC 9-11014/41 (3/67)  
 Supersedes NAVDOCKS 2544  
 S/N 0105-LF-004-0000

DATE OF INSPECTION  
 27 DEC 1978

TYPE OF INSPECTION  
 A  INTERNAL & EXTERNAL B  INTERNAL & EXTERNAL WITH PRESSURE TEST C  OPERATIONAL

1. FROM  
 2. TO  
 BASE MAINT. OFFICER CAMP LEJEUNE N.C.  
 NAUFACENG-COM NORFOLK VA. 23511

14. CERTIFICATE ISSUED  YES  NO

15. BOILER INSPECTOR  
 Jesse J. Sellan  
 NAVY OR NATIONAL BOARD NO.

NAUFAC 225

16. REASON FOR NOT ISSUING CERTIFICATE  
 DRY LAY UP

BOILER DATA

3. MANUFACTURER  
 CRANE

4. PROPERTY NO. 70  
 5. MFG. SERIAL NO. 133433  
 6. MFG. MODEL NO. P3903-25  
 7. BUILDING NO. SB-215  
 8. YEAR BUILT  
 9. CAPACITY

10. FUEL (Check)  
 COAL  OIL  GAS  
 11. PRESSURE  
 DESIGNED 15 psi OPERATING TEST psi

12. FEED WATER TREATMENT  
 SATISFACTORY  UNSATISFACTORY  
 13. TYPE  
 WATER TUBE  FIRE TUBE  C. I.

17. BOILER USE  
 HEATING  
 19. COMBUSTION  
 % CO<sub>2</sub> % EXCESS O<sub>2</sub>

18. COMBUSTION CONTROL (Mfg. Name)  
 HONEYWELL  
 20. FLUE GAS TEMPERATURE  
 AFTER BOILER °F : AFTER HEAT TRAP °F

SAFETY DEVICES  
 SAFETY VALVES

21. MANUFACTURER  
 Consolidated  
 22. NUMBER AND SIZE 1-2"  
 23. PSI SETTING  
 24. CONDITION

STEAM PRESSURE GAUGE

25. MANUFACTURER  
 ASHCROFT  
 26. CORRECTIONS  
 WATER LEG CONSTANT psi; OTHER psi  
 27. REASON IF NOT TESTED

FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER		
29. TYPE	NOZZLE SPRAY	
30. FUEL GRADE	#2	

31. INSPECTOR'S COMMENTS  
 OIL FIRESIDES - REPLACE GASKETS & DRYING AGENT.

32. ATTACHMENT(S) (Check)  
 COPY OF INSPECTOR'S REPORT  SPECIAL COMMENTS

33. SIGNATURE  
 R.M. Sellan  
 BY DIRECTION

