

File

CONTRACTOR'S SUBMITTAL TRANSMITTAL

LANTDIV NORFOLK 4-4355/3 (Rev. 11-80)

CONTRACT NO. 81-C-1766	TRANSMITTAL NO. 38B	DATE 26 Aug 83
PROJECT TITLE AND LOCATION Public Works & Helipad MCB Camp Lejeune		

FROM CONTRACTOR
Trader Construction Company

TO
Lockwood Greene/Six Associates

Factmgt

CONTRACTOR USE ONLY

REVIEWER USE ONLY

*List only one specification division per form.

**ACTION CODES

List only one of the following categories on each transmittal form, and indicate which is being submitted

- A-Approved
- D-Disapproved
- AN-Approved as noted
- RA-Receipt acknowledged.
- C-Comments
- R-Resubmit

Contractor Approved OICC Approval Deviation/Substitution For OICC Approval

ITEM NO.	PROJ. SPEC. SECT. & PARA. and/or PROJ. DWG. NO.	ITEM IDENTIFICATION (Type, size, model no., Mfg. name, dwg. or brochure number)	NO. OF COPIES	ACTION CODES **	REVIEWER'S INITIALS CODE AND DATE
158	15605	Underground Gasoline Storage Tank	7	AN/RA	JLD- 9 Sept. 83
		Dispensing Pump	7		
		Underground Fuel Oil Tank	7		
		Accessories			

ROUTING SLIP

INT

450

1

2

3

4

5

6

7

CONTRACTOR'S COMMENTS

COPY OF TRANSMITTAL AND SUBMITTALS TO ROICC
ROICC, Camp Lejeune, NC

CONTRACTOR REPRESENTATIVE (Signature)
John M. [Signature]

DATE RECEIVED BY REVIEWER
3/31/83

FROM (Reviewer)
Six Associates, Inc.

TO
Trader Construction Co.

- Submittals are returned with action indicated. Approval of an item does not include approval of any deviation from the contract requirements unless the contractor calls attention to and supports the deviation.
- Submittals are forwarded to LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section and in comments below on ONE COPY of the transmittal form.

REVIEWER'S COMMENTS

1- Vent cap with flame arrester not submitted for gasoline system.


2, No fill cap submitted for fuel oil tank.

Copy - Filed
9-26-83

COPIES TO:
ROICC (2) ✓
LANTDIV (1)
A-E (1)

DATE
9 Sept. 83

SIGNATURE
J. Spencer Jr.

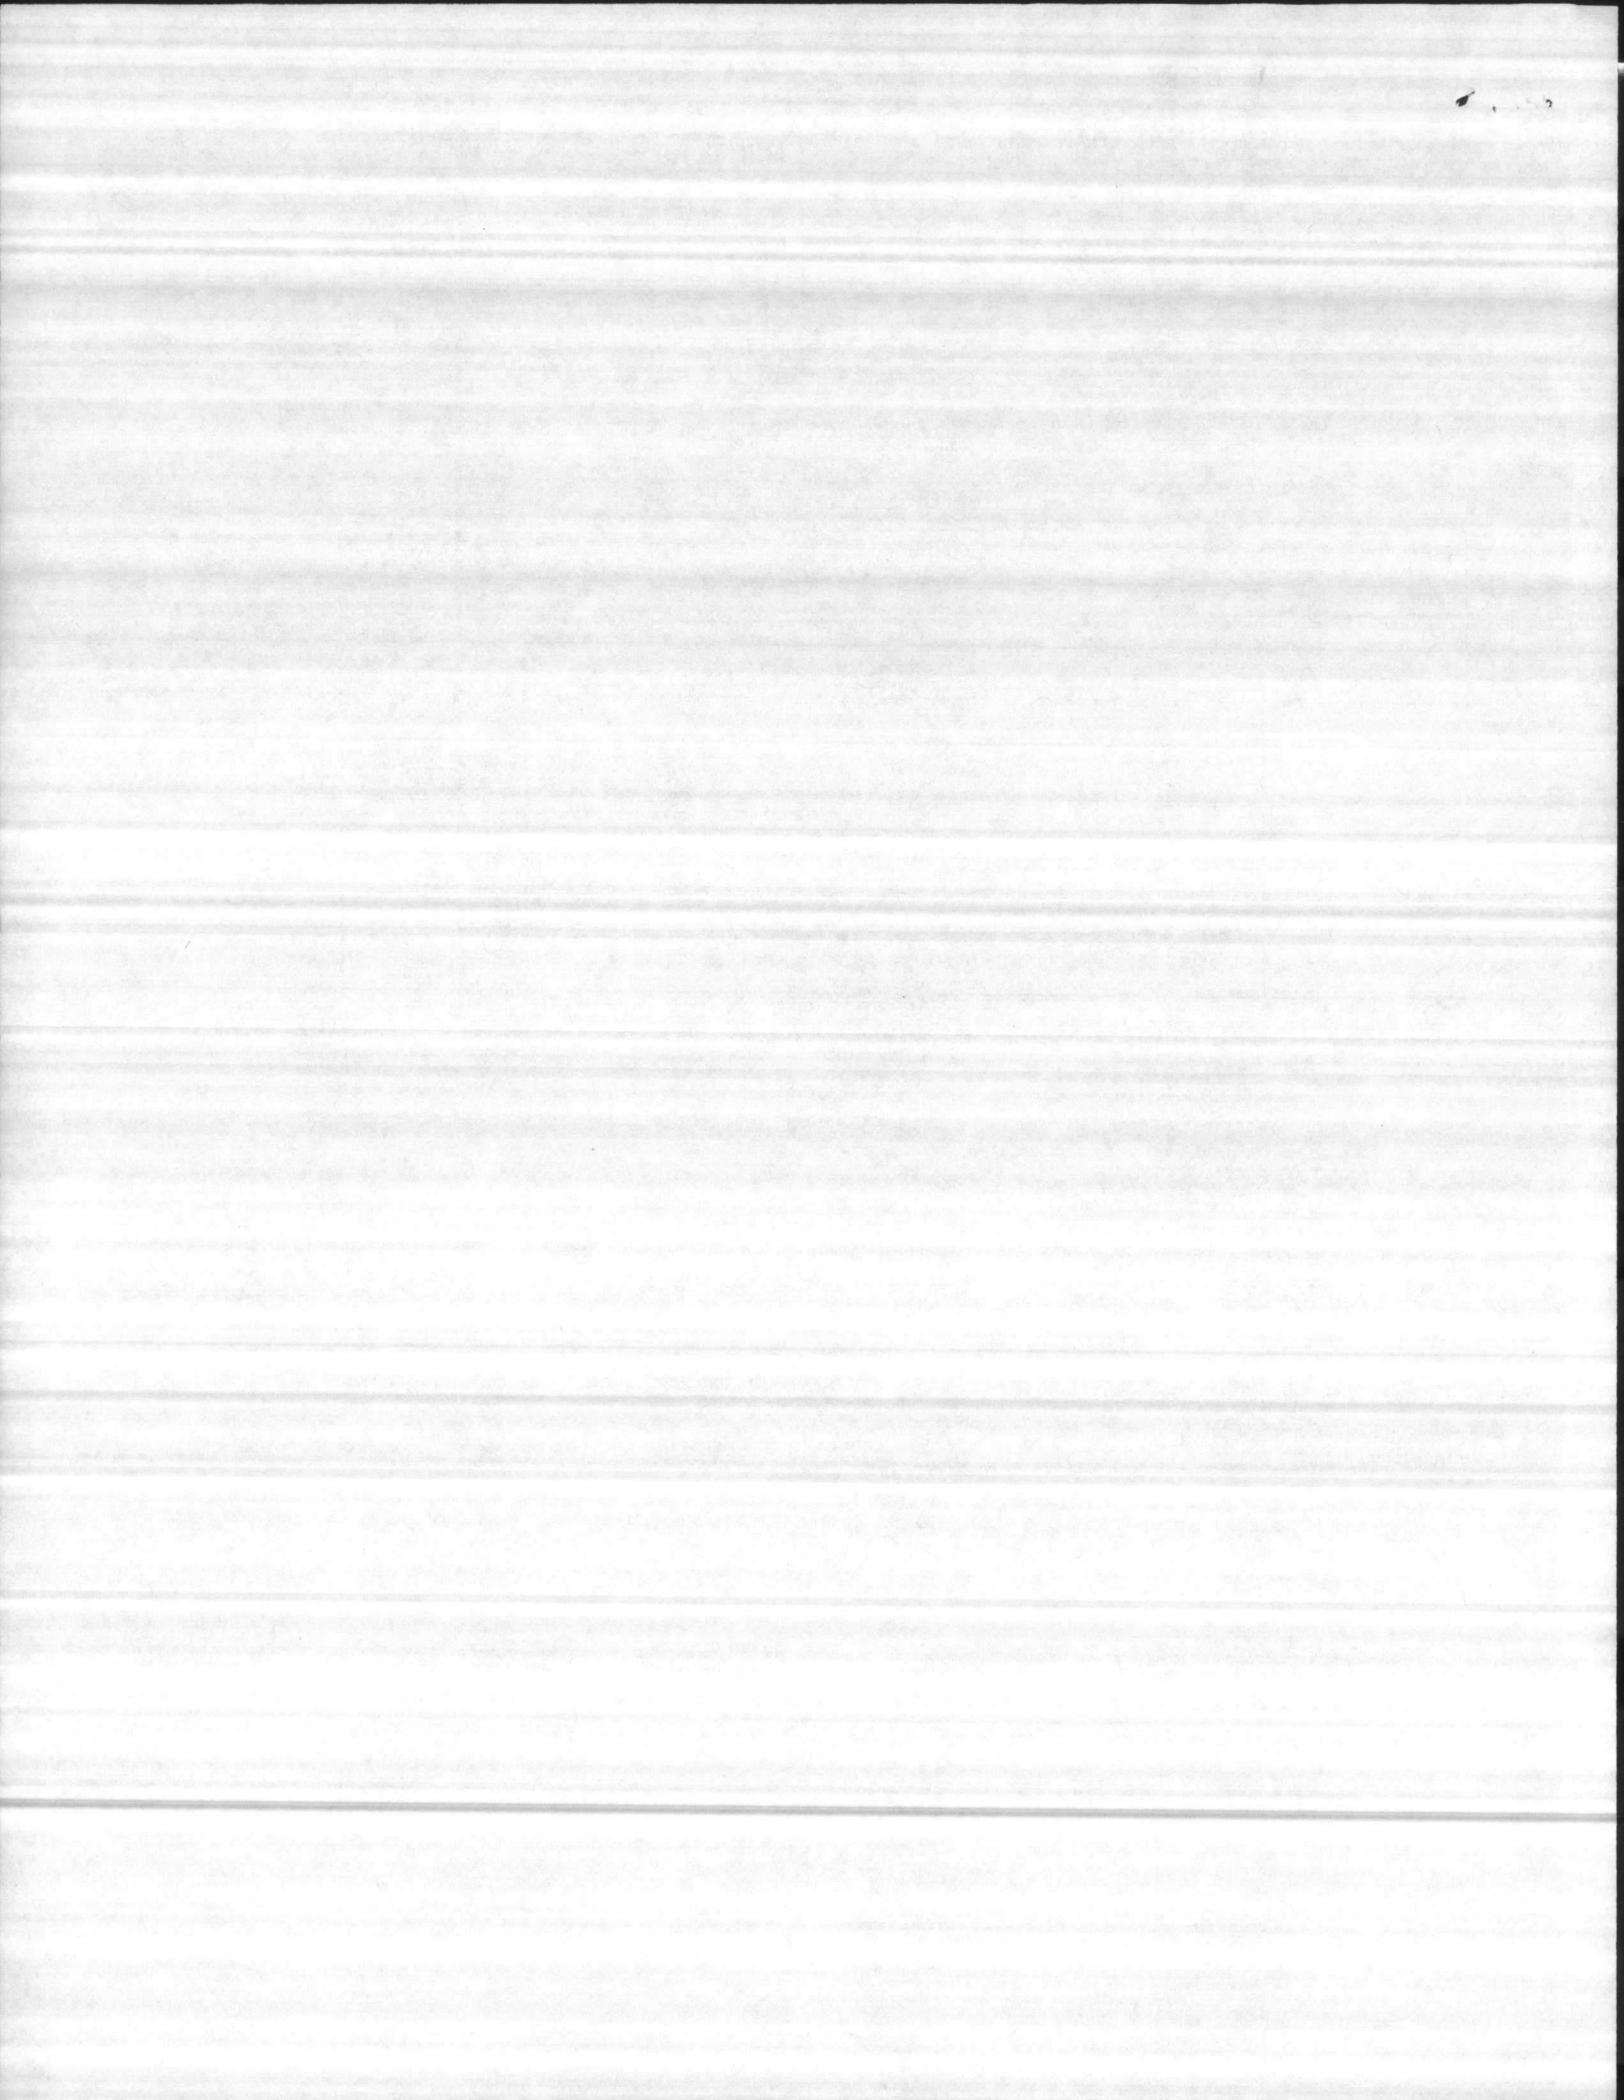



"Fluid Handling Equipment"

PROJECT: PUBLIC WORKS FACILITY
CAMP LEJEUNE, NC
N62470-81-B-1766

SUPPLIER: JONES & FRANK
RALEIGH, NC

SECTION: 15605 - GASOLINE STORAGE
AND DISPENSING SYSTEM

ATLANTIC DIVISION
NAVAL FACILITIES ENGINEERING COMMAND
NORFOLK, VIRGINIA 23511

APPROVED _____
APPROVED AS NOTED _____
DISAPPROVED _____

SUBJECT TO THE REQUIREMENTS OF
CONTRACT NO. 81-C-1766

APPROVAL OF A SUBMITTAL DOES NOT INCLUDE
APPROVAL OF ANY DEVIATION FROM THE CON-
TRACT REQUIREMENTS UNLESS THE CONTRACTOR
CALLS ATTENTION TO AND SUPPORTS THE DEVI-
ATION... THE CONTRACTOR SHALL BE RESPONSIBLE
FOR PROVIDING PROPER PHYSICAL DIMENSIONS
& WEIGHTS, COORDINATION OF TRADES, ETC., AS
REQUIRED.

REVIEWER JFA DATE 9 Sept 83

FOR OFFICER IN CHARGE OF CONSTRUCTION



