

VALUABLE

RETURN TO
PUBLIC WORKS
OFFICE
CAMP LEJEUNE
NEW RIVER, N. C.

SUBJECT Water line to
New office Bldg.
End. & Supply Area.


FIELD PARTY

T. Henry IN CHARGE
INSTRUMENT _____
NOTES _____
TAPE READ _____
TAPE OR ROD _____
TAPE OR ROD _____
INSTRUMENT NO. _____
TAPE NO. _____

WEATHER

CLEAR SNOW
CLOUDY HOT
WINDY MODERATE
RAIN COLD
FAIR FOG
FILE No. _____
FLDR. No. _____
SHEET _____
FIGURED BY _____
NOTES CHECKED BY _____
PLOTTED BY _____ DATE 6/30 1943
Quad. No. 160C-1A-2

STATION	DIST.	ANGLE "	+	H. I.	VER. ANG. DIFF.	ELEVATION
B.M. (Bldg.)				5.81	35.28	29.47
0+0	tee at old line					
0+04	8" Valve					
1+04				9.70		25.58
1+72	tee 8" 84"					
1+72	4' Lt. to 4" Valve.			8.75		26.53
3+04				7.95		27.33
3+17	8" 84" Tee					
3+17	4' Rt. to 4" Valve			7.93		27.35
3+75	8" 84" Tee					
3+75	4' Lt. to 4" Valve.			8.33		26.95
3+84	8" 86" Tee and Plug			8.29		26.99
3+84	4' Rt. to 6" Valve.					
3+84	23' Rt. to Fire Hydrant					
B.M. (Bldg.)				5.81		29.47

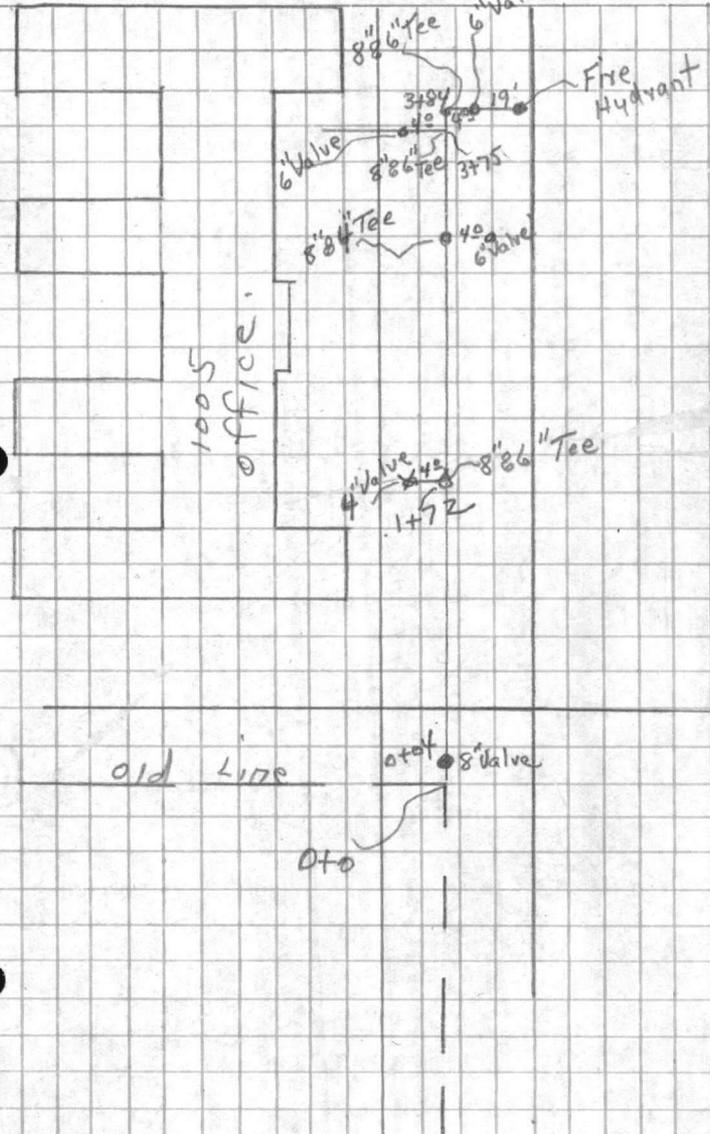

AVAILABLE

DATE
TIME
BY

~~Not~~ Plotted

JFW

BCB