

FILE FOLDER

DESCRIPTION ON TAB:

BLDG # R.R. 11

Armory, MCB

Outside/inside of actual folder did not contain hand written information

Outside/inside of actual folder did contain hand written information

***Scanned as next image**

21 Jan 86

TO: Supervisory Ecologist

From: Environmental Protection Specialist


Subj: Hazardous Waste Inspection, 2nd Amphibious Assault
Bn.

Ref (a) N.C. Division of Health Services Regulation
promulgated and the Resource Conservation and Recovery Act.

1. Subject inspection was conducted 16 Jan 86 on all
Hazardous Waste storage facilities at 2nd AAB
Three sites were identified, and two were for the
storage of waste solvent and one was for the storage
of used Lithium Batteries.

There were no violations ^{of the reference} noted; however, the two
solvent storage areas were not limited to access
by authorized personnel only.

Persons involved in the inspection were Danny Beckore,
NREAD; CAPT. TEDESCHI, 2nd AAB; & MSGT KAY, DIV ENG.

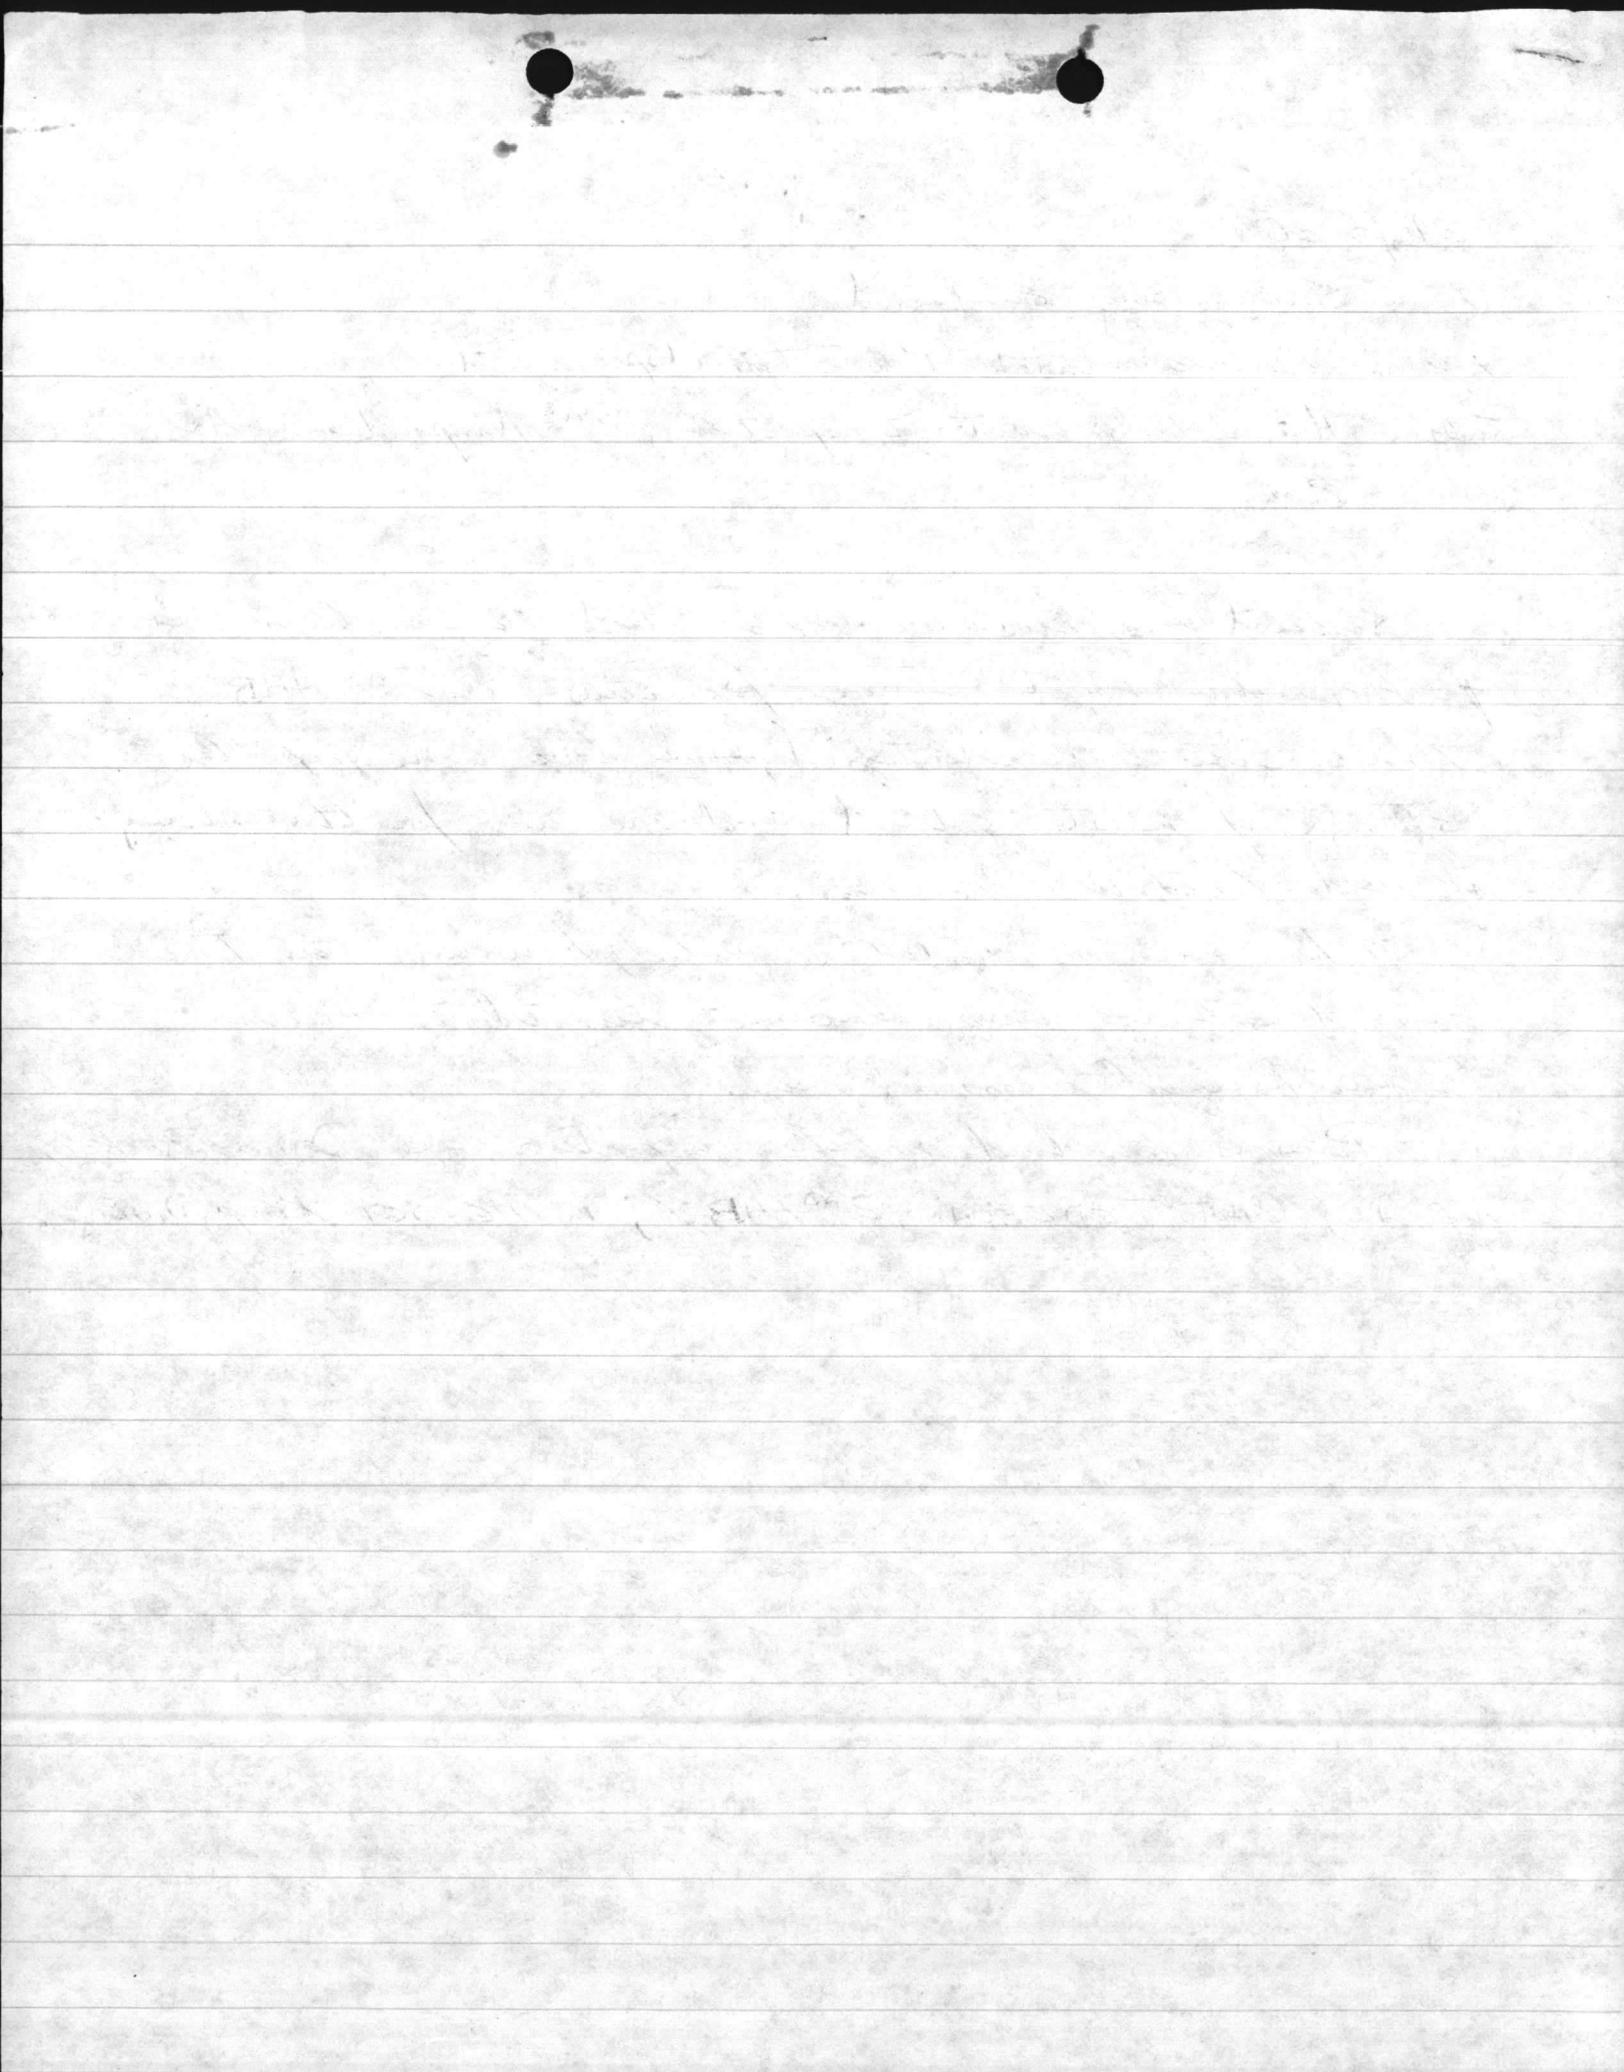

21 Jan 86

forwarded 24 Jan 86

TO: Supervisory Ecologist


From: Environmental Protection Specialist

Subj: Hazardous Waste Inspection, 2nd Amphibious Assault
Bn.

Subject inspection was conducted 16 Jan 86 on all
Hazardous Waste storage facilities at 2nd AAB
Three sites were identified, and two were for the
storage of waste solvent and one was for the storage
of used Lithium Batteries.

There were no violations noted; however, the two
solvent storage areas were not limited to access
by authorized personnel only.

Persons involved in the inspection were Danny Becker
NRBAD; CAPT. TEDESCHI, 2nd AAB; & MSGT KAY, DIV ENG

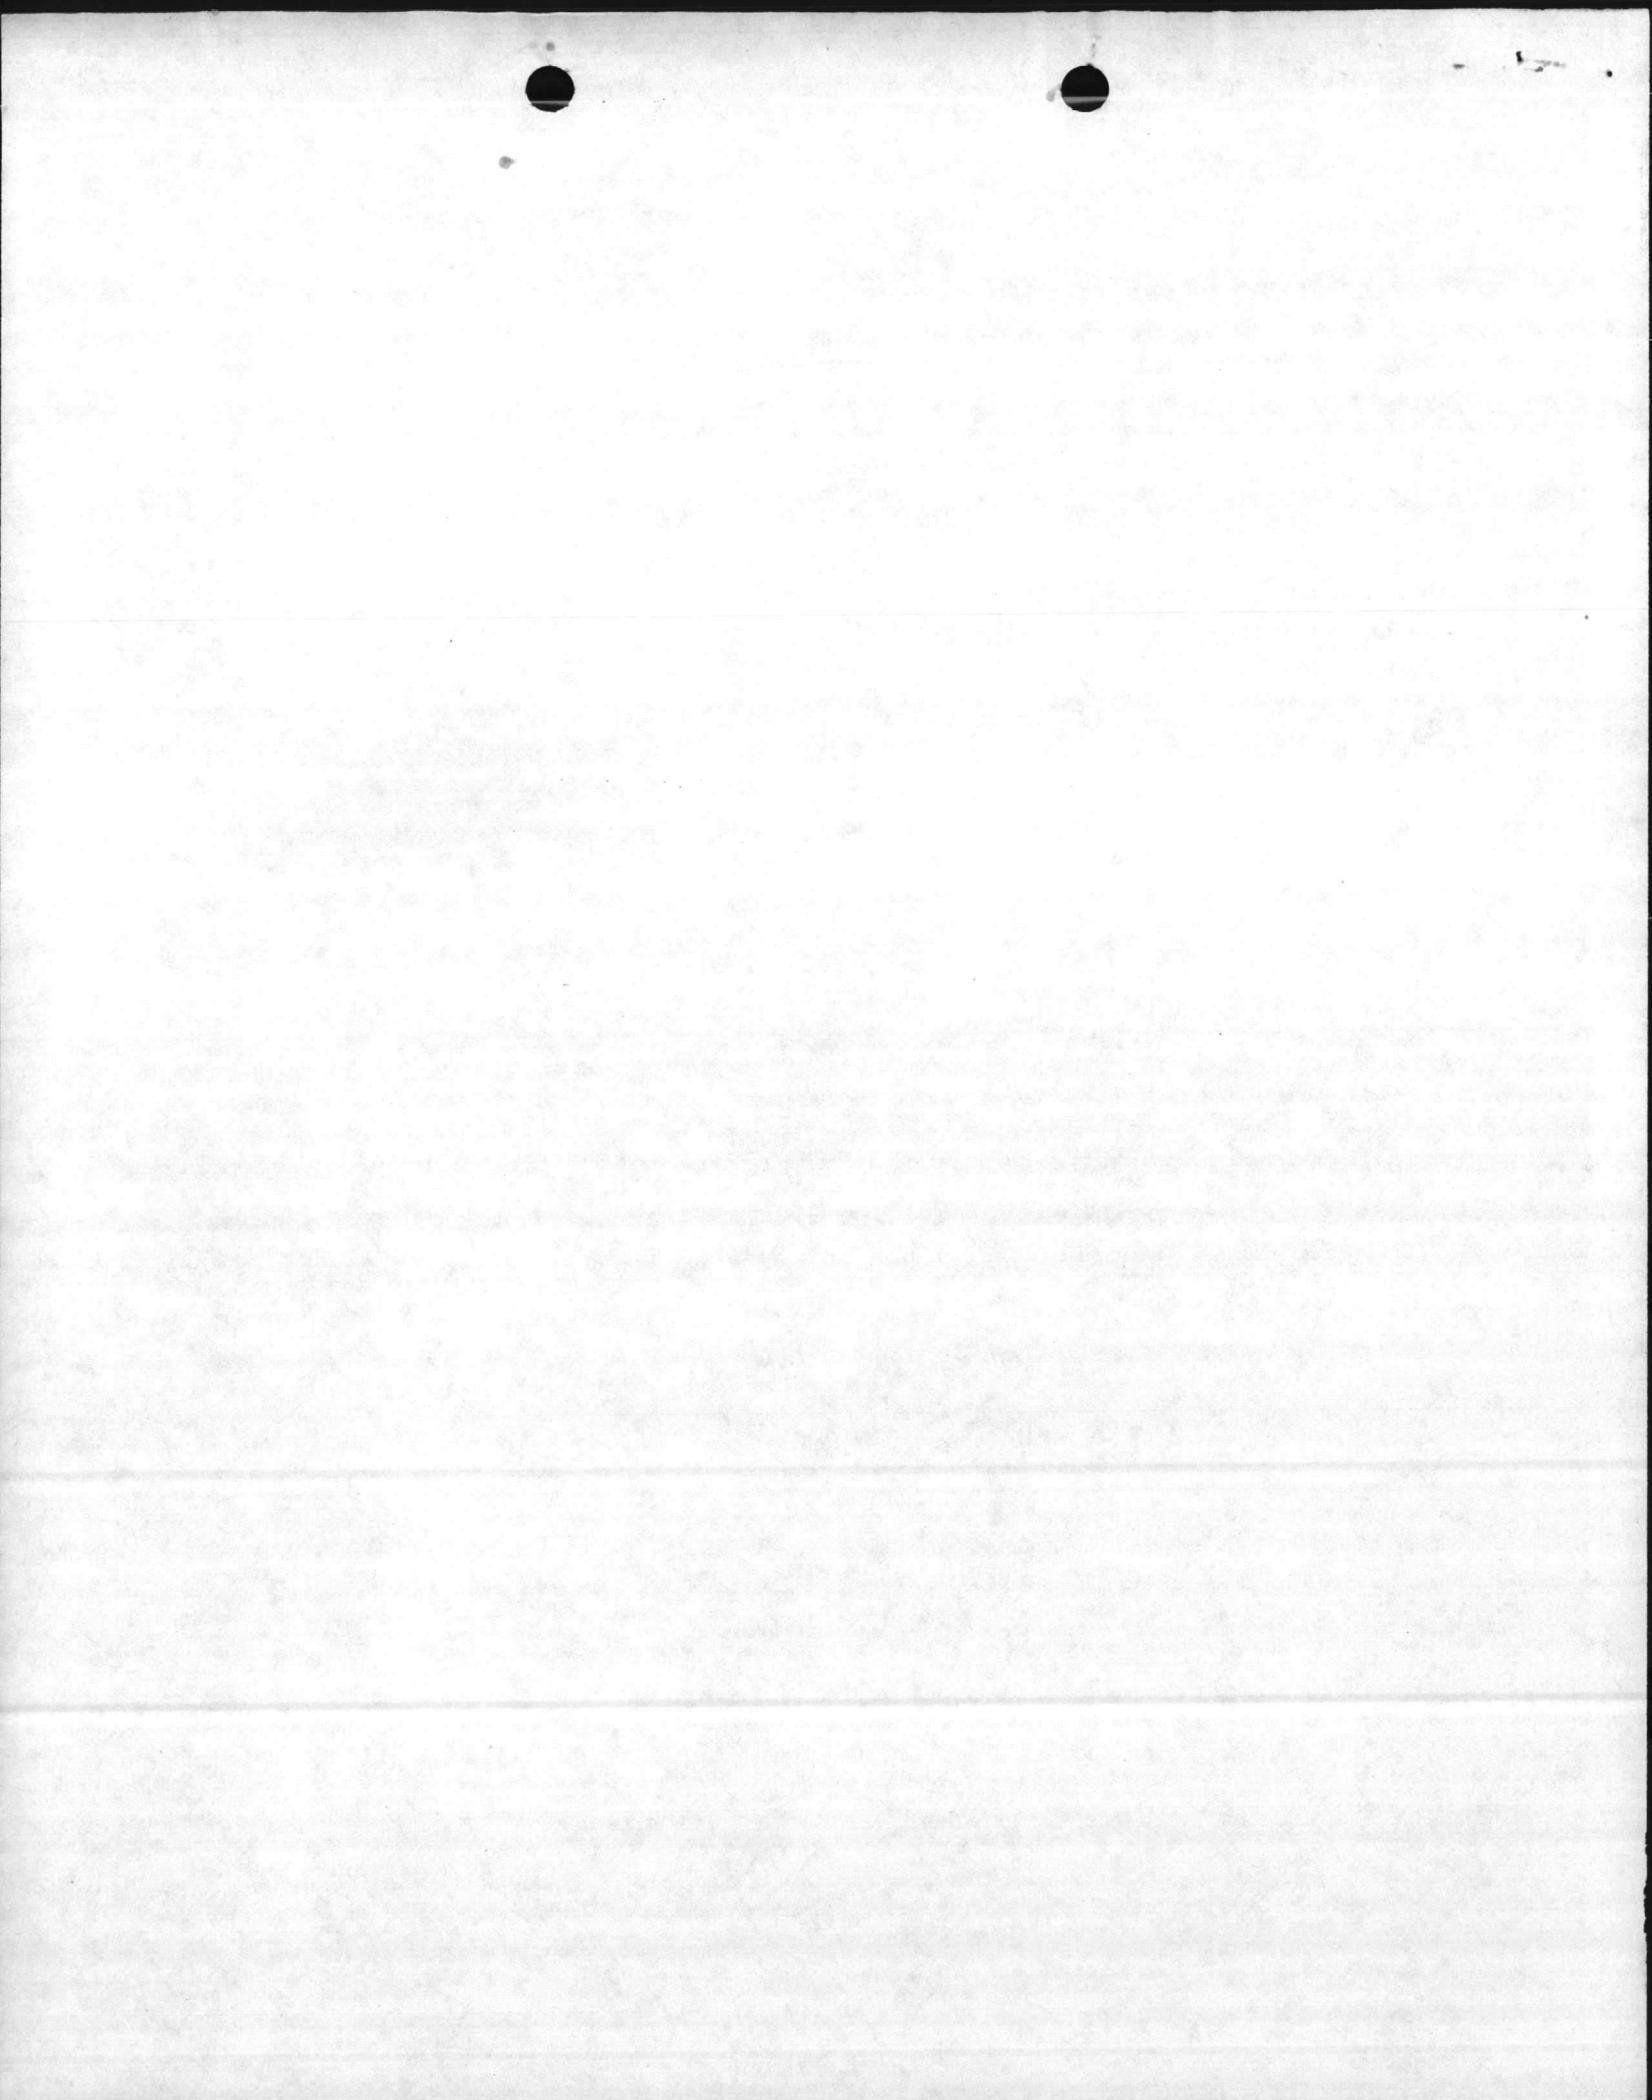

HAZARDOUS WASTE MANAGEMENT INSPECTION

1. Organization Inspected: 2nd AAB Bn, 2nd MAR DIV

2. Name and title of persons conducting inspection:

a. NREAD Representative: DANNY BELKER Env. Pro. Spec

b. Organizational Commander Representative: CAPT TEDESCHI


c. Other (Specify): MGYSGT KAUP. HMTD DIVISION

3. Brief Description of HW Activity: GENERATE WASTE lithium BATTs. GENERATE WASTE SOLVENT FROM DEGREASING OPS.

4. Summary of Findings (See Attachment A- C)

a. Assignment of HW management responsibilities and related personnel training and record keeping: CAPT TEDESCHI - Bn POC
TOP GODFELTER - INSPECTIONS OF STORAGE FACILITIES
CAPT. ENGLE }
CWO HOIT } lithium BATTs.

b. Adequacy of HW handling, storage and related internal controls and inspection: HW Handling - ADEQUATE
STORAGE - ADEQUATE; DOES NOT HAVE LIMITED ACCESS
TRNG & INSPECTION RECORDS - EXCELLENT

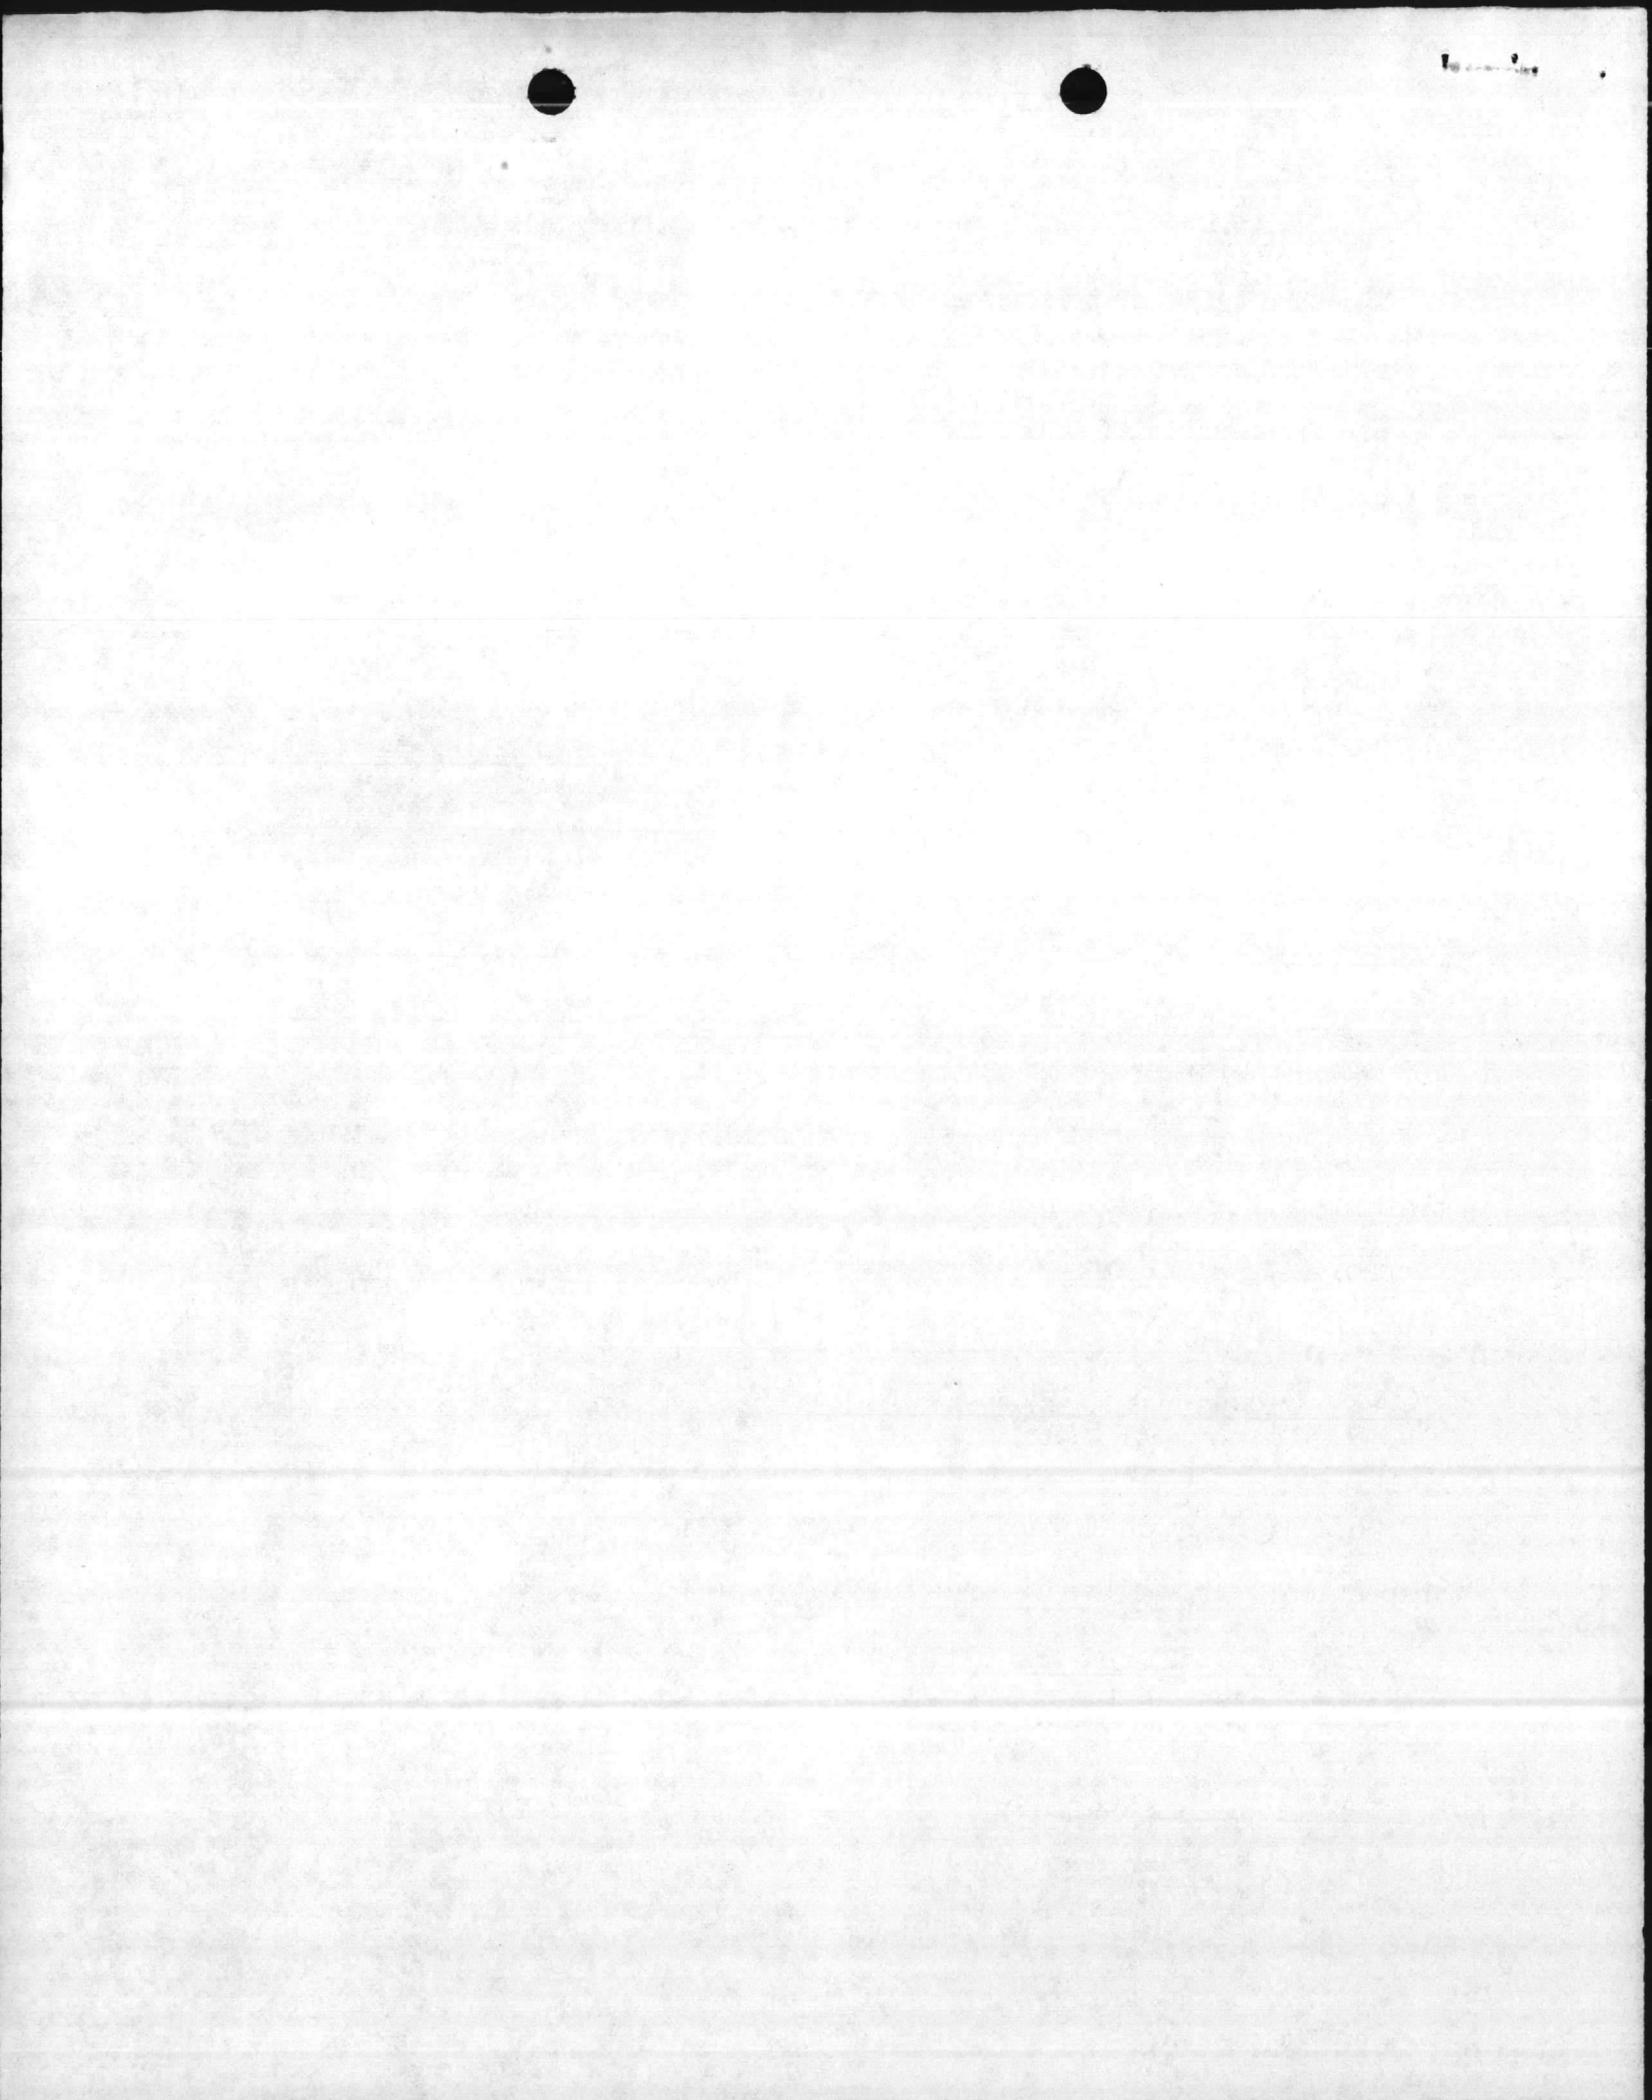

INSPECTION FORM FOR HAZARDOUS WASTE HANDLING AND STORAGE AREAS


Name of Facility: Bn maint Bldg A-2

Name/Title OIC: Capt Tenaschi

AREA OF CONCERN	YES	NO	CORRECTIVE ACTION NEEDED (use back of page to log action taken)
<p><u>A. CONDITION OF CONTAINERS</u></p> <p>1. Are containers closed</p> <p>2. Are containers leaking</p> <p>3. Are containers bulging</p> <p>4. Are containers collapsed</p> <p>5. Are containers corroded</p> <p>6. Are containers over-filled</p> <p>7. Other problems present</p>		<p align="center">✓</p> <p align="center">✓</p> <p align="center">✓</p> <p align="center">✓</p> <p align="center">✓</p> <p align="center">✓</p>	
<p><u>F. LABELING AND MARKING</u></p> <p>1. Are HW labels in place</p> <p>2. Are HW labels filled out</p> <p>3. Are hazards (i.e., flammable, corrosive, etc.) labels or markings adequate</p>	<p align="center">✓</p> <p align="center">✓</p> <p align="center">✓</p>		
<p><u>C. Are HWs being disposed of by deadlines</u></p>	<p align="center">✓</p>		
<p><u>D. SECURITY AND EMERGENCIES</u></p> <p>1. Is access limited to authorized personnel only</p> <p>2. Is emergency response information posted</p> <p>3. Supplies and equipment readily available</p>	<p align="center">✓</p> <p align="center">✓</p>	<p align="center">✓</p>	


DATE: 16 Jan 86


SIGNATURE: DT Biker

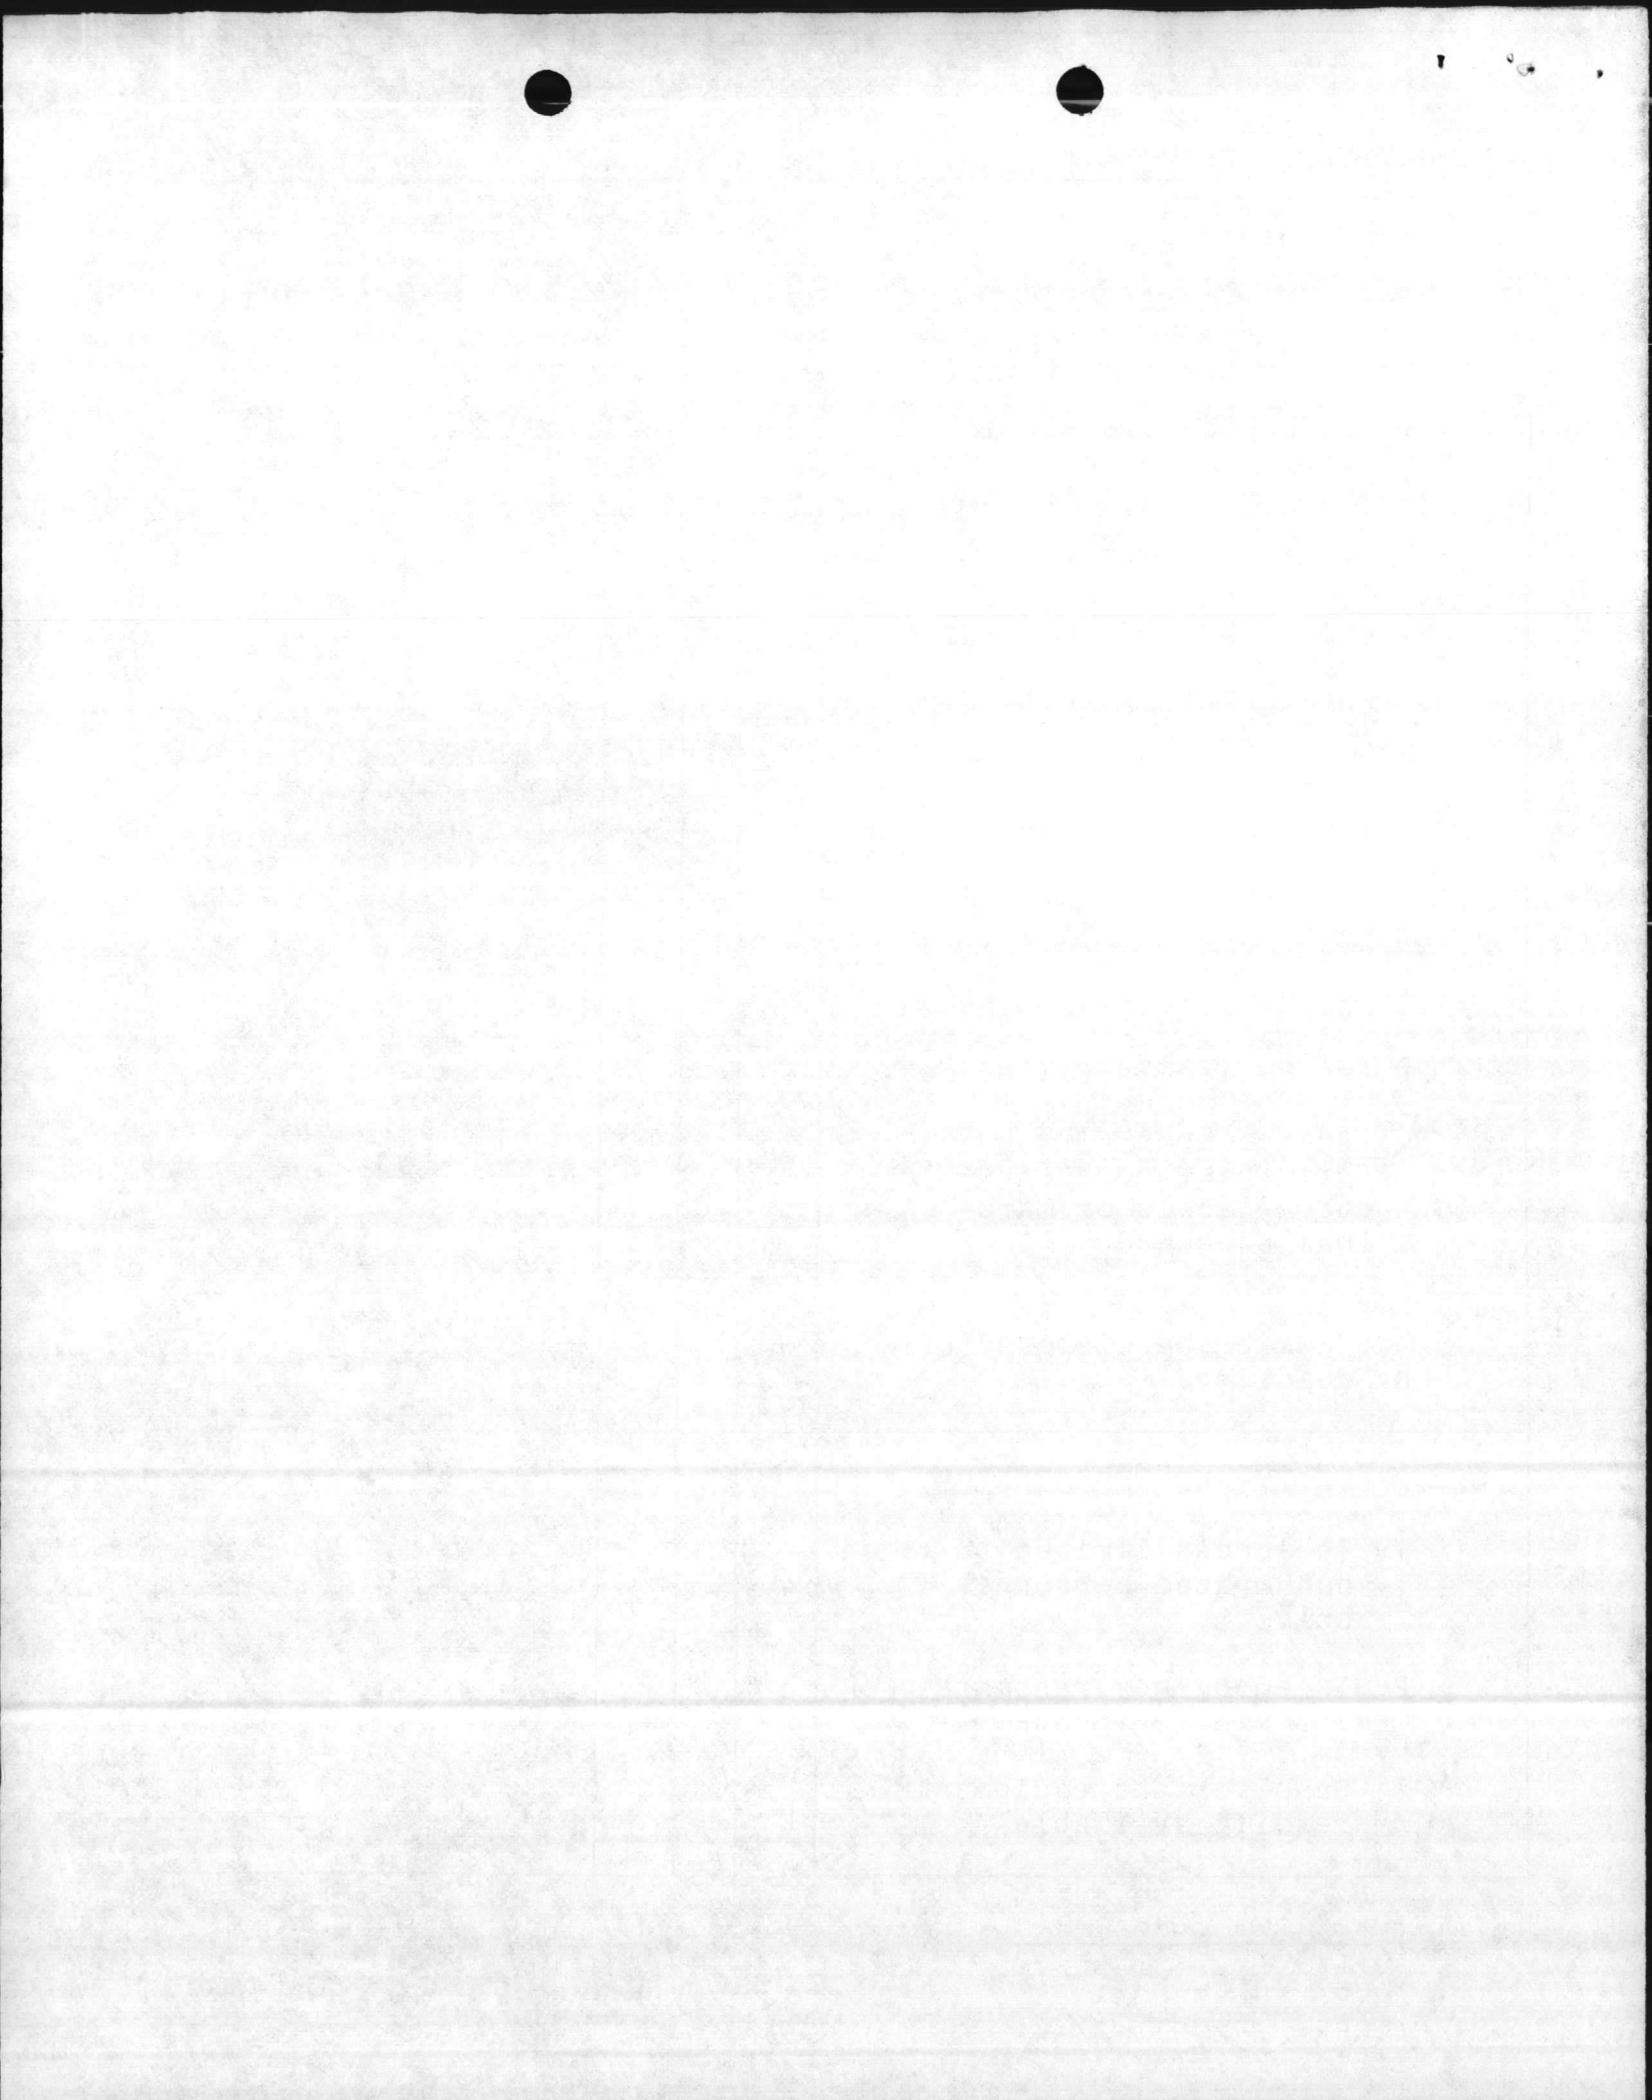

e. Corrective Action Recommended: *NOAB RECOMMENDED*

f. Sketch showing location of Facility:

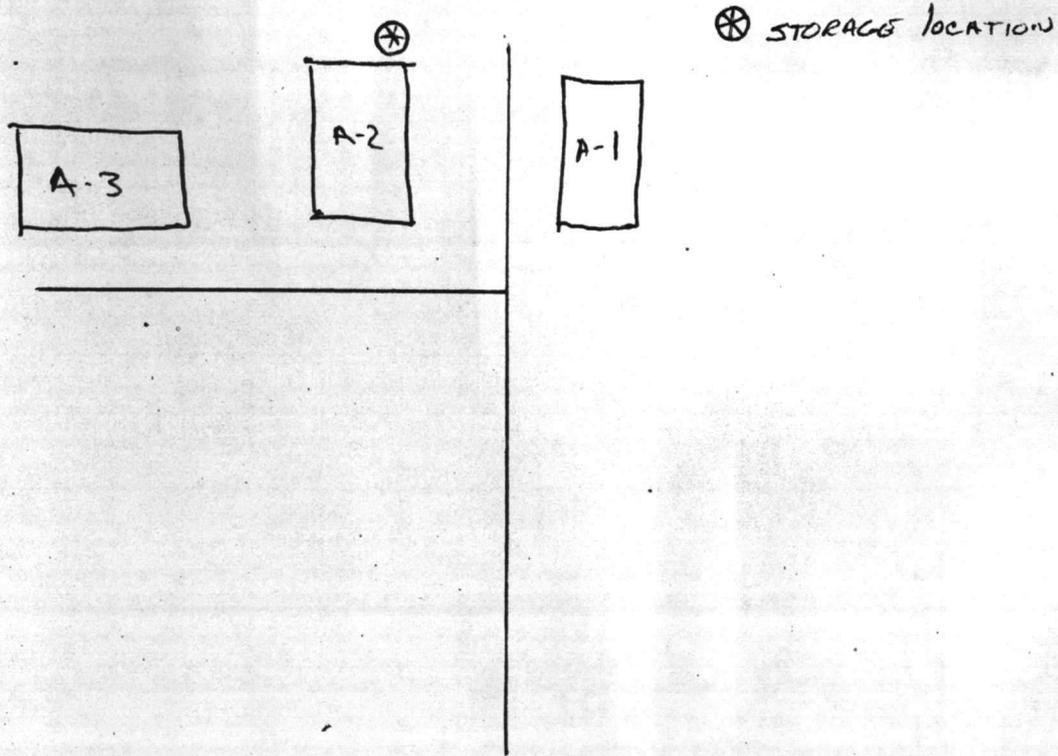

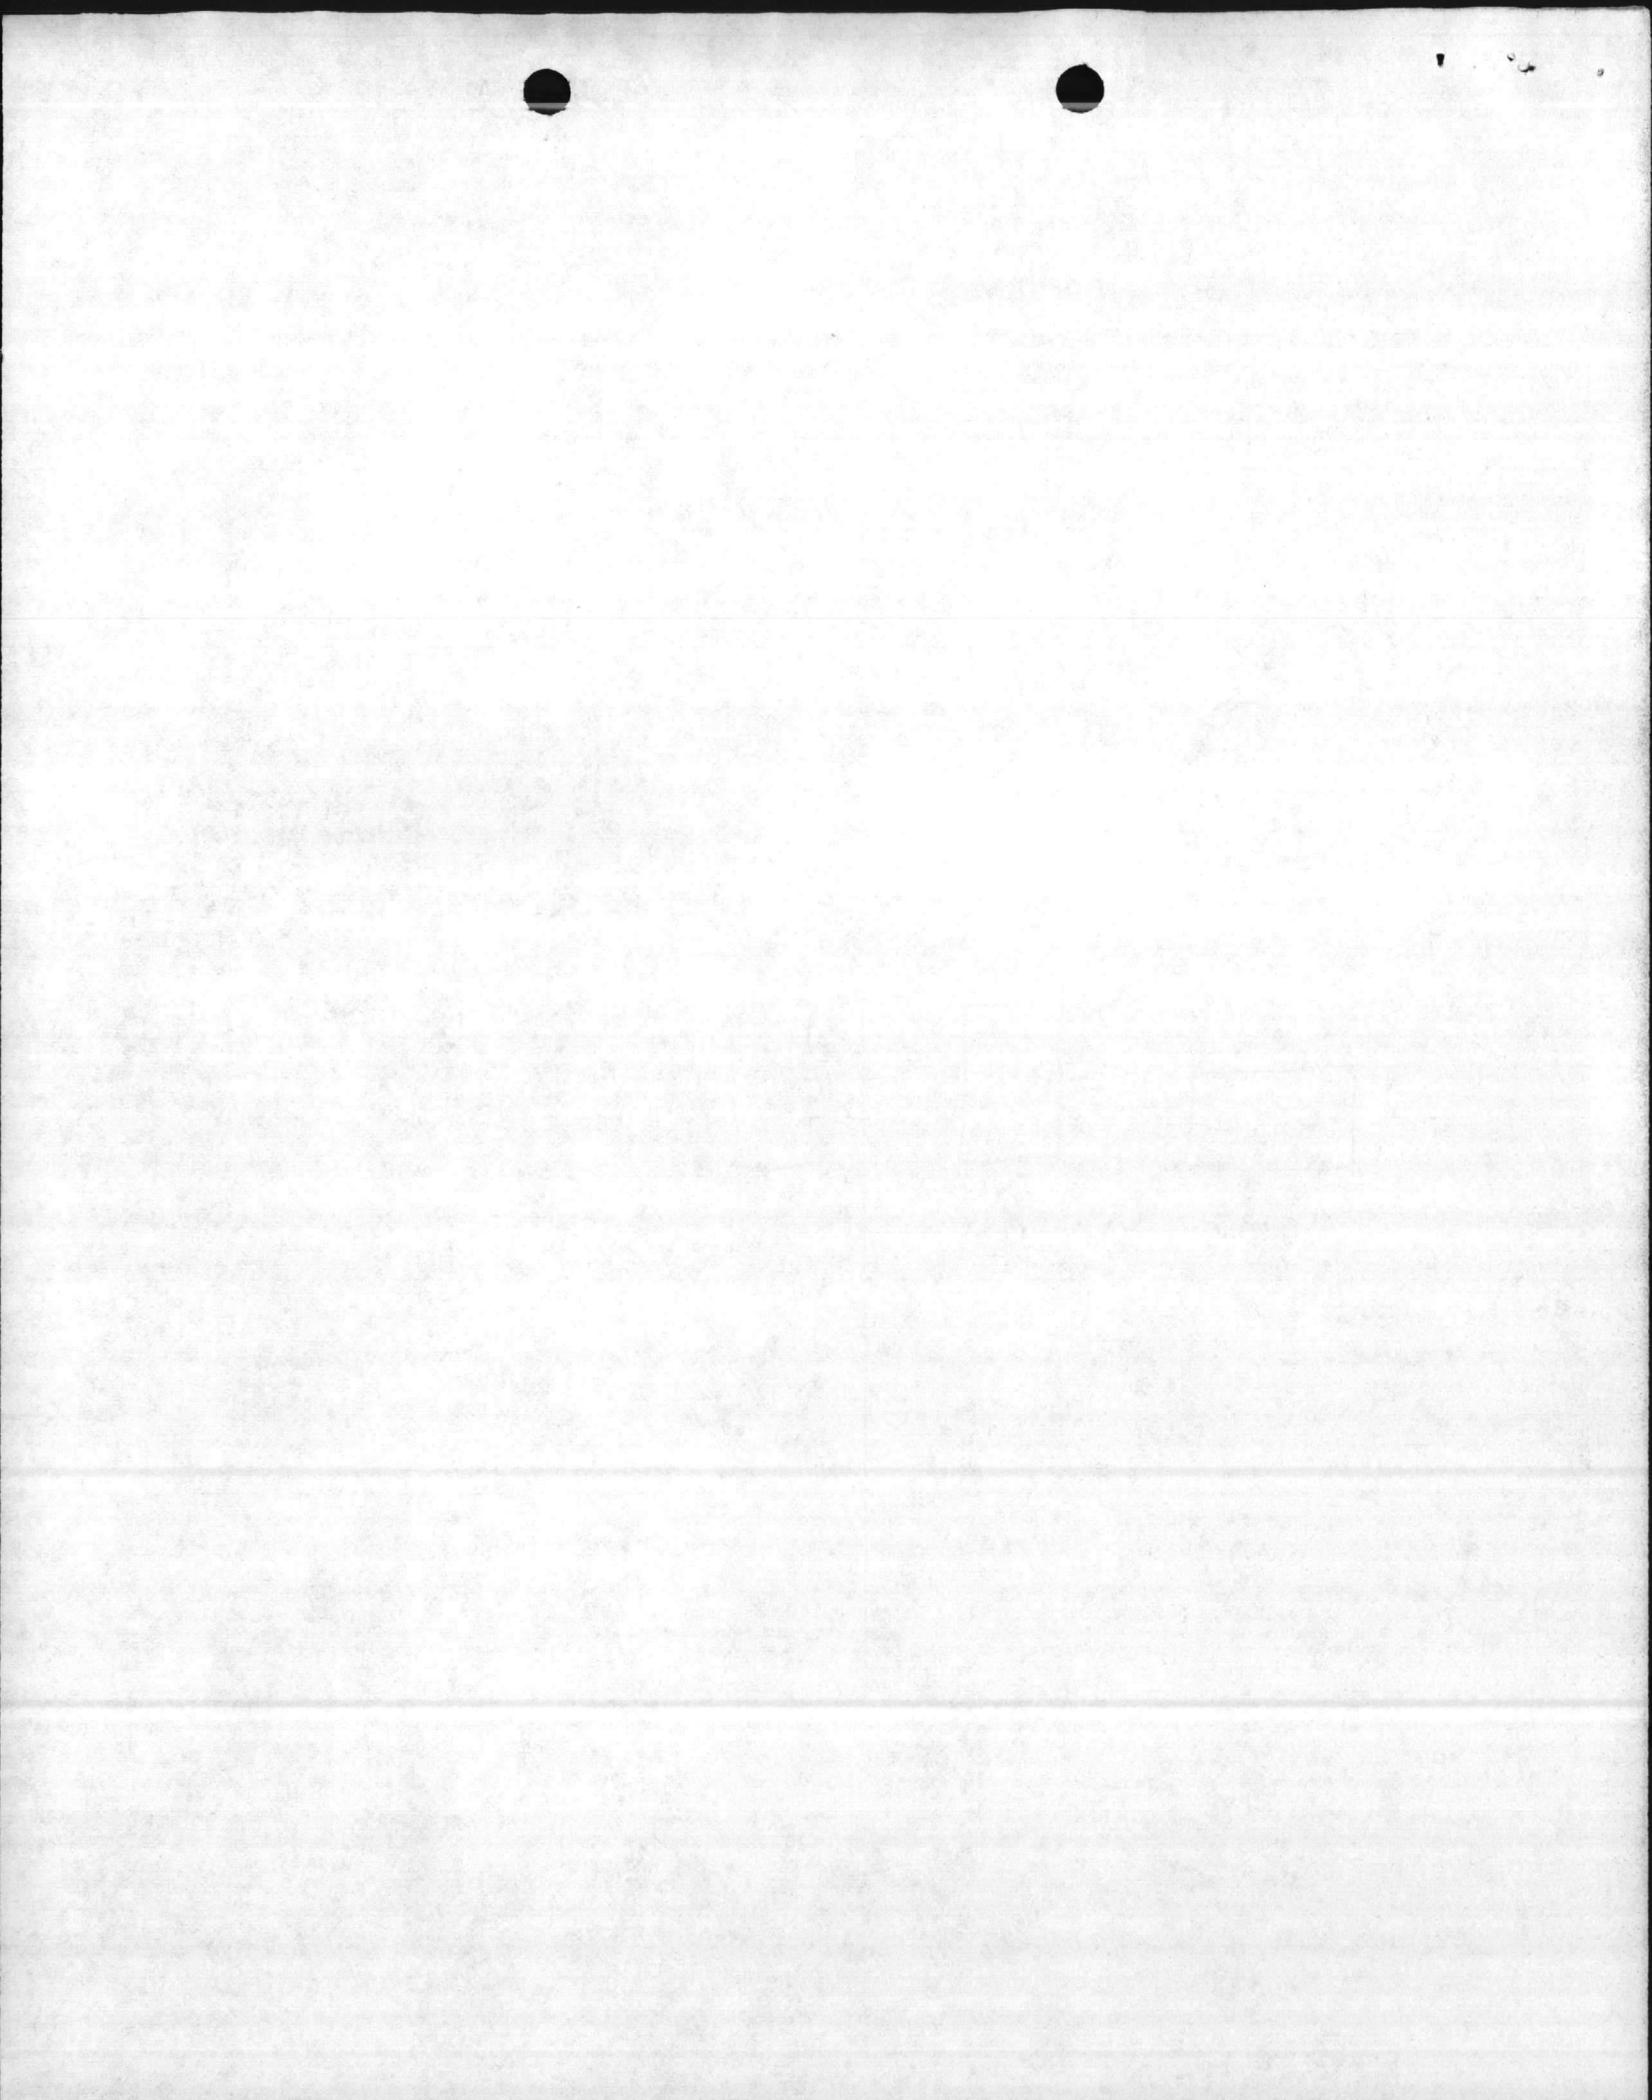

INSPECTION FORM FOR HAZARDOUS WASTE HANDLING AND STORAGE AREAS


Name of Facility: Company Maint Shop A, B, C & D 2nd AAB

Name/Title OIC: CWO4 SKyles

AREA OF CONCERN	YES	NO	CORRECTIVE ACTION NEEDED (use back of page to log action taken)
<p><u>A. CONDITION OF CONTAINERS</u></p> <p>1. Are containers closed</p> <p>2. Are containers leaking</p> <p>3. Are containers bulging</p> <p>4. Are containers collapsed</p> <p>5. Are containers corroded</p> <p>6. Are containers over-filled</p> <p>7. Other problems present</p>	<p>✓</p>		<p>*CONTAINERS EMPTY AT THIS TIME</p>
<p><u>F. LABELING AND MARKING</u></p> <p>1. Are HW labels in place</p> <p>2. Are HW labels filled out</p> <p>3. Are hazards (i.e., flammable, corrosive, etc.) labels or markings adequate</p>	<p>X</p>		<p>*CONTAINERS EMPTY AT THIS TIME</p>
<p><u>C. Are HWs being disposed of by deadlines</u></p>			
<p><u>D. SECURITY AND EMERGENCIES</u></p> <p>1. Is access limited to authorized personnel only</p> <p>2. Is emergency response information posted</p> <p>3. Supplies and equipment readily available</p>	<p>X</p>	<p>X</p> <p>X</p>	<p>*SPACE IS MAINTAINED INSIDE OF SHOP</p>

DATE: 16 Jan 86

SIGNATURE: DT Becker

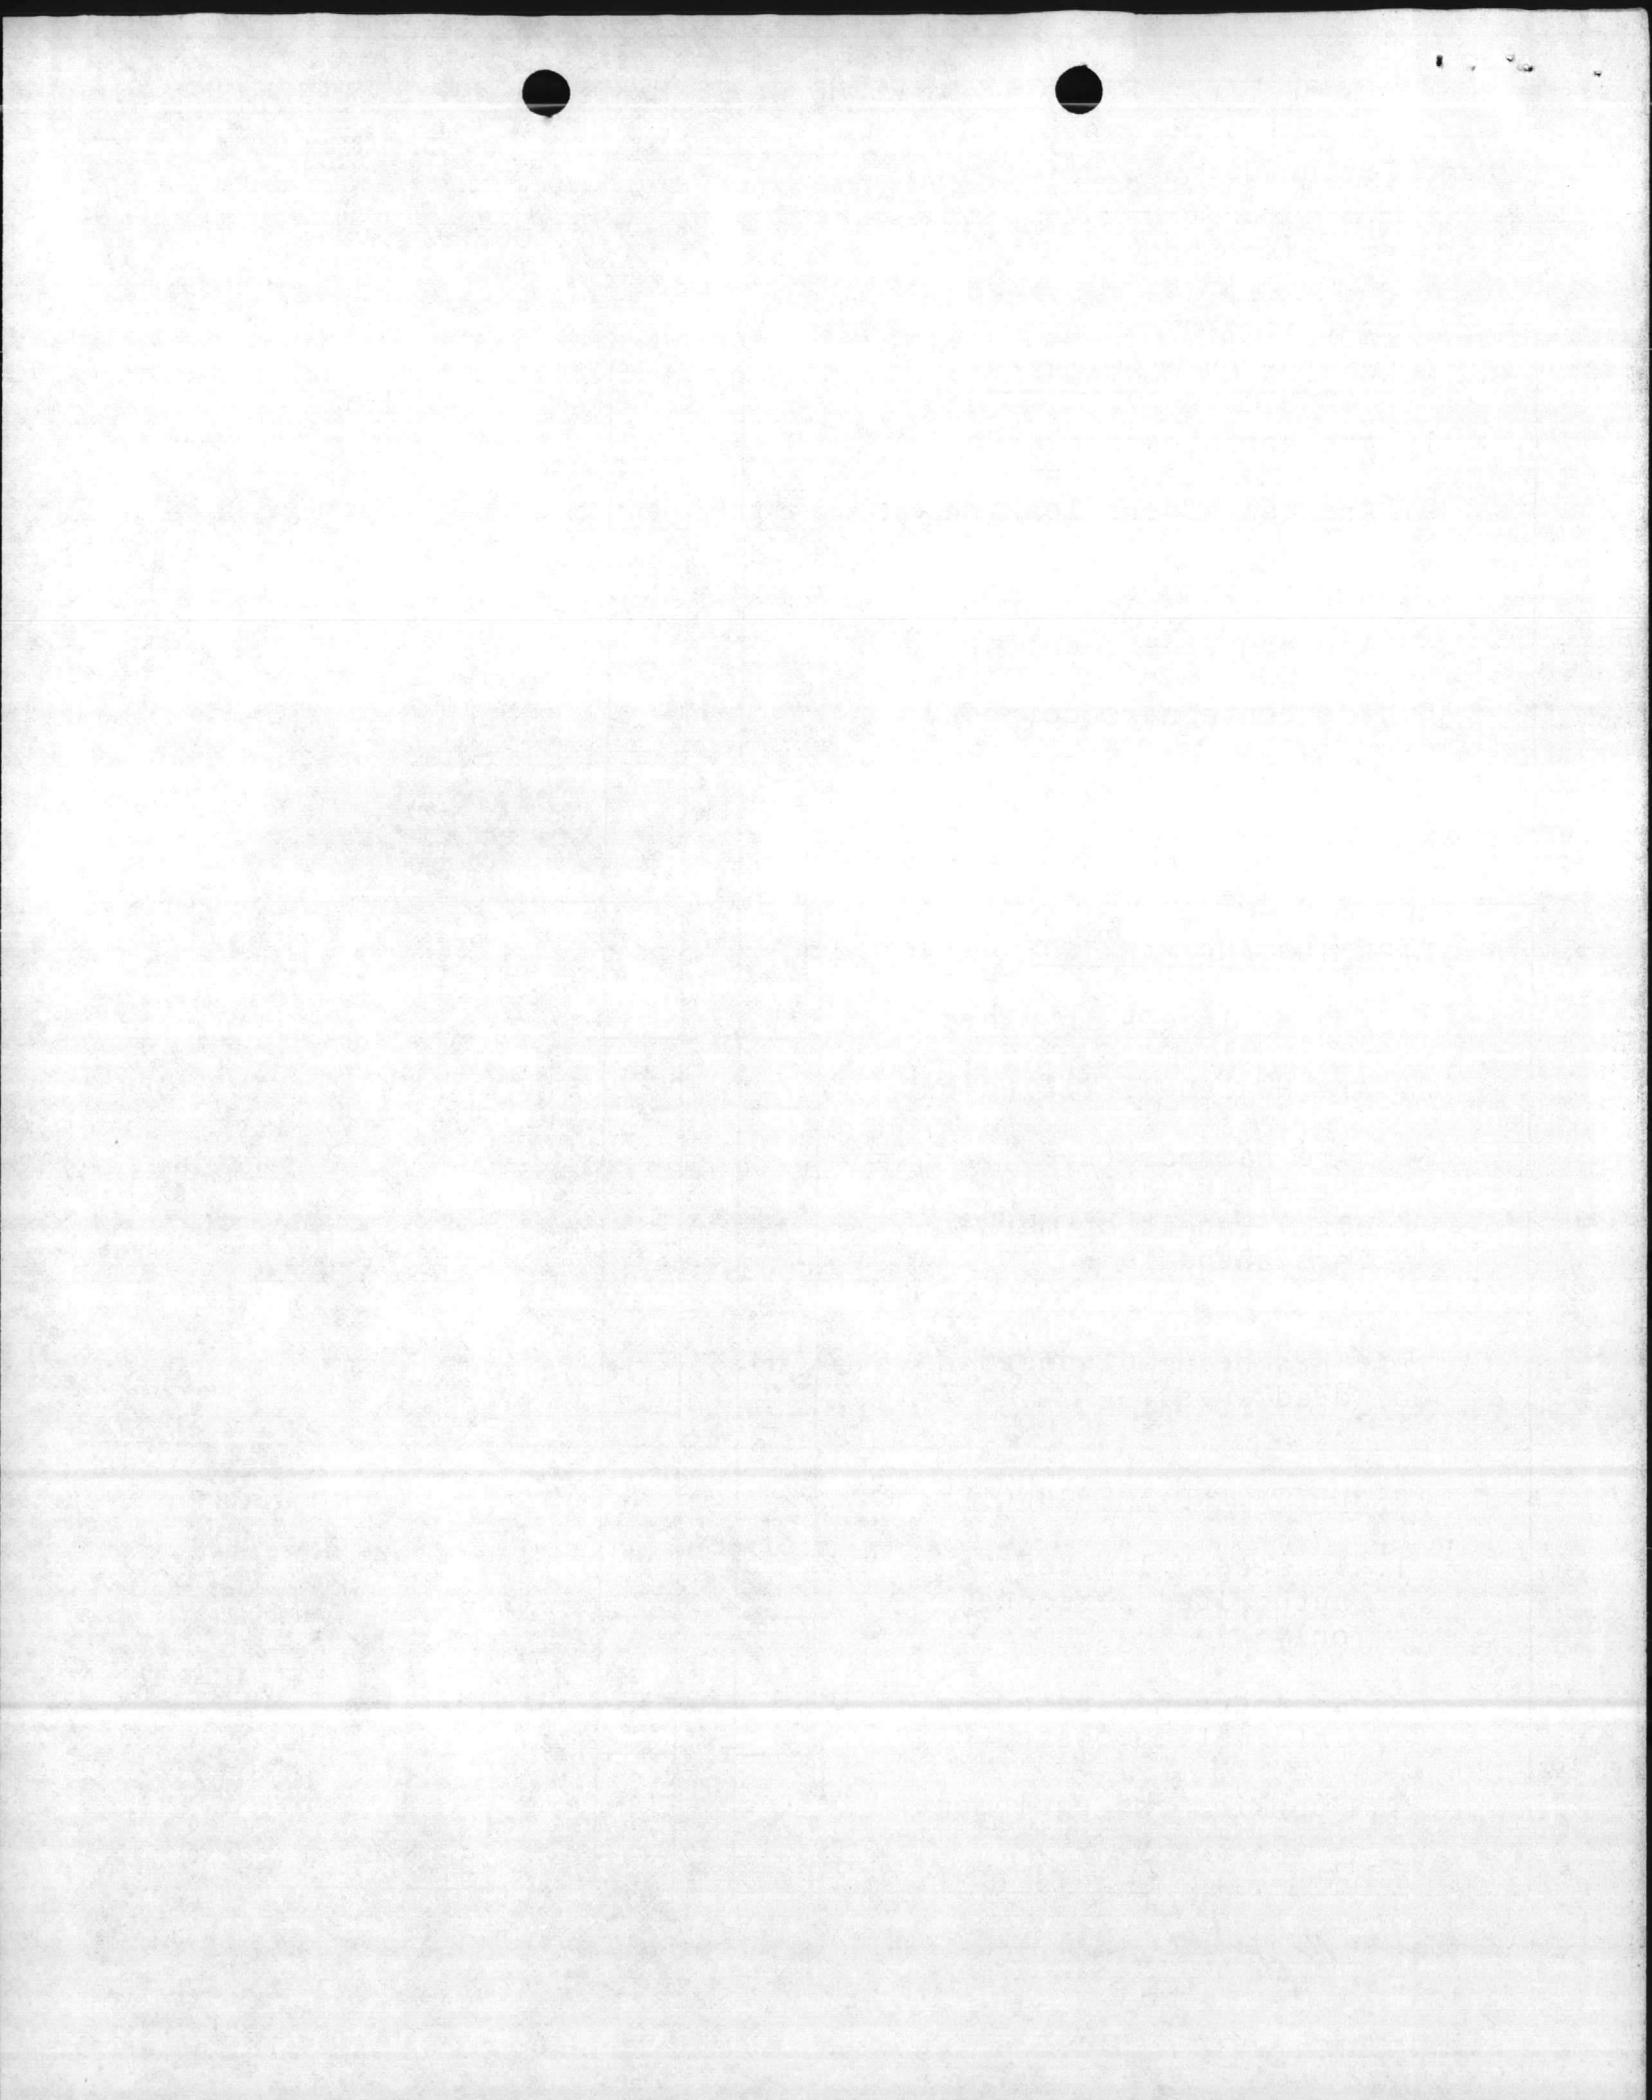



e. Corrective Action Recommended:

Waste Solvent Barrel is currently being stored inside of Bldg. A-3 & is within 50 feet of offices.

PASTING OF Spill Response INFORMATION PER BO 11090.1B ETK(K2)

f. Sketch showing location of Facility:

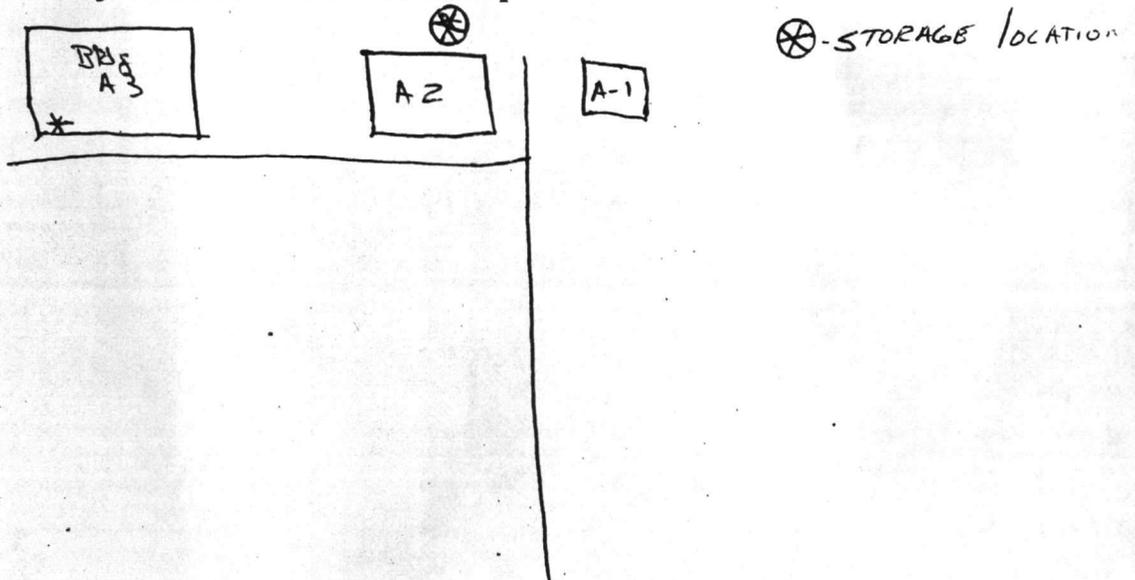

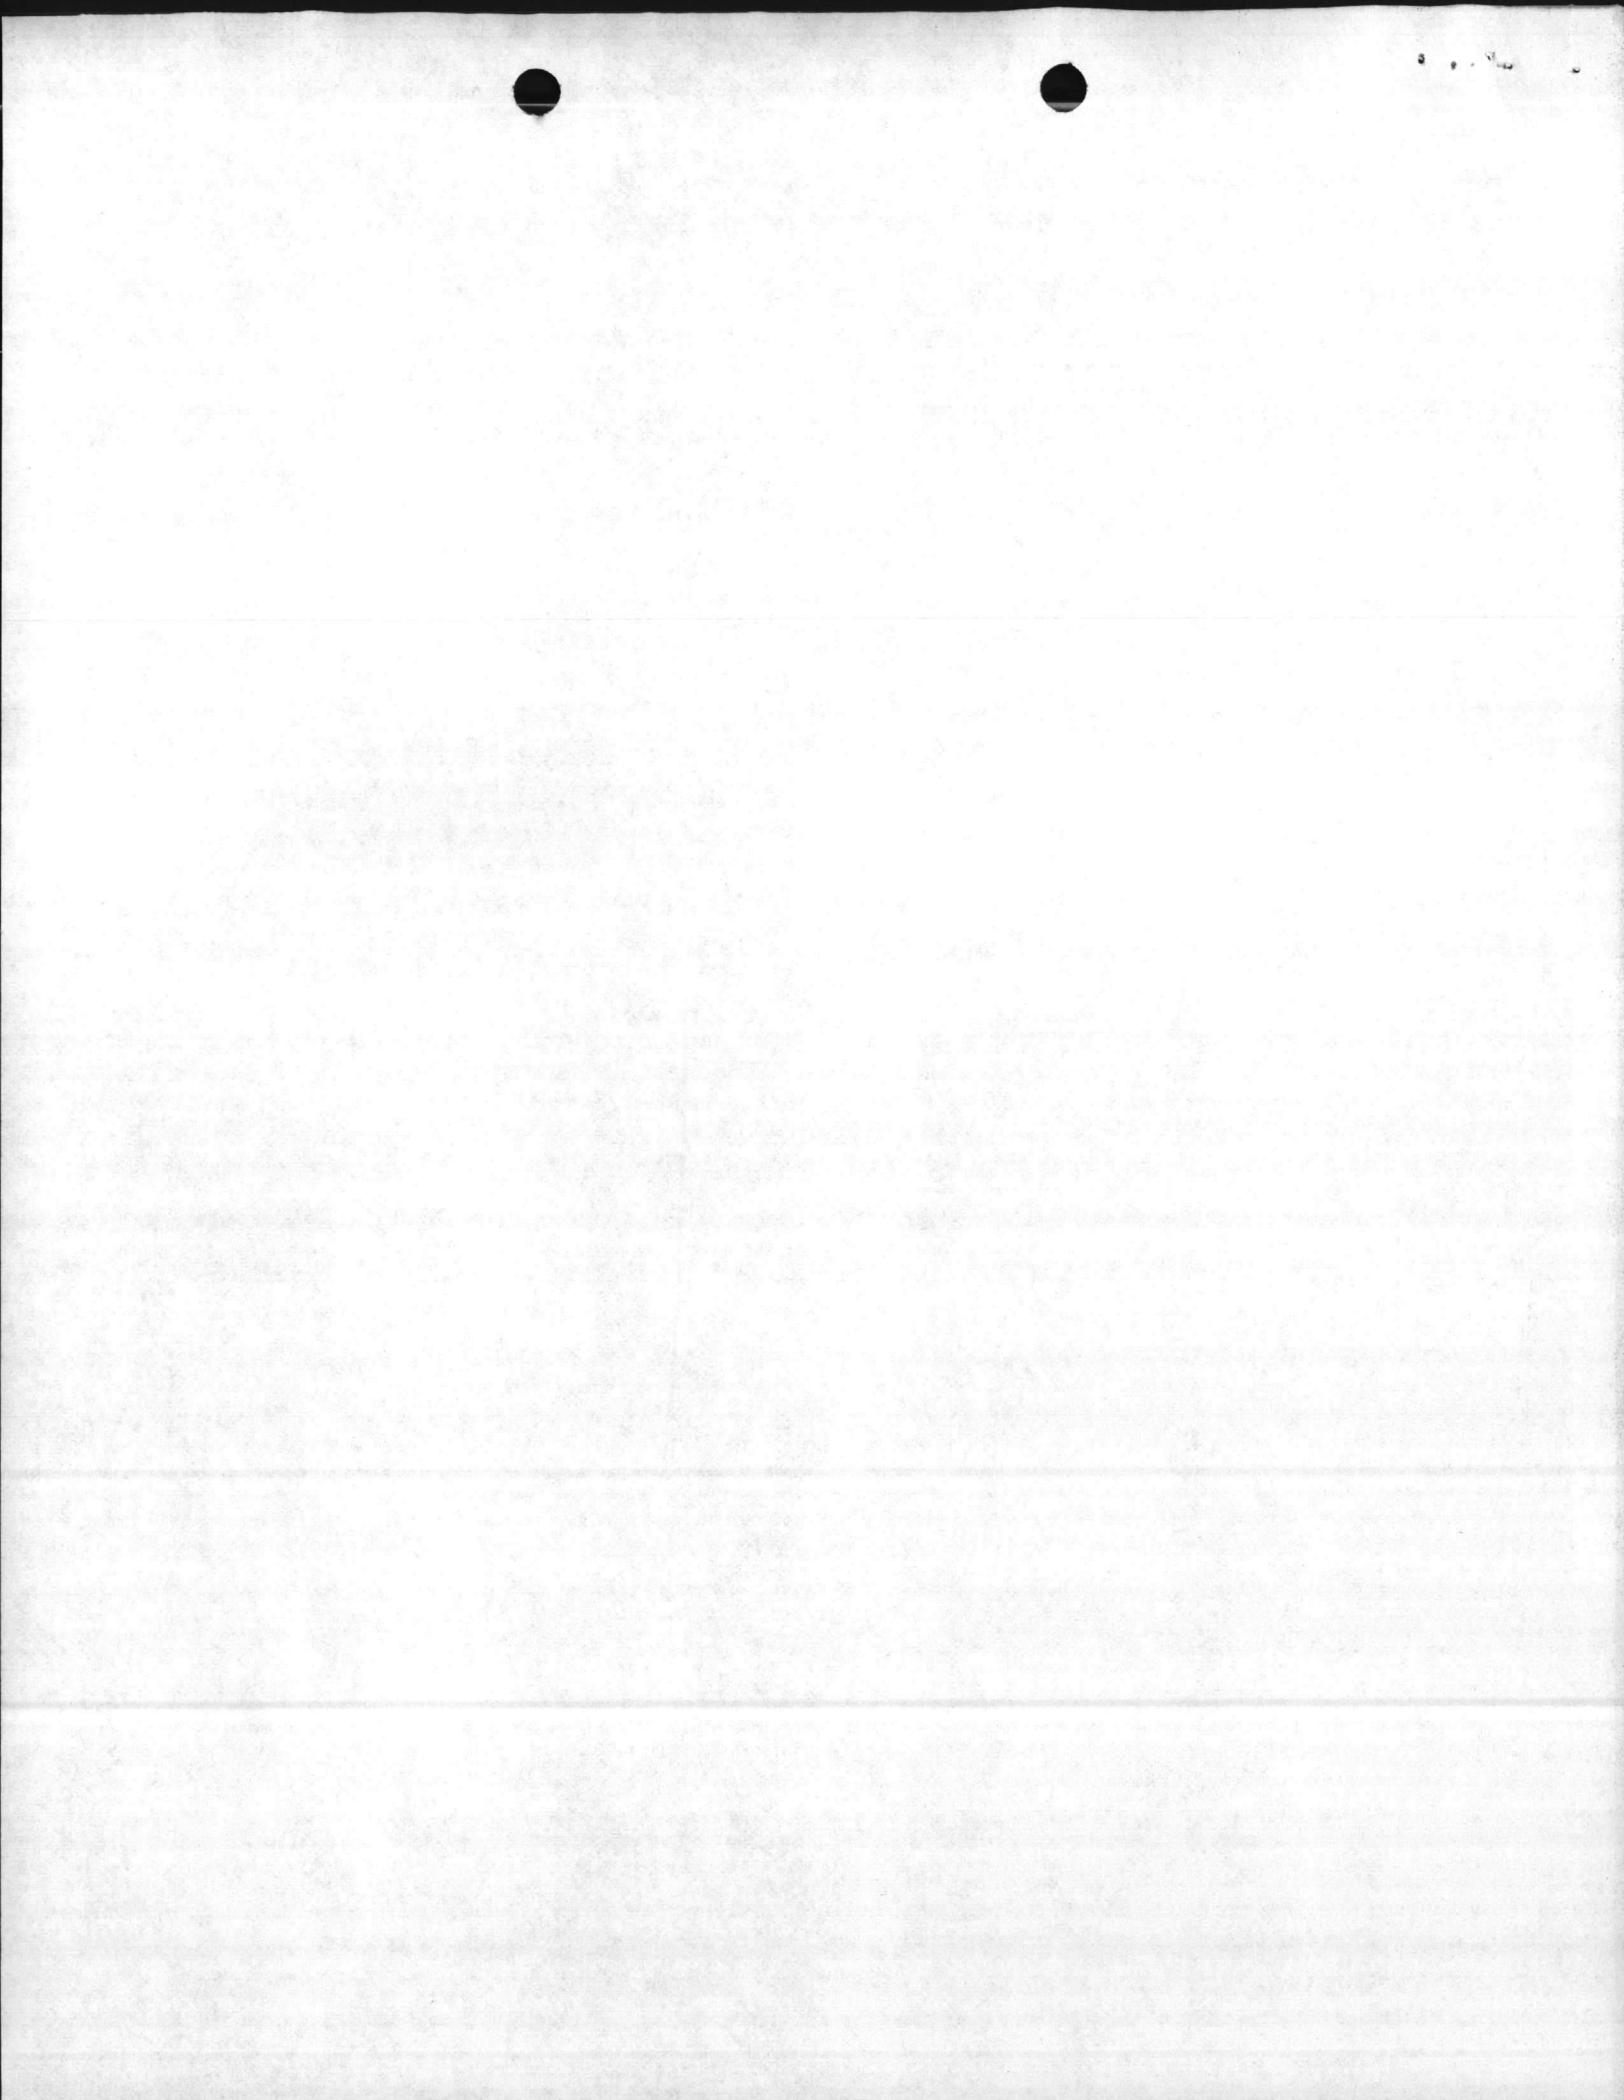

INSPECTION FOR HAZARDOUS WASTE HANDLING AND STORAGE AREAS


Name of Facility: 2nd AAB Supply

Name/Title OIC: Capt Engle

AREA OF CONCERN	YES	NO	CORRECTIVE ACTION NEEDED (use back of page to list action taken)
<p><u>A. CONDITION OF CONTAINERS</u></p> <p>1. Are containers closed</p> <p>2. Are containers leaking</p> <p>3. Are containers bulging</p> <p>4. Are containers collapsed</p> <p>5. Are containers corroded</p> <p>6. Are containers over-filled</p> <p>7. Other problems present</p>			<p><i>No Probl. currently in storage</i></p>
<p><u>B. LABELING AND MARKING</u></p> <p>1. Are HW labels in place</p> <p>2. Are HW labels filled out</p> <p>3. Are hazards (i.e., flammable, corrosive, etc.) labels or markings adequate</p>			
<p><u>C. Are HWs being disposed of by deadlines</u></p>			
<p><u>D. SECURITY AND EMERGENCIES</u></p> <p>1. Is access limited to authorized personnel only</p> <p>2. Is emergency response information posted</p> <p>3. Supplies and equipment readily available</p>			


DATE: 16 Jan 86


SIGNATURE: DT Beck

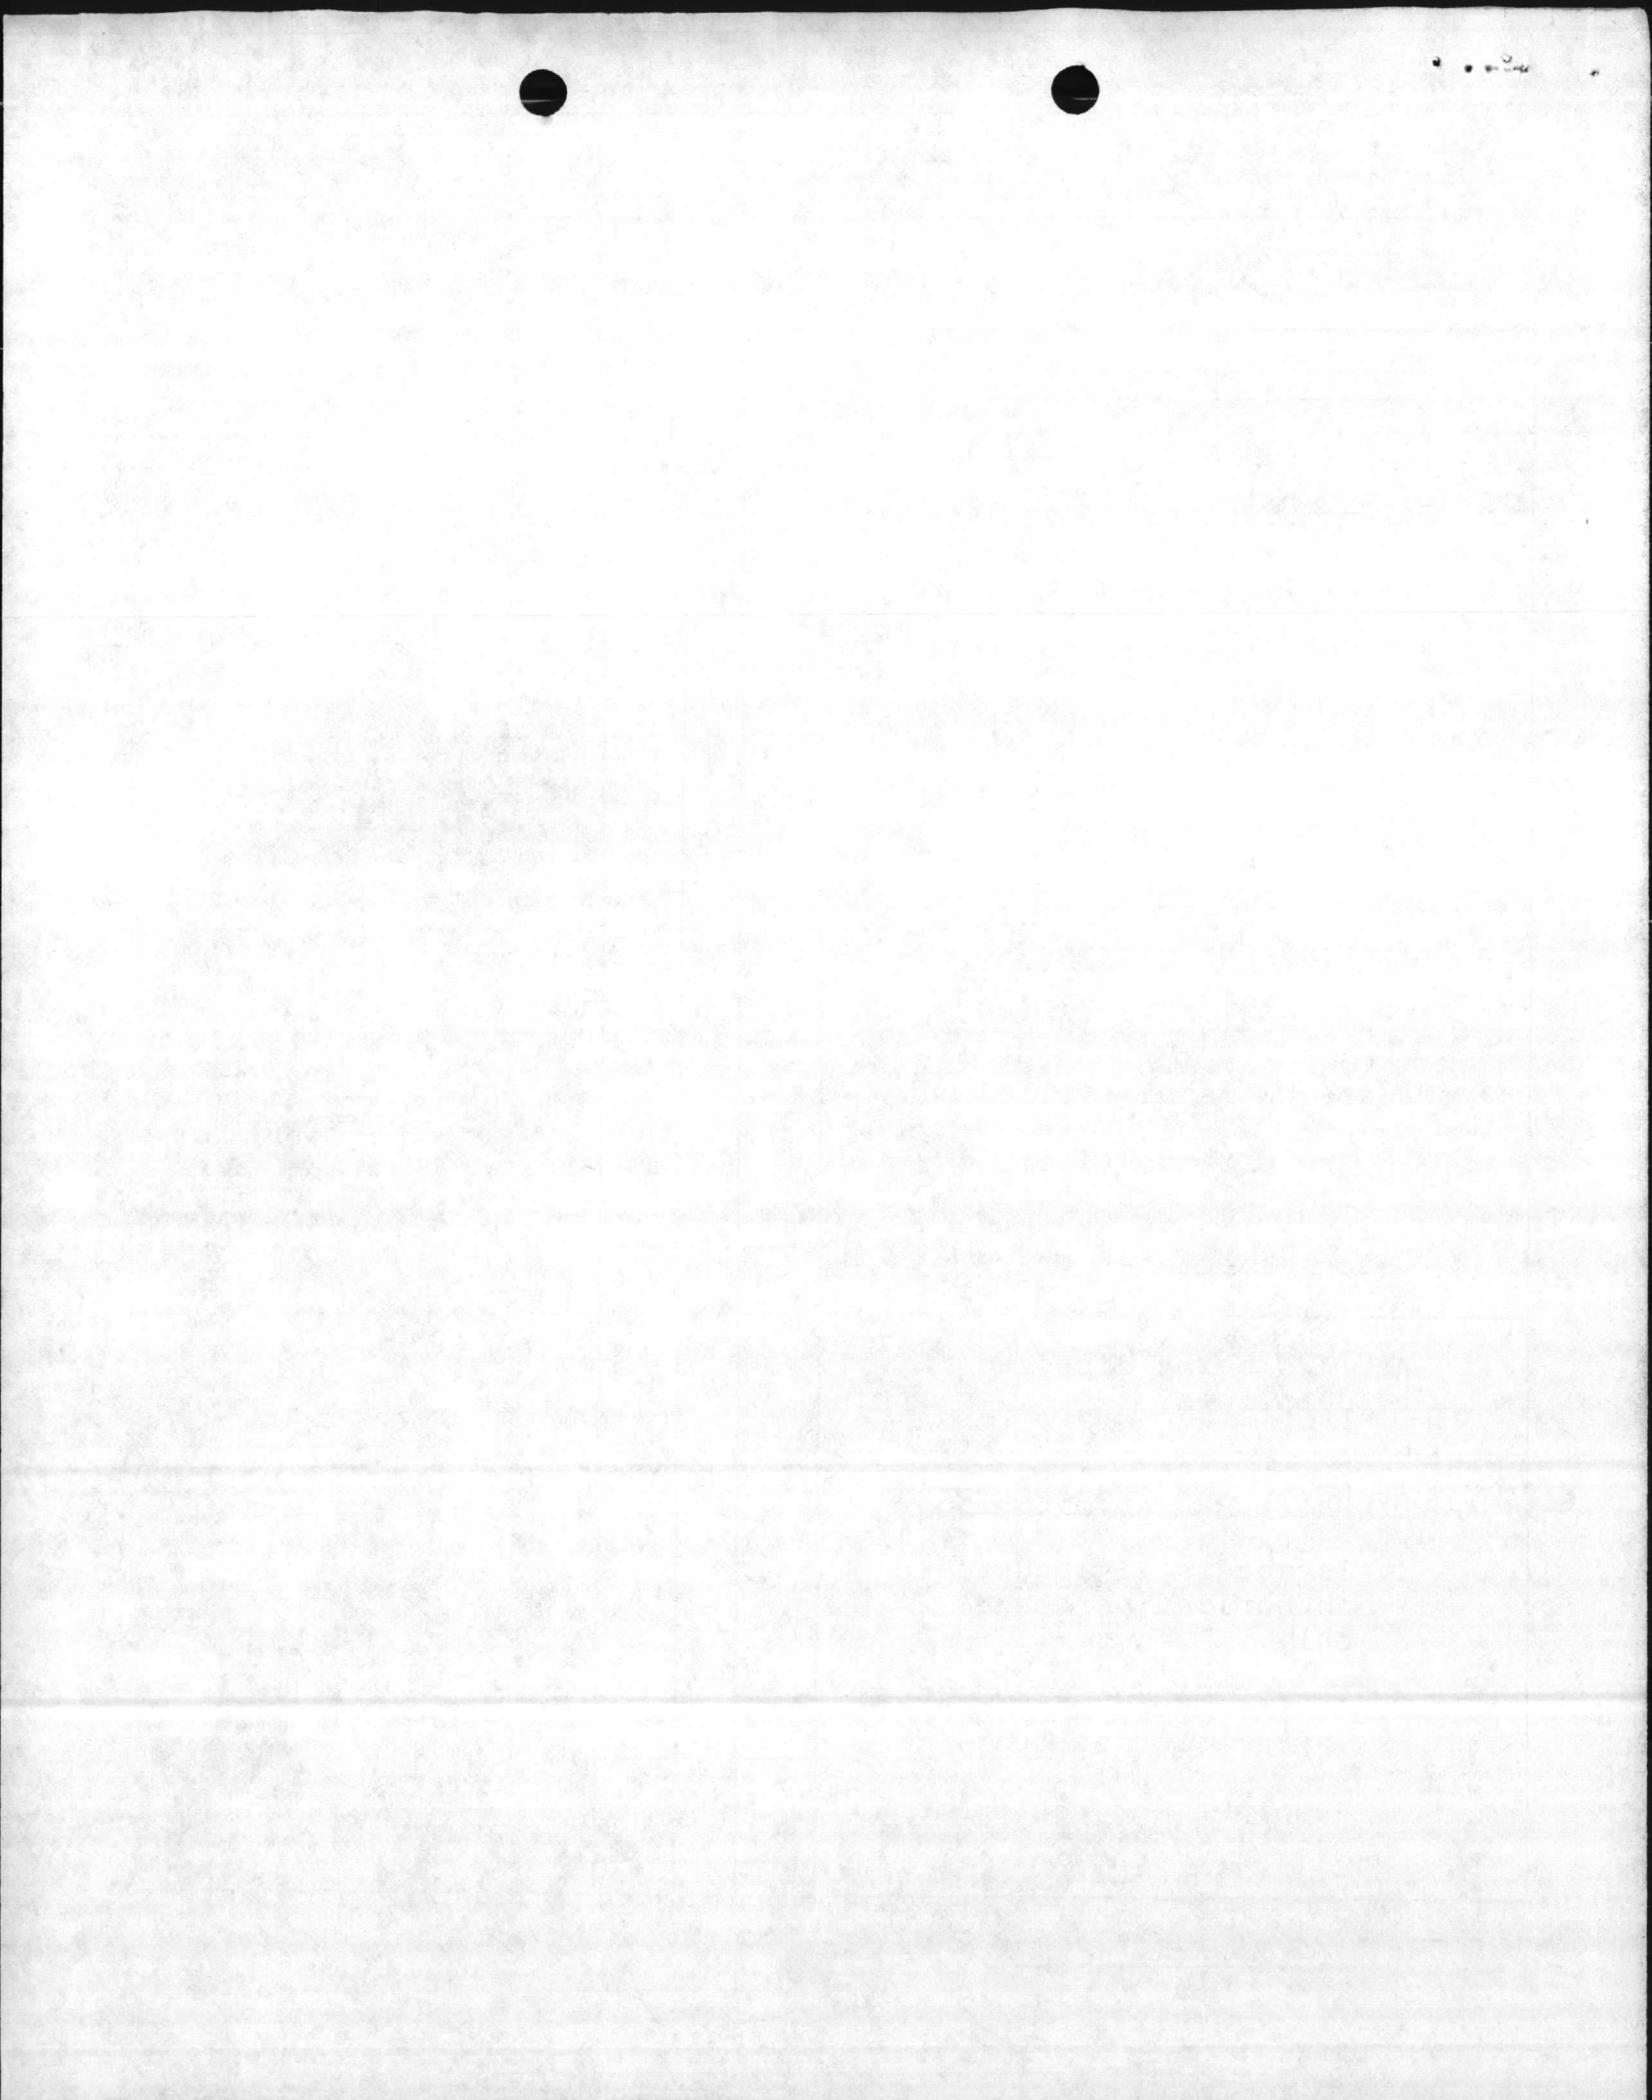

e. Corrective Action Recommended: *NONE RECOMMENDED*

f. Sketch showing location of Facility:

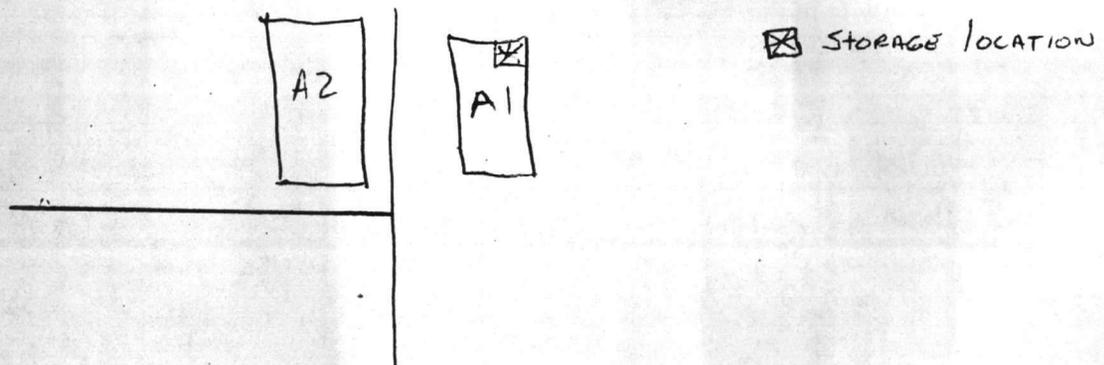

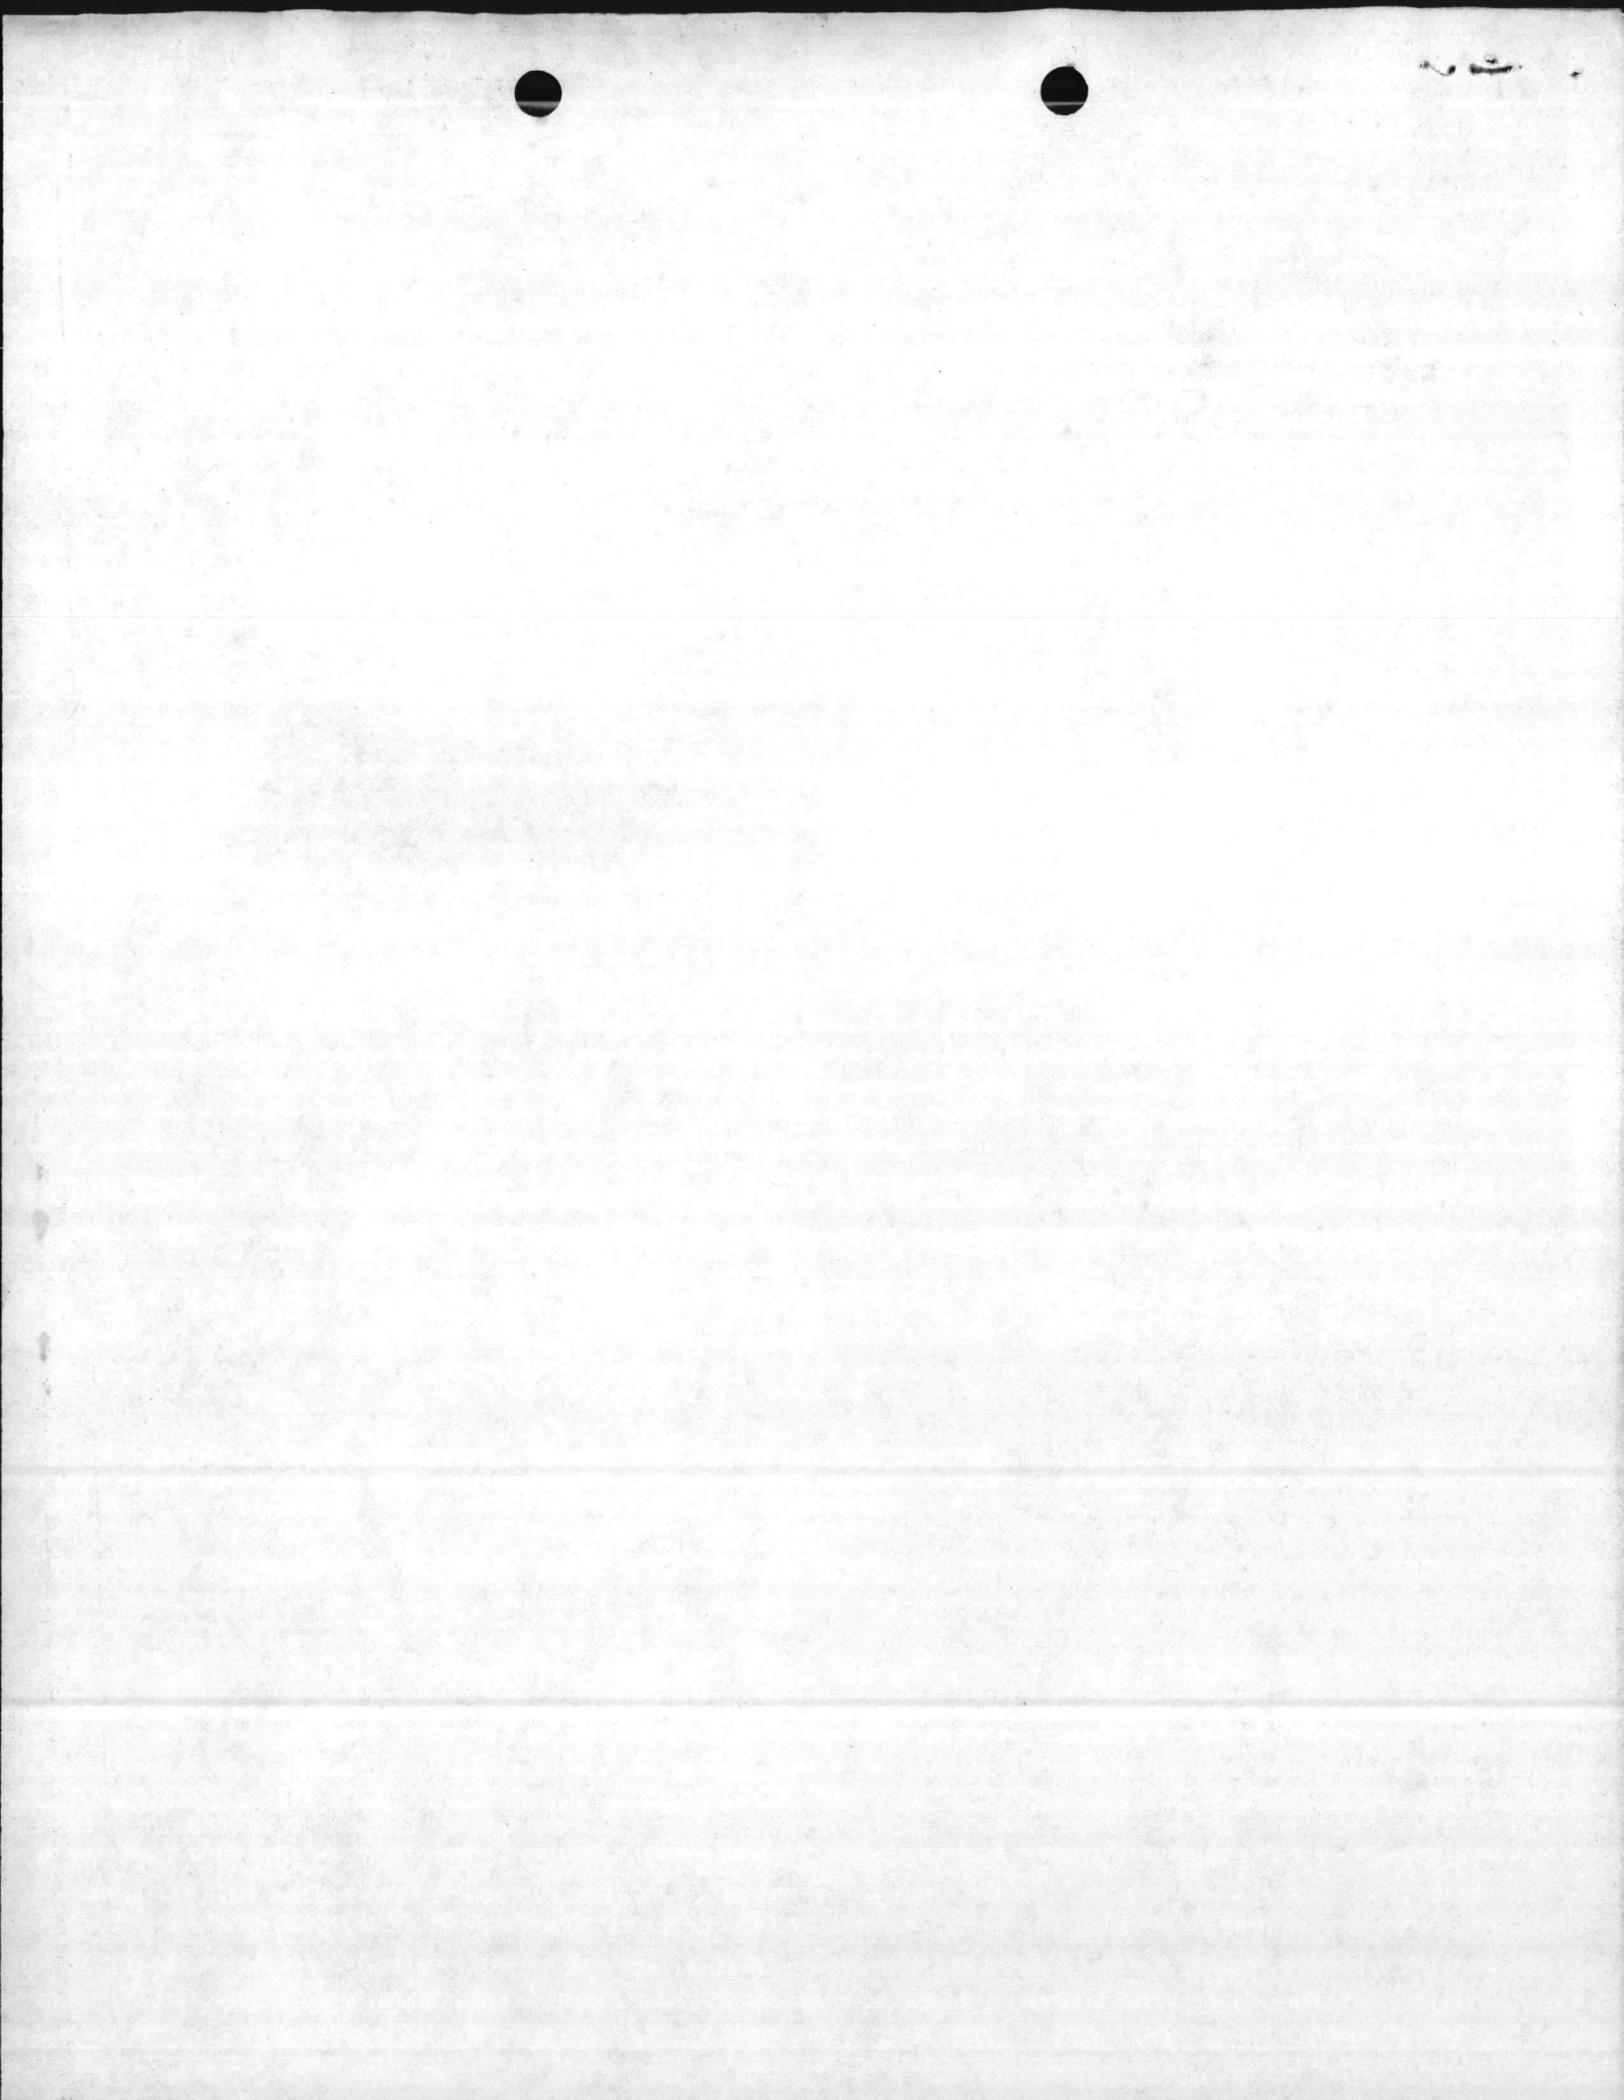

Return to NREAD

6240
NREAD
APR 08 1987

From: Commanding General, Marine Corps Base, Camp Lejeune
To: Commanding General, 2d Marine Division, Camp Lejeune

Subj: HAZARDOUS WASTE MANAGEMENT COMPLIANCE INSPECTION OF
2D ANTRAC BN DTD 16 DEC 86; FOLLOW UP ON

Ref: (a) CG MCB ltr dtd 7 Jan 87
(b) CG MCB MSG 291625 Oct 86
(c) CG MCB MSG 192005 Sep 84
(d) BO 6240.5A

DJ
224
Encl


Encl: (1) Hazardous Waste Management Compliance Re-Inspection
Report for 2d ANTRACBN, 2d MARDIV of 13 Mar 87

1. On 13 March 87, a re-inspection was conducted by Base Environmental personnel to determine the adequacy of action taken to correct discrepancies identified during the subject inspection and documented in reference (a). The subject inspection was conducted in cooperation with the Hazardous Material Disposal Coordinator, 2D MARDIV, in accordance with references (b) and (c) to determine compliance with hazardous waste regulations described in reference (d). The enclosure provides findings during the re-inspection. Required corrective action was discussed with 2D ANTRAC personnel during the re-inspection.

2. Based on the enclosure and observations made during the re-inspection, the following comments are provided: (a) The level of compliance with hazardous waste regulations appears to have deteriorated since the subject inspection, and (b) In order to increase awareness to regulatory requirements, all personnel with significant hazardous waste management responsibilities should be provided formal classroom training. Base environmental personnel are available upon written request to conduct the recommended training. Addressee should arrange for training site. Classes should last approximately two hours.

3. Point of contact for this matter is Mr. Danny Sharpe, extensions 2083/1690.

T. J. DALZELL
By direction

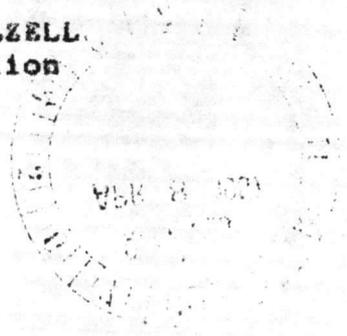




ORGANIZATION:

2d MARDIV
2d AMTRAC BN

INSPECTION DATE: 13 March 87

INSPECTOR'S NAME SAMMY GWYNN

NO.	SPECIFIC LOCATION	DISCREPANCY	REF	RECOMMENDED CORRECTIVE ACTION
1.		<u>COMMUNICATIONS SHOP</u>		
a.	Bldg. #A-1	Failure to post hazardous waste spill contingency plan.	1	Post spill contingency plan at all hazardous waste sites.
b.	Bldg. #A-1	Failure to establish and maintain training records for all personnel involved in hazardous waste management.	2	Training records shall be maintained for hazardous waste handlers and alternate to include a description of duties and training received for personnel at each site.
c.	Bldg. #A-1	Failure to conduct weekly inspections and maintain a log of hazardous waste sites.	3	Conduct weekly inspections and maintain an inspections log on all hazardous waste sites.
d.	Bldg. #A-1	Failure to maintain copies of BO 6240.5A, BO 11090.1B and BO 11090.3.	4	Maintain copies of BO 6240.5A, BO 11090.1B and BO 11090.3 at all sites.
e.	Bldg. #A-1	Failure to post emergency spill response information.	5	Purchase/fabricate and post emergency spill response signs.

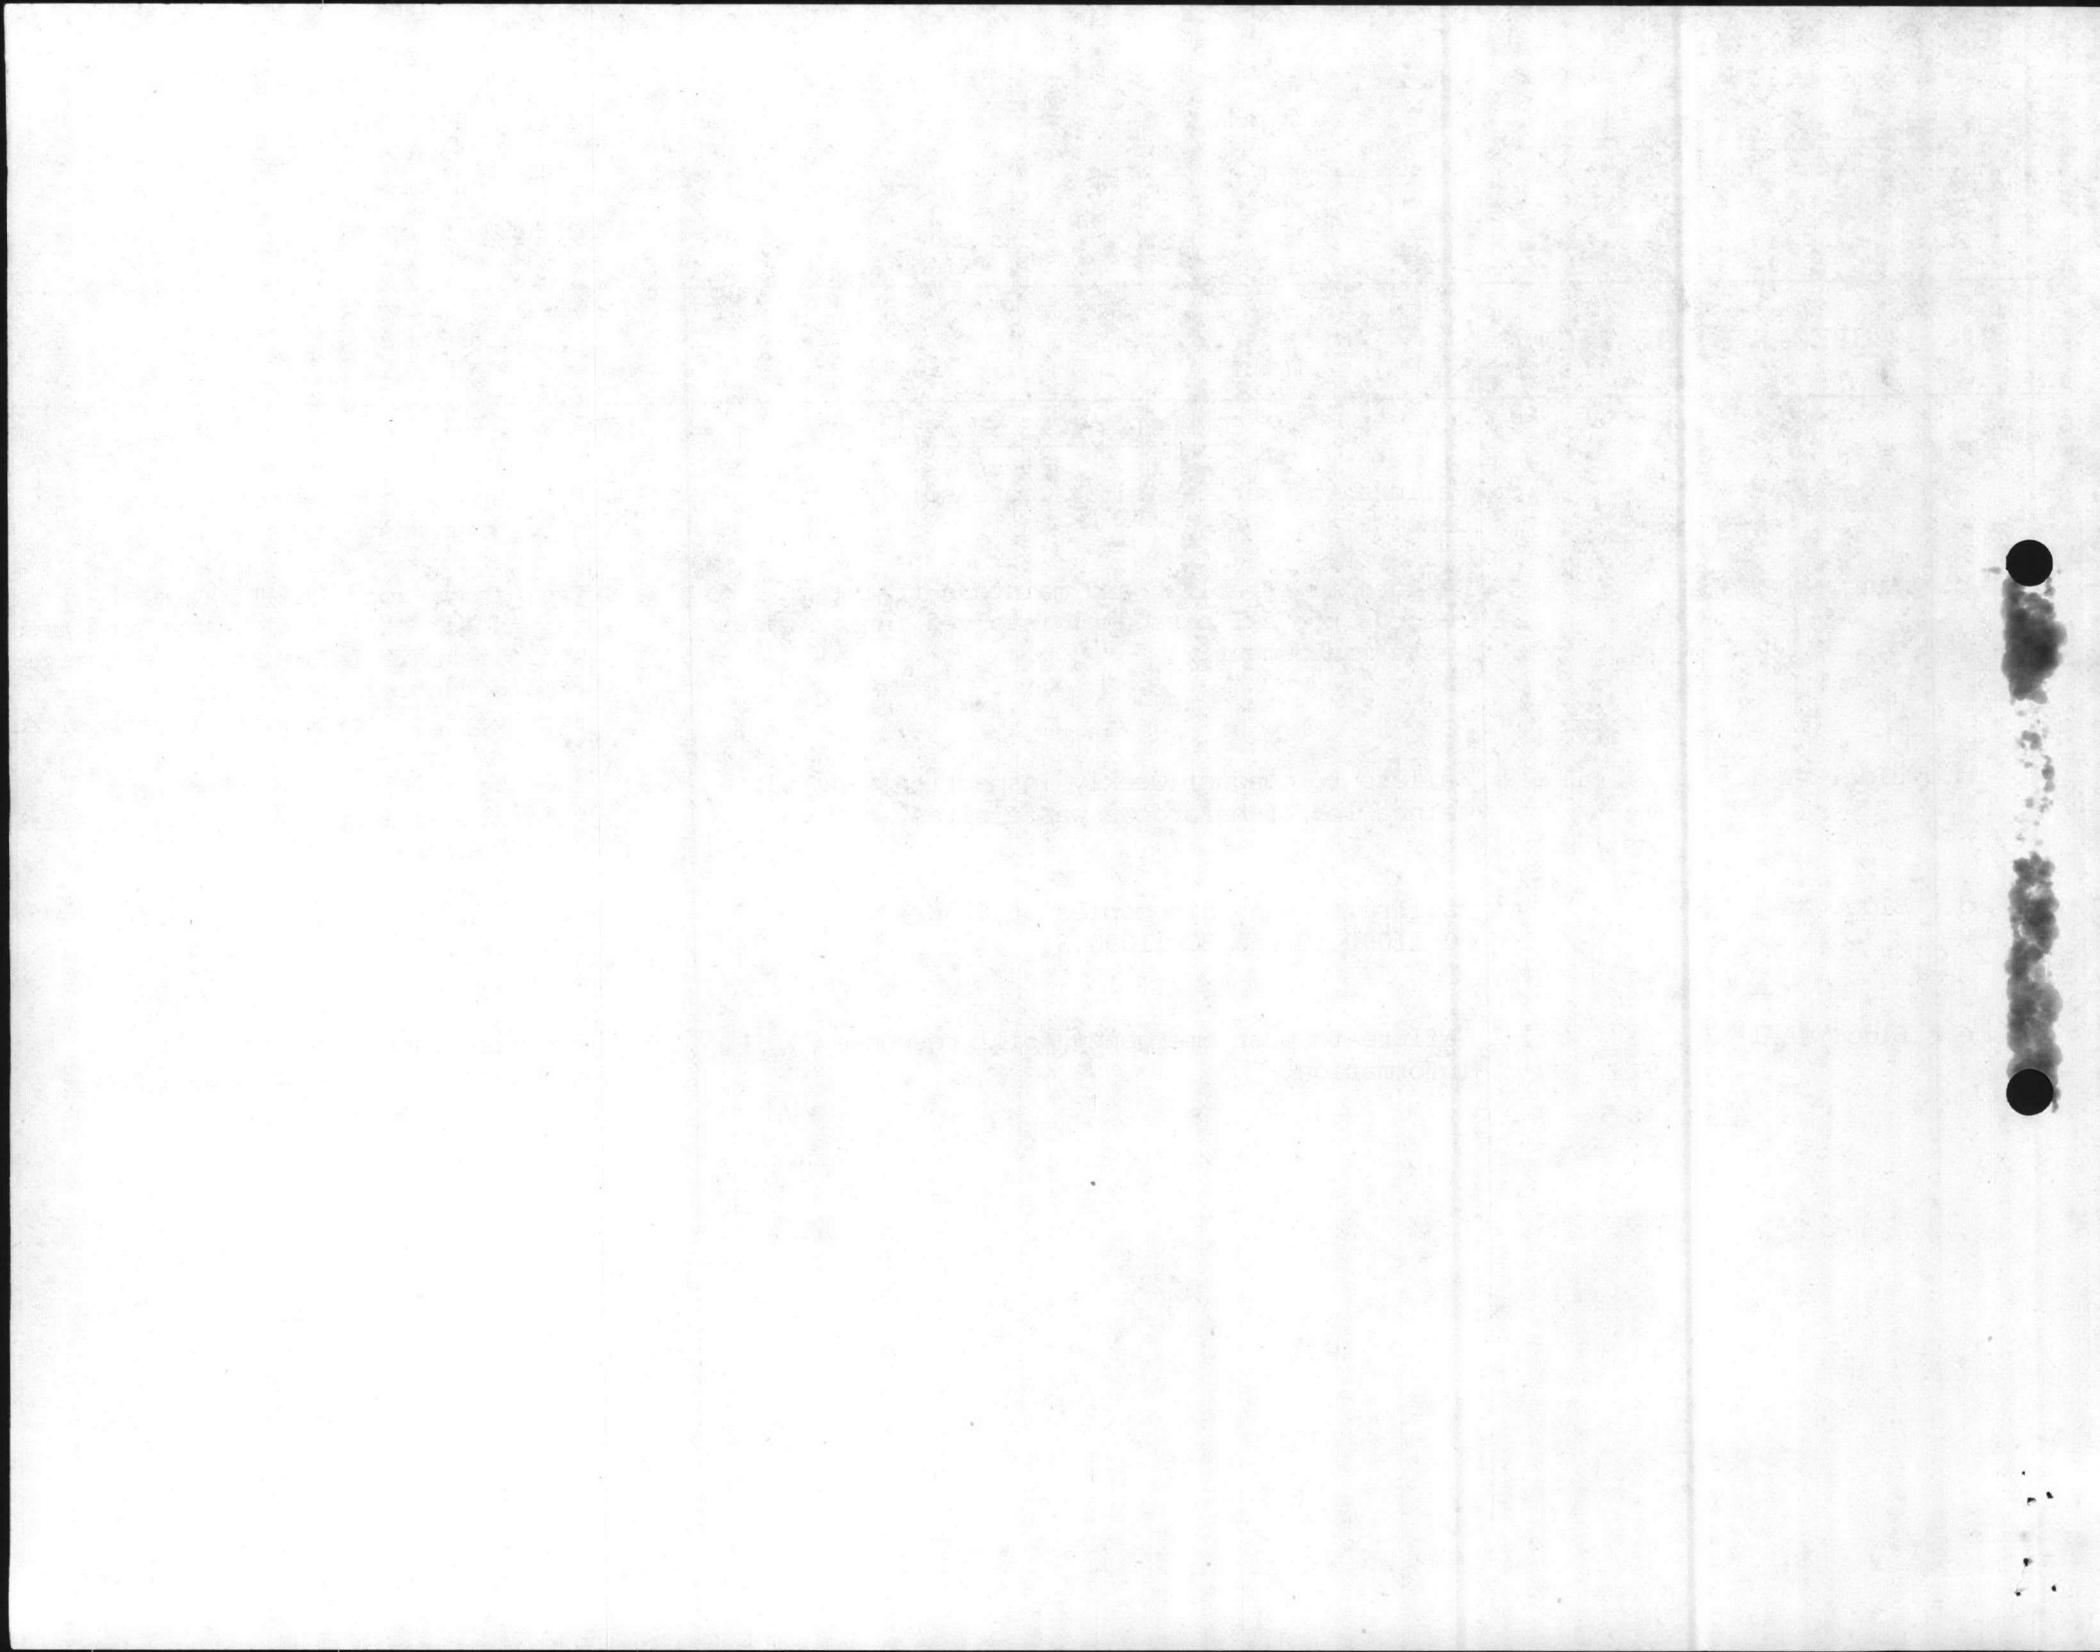

ORGANIZATION:


2d MARDIV
2d AMTRAC BN

INSPECTION DATE: 13 MARCH 87

INSPECTOR'S NAME SAMMY GWYNN

NO.	SPECIFIC LOCATION	DISCREPANCY	REF	RECOMMENDED CORRECTIVE ACTION
2.		<u>ARMORY</u>		
a.	Bldg. #A-2	Failure to post hazardous waste spill contingency plan.	1	Post spill contingency plan at all hazardous waste sites.
b.	Bldg. #A-2	Failure to establish and maintain training records for all personnel involved in hazardous waste management.	2	Training records shall be maintained for hazardous waste handlers and alternate to include a description of duties and training received for personnel at each site.
c.	Bldg. #A-2	Failure to conduct weekly inspections and maintain a log of hazardous waste sites.	3	Conduct weekly inspections and maintain an inspection log on all hazardous waste sites.
d.	Bldg. #A-2	Failure to maintain copies of BO 6240.5A, BO 11090.1B and BO 11090.3.	4	Maintain copies of BO 6240.5A, BO 11090.1B and BO 11090.3 at all Hazardous waste sites.
3.		<u>MAINTENANCE FACILITY</u>		
a.	Bldg. #A-2	Failure to post hazardous waste spill contingency plan.	1	Post spill contingency plan at all hazardous waste sites.
4.		<u>MOTOR TRANSPORT SECTION</u>		
a.	Bldg. #A-2	Failure to post hazardous waste spill contingency plan.	1	Post spill contingency plan at all hazardous waste sites.
b.	Bldg. #A-2	Failure to close containers	2	Seal containers with bung hole caps.

ENCLOSURE (1)

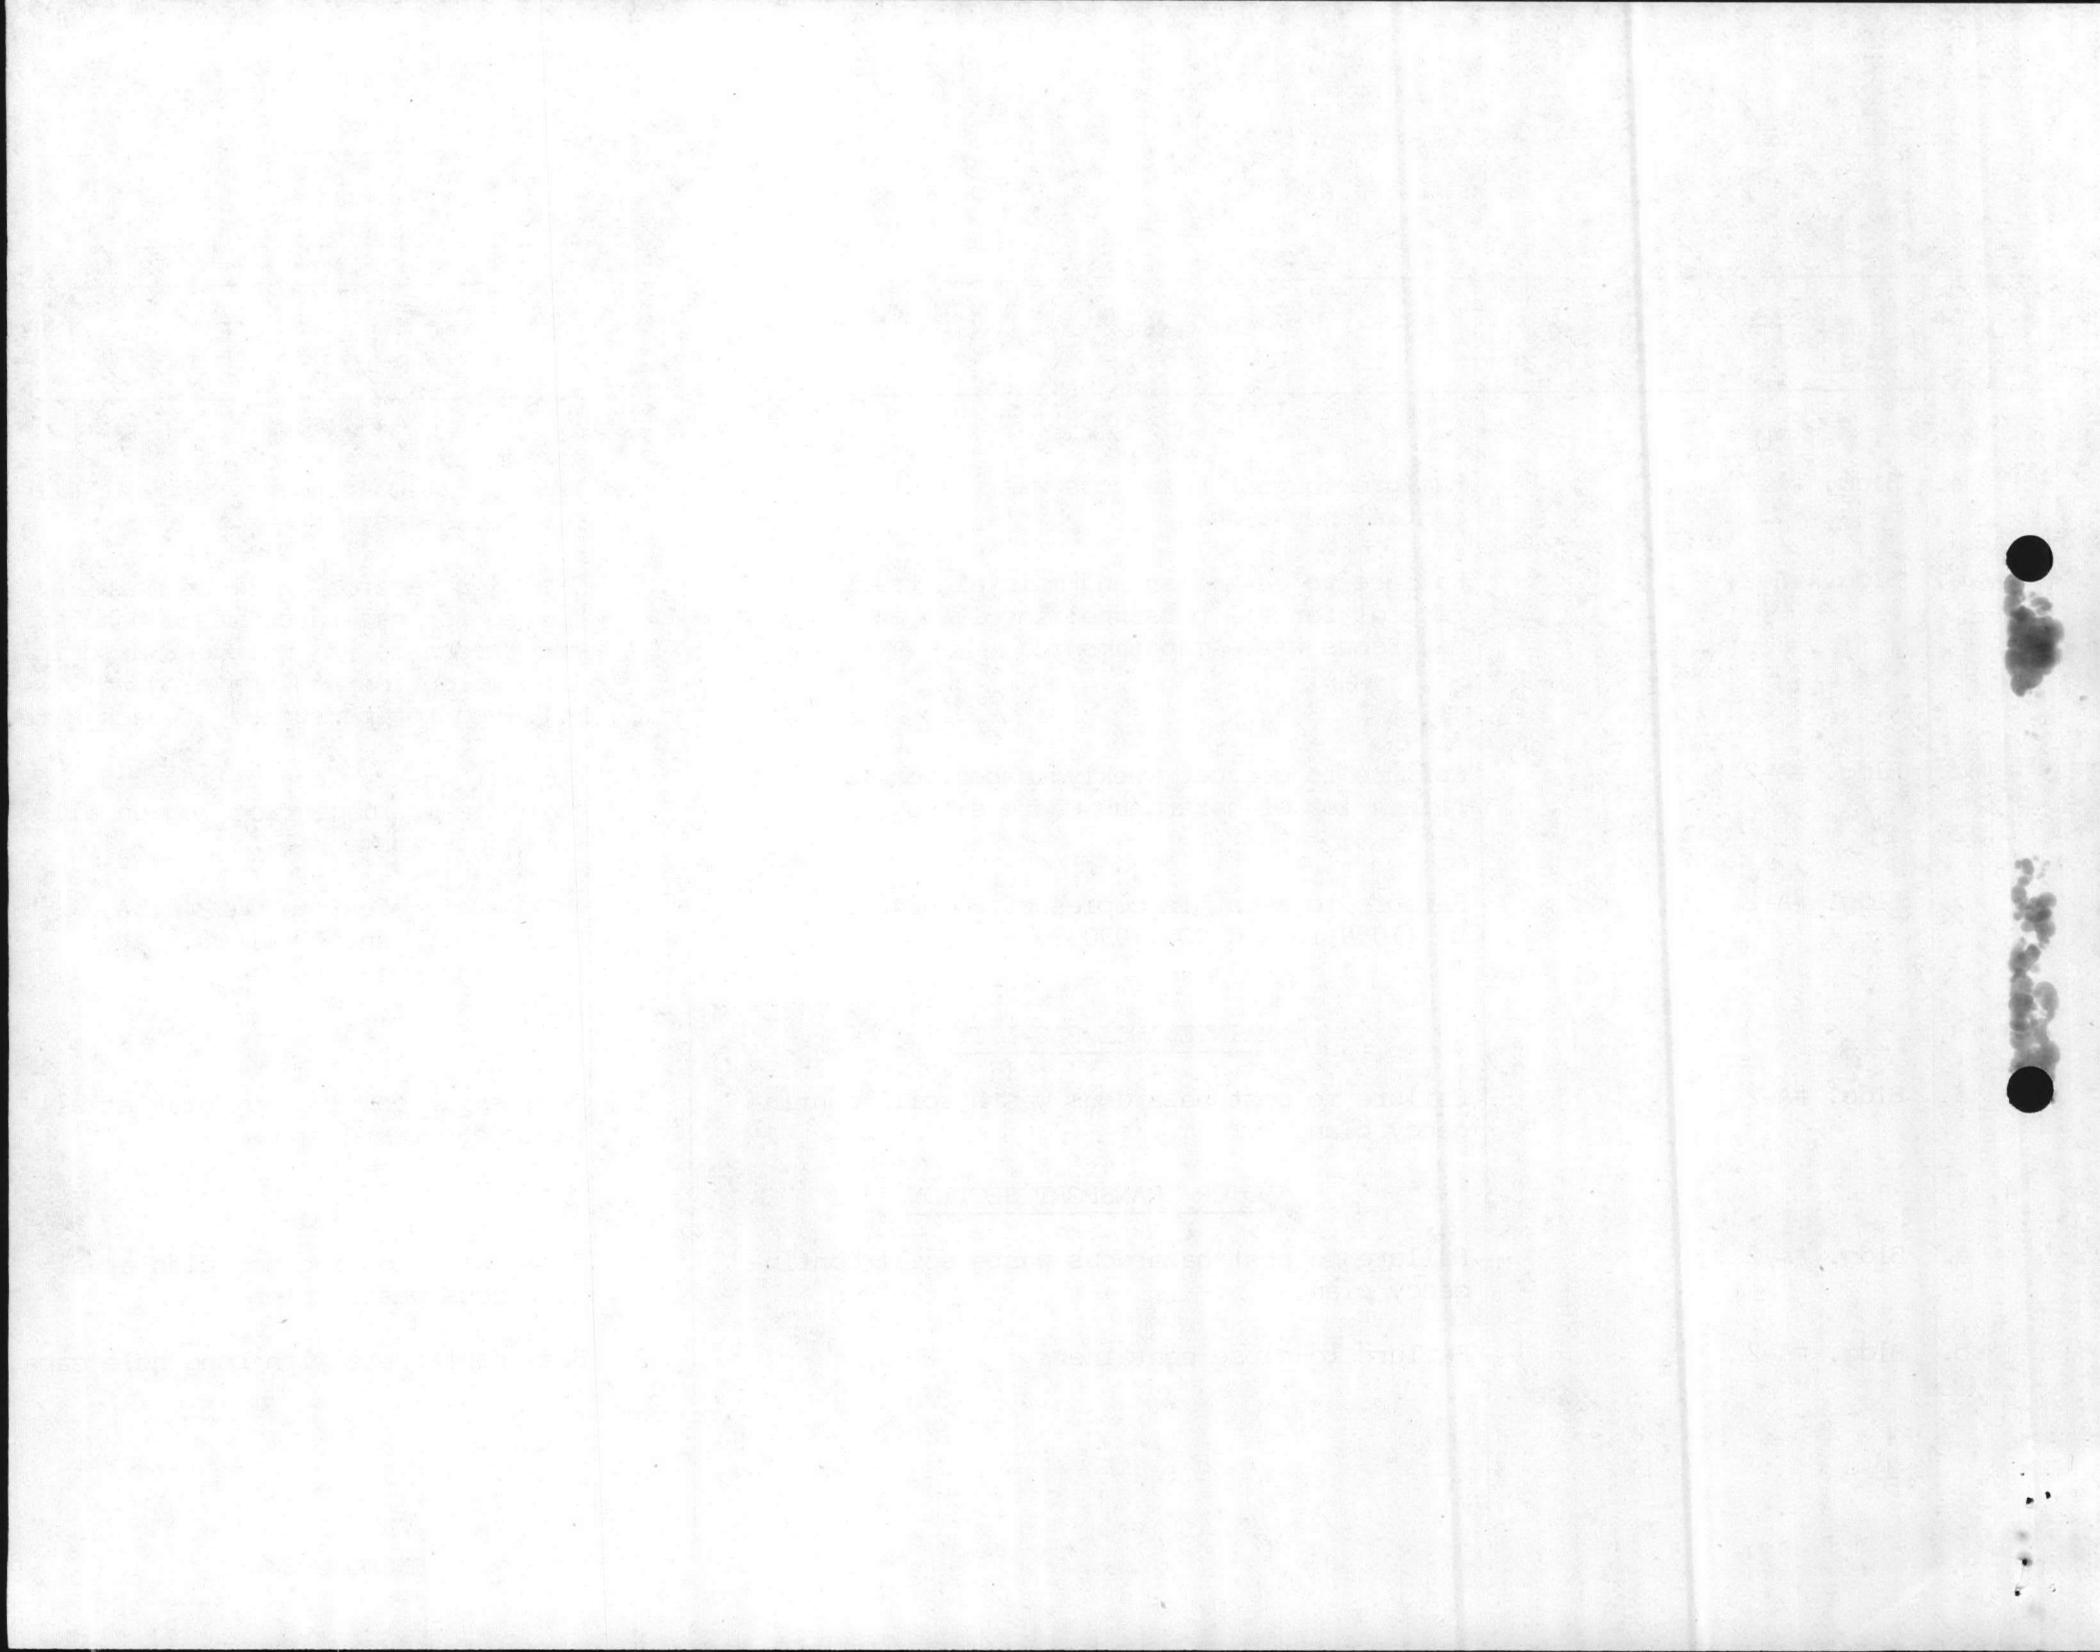

REFERENCES:

1. CG ltr NREAD of 10 NOV 86, requires the posting and development of sites specific hazardous waste spill responsibilities prevention and related guidance.

2. Section 1 of enclosure (1) CG ltr 6240 of 9 SEP 85
"Clear, concise training records shall be maintained on each person actively involved in hazardous waste management.

3. BO 6240.5A enclosure (1), para 2d - All HW containers and storage areas will be inspected weekly using format provided by cognizant HMDC/HMDO.

4. BO 6240.5A enclosure (1), para 1 & b - Each organization routinely generating or handling HW or disposing of HM will provide a copy of BO 6240.5A, BO 11090.1B, BO 11090.3 and related local instructions.

5. BO 11090.1B enclosure (2), para 1c - posting of Oil Spill Procedure - Signs shall be posted in every building, tank location and field service location where oil or hazardous materials are used. See BO 11090.1B for proper wording of sign.

6. CG MCB Message 192005 SEP 84, para 5E - Keep containers closed except when actually pouring wastes into them.

1948

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

...

2d MAR DIV

AUTHORIZED HW GENERATION AND STORAGE SITES FOR 2d AMTRAC BN

SITE NO. 1
GENERATION/ACCUMULATION

BLDG. #A-1, COMMUNICATIONS SHOP
LITHIUM BATTERIES

SITE NO. 2
GENERATION/ACCUMULATION

BLDG. #A-2, MOTOR TRANSPORT
DRY CLEANING SOLVENT & WASTE OIL

SITE NO. 3
GENERATION/ACCUMULATION

BLDG. #A-47, MAINTENANCE FACILITY
DRY CLEANING SOLVENT, ELECTROLYTE
AND WASTE OIL



HAZARDOUS WASTE (HW) MANAGEMENT INSPECTION FORM

Date: 13 MAR 87

1. Facility being Inspected: 2d AMTRAC BN Communication Shop
2. Organization in Charge: - 2d MAR DIV Bldg A-1
3. Inspection Participants/Phone Number: WO. Montoya (prim)
MSGT Chaney (alternate) Phone 7389-7483
4. Description of HW Streams: Lithium Batteries

5. Are records of HW generation consistent with HW streams? NO

6. HW Training

a. Are job descriptions available for all personnel actively involved in HW management? NO

b. Are training records adequate/current? NO

c. Are alternate personnel assigned to key positions? NO
 (If not, explain how unit deals with absence of key personnel)

d. Do contacted personnel demonstrate adequate knowledge of:

- (1) Regulatory Requirements NO
- (2) Applicable Base Orders NO
- (3) Types of HW Handled NO
- (4) Proper Containers NO
- (5) Proper Labeling NO
- (6) Weekly HW Inspections NO
- (7) HW Turn-in Procedures NO
- (8) Health and Safety NO
- (9) Spill Reporting Procedures NO
- (10) Spill Response Duties NO


7. Condition of Storage Facilities

a. Date of last Fire Dept Inspection? _____

b. Are spills likely to reach soil or water? Yes

c. Are HW protected from weather? Part

d. Are weekly HW inspections conducted properly? NO

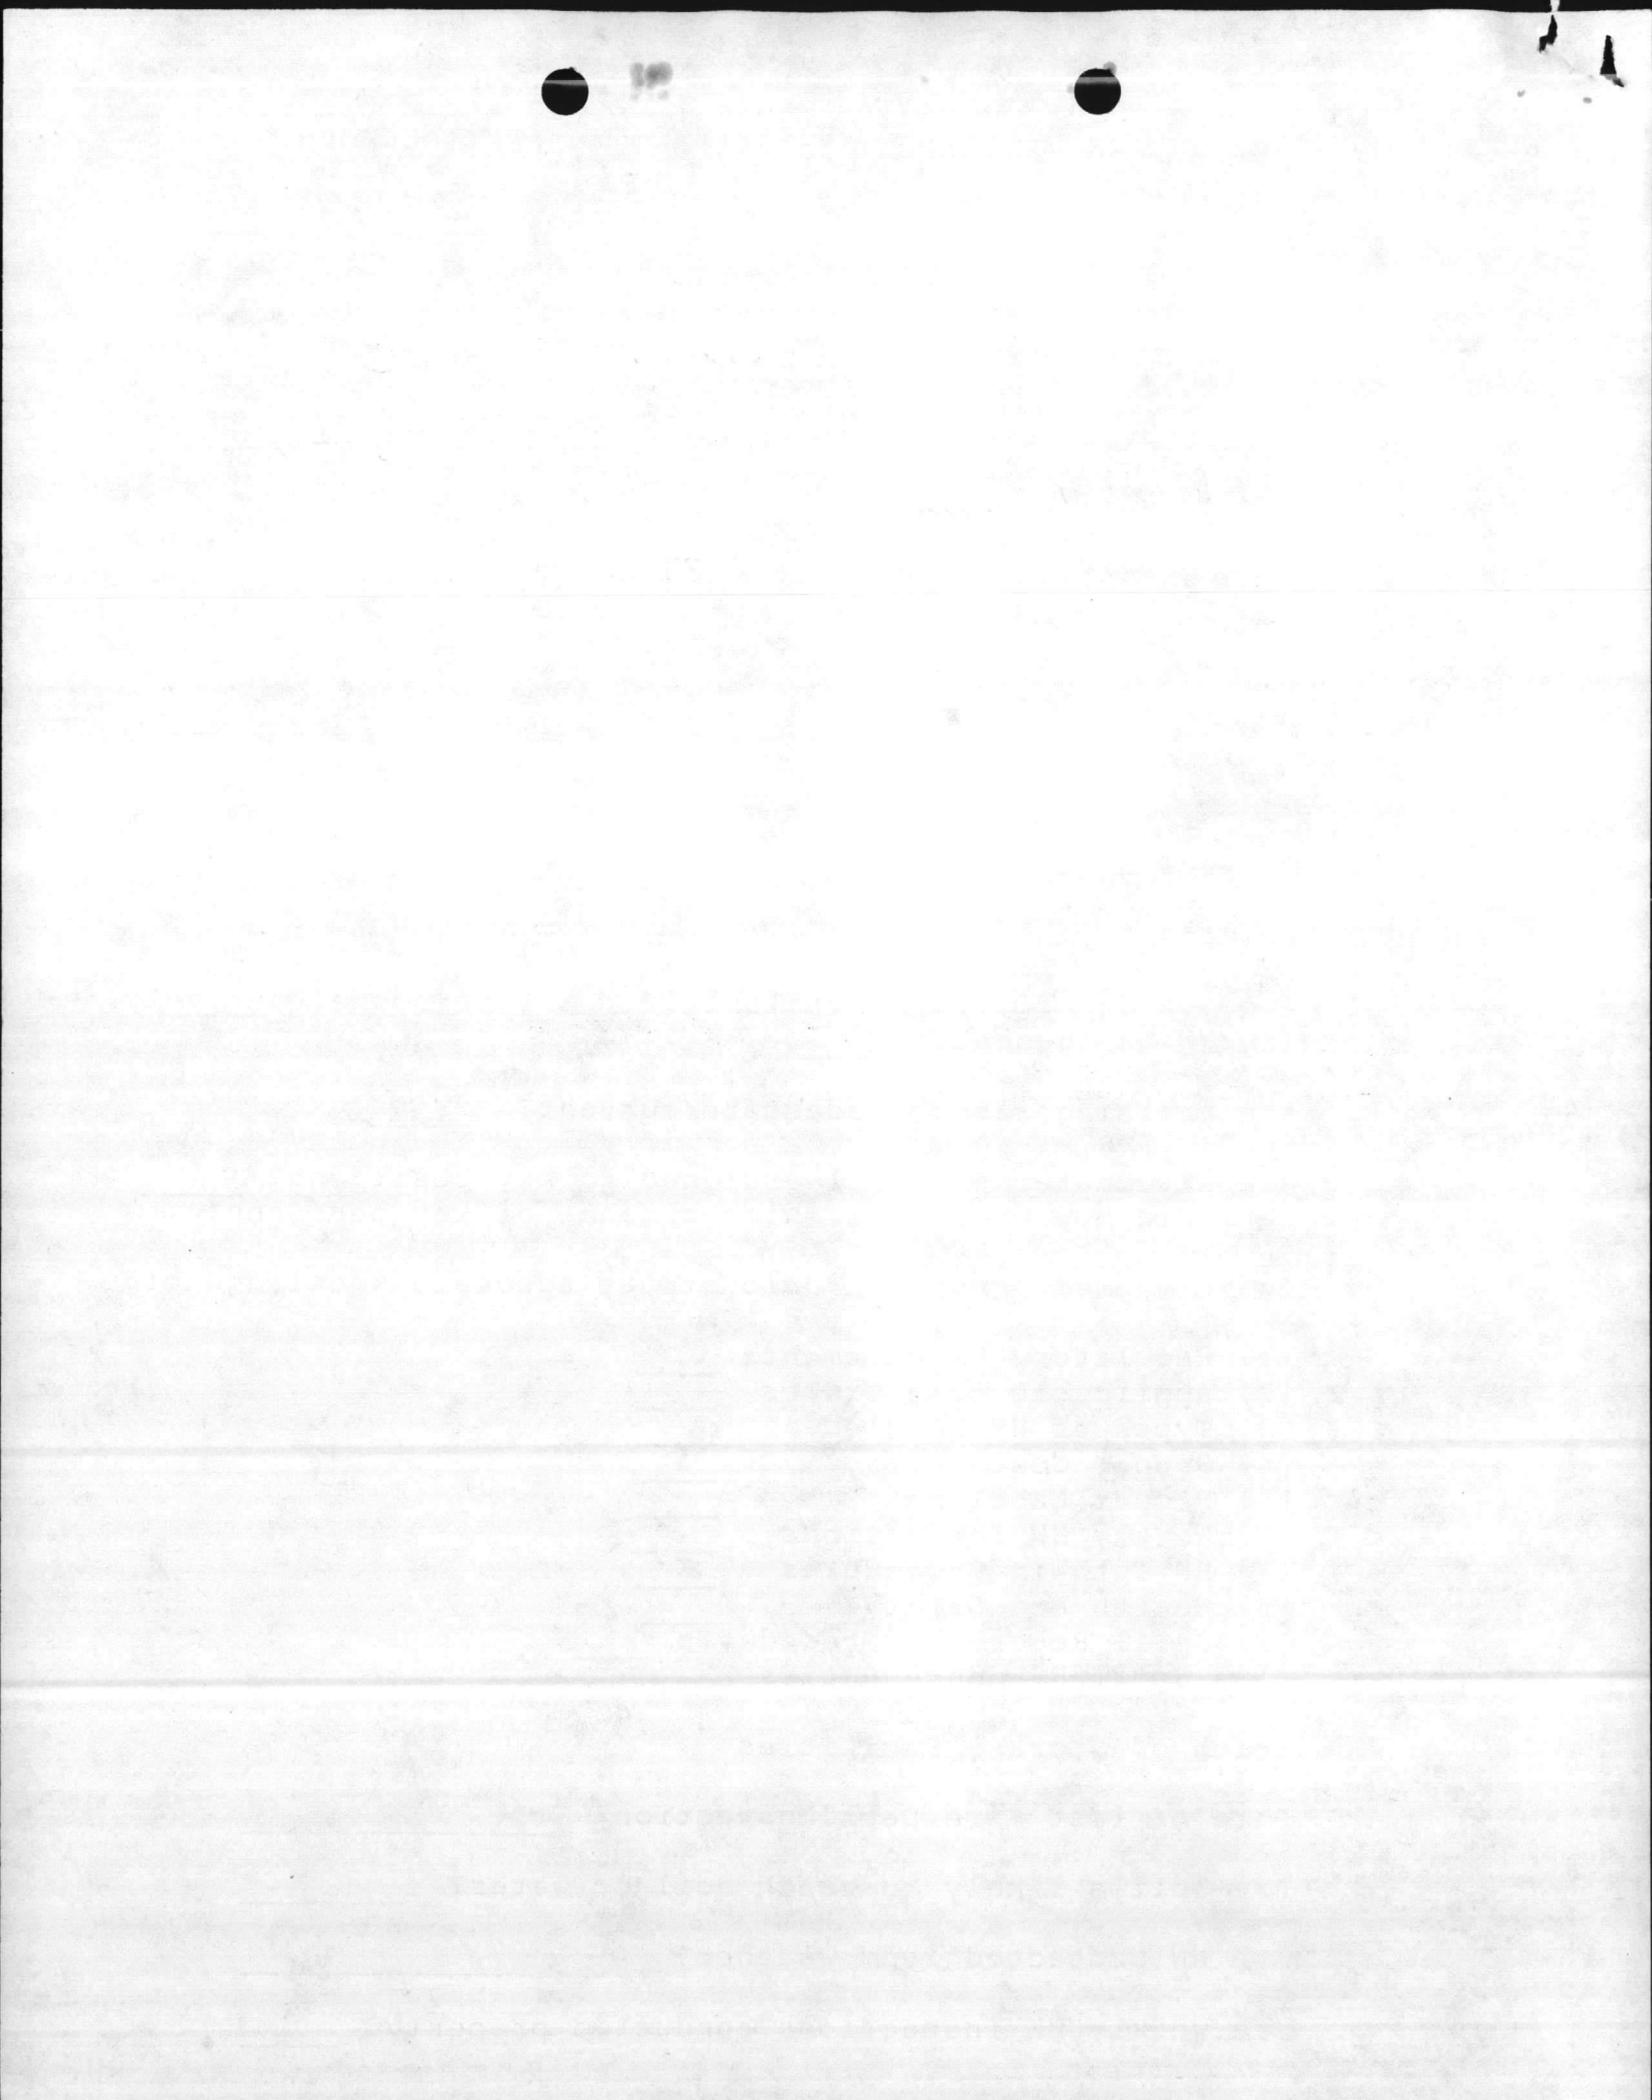

e. Are discrepancies corrected promptly? _____

f. Condition of containers? ("X" indicates discrepancy)

- | | |
|----------------------|---|
| (1) Closed _____ | (7) Properly Labeled _____ |
| (2) Leaking _____ | (8) Properly Dated _____ |
| (3) Bulging _____ | (9) Properly Stacked _____ |
| (4) Collapsed _____ | (10) Properly Packaged _____ |
| (5) Corroded _____ | (11) Meet DOT Requirements for Contents _____ |
| (6) Overfilled _____ | |

g. Are 90 day turn-in deadlines being met? _____

h. Are HW turn-in documents being prepared and submitted in a timely, proper manner? _____

i. Comments: _____


NO Contingency Plan

NO Training Records

NO Weekly Inspections

NO Emergency Spill Response sign

NO Base order

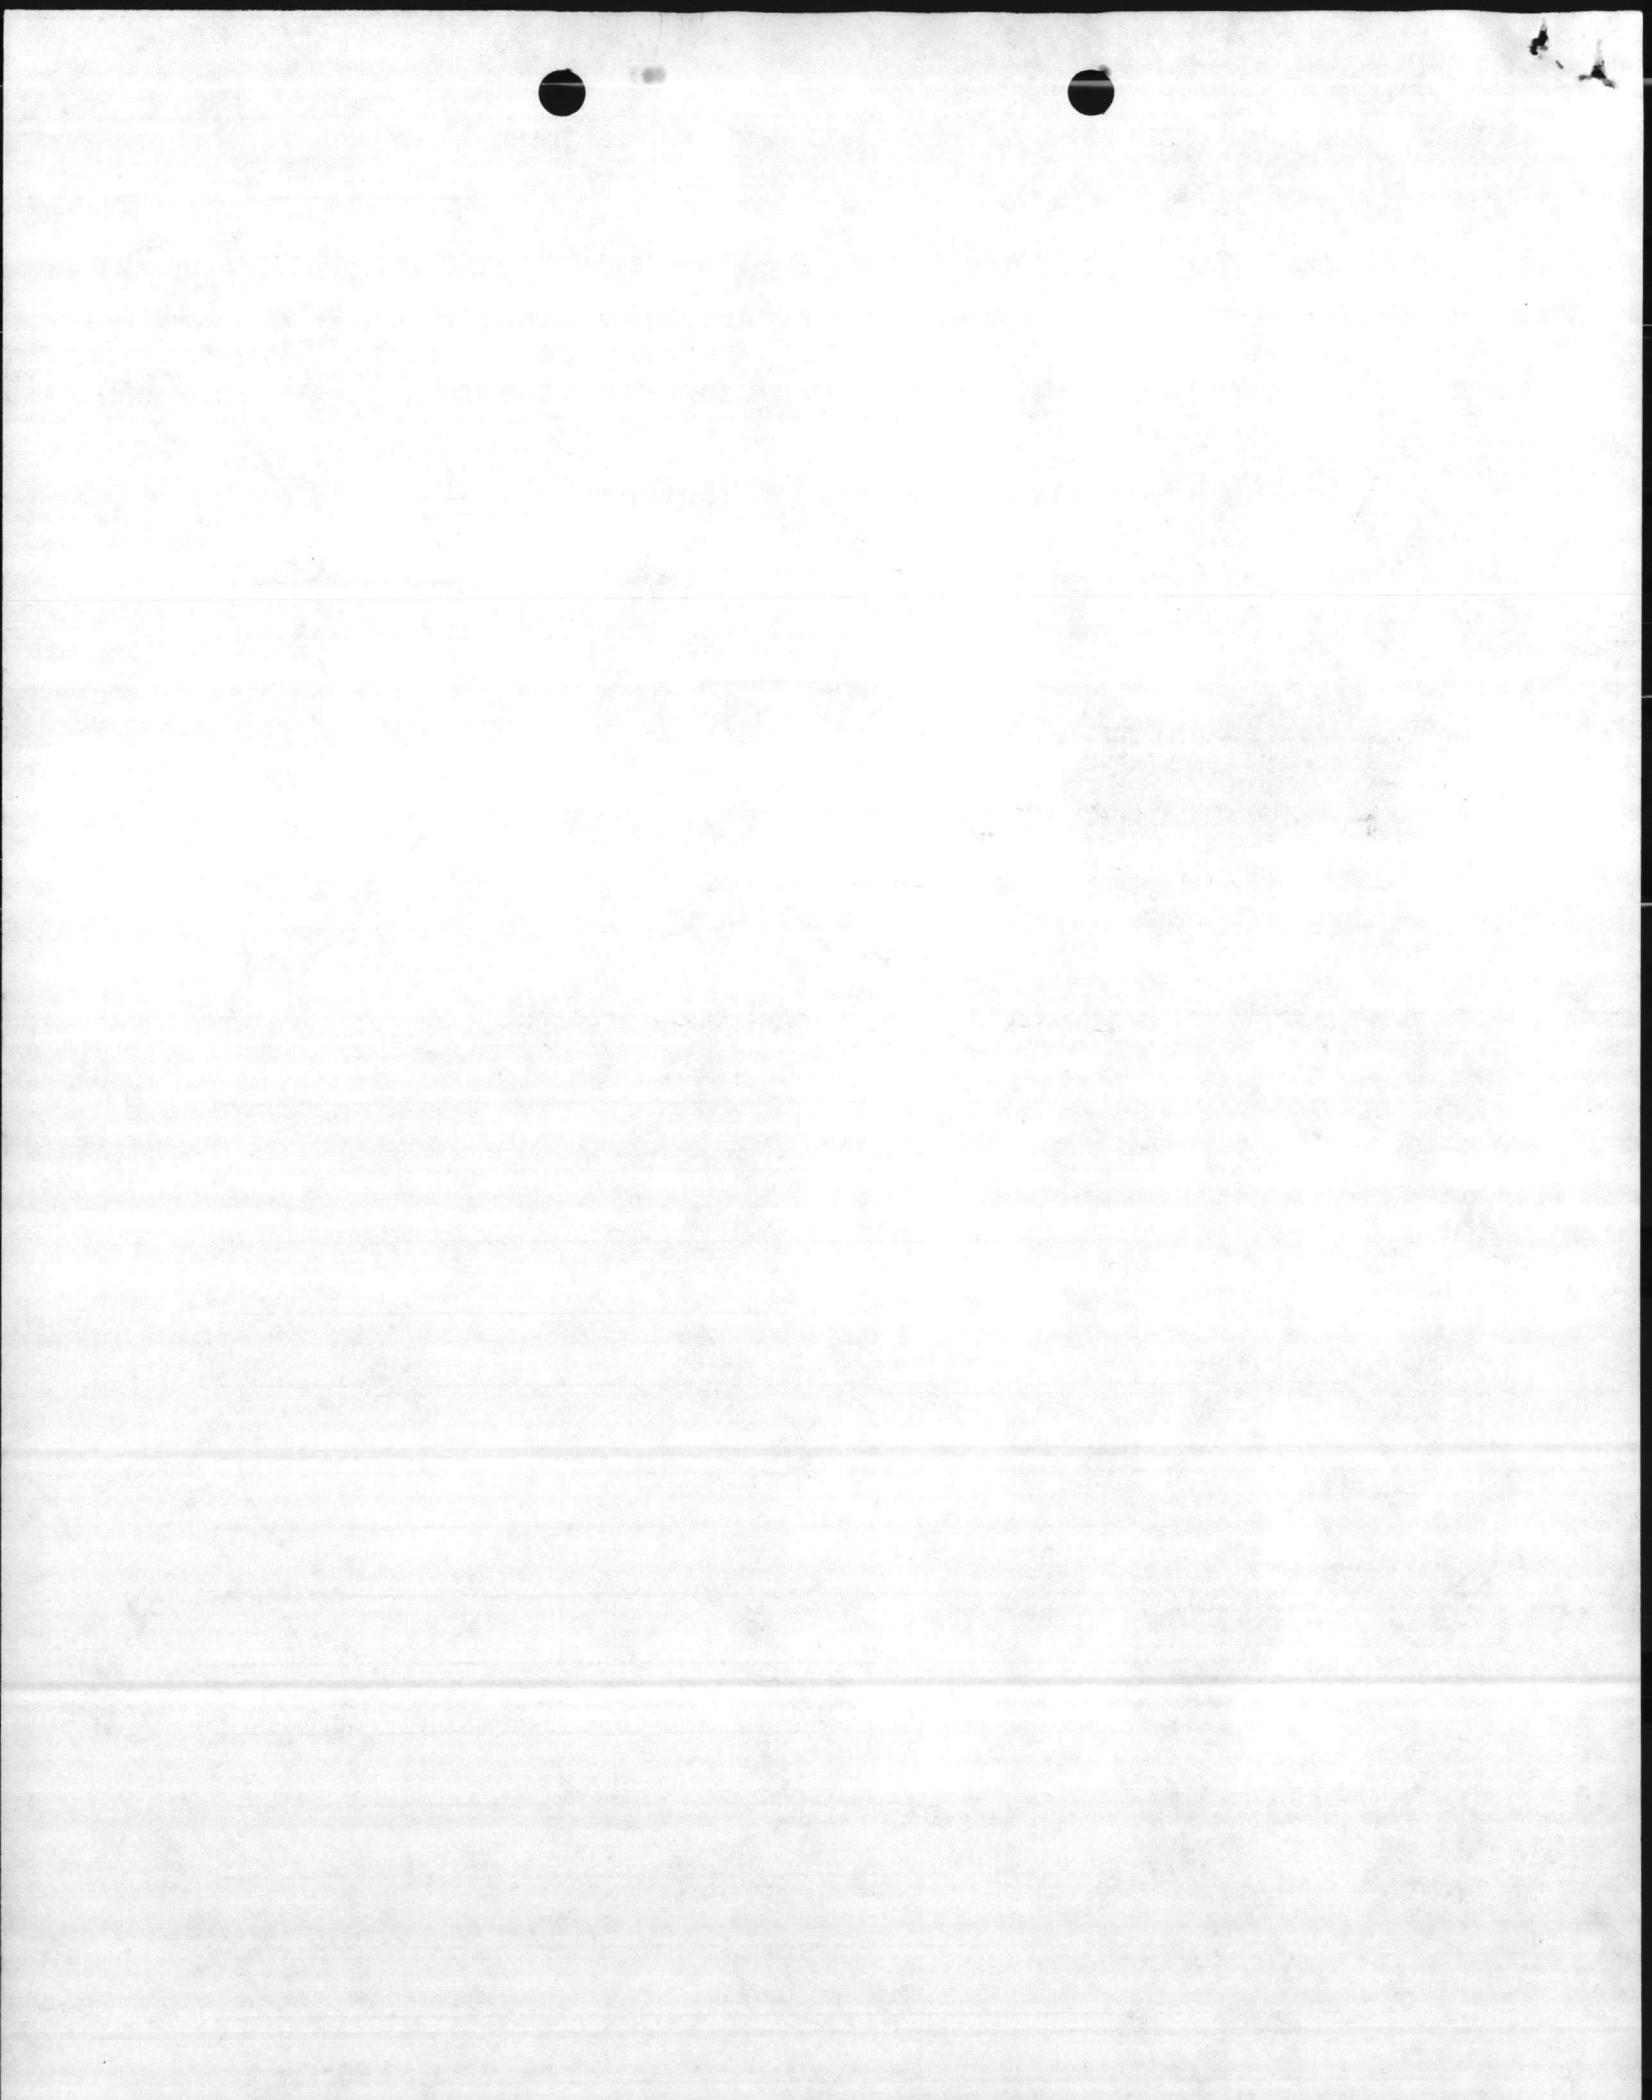

HAZARDOUS WASTE (HW) MANAGEMENT INSPECTION FORM

Date: 13 MARCH 87

1. Facility being Inspected: 2d AMTRAC BN Army BB-C.

2. Organization in Charge: 2d MAR DIV

3. Inspection Participants/Phone Number: Sgt Ullrich (Primary)
Sgt Greenhagen (alternate) Phone NO. 7176

4. Description of HW Streams: Dry Cleaning Solvent

5. Are records of HW generation consistent with HW streams? NO

6. HW Training

a. Are job descriptions available for all personnel actively involved in HW management? NO

b. Are training records adequate/current? NO

c. Are alternate personnel assigned to key positions? NO
(If not, explain how unit deals with absence of key personnel)

d. Do contacted personnel demonstrate adequate knowledge of:

- (1) Regulatory Requirements NO
- (2) Applicable Base Orders NO
- (3) Types of HW Handled NO
- (4) Proper Containers NO
- (5) Proper Labeling NO
- (6) Weekly HW Inspections NO
- (7) HW Turn-in Procedures NO
- (8) Health and Safety NO
- (9) Spill Reporting Procedures NO
- (10) Spill Response Duties NO


7. Condition of Storage Facilities

a. Date of last Fire Dept Inspection? _____

b. Are spills likely to reach soil or water? NO

c. Are HW protected from weather? yes


d. Are weekly HW inspections conducted properly? NO

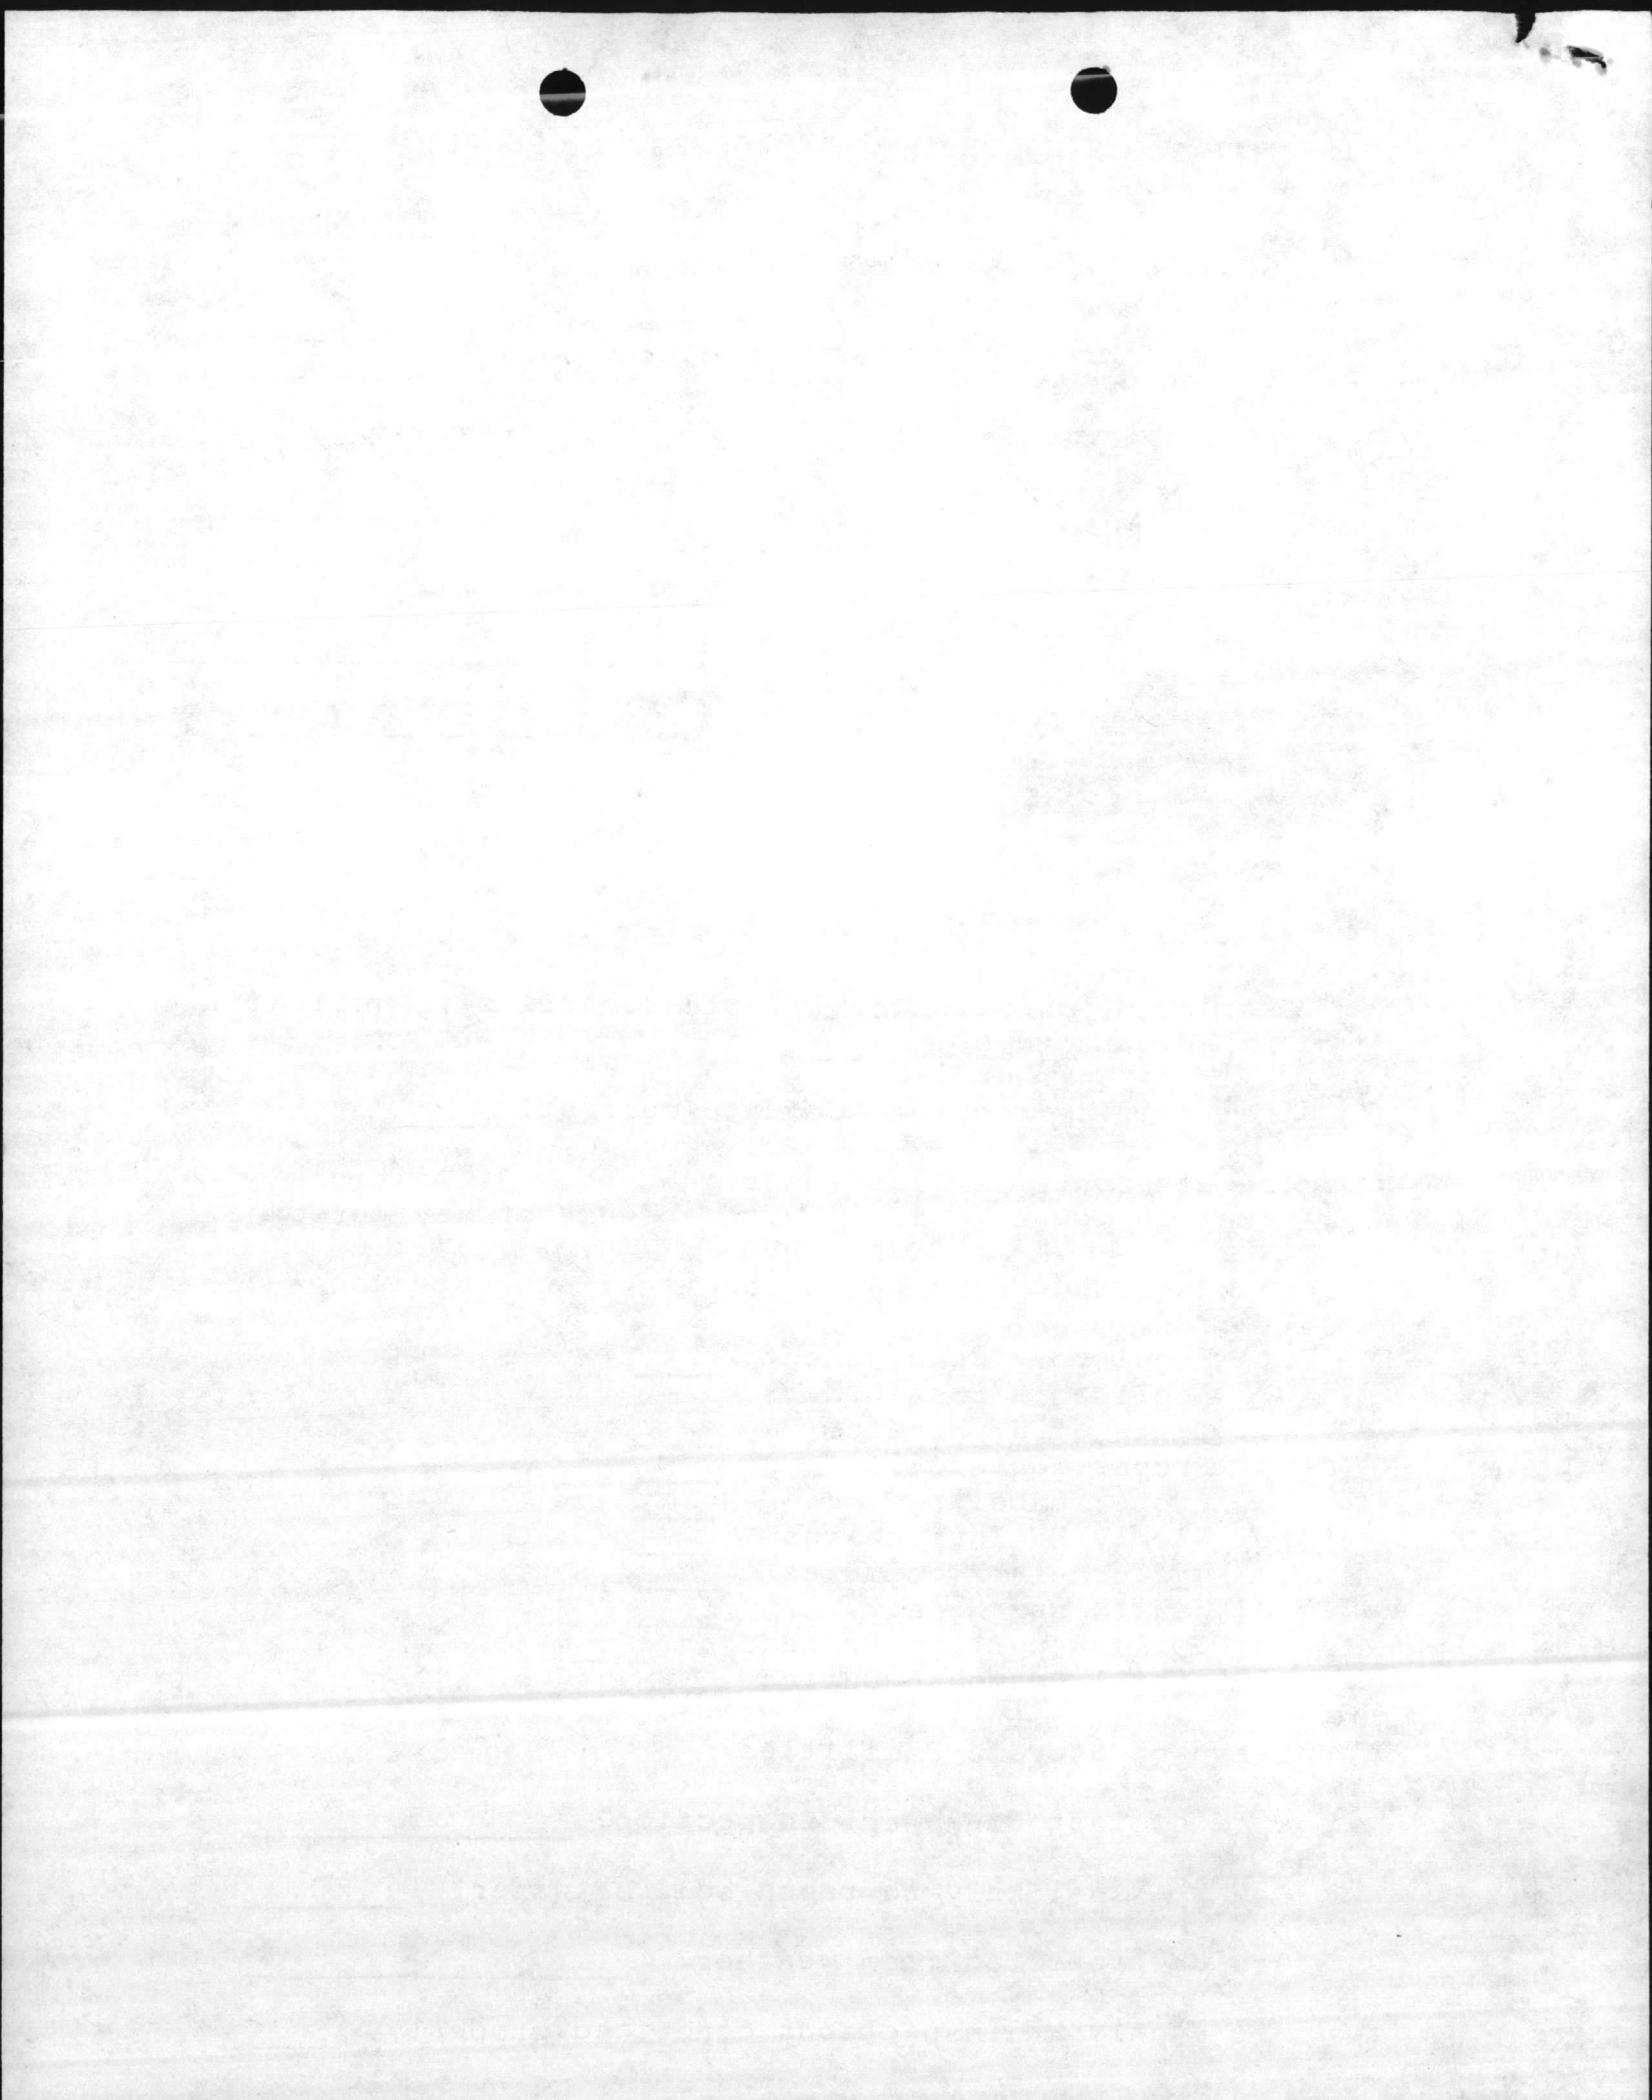

MOTOR TRANSPORT
2d AMTRACBN

Bldg A-2
Bldg BB-6

ARMORY-2dAMTRACBN

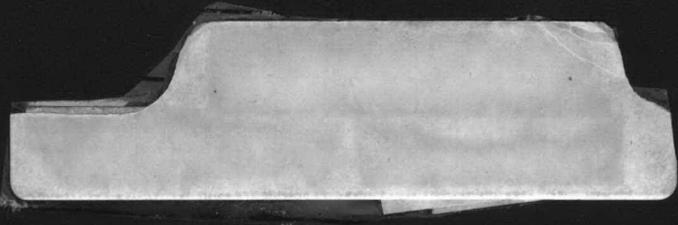

e. Are discrepancies corrected promptly? NO

f. Condition of containers? ("X" indicates discrepancy)

- | | | | |
|----------------|-------|--------------------------------|-------|
| (1) Closed | _____ | (7) Properly Labeled | _____ |
| (2) Leaking | _____ | (8) Properly Dated | _____ |
| (3) Bulging | _____ | (9) Properly Stacked | _____ |
| (4) Collapsed | _____ | (10) Properly Packaged | _____ |
| (5) Corroded | _____ | (11) Meet DOT Requirements for | _____ |
| (6) Overfilled | _____ | Contents | _____ |

g. Are 90 day turn-in deadlines being met? P

h. Are HW turn-in documents being prepared and submitted in a timely, proper manner? _____


i. Comments: _____

NO Contingency Plan

NO Trig Rewrite

NO Weekly Inspection

NO Base Order

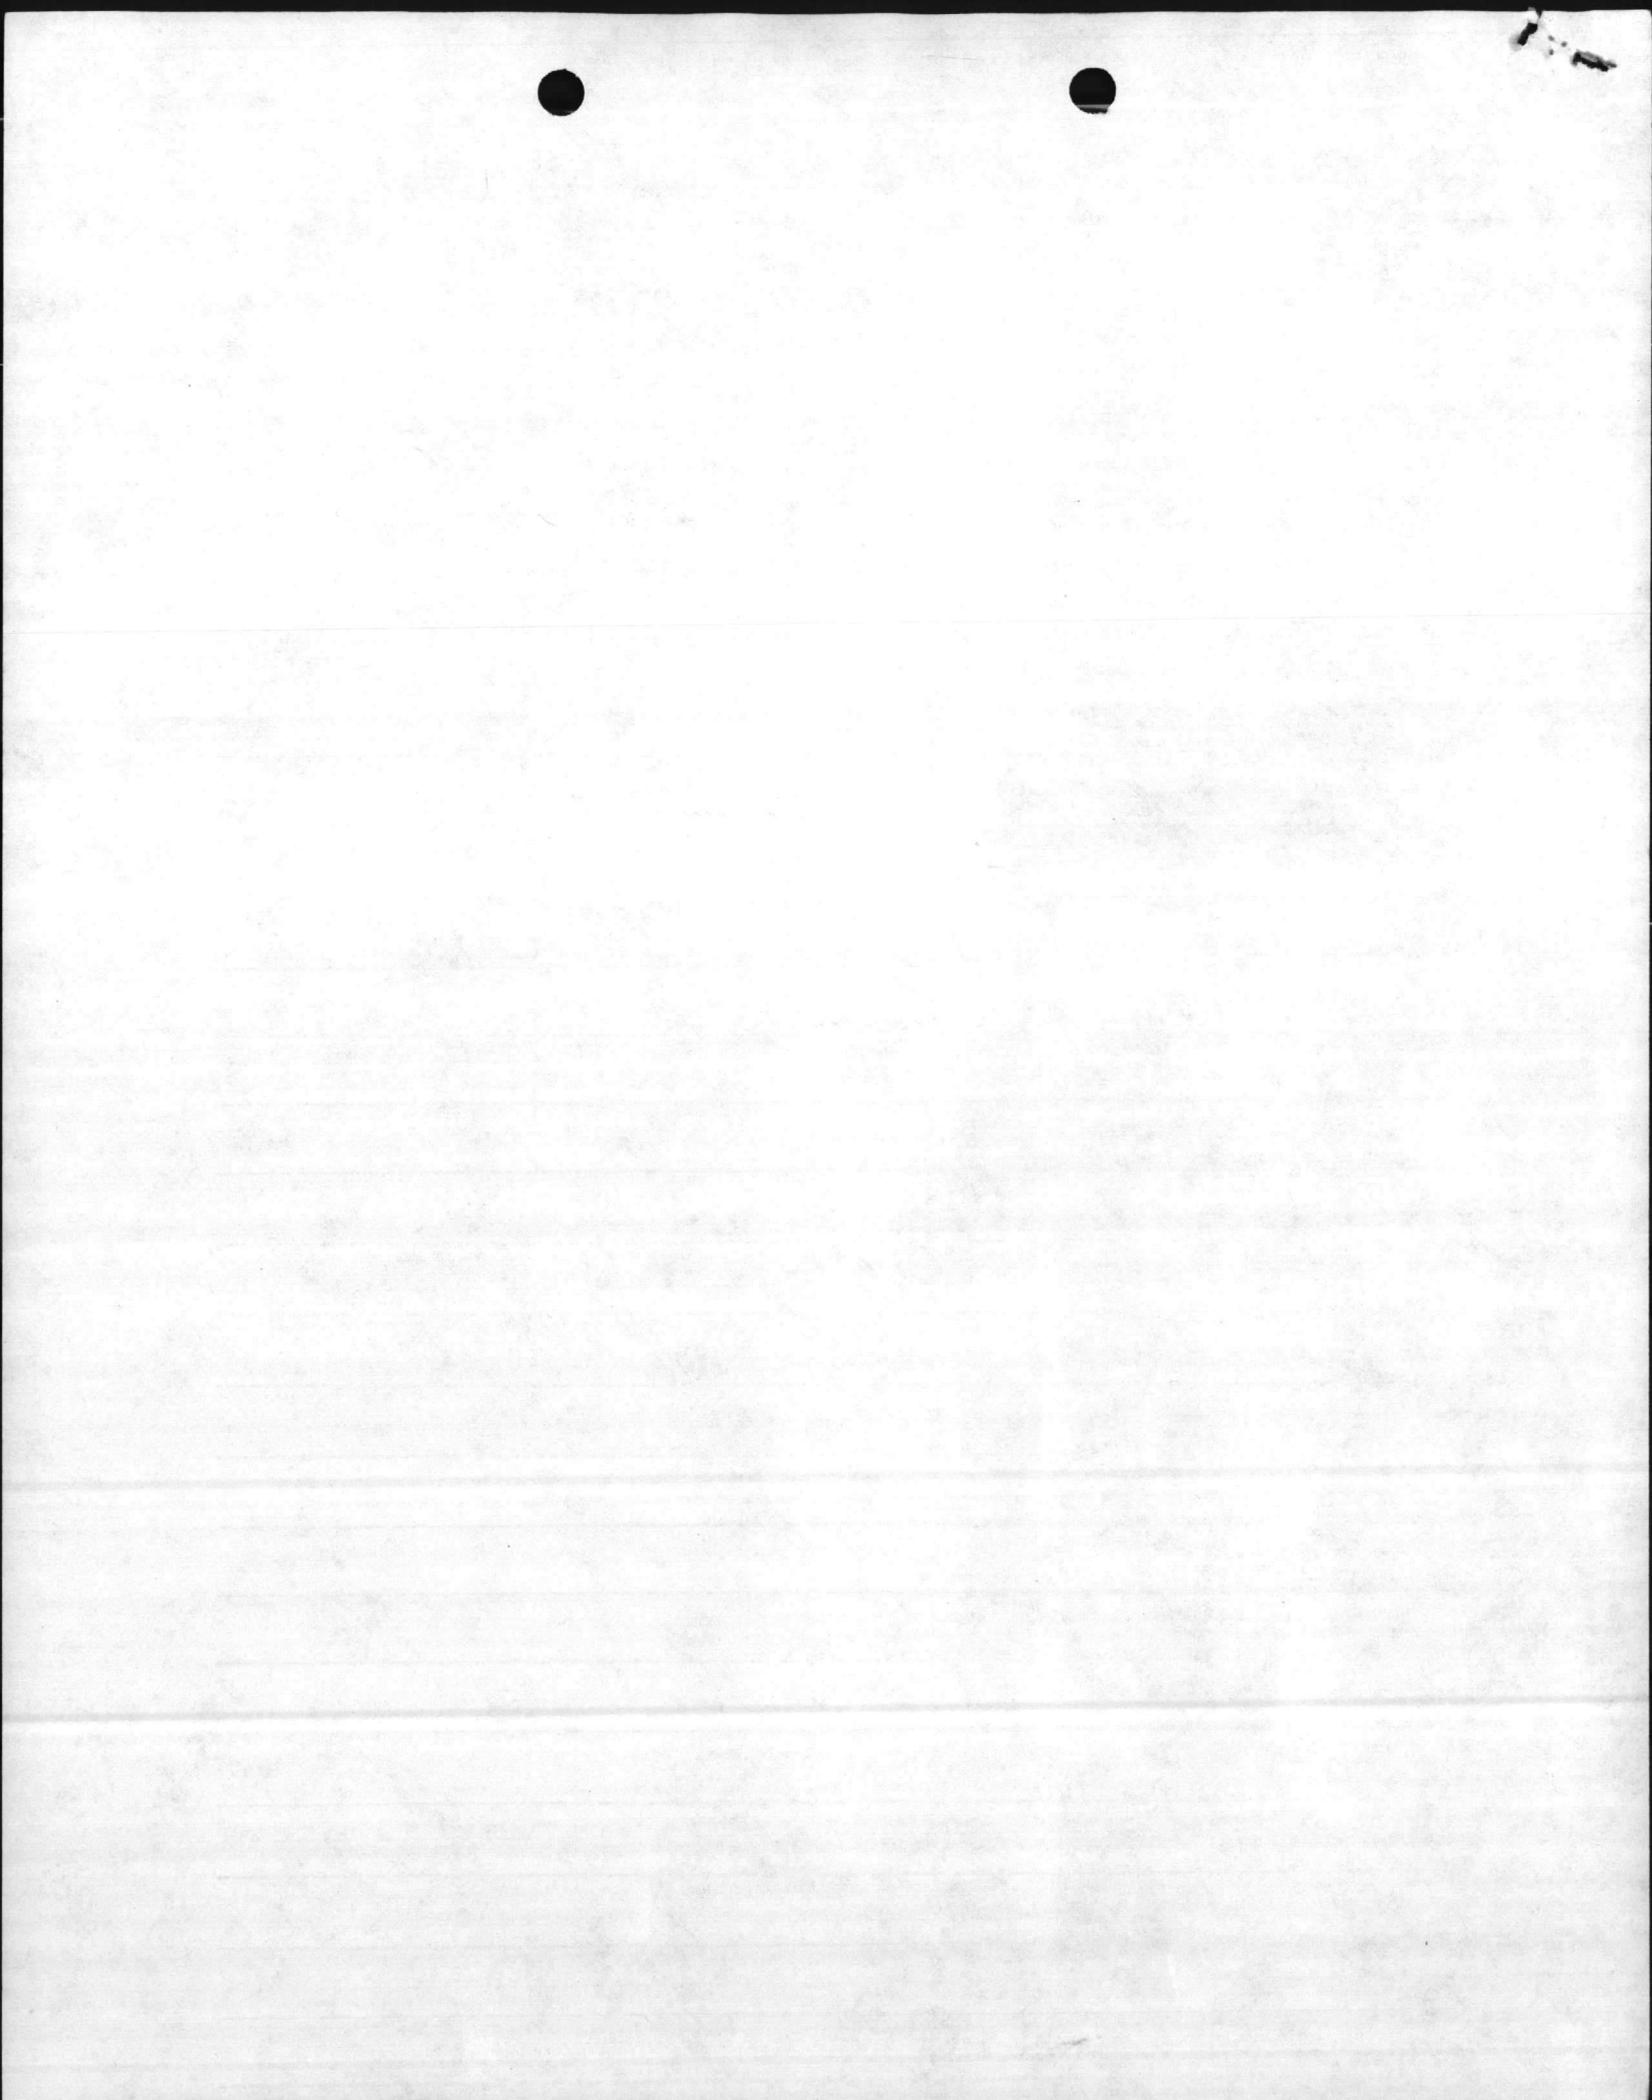

HAZARDOUS WASTE (HW) MANAGEMENT INSPECTION FORM

Date: 13 MAR 87 Blk No

1. Facility being Inspected: 2d AMTRAC BN MOTOR TRANSPORT A-2

2. Organization in Charge: 2d MAR DIV

3. Inspection Participants/Phone Number: LT Owenshire (primary)
MSgt Bunn (alt) Ph. No. # 7359

4. Description of HW Streams: Dry Cleaning Solvent, PD-180
1 site + POL Area
2


5. Are records of HW generation consistent with HW streams? yes

6. HW Training
- a. Are job descriptions available for all personnel actively involved in HW management? yes
 - b. Are training records adequate/current? yes
 - c. Are alternate personnel assigned to key positions? yes
 (If not, explain how unit deals with absence of key personnel)
 - d. Do contacted personnel demonstrate adequate knowledge of:

- (1) Regulatory Requirements yes
- (2) Applicable Base Orders yes
- (3) Types of HW Handled yes
- (4) Proper Containers yes
- (5) Proper Labeling yes
- (6) Weekly HW Inspections yes
- (7) HW Turn-in Procedures yes
- (8) Health and Safety yes
- (9) Spill Reporting Procedures yes
- (10) Spill Response Duties yes

Records kept at A-47

7. Condition of Storage Facilities
- a. Date of last Fire Dept Inspection? _____
 - b. Are spills likely to reach soil or water? NO
 - c. Are HW protected from weather? yes
 - d. Are weekly HW inspections conducted properly? yes

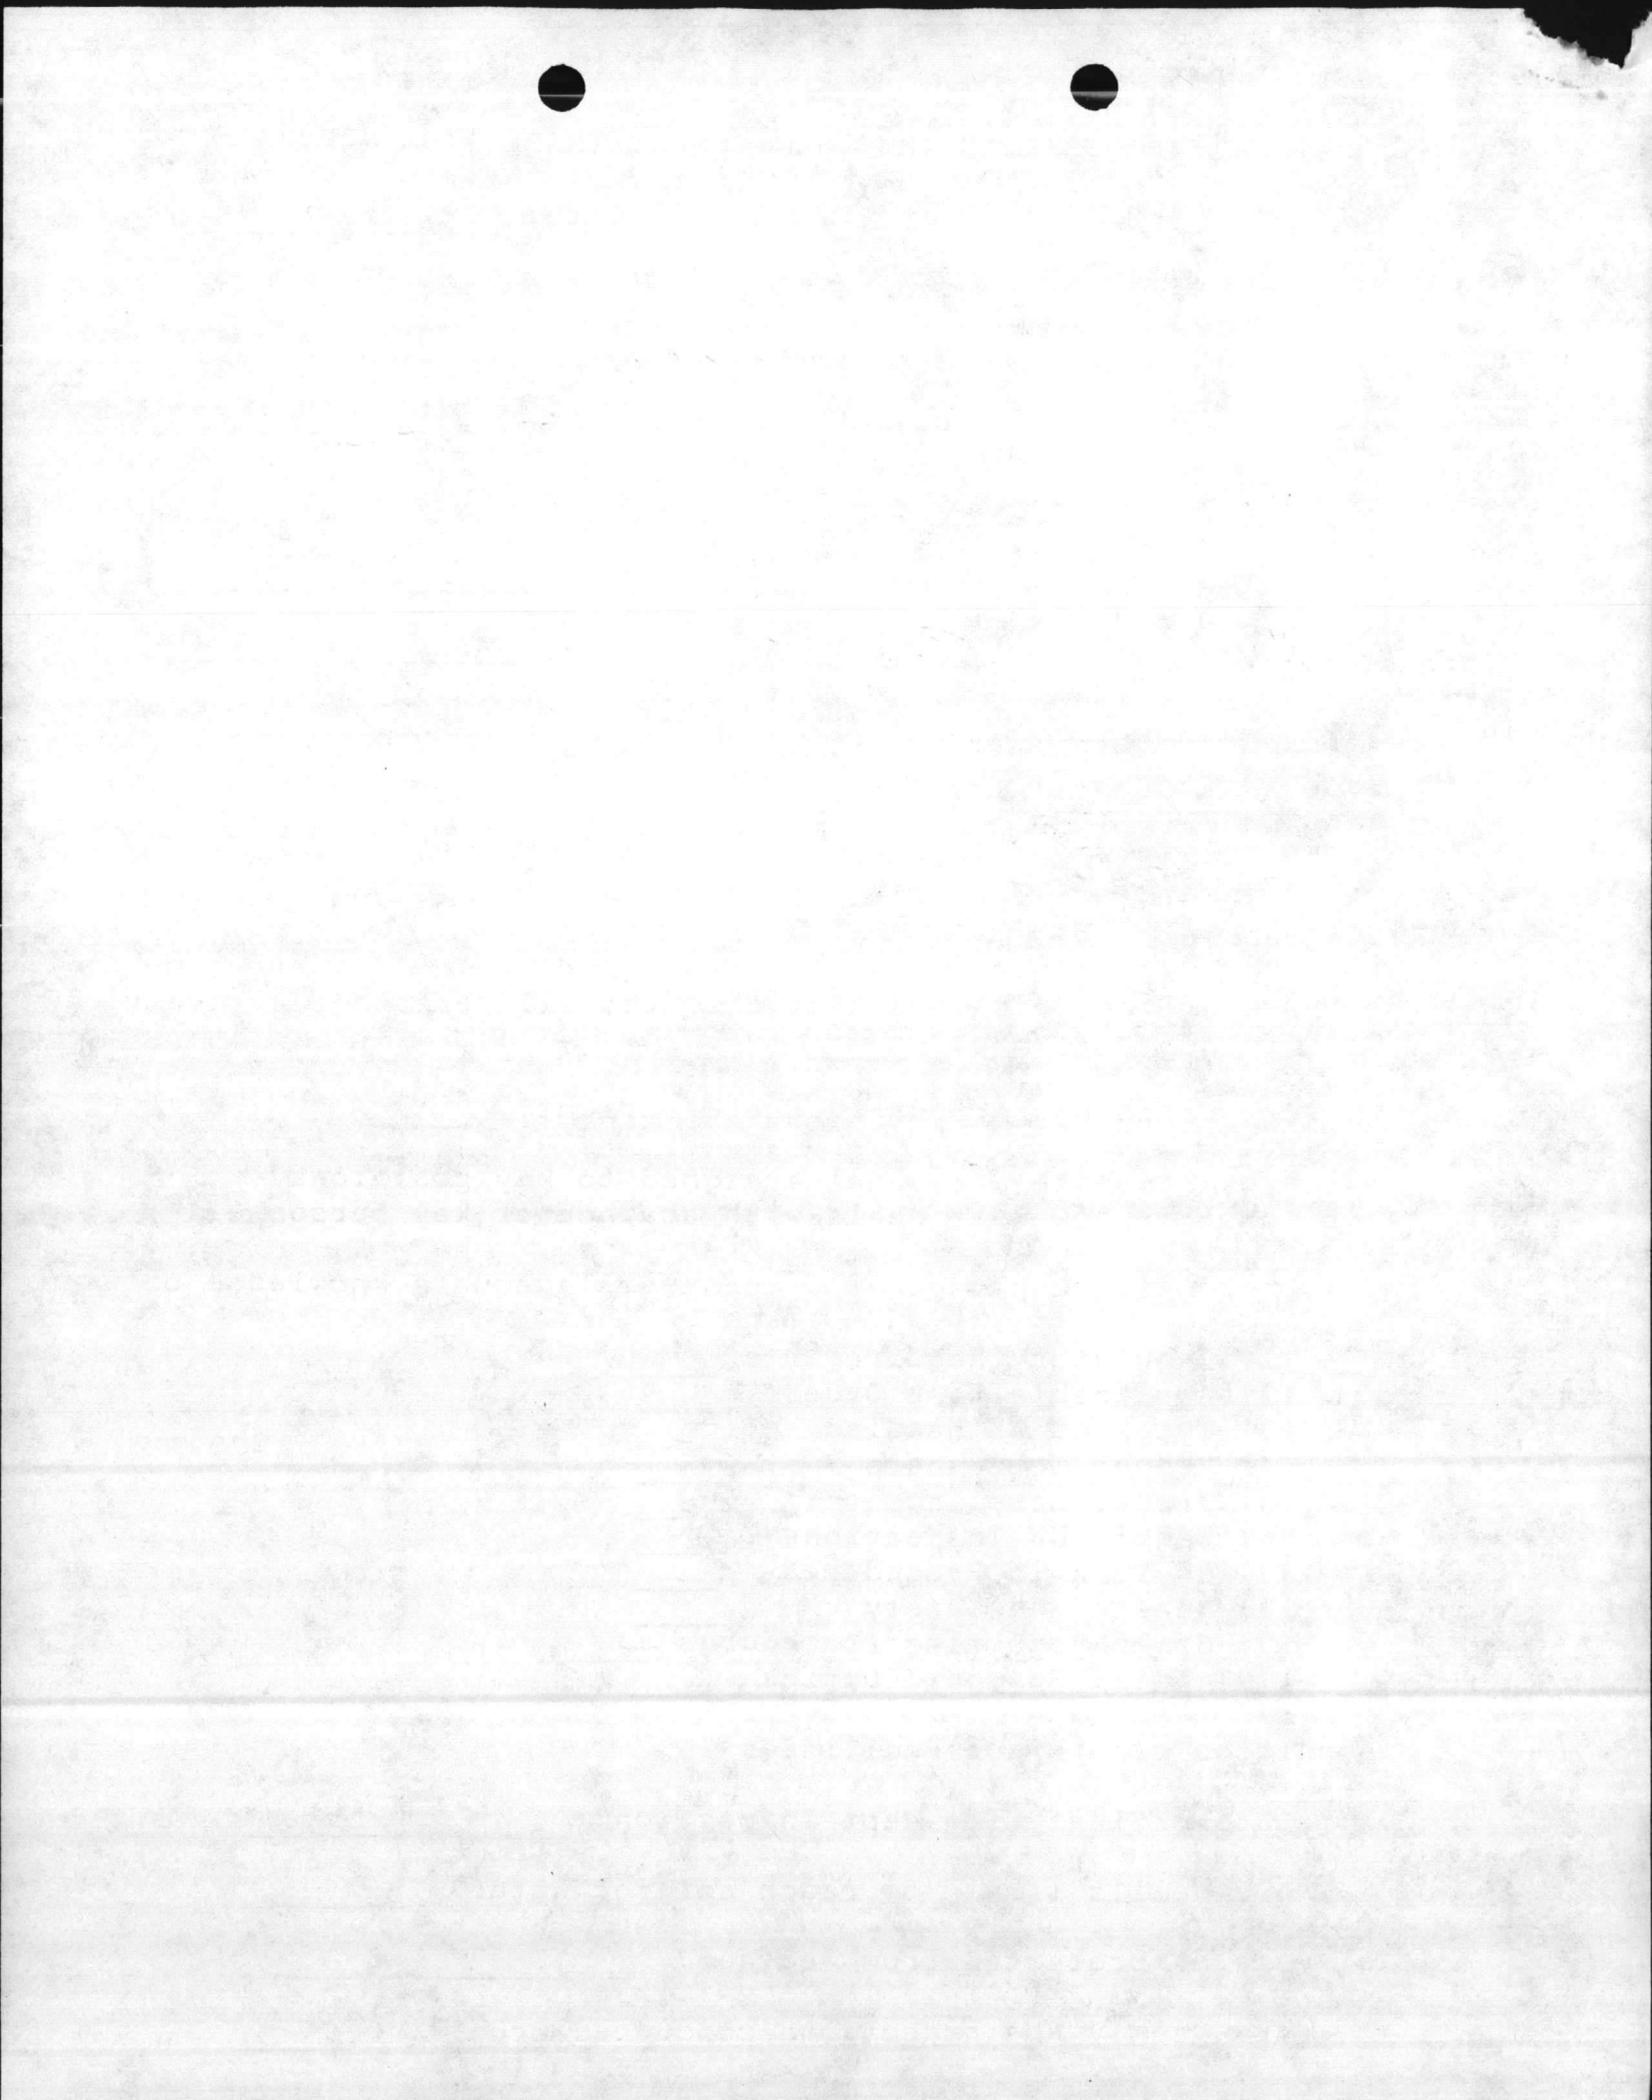

e. Are discrepancies corrected promptly? yes

f. Condition of containers? ("X" indicates discrepancy)

- | | |
|----------------------|---|
| (1) Closed _____ | (7) Properly Labeled _____ |
| (2) Leaking _____ | (8) Properly Dated _____ |
| (3) Bulging _____ | (9) Properly Stacked _____ |
| (4) Collapsed _____ | (10) Properly Packaged _____ |
| (5) Corroded _____ | (11) Meet DOT Requirements for Contents _____ |
| (6) Overfilled _____ | |


g. Are 90 day turn-in deadlines being met? yes

h. Are HW turn-in documents being prepared and submitted in a timely, proper manner? yes

i. Comments: _____

Missing Contingency Plan

(Band Bury Case in two oil drum)

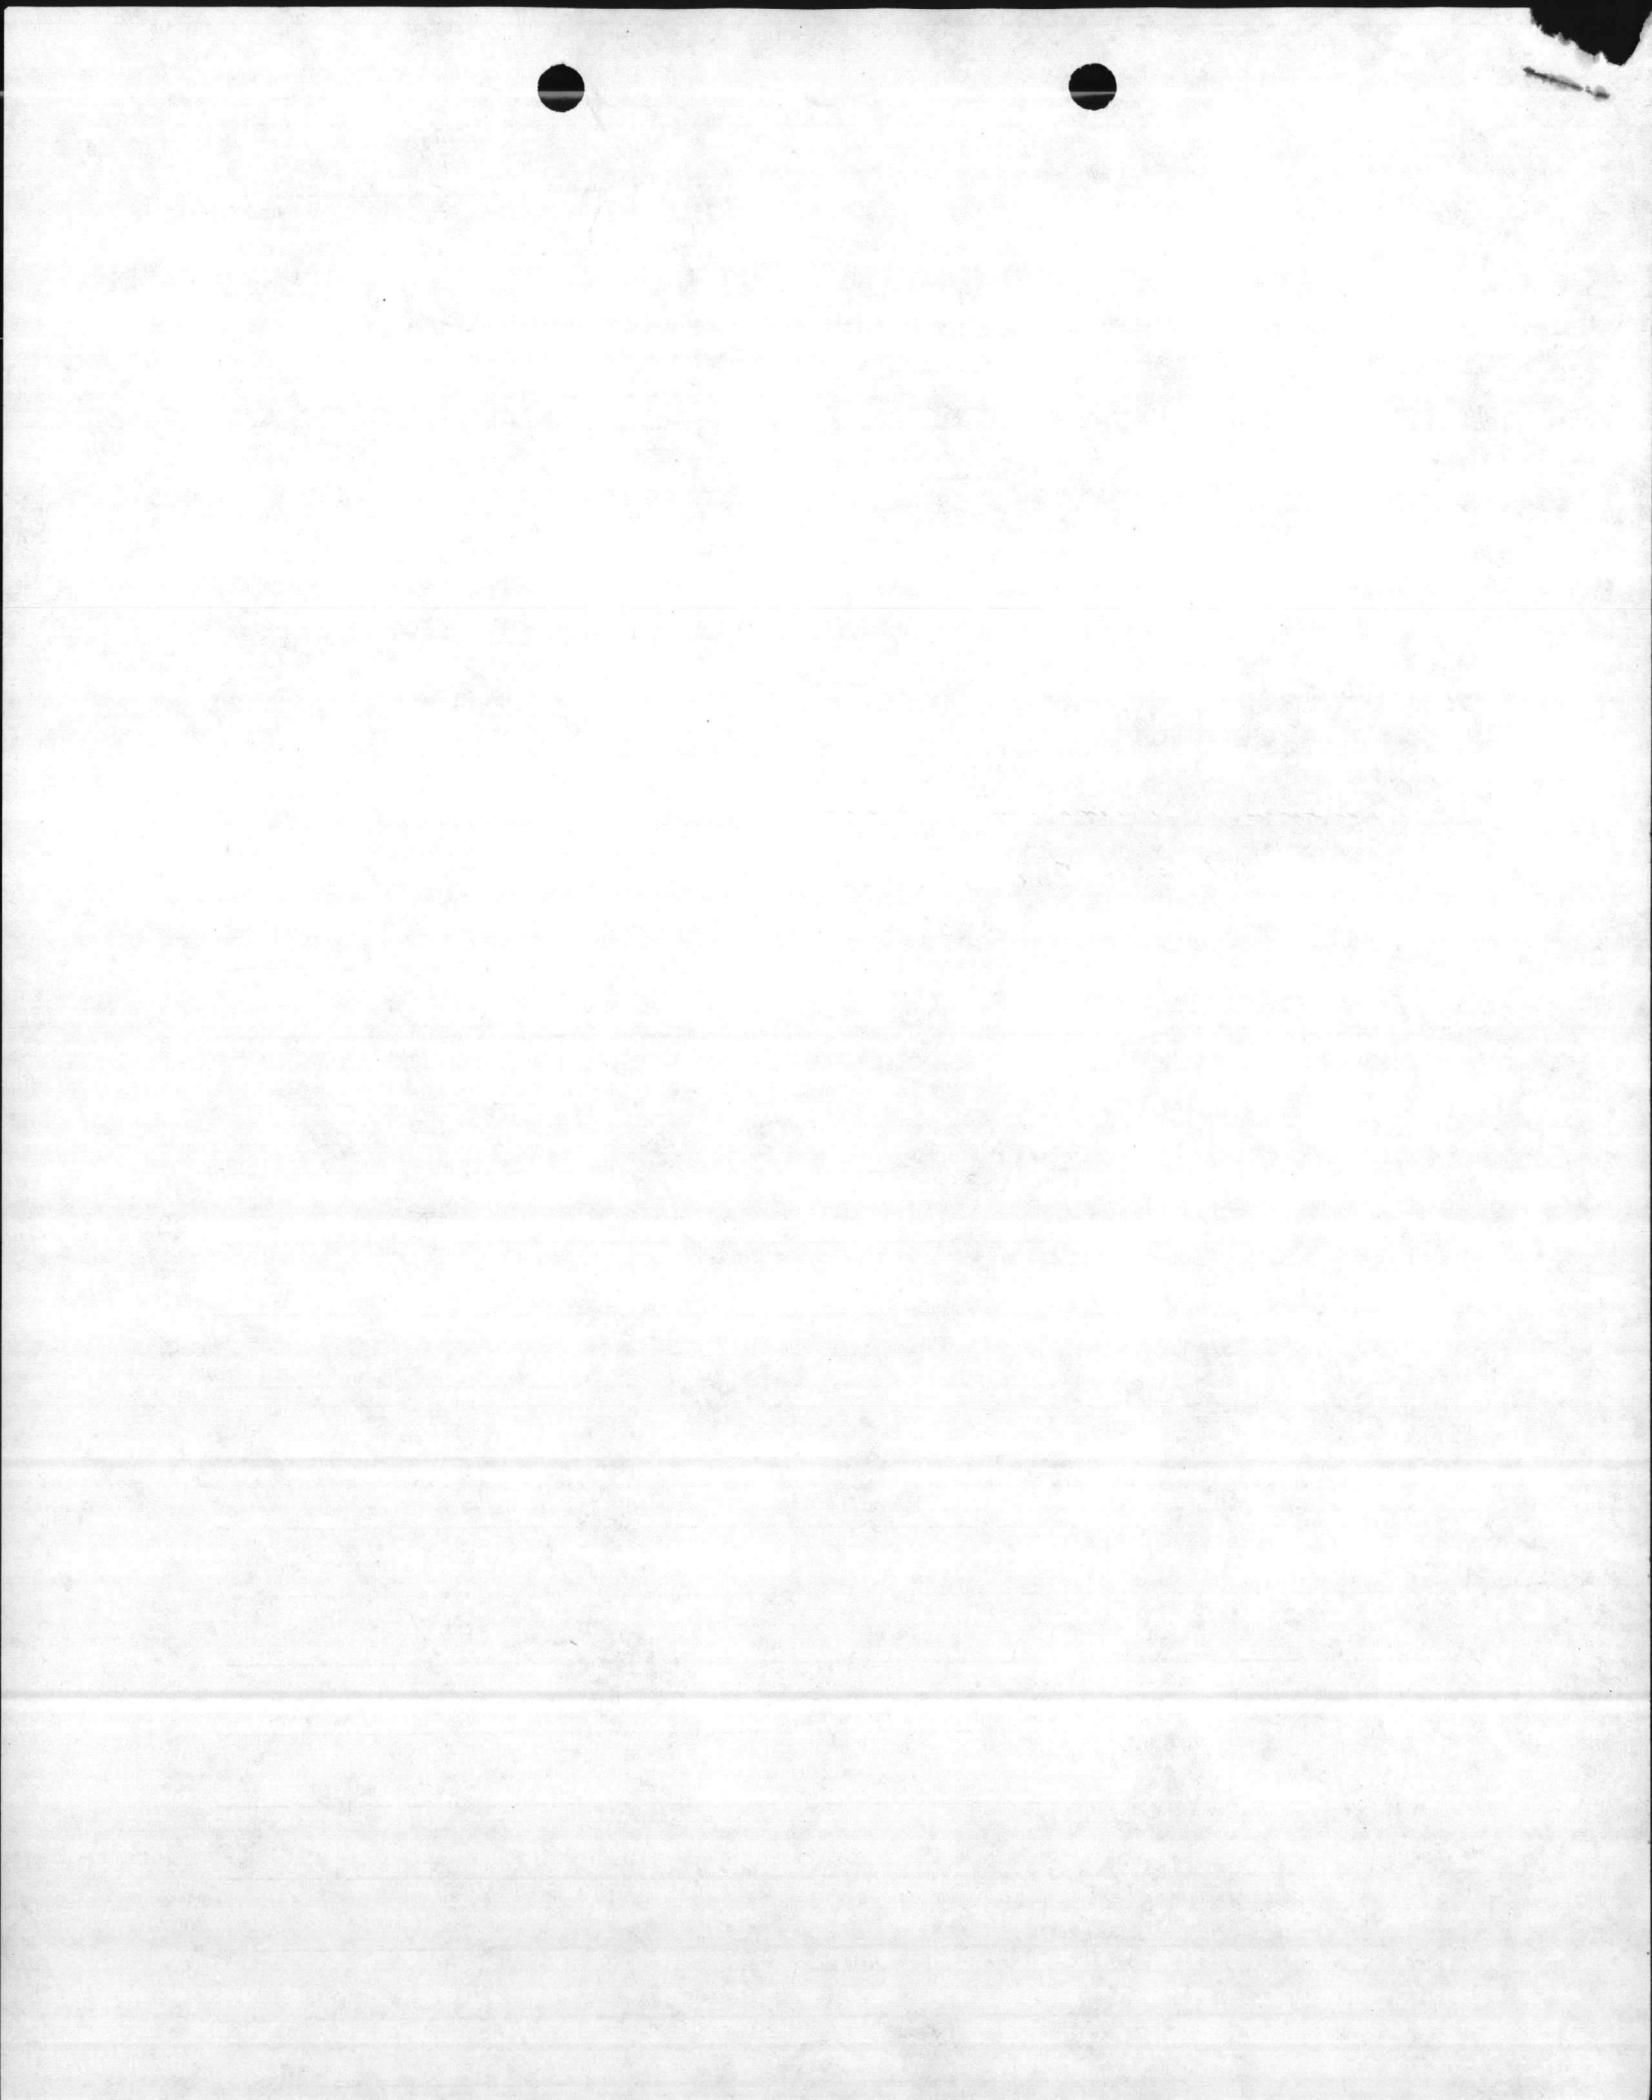

HAZARDOUS WASTE (HW) MANAGEMENT INSPECTION FORM

Date: 13 MARCH 87

1. Facility being Inspected: 2d AMTRAC BN Maintenance Facility

2. Organization in Charge: 2d MARSW Bldg A-47

3. Inspection Participants/Phone Number: 2t Parker (primary)

MCVSGT Plodfelter (alternate) phone 7436-7585

4. Description of HW Streams: Dry Cleaning Solvent

Electrolyte & waste oil

5. Are records of HW generation consistent with HW streams? yes

6. HW Training

a. Are job descriptions available for all personnel actively involved in HW management? yes

b. Are training records adequate/current? yes

c. Are alternate personnel assigned to key positions? yes
(If not, explain how unit deals with absence of key personnel)

d. Do contacted personnel demonstrate adequate knowledge of:

- (1) Regulatory Requirements yes
- (2) Applicable Base Orders yes
- (3) Types of HW Handled yes
- (4) Proper Containers yes
- (5) Proper Labeling yes
- (6) Weekly HW Inspections yes
- (7) HW Turn-in Procedures yes
- (8) Health and Safety yes
- (9) Spill Reporting Procedures part
- (10) Spill Response Duties part


7. Condition of Storage Facilities

a. Date of last Fire Dept Inspection? _____

b. Are spills likely to reach soil or water? no

c. Are HW protected from weather? yes

d. Are weekly HW inspections conducted properly? yes

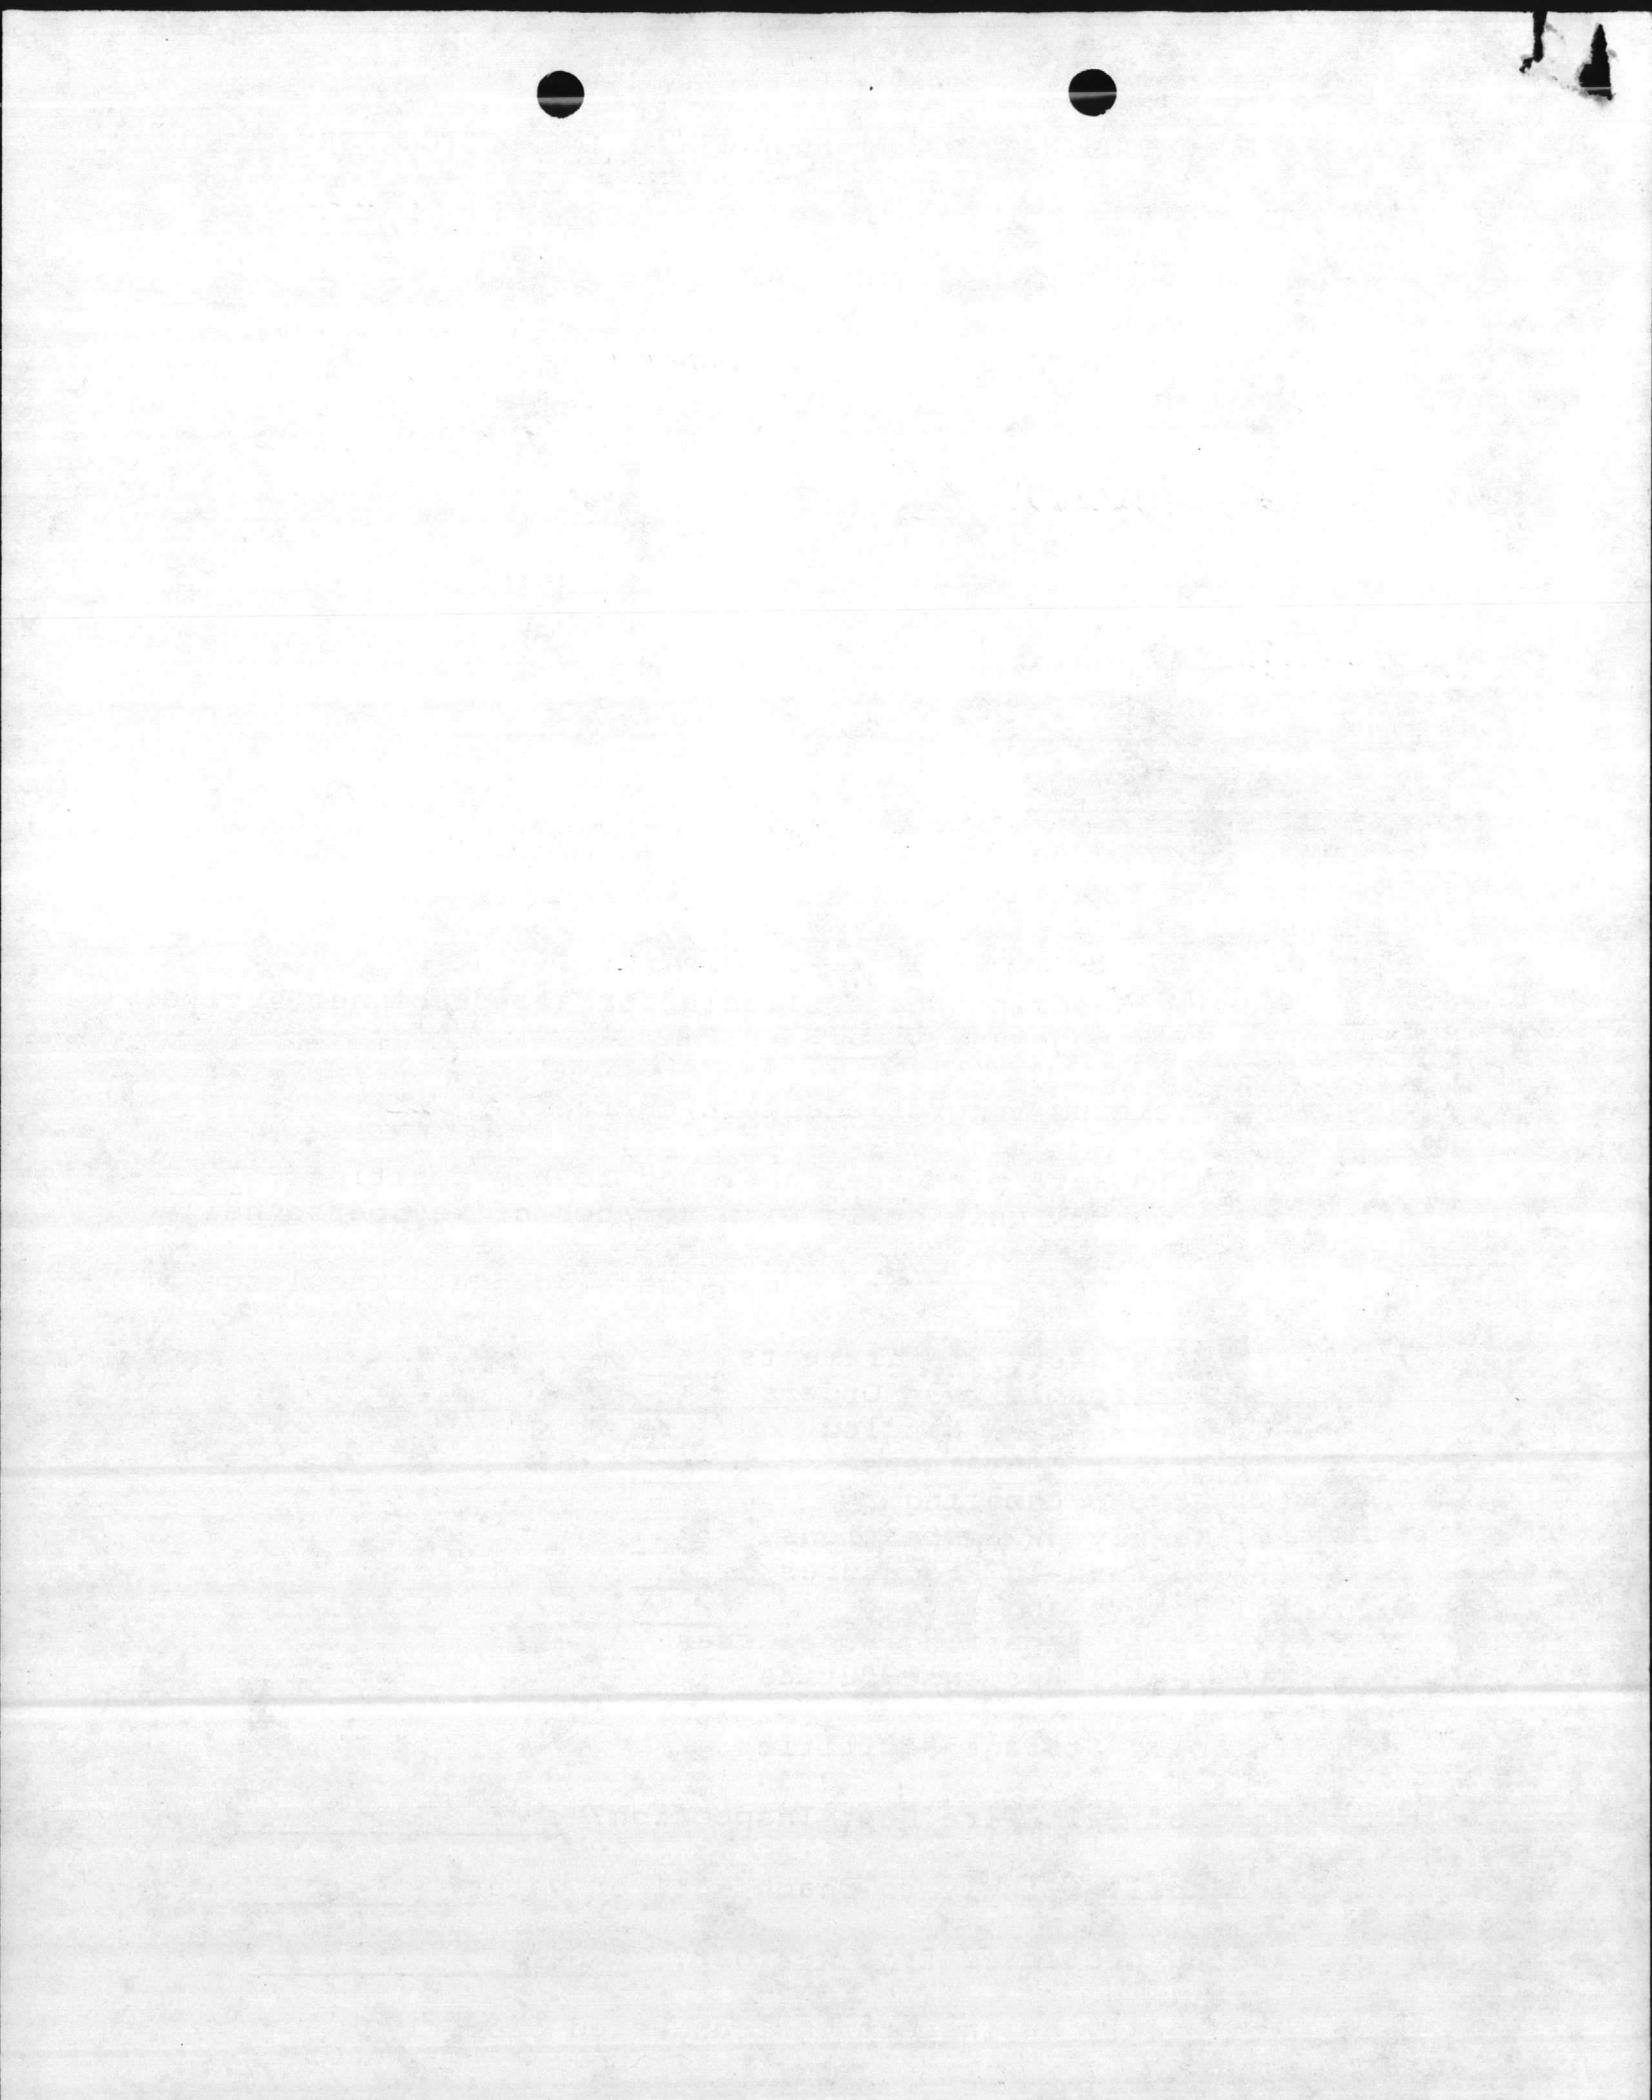

e. Are discrepancies corrected promptly? yes

f. Condition of containers? ("X" indicates discrepancy)


- | | | | |
|----------------|-------|--------------------------------|-------|
| (1) Closed | _____ | (7) Properly Labeled | _____ |
| (2) Leaking | _____ | (8) Properly Dated | _____ |
| (3) Bulging | _____ | (9) Properly Stacked | _____ |
| (4) Collapsed | _____ | (10) Properly Packaged | _____ |
| (5) Corroded | _____ | (11) Meet DOT Requirements for | _____ |
| (6) Overfilled | _____ | Contents | _____ |

g. Are 90 day turn-in deadlines being met? yes

h. Are HW turn-in documents being prepared and submitted in a timely, proper manner? yes

i. Comments: _____

*No Contingency plans in Battery Shop
+ and by solvent tank in bay area
: 3,000 gal tank in parking area*

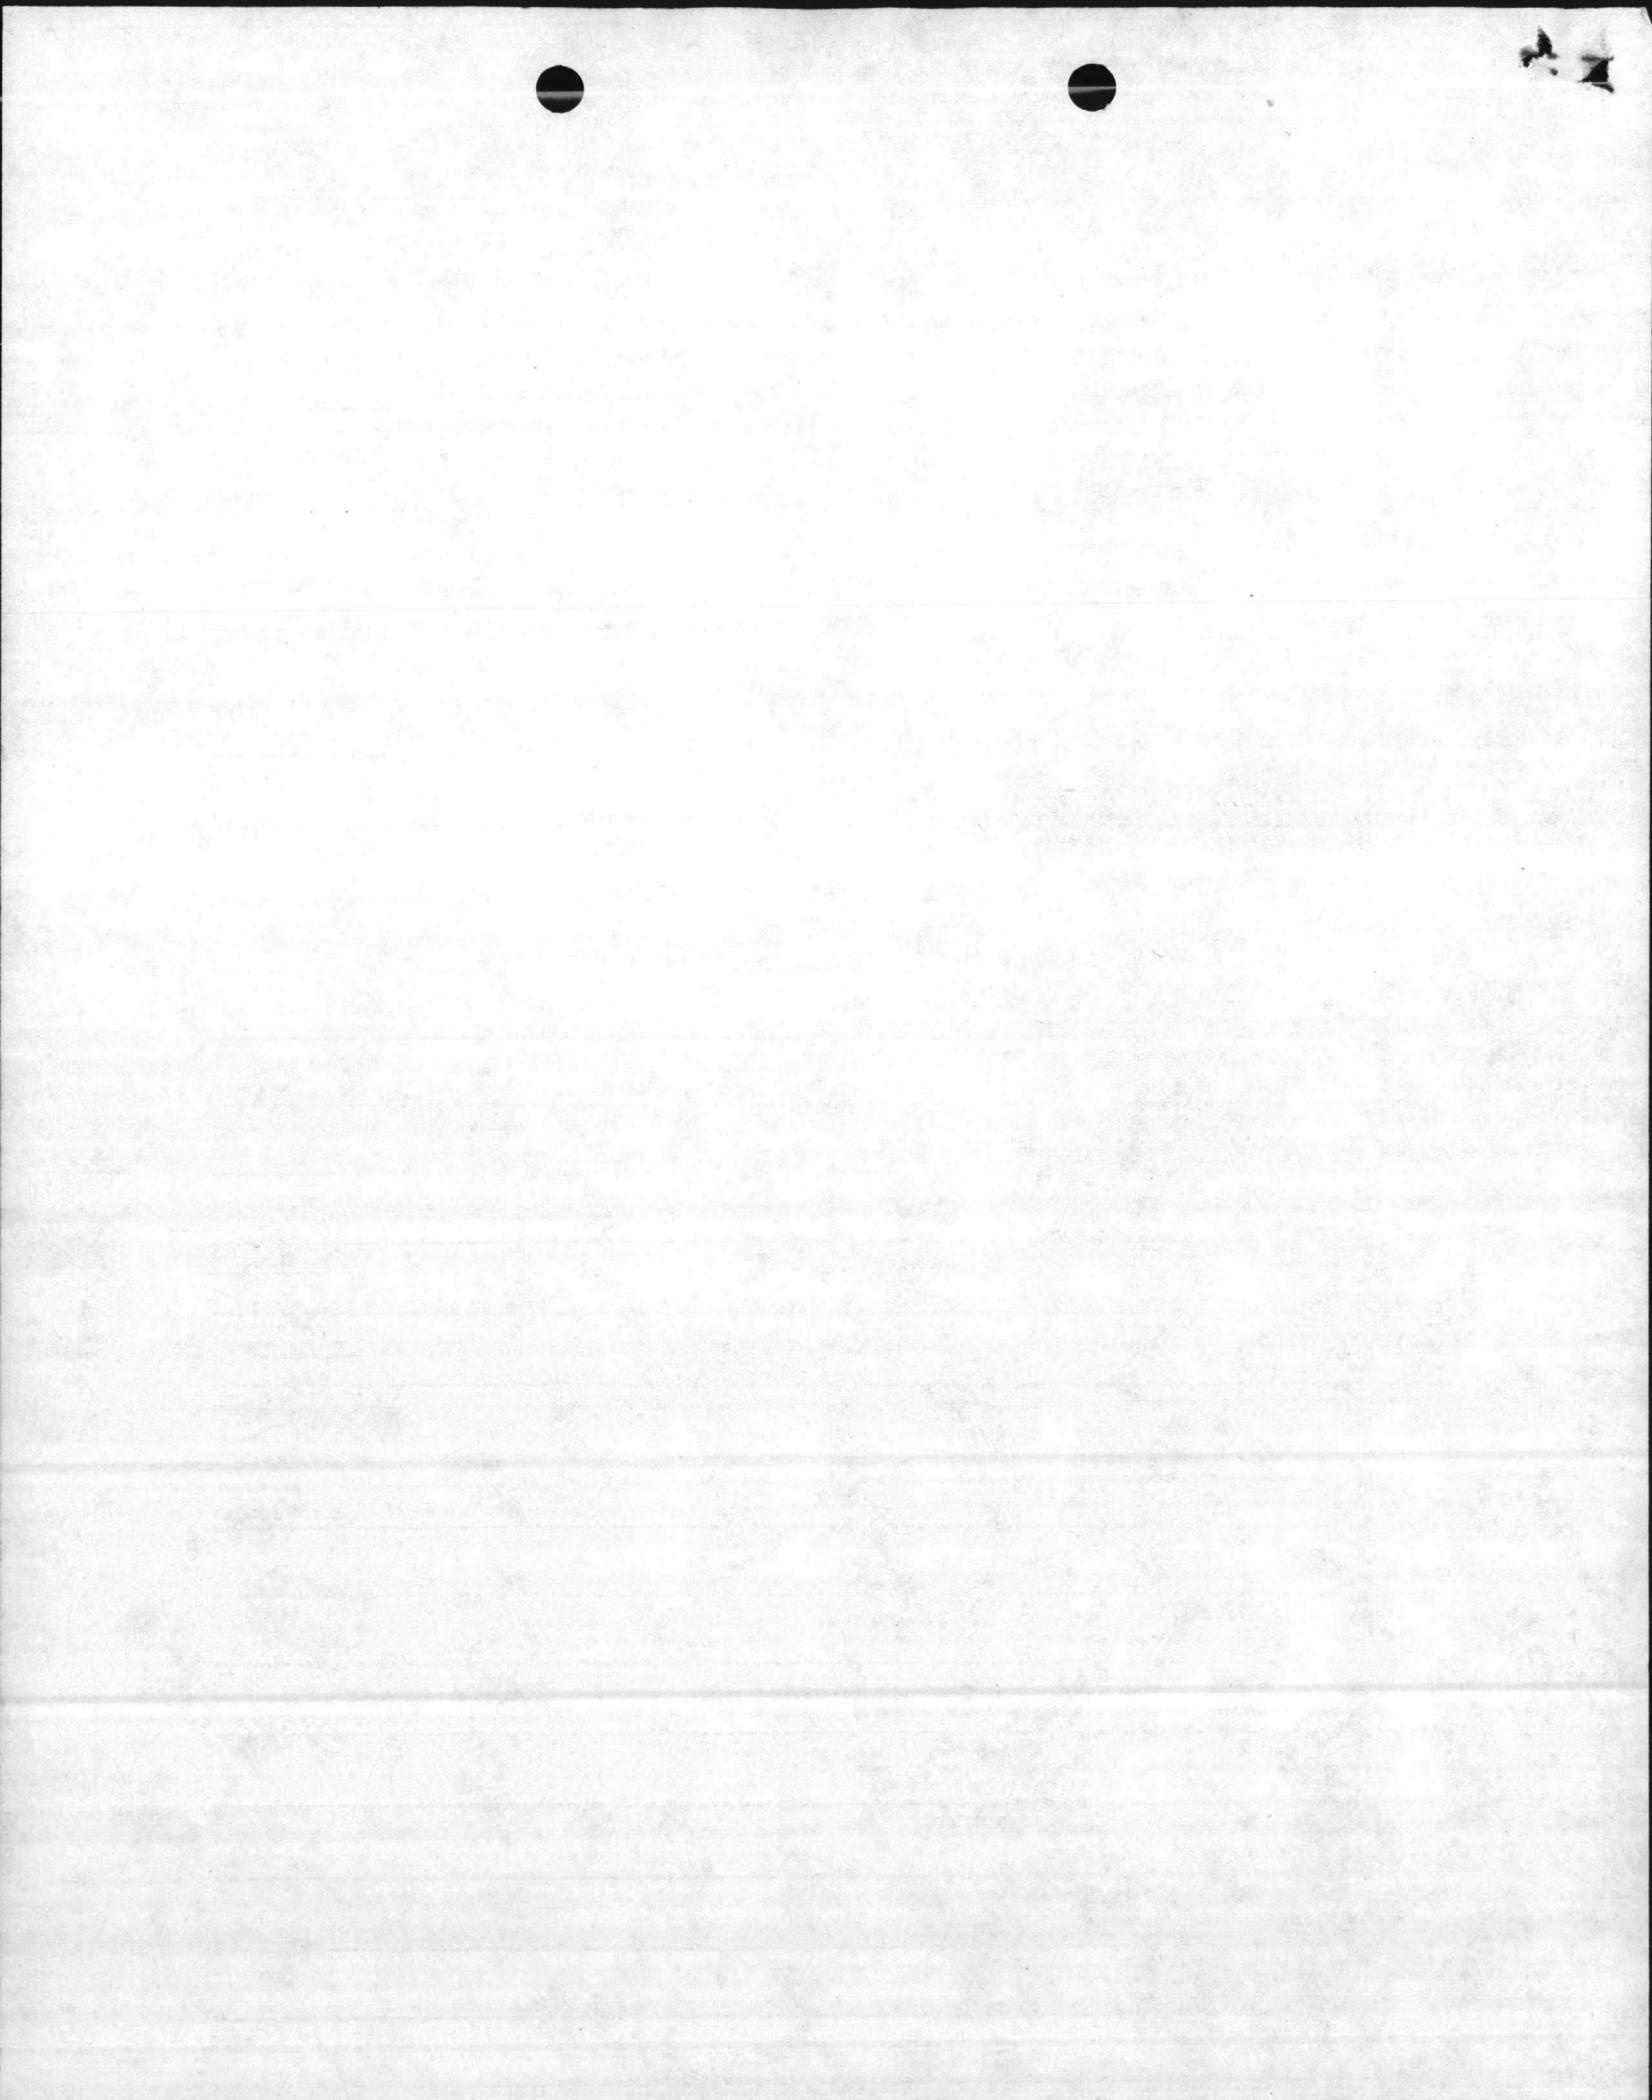


ORGANIZATION:

2d MARDIV
2d AMTRAC BN

INSPECTION DATE: 16 December 1986

INSPECTOR'S NAME Danny Becker

NO.	SPECIFIC LOCATION	DISCREPANCY	REF	RECOMMENDED CORRECTIVE ACTION
<u>MOTOR TRANSPORT</u>				
1.	a. Bldg. #A-2	Failure to establish and maintain training records for all personnel involved in hazardous waste.	1	Training records shall be maintained for hazardous waste handlers and alternate to include a description of duties and training received for personnel at each site.
	b. Bldg. #A-2	Failure to record appropriate information on hazardous waste labels when accumulation begins	2	Make appropriate entries on hazardous waste labels when accumulation starts.
<u>ARMORY</u>				
2.	a. Bldg. #BB-6	Failure to establish and maintain training records for all personnel involved in hazardous waste.	1	Training records shall be maintained for hazardous waste handlers and alternate to include a description of duties and training received for personnel at each site.

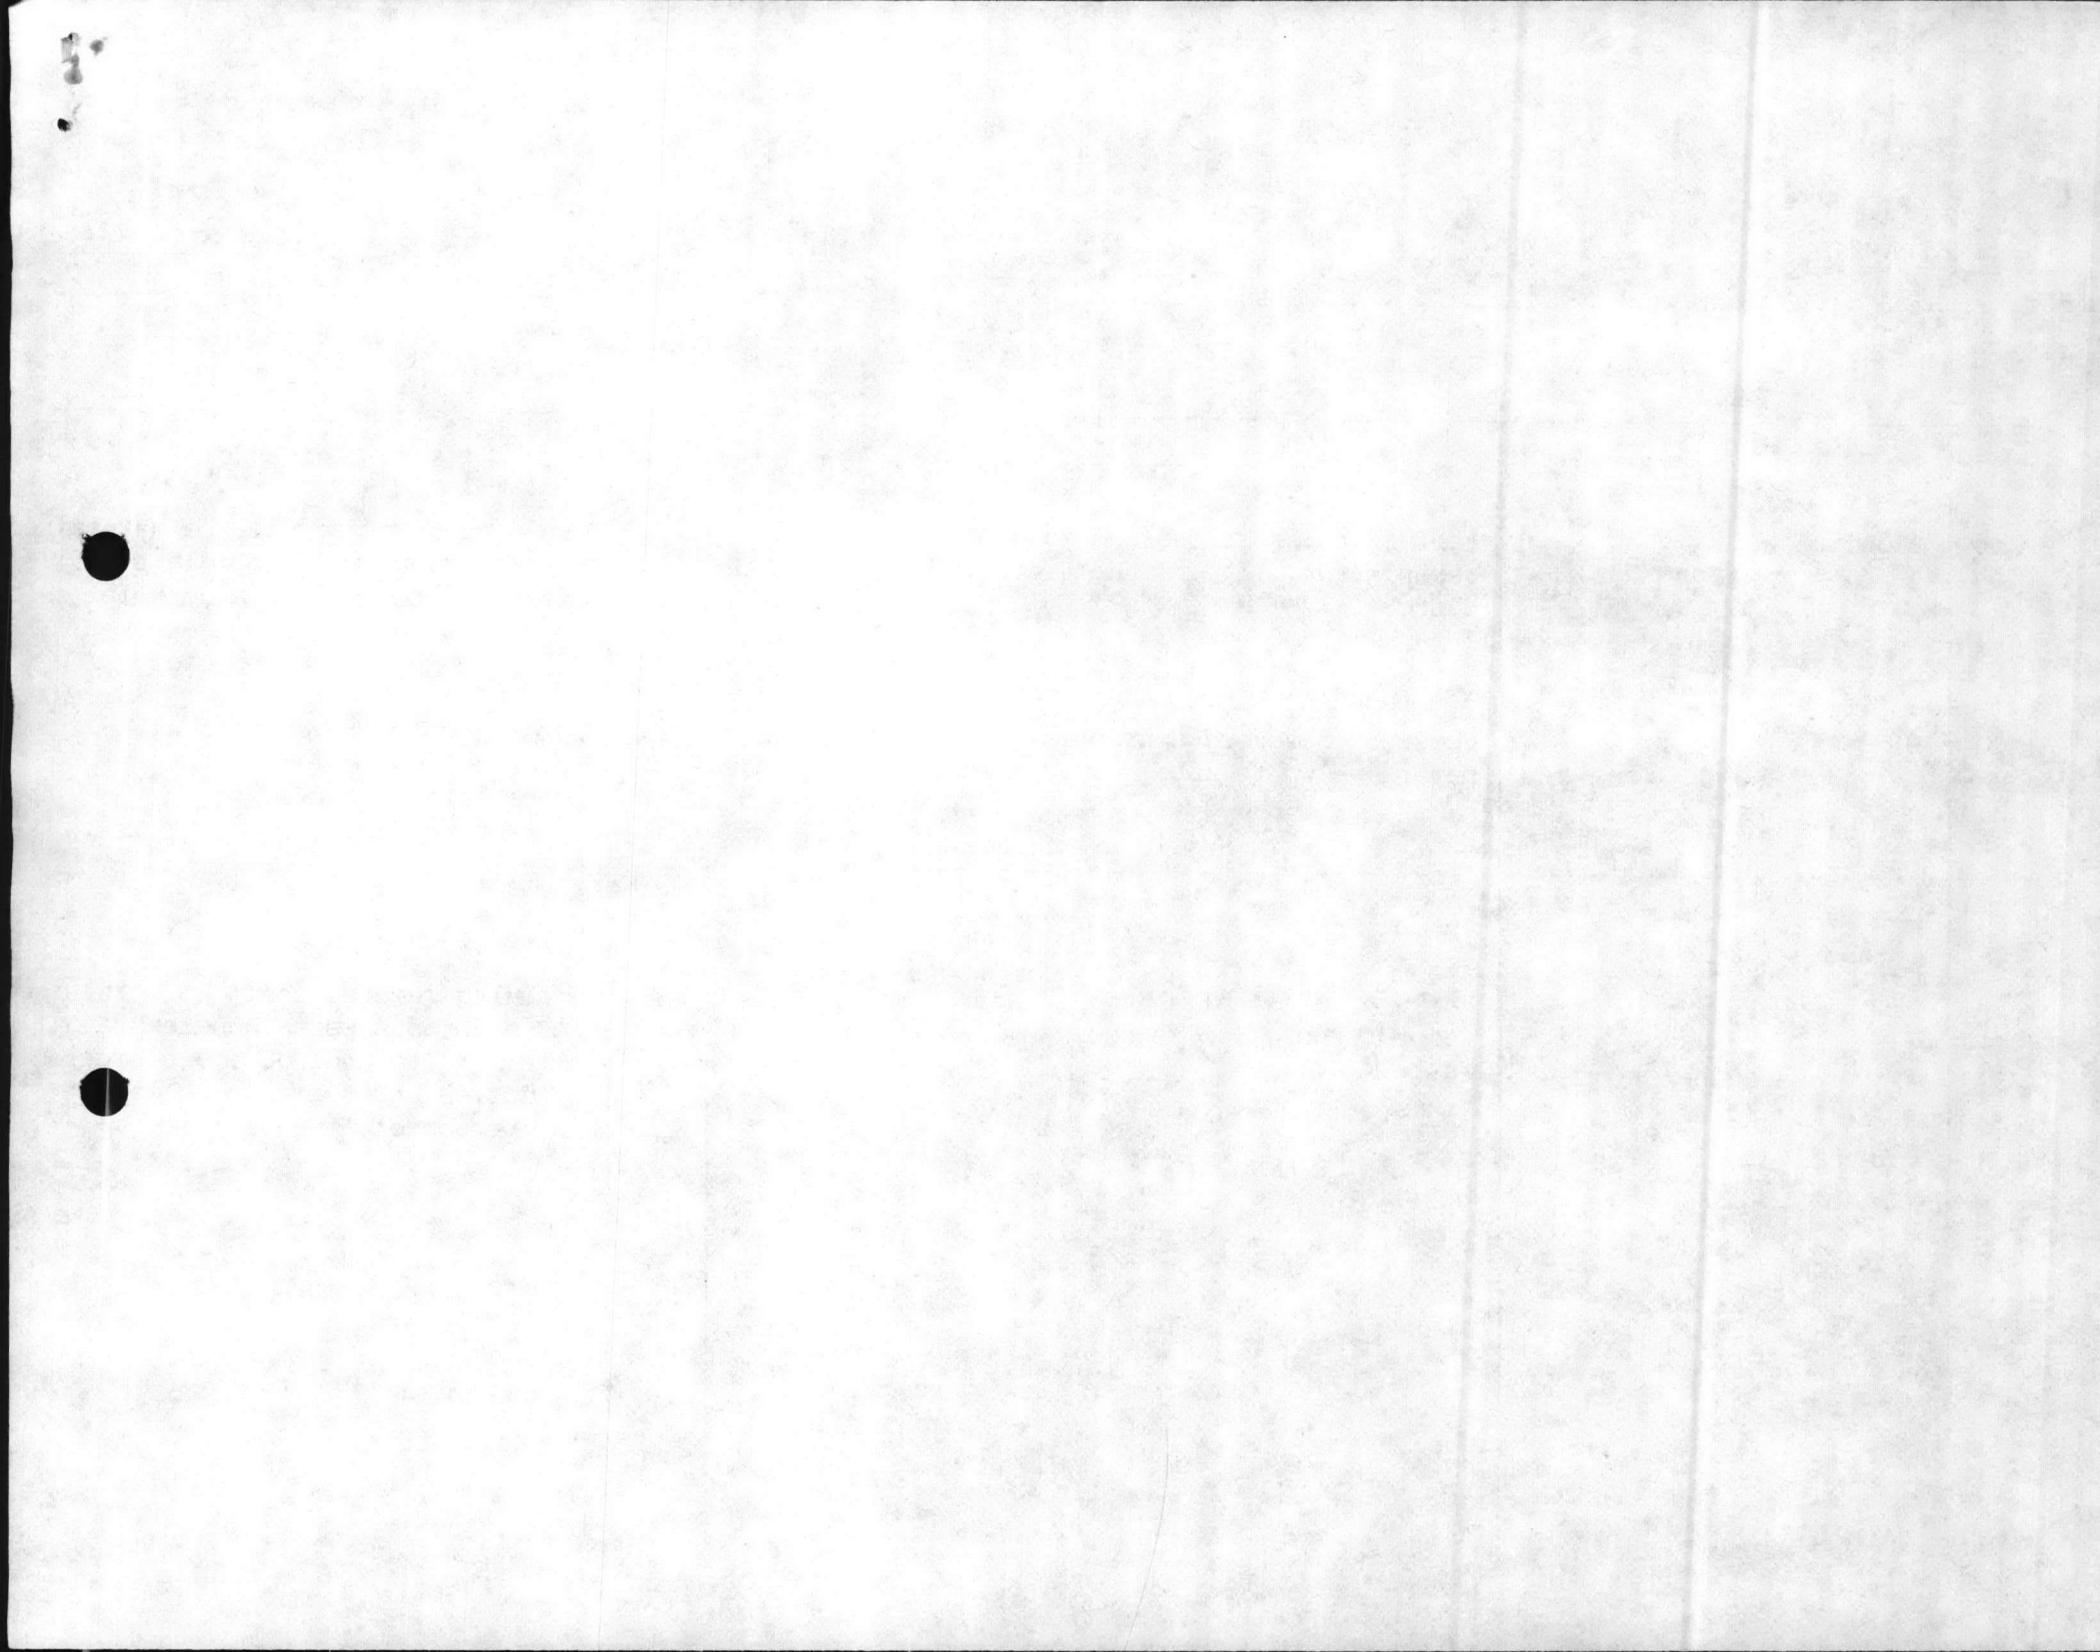


ORGANIZATION:

2d MARDIV
2d AMTRAC BN

INSPECTION DATE: 16 December 1986

INSPECTOR'S NAME Danny Becker

NO.	SPECIFIC LOCATION	DISCREPANCY	REF	RECOMMENDED CORRECTIVE ACTION
<u>ARMORY (CONT.)</u>				
b.	Bldg. #BB-6	Failure to complete hazardous waste spill contingency plan.	3	Complete spill contingency plan with appropriate information.
c.	Bldg. #BB-6	Failure to post emergency spill response information.	4	Purchase/fabricate and post emergency spill response signs.

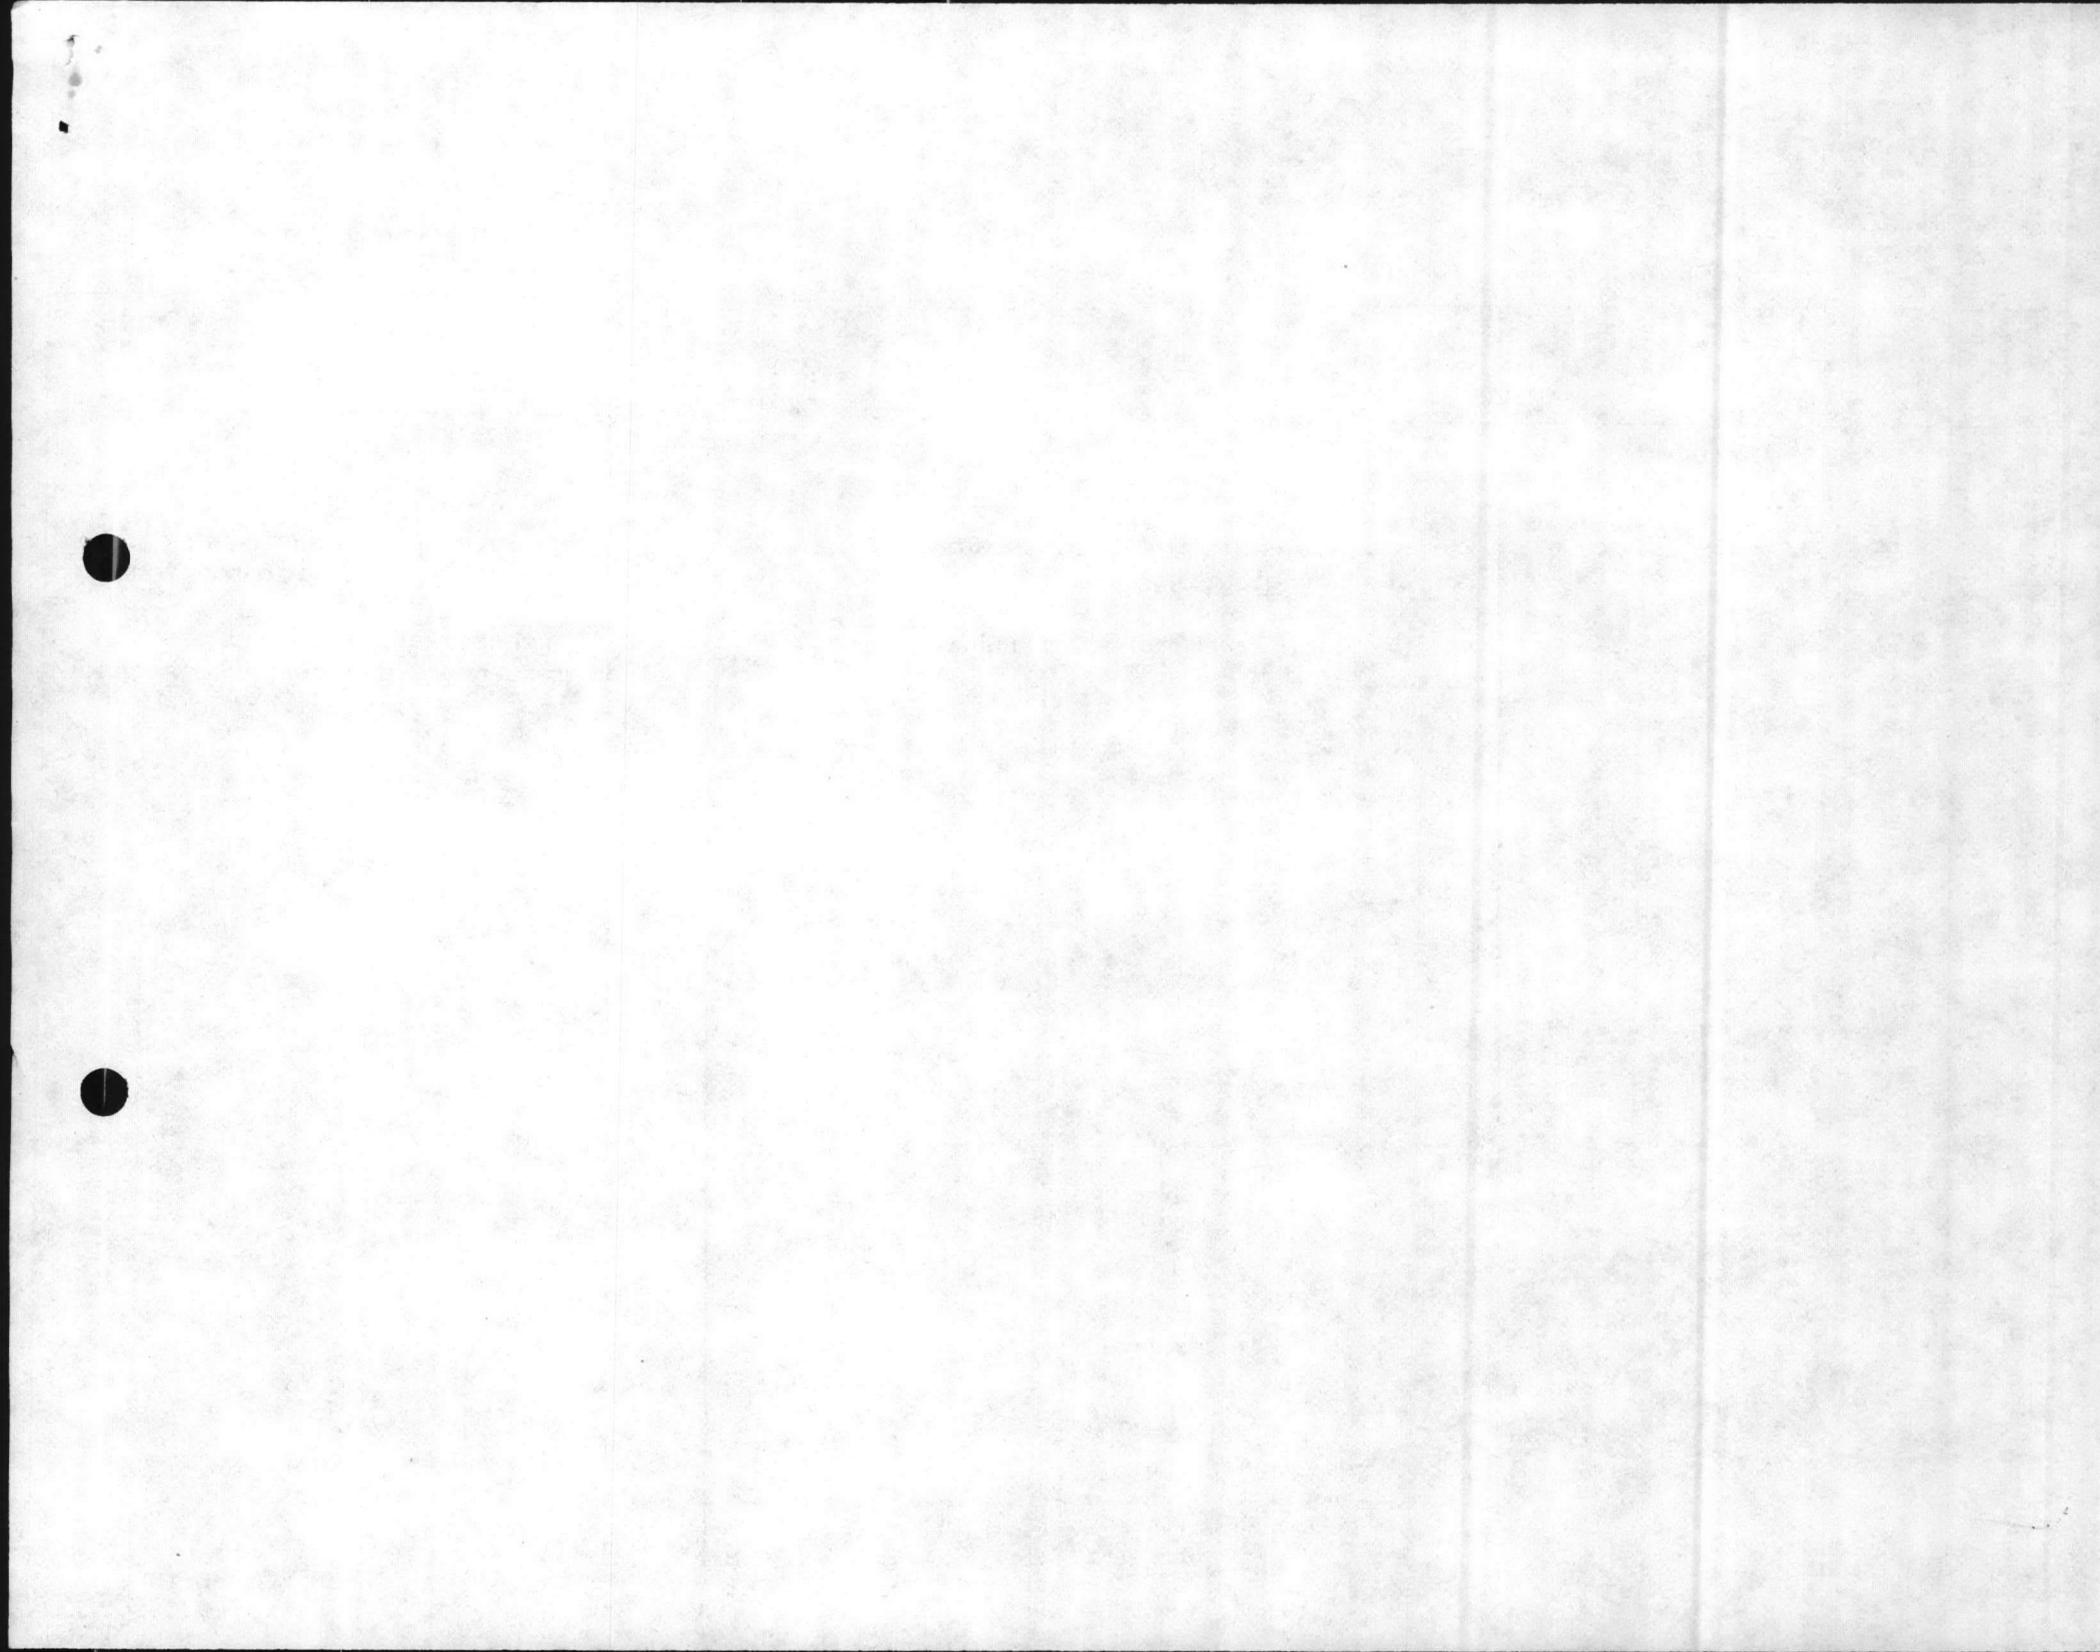


REFERENCES:

1. Section 1 of enclosure (1) CG ltr 6240 NREAD of 9 Sep 85 "Clear, Concise training records shall be maintained on each person actively involved in hazardous waste management."

2. BO 6240.5 enclosure (1) Note #2 & 3 - If known, insert name and UN or NA # listed in 49 CFR part 172, otherwise enter NSN and common/trade name used locally to identify item. Insert date that filling of container begins.

3. CG ltr 6240 NREAD of 10 Nov 86, provided by 6240 NREAD 20 Nov 86 requires the posting and development of sites specific hazardous waste spill responsibilities prevention and related guidance.

4. BO 11090.1B enclosure (2), para 1c - posting of Oil Spill Procedures Signs shall be posted in every building, tank location and field service location where oil or hazardous materials are used. The sign shall have a yellow background with black lettering. See BO 11090.1B for proper wording of sign.

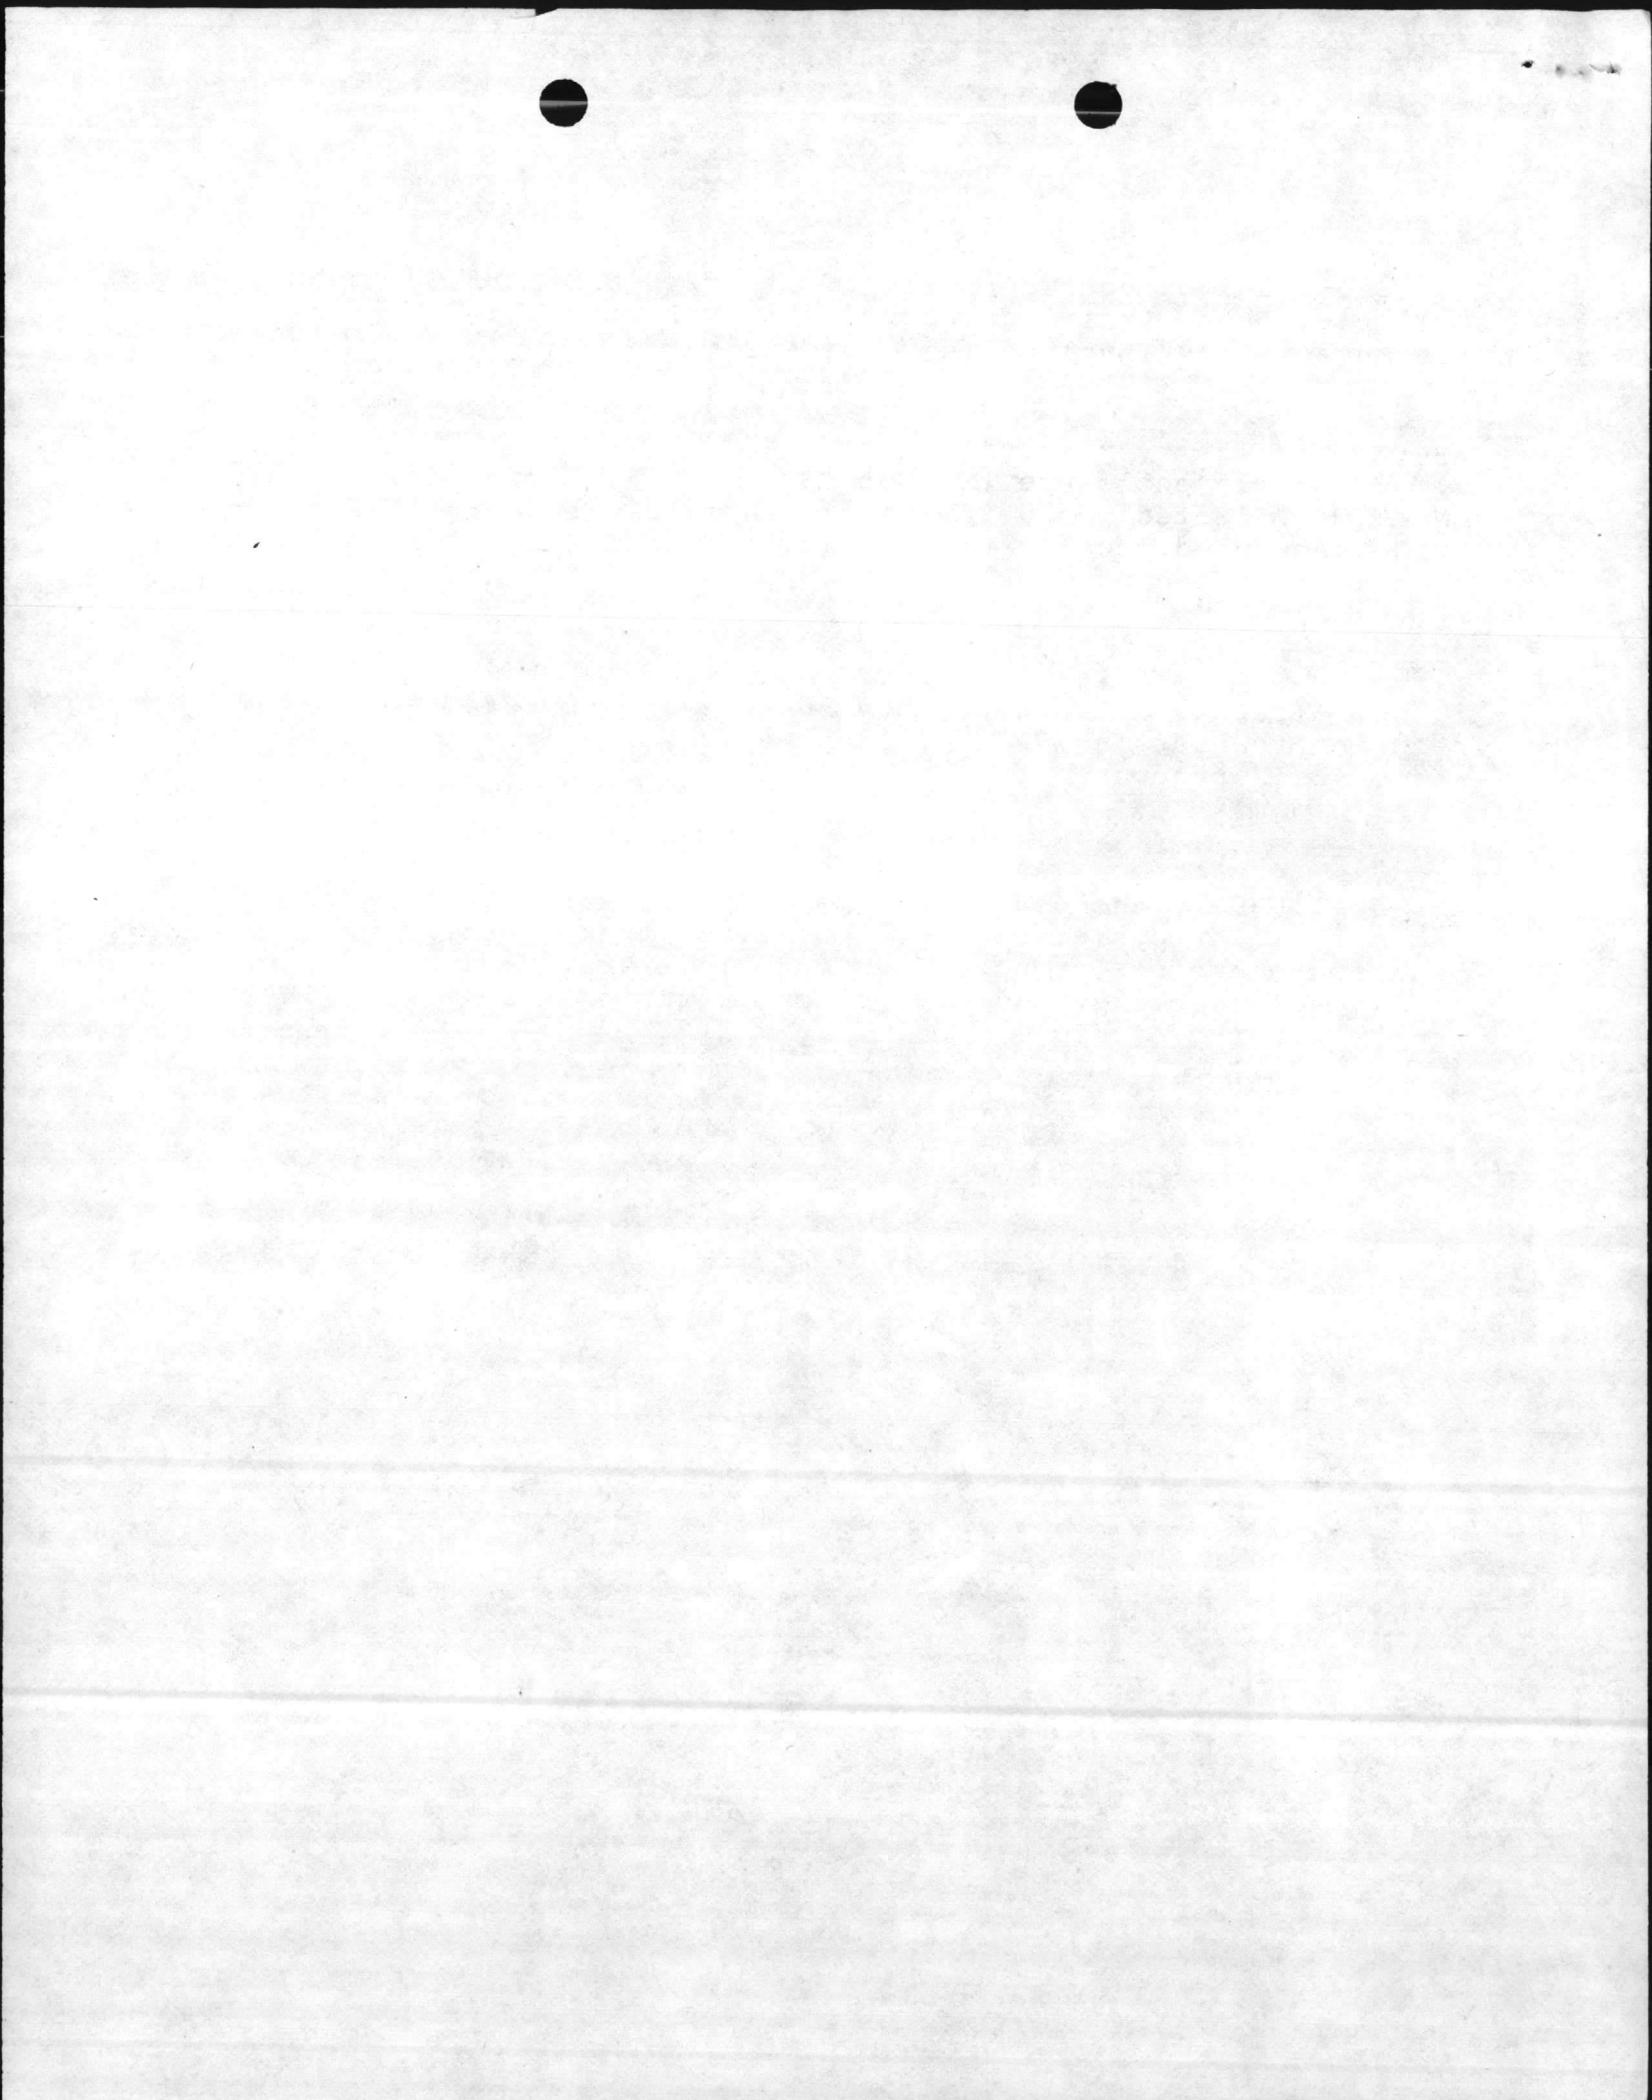

2d MARDIV

AUTHORIZED HW GENERATION AND STORAGE SITES FOR 2d AMTRAC BN

SITE NO. 1
GENERATION/ACCUMULATION

Bldg. A-2, Motor Transport
SOLVENTS, ELECTROLYTE &
WASTE OIL

SITE NO. 2
GENERATION/ACCUMULATION

Bldg. A-47, Maintenance Shop
SOLVENTS

SITE NO. 3
GENERATION/ACCUMULATION

Bldg. A-47, Maintenance Shop
Battery Room
ELECTROLYTE

